

# **System Water Balance Report: "WRIMS GUI" vs "CalLite GUI"**

**Author:**


Generated on 06-May-2013

# System Flow Comparison: "WRIMS GUI" vs "CalLite GUI"


Comparison of CalLite GUI D1641+BO (R589) to Holly's 5/12013 results

	1922-2003				1929-1934				1987-1992			
	"WRIMS GUI"	"CalLite GUI"	Diff	% Diff	"WRIMS GUI"	"CalLite GUI"	Diff	% Diff	"WRIMS GUI"	"CalLite GUI"	Diff	% Diff
<b>River Flow</b>												
Trinity R blw Lewiston	701	701	0	0	411	411	0	0	472	472	0	0
Trinity Export	529	529	0	0	378	378	0	0	445	445	0	0
Clear Cr blw Whiskeytown	129	129	0	0	101	101	0	0	116	116	0	0
Sacramento R @ Keswick	6244	6244	0	0	4018	4018	0	0	4508	4508	0	0
Sacramento R @ Wilkins Slough	6618	6618	0	0	4014	4014	0	0	4781	4781	0	0
Feather R blw Thermalito	3179	3179	0	0	1555	1555	0	0	1457	1457	0	0
American R blw Nimbus	2386	2386	0	0	1233	1233	0	0	1079	1079	0	0
<b>Delta Inflow</b>	<b>21590</b>	<b>21590</b>	<b>0</b>	<b>0</b>	<b>9811</b>	<b>9811</b>	<b>0</b>	<b>0</b>	<b>10321</b>	<b>10321</b>	<b>0</b>	<b>0</b>
Sacramento R @ Hood	15667	15667	0	0	8160	8160	0	0	8954	8954	0	0
Yolo Bypass	2233	2233	0	0	100	100	0	0	141	141	0	0
Mokelumne R	666	666	0	0	206	206	0	0	155	155	0	0
San Joaquin R d/s Vernalis	3024	3024	0	0	1346	1346	0	0	1071	1071	0	0
<b>Delta Outflow</b>	<b>10703</b>	<b>10703</b>	<b>0</b>	<b>0</b>	<b>1519</b>	<b>1519</b>	<b>0</b>	<b>0</b>	<b>2135</b>	<b>2135</b>	<b>0</b>	<b>0</b>
Delta Outflow for X2 and NDO	5067	5067	0	0	4141	4141	0	0	4044	4044	0	0
<b>Delta Exports</b>	<b>4856</b>	<b>4856</b>	<b>0</b>	<b>0</b>	<b>2985</b>	<b>2985</b>	<b>0</b>	<b>0</b>	<b>2914</b>	<b>2914</b>	<b>0</b>	<b>0</b>
Banks SWP	2588	2588	0	0	1469	1469	0	0	1296	1296	0	0
Banks CVP	59	59	0	0	21	21	0	0	31	31	0	0
Jones	2209	2209	0	0	1495	1495	0	0	1587	1587	0	0
<b>SWP SOD Deliveries</b>	<b>2563</b>	<b>2563</b>	<b>0</b>	<b>0</b>	<b>1427</b>	<b>1427</b>	<b>0</b>	<b>0</b>	<b>1262</b>	<b>1262</b>	<b>0</b>	<b>0</b>
Table A (Incl. Article 56)	2429	2429	0	0	1370	1370	0	0	1224	1224	0	0
Article 21	56	56	0	0	38	38	0	0	14	14	0	0
Article 56	78	78	0	0	20	20	0	0	24	24	0	0
<b>CVP SOD Deliveries</b>	<b>2381</b>	<b>2381</b>	<b>0</b>	<b>0</b>	<b>1462</b>	<b>1462</b>	<b>0</b>	<b>0</b>	<b>1661</b>	<b>1661</b>	<b>0</b>	<b>0</b>


# Exceedance Trinirty Storage (Sept)

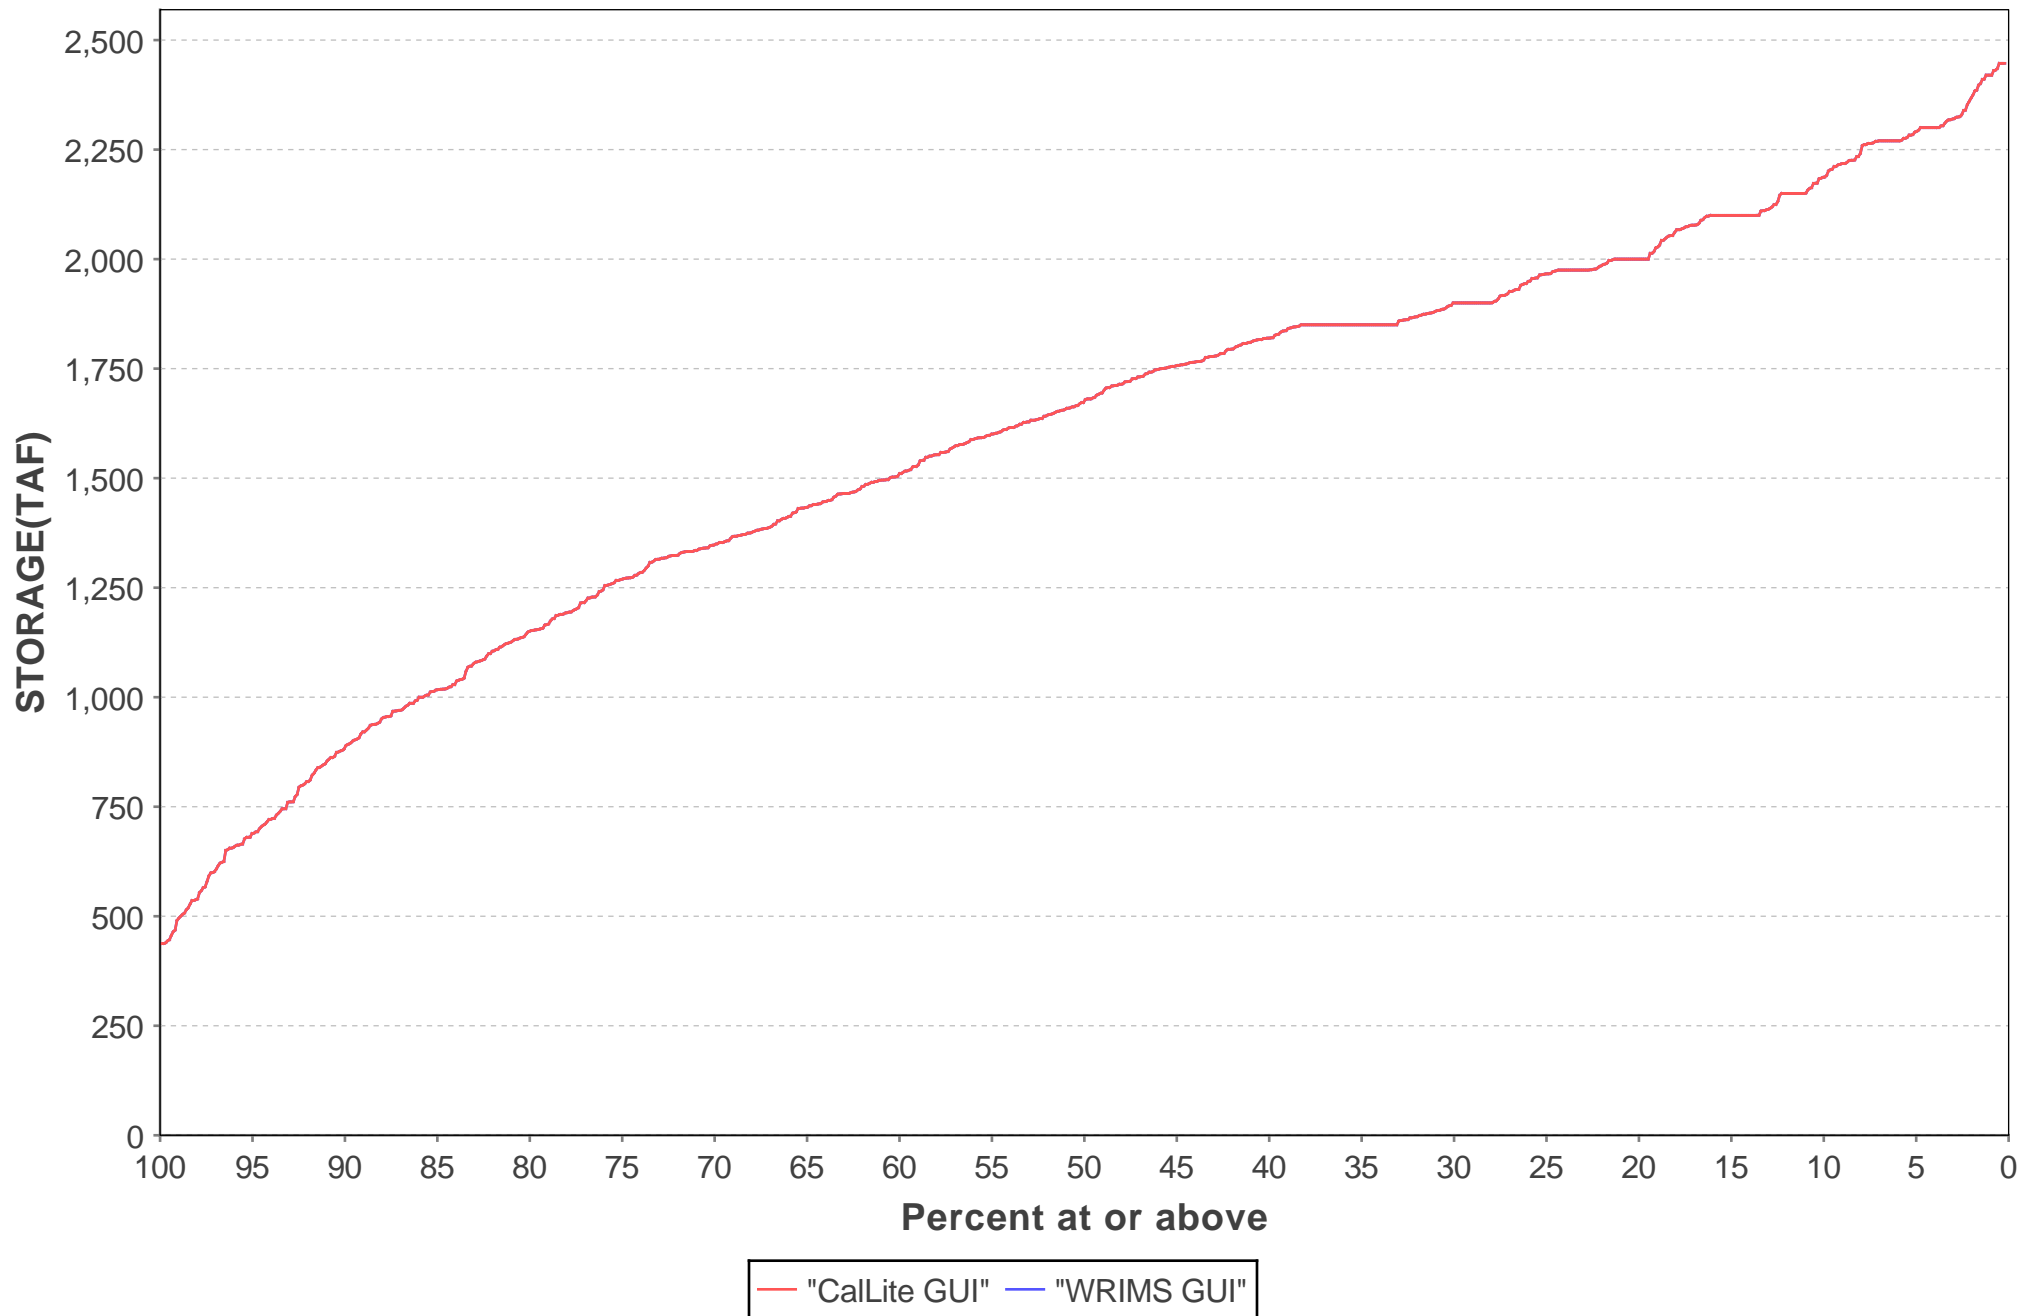


## Exceedance Shasta Storage (Sept)

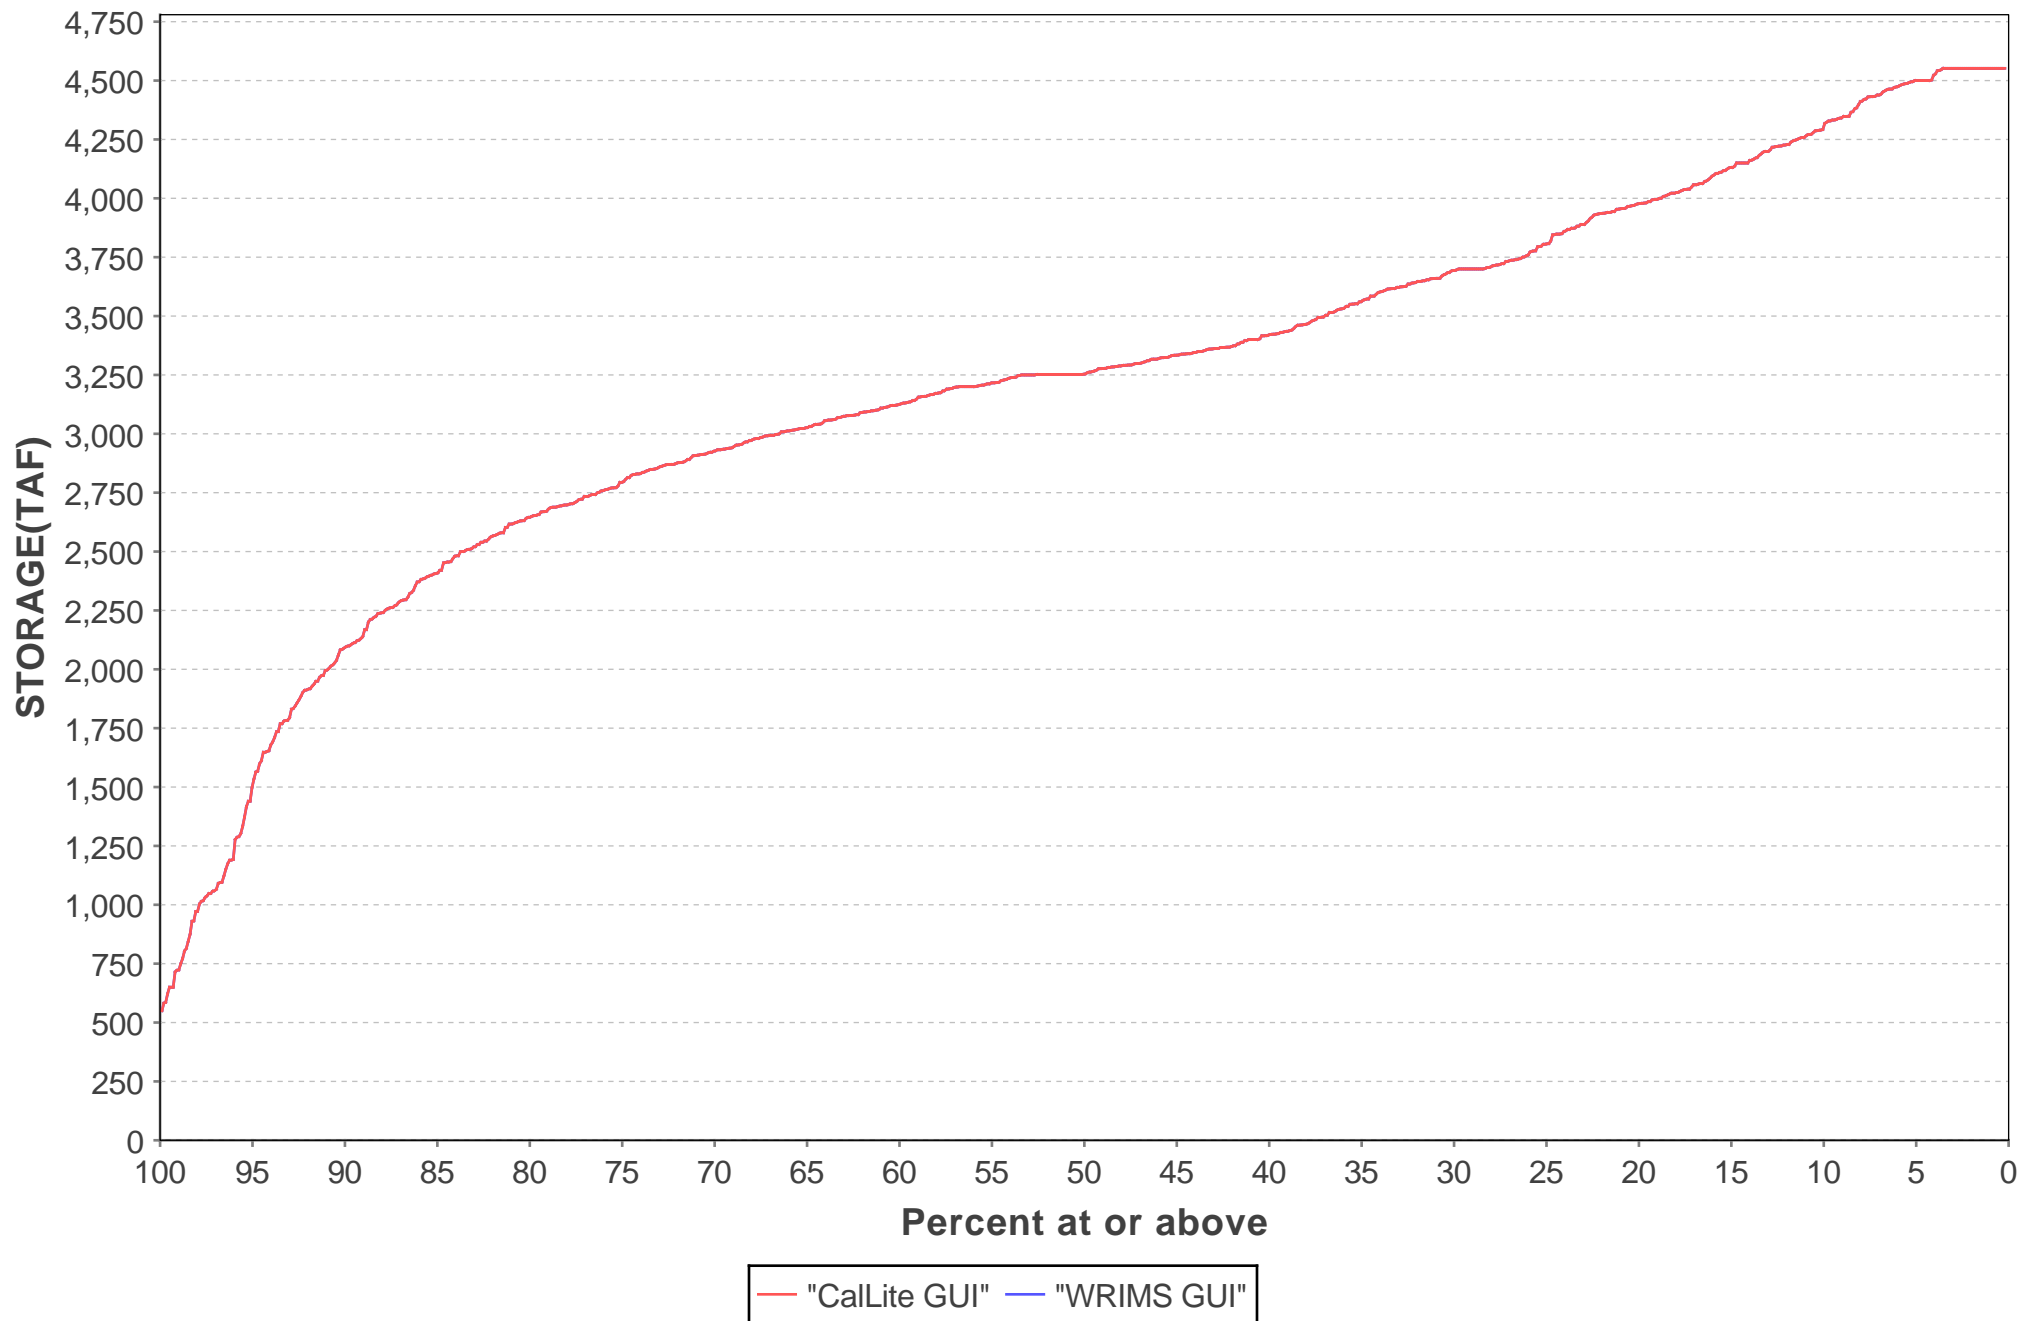


## Exceedance FolSom Storage (Sept)

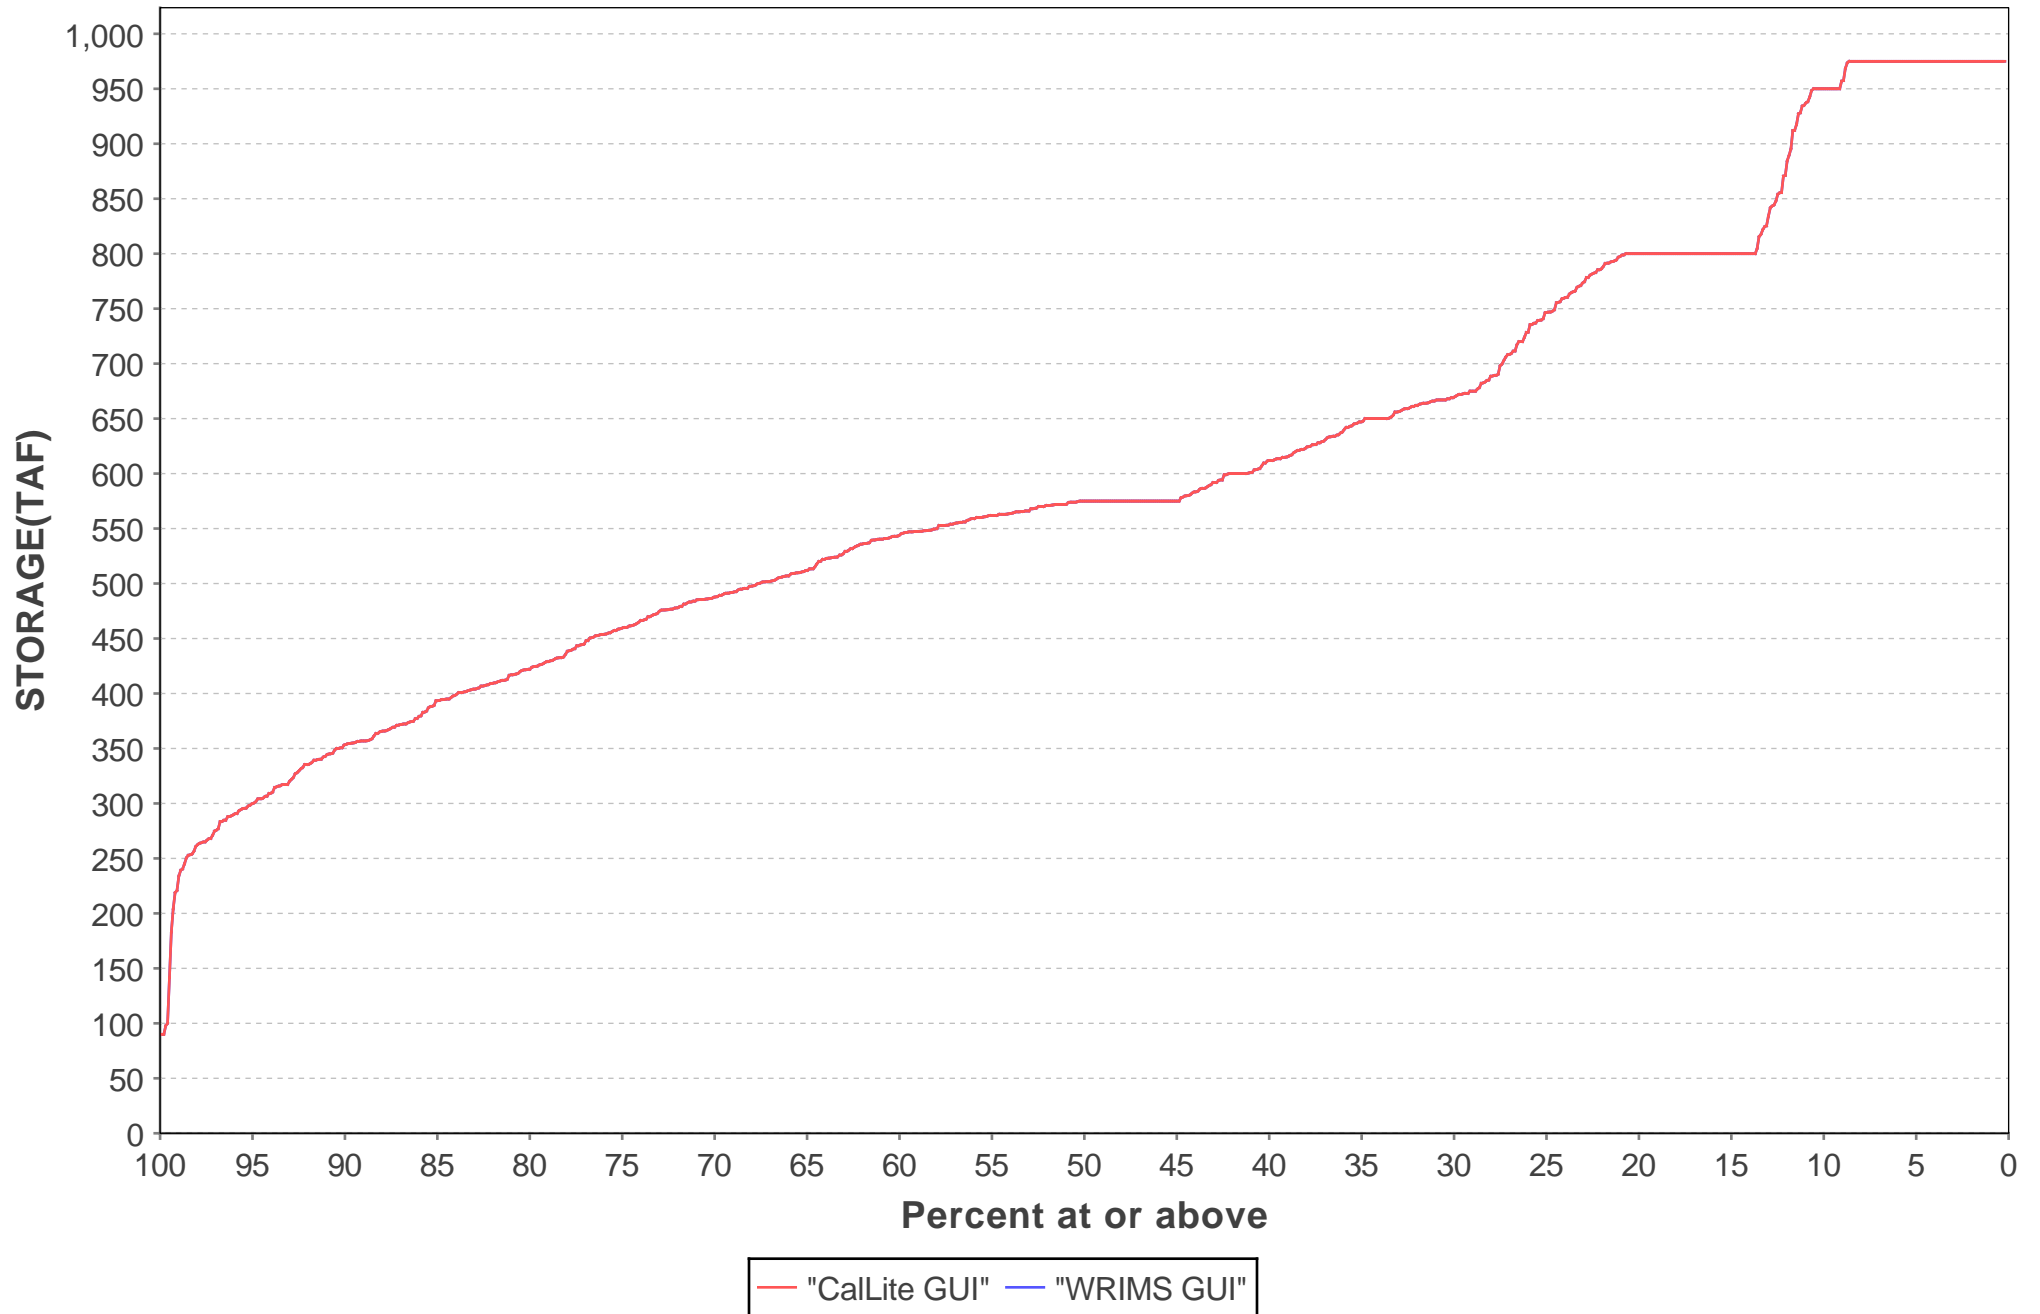


## Exceedance NOD Storage (Sept)

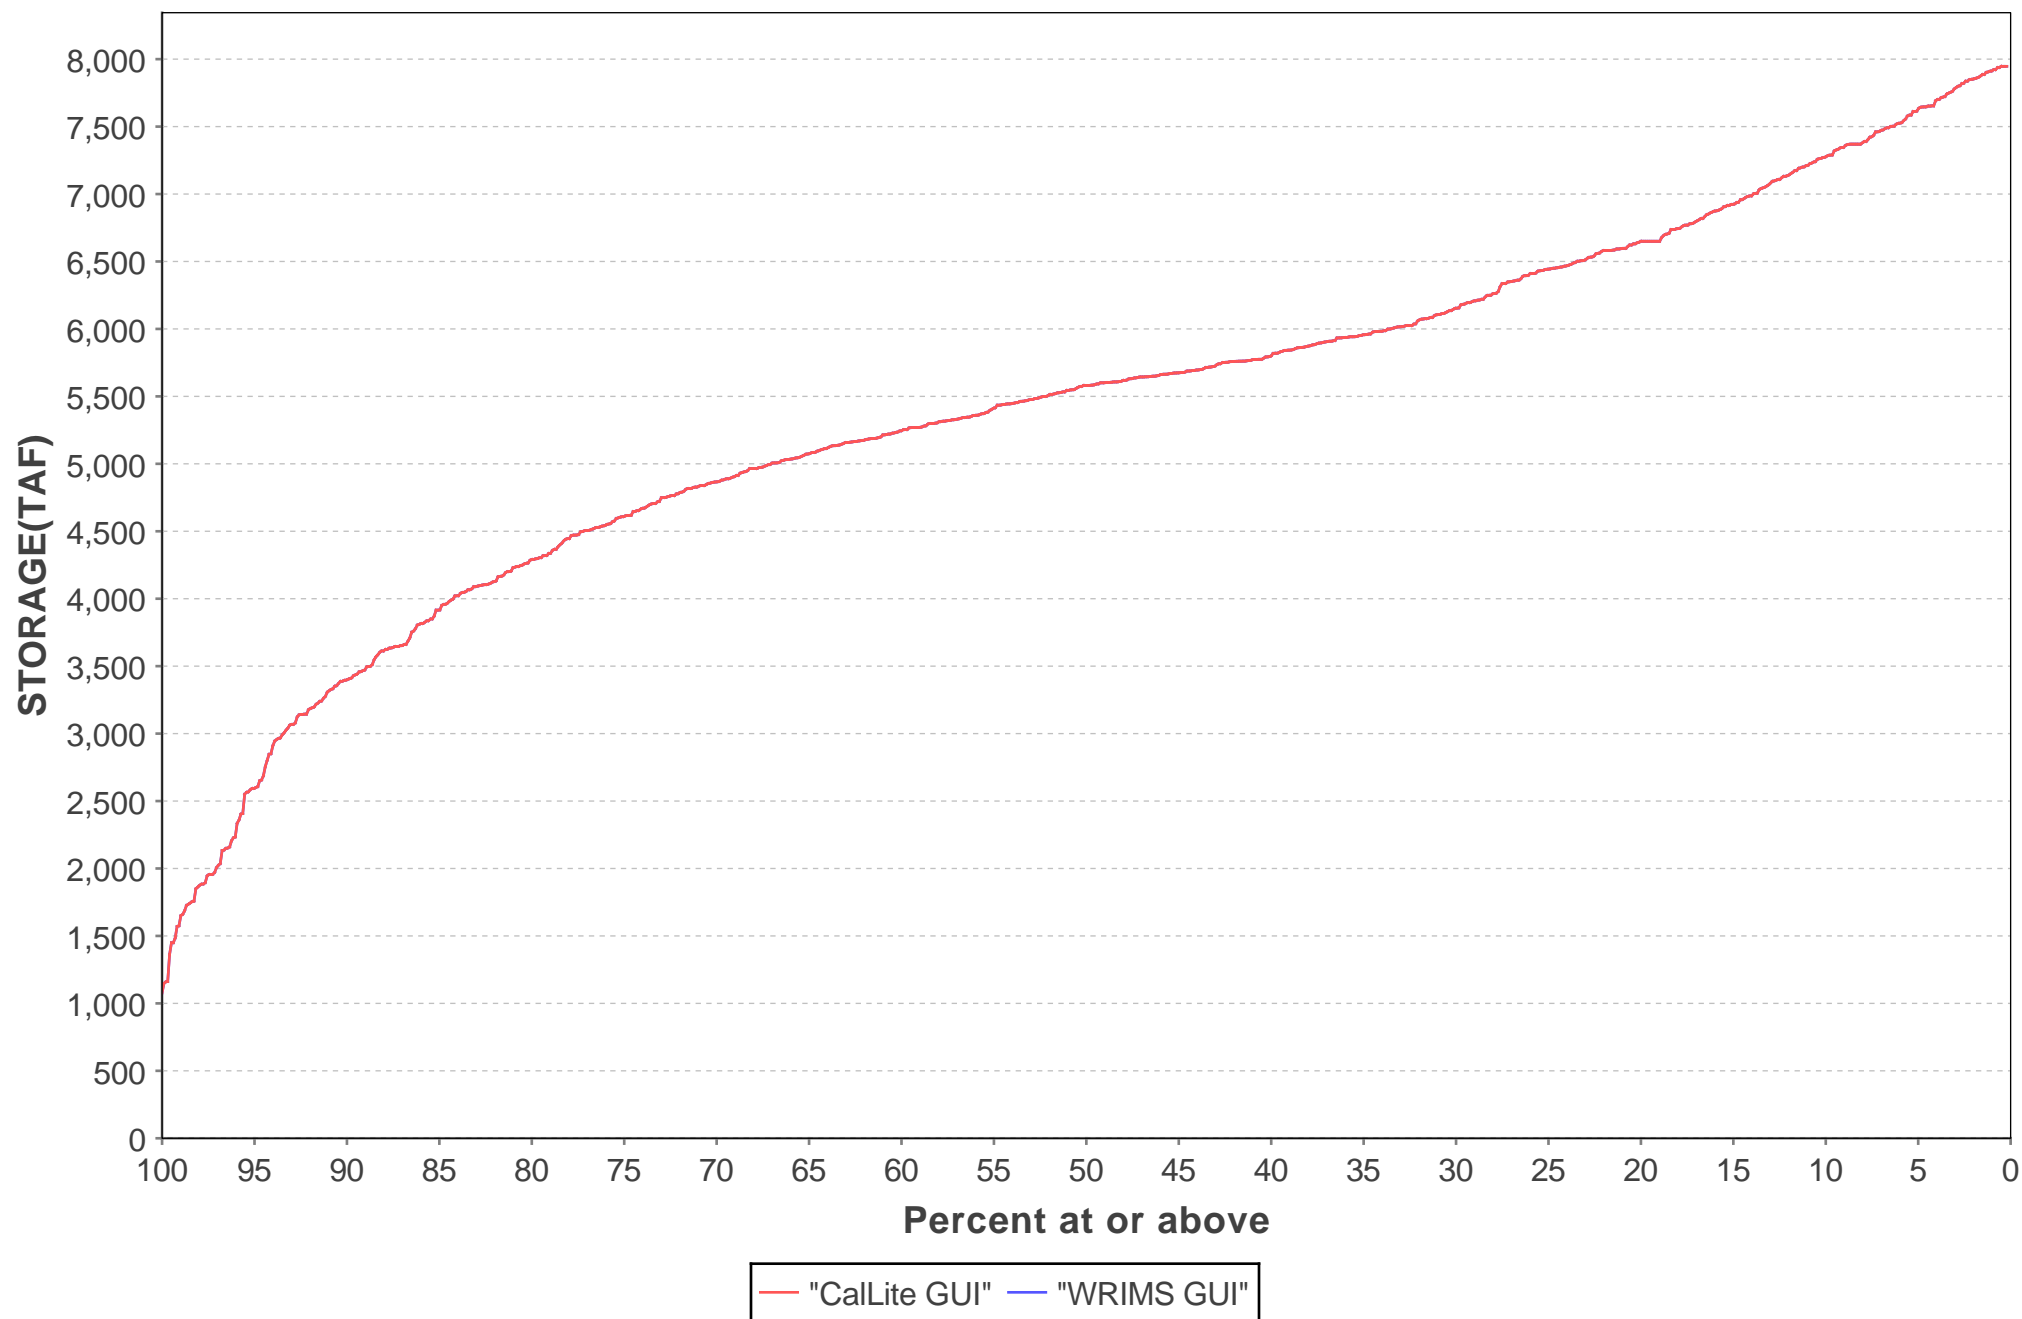

## Exceedance Oroville Storage (Sept)

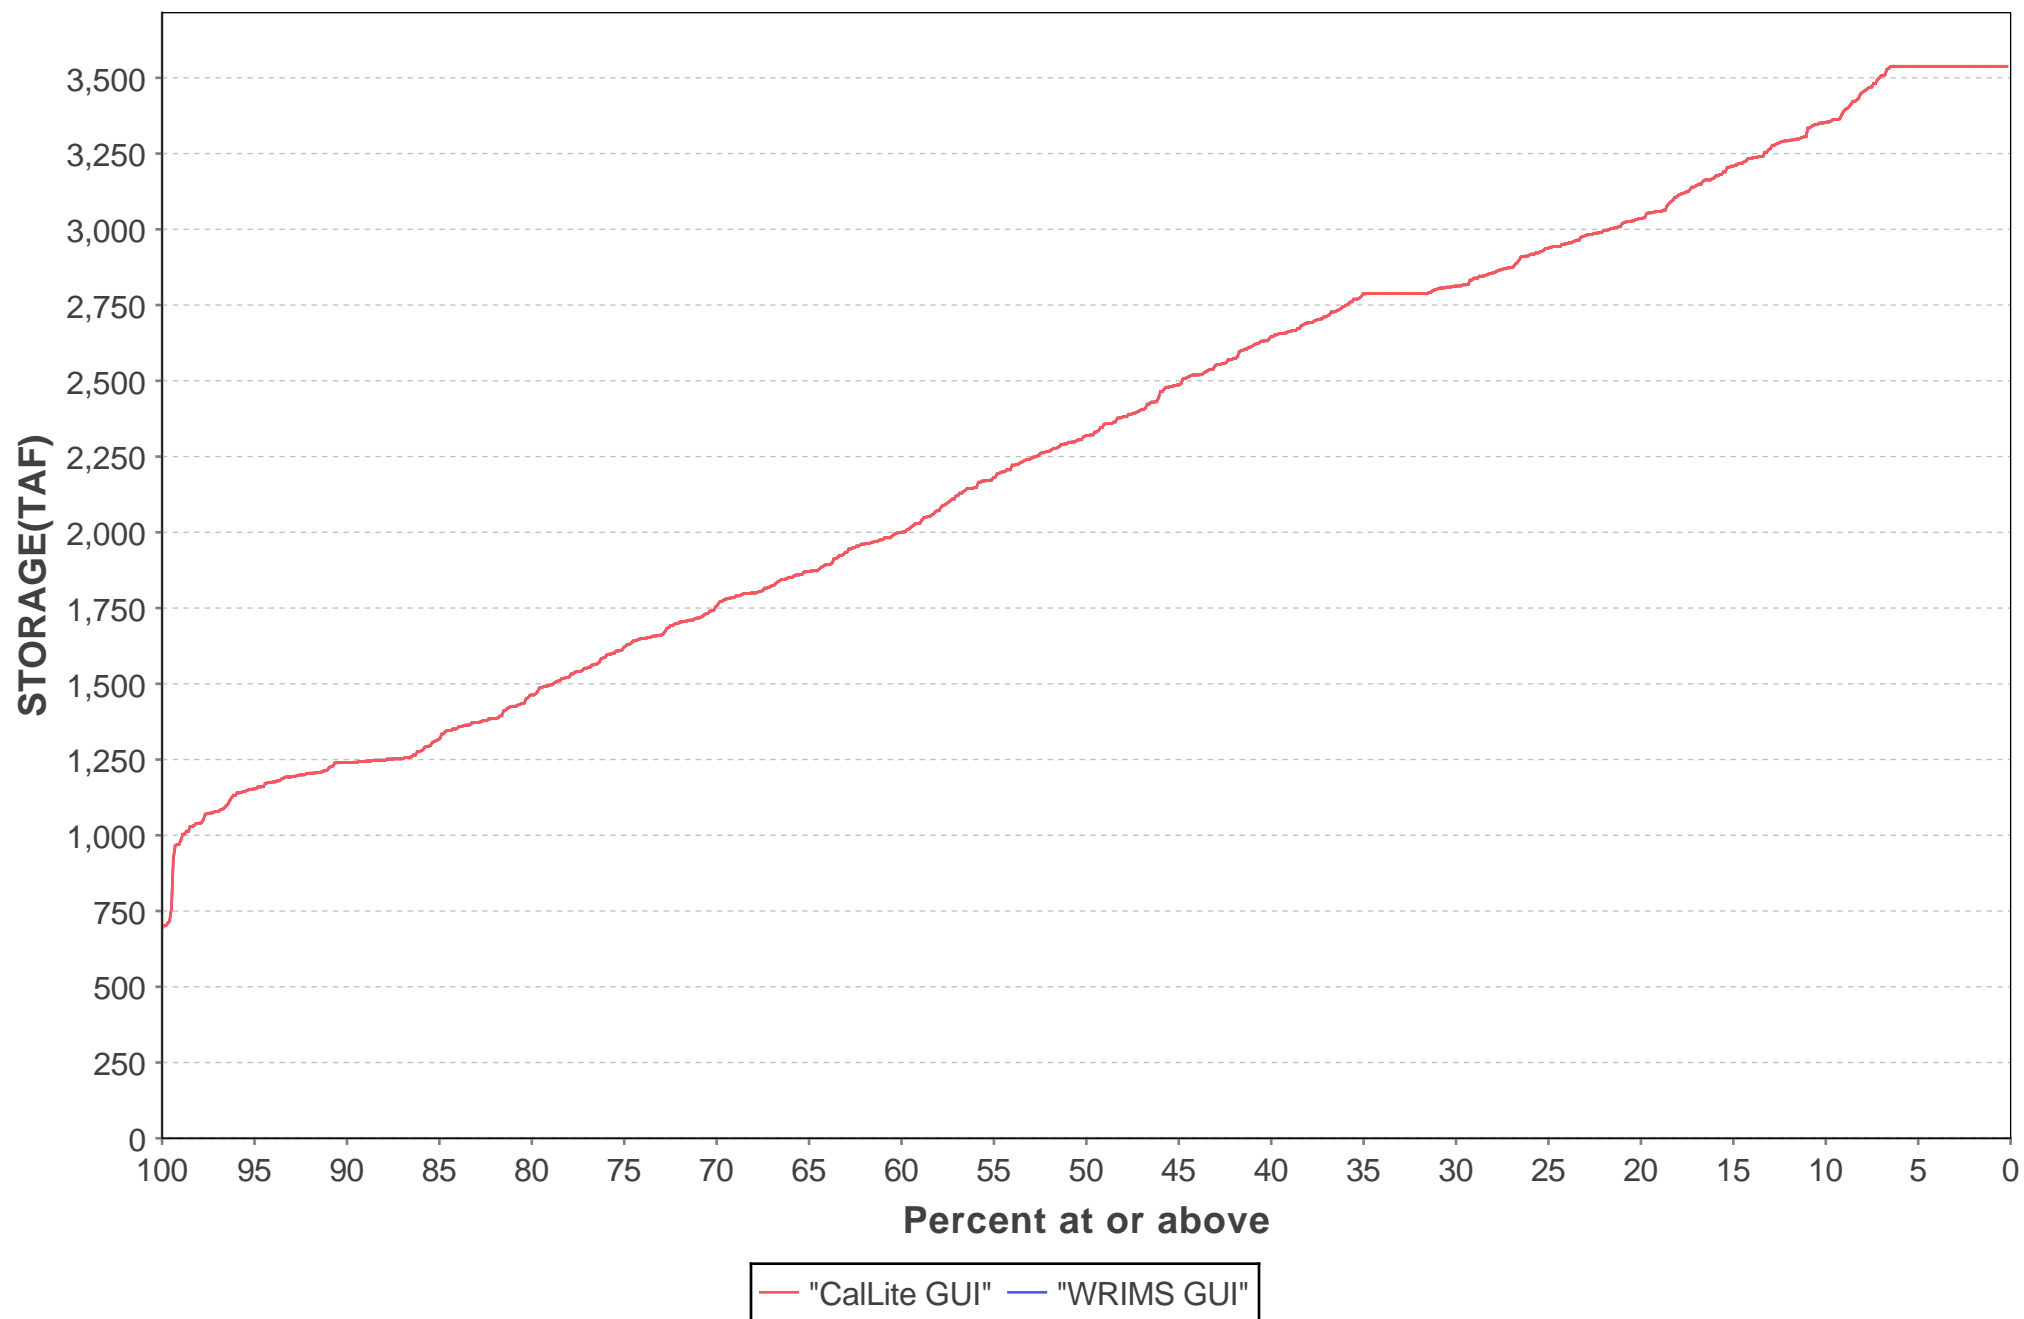


## Exceedance CVP SanLuis Storage (Sept)

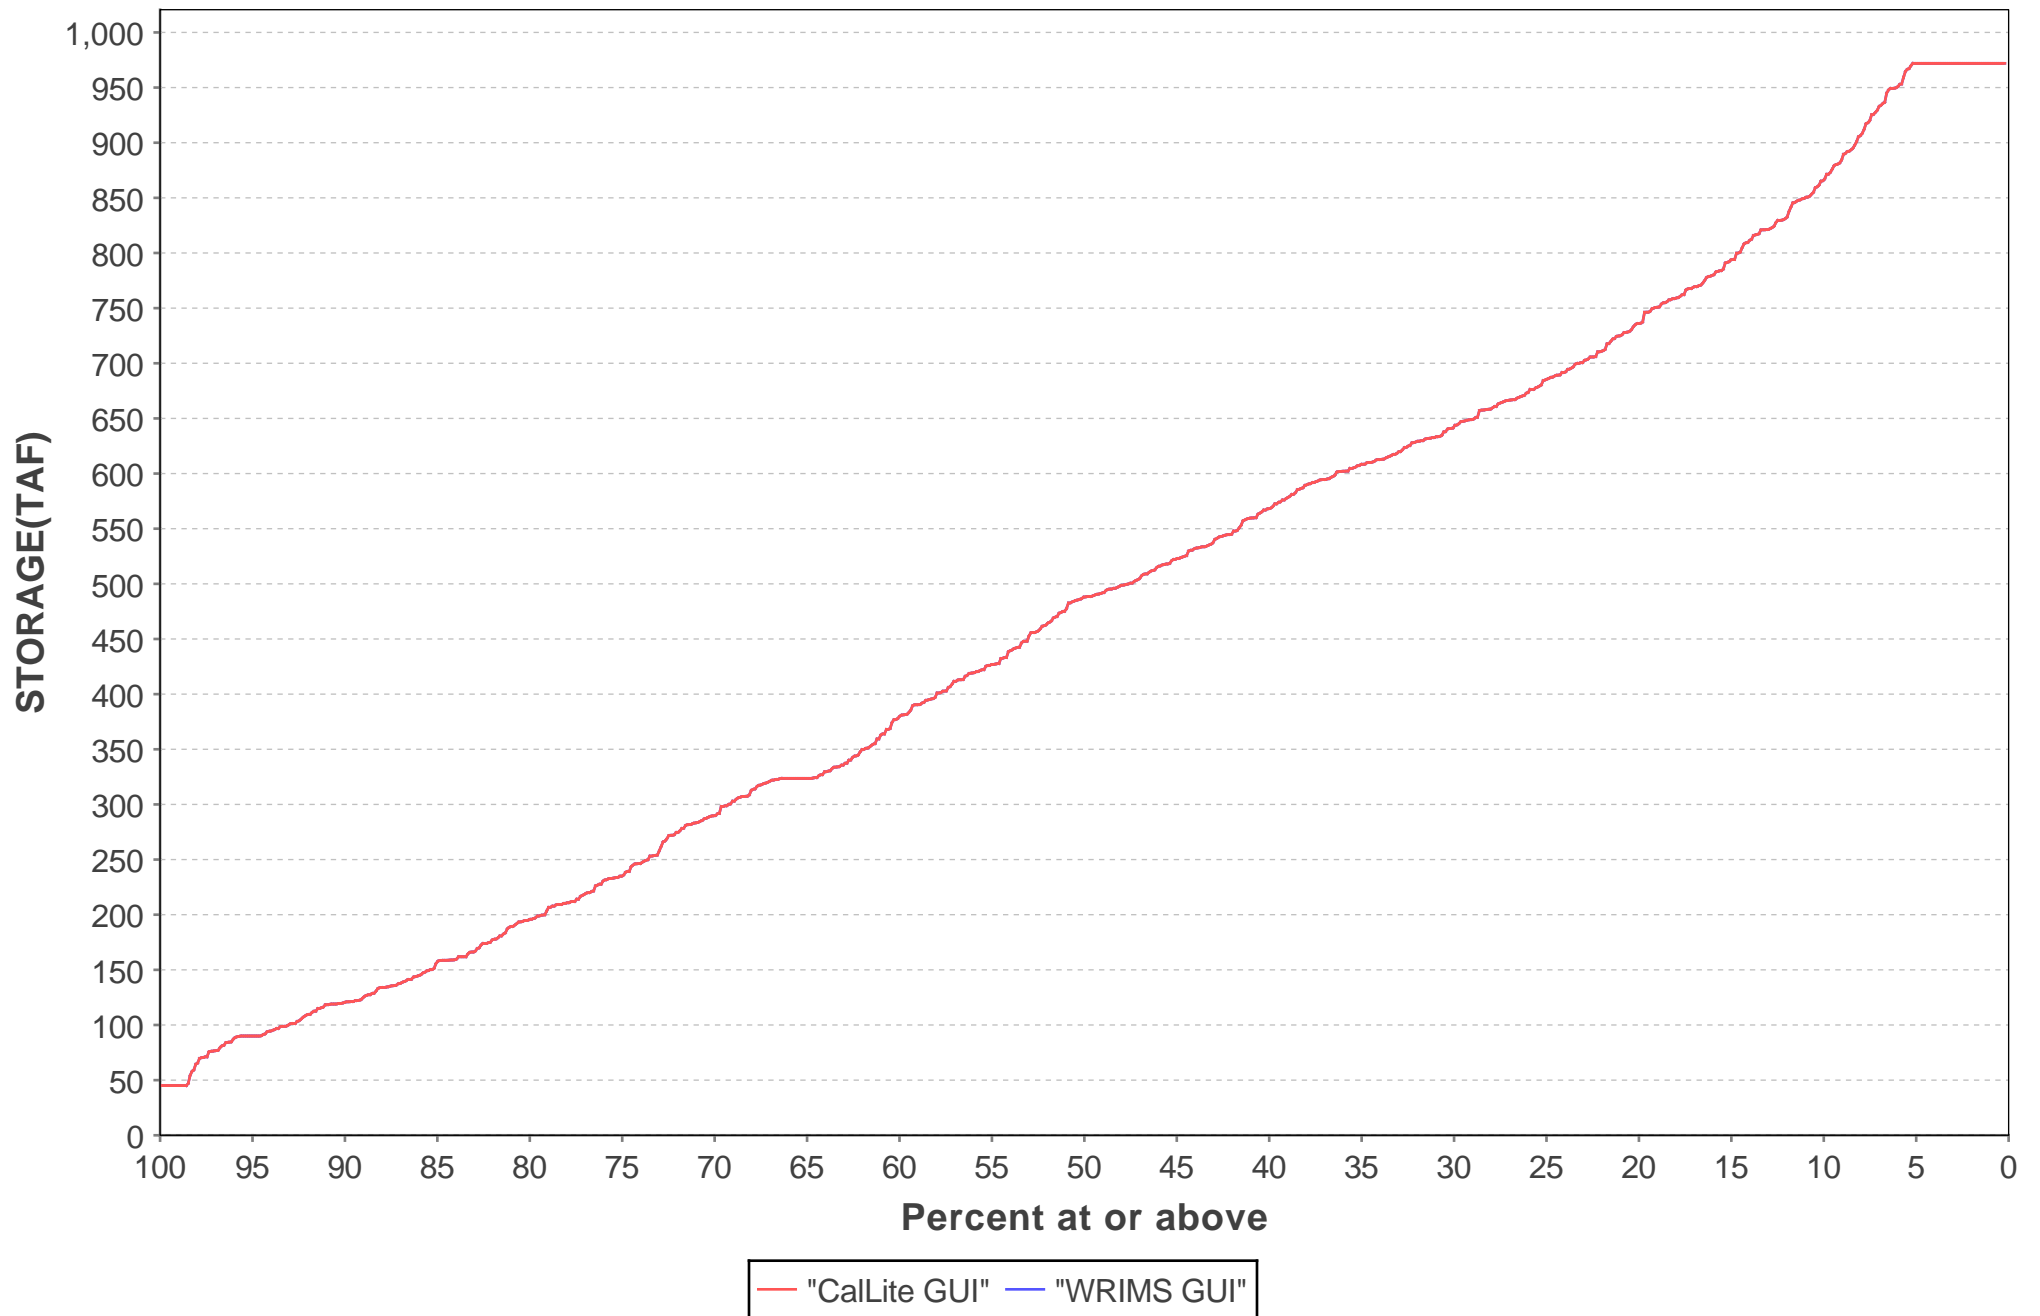





## Exceedance SWP SanLuis Storage (Sept)

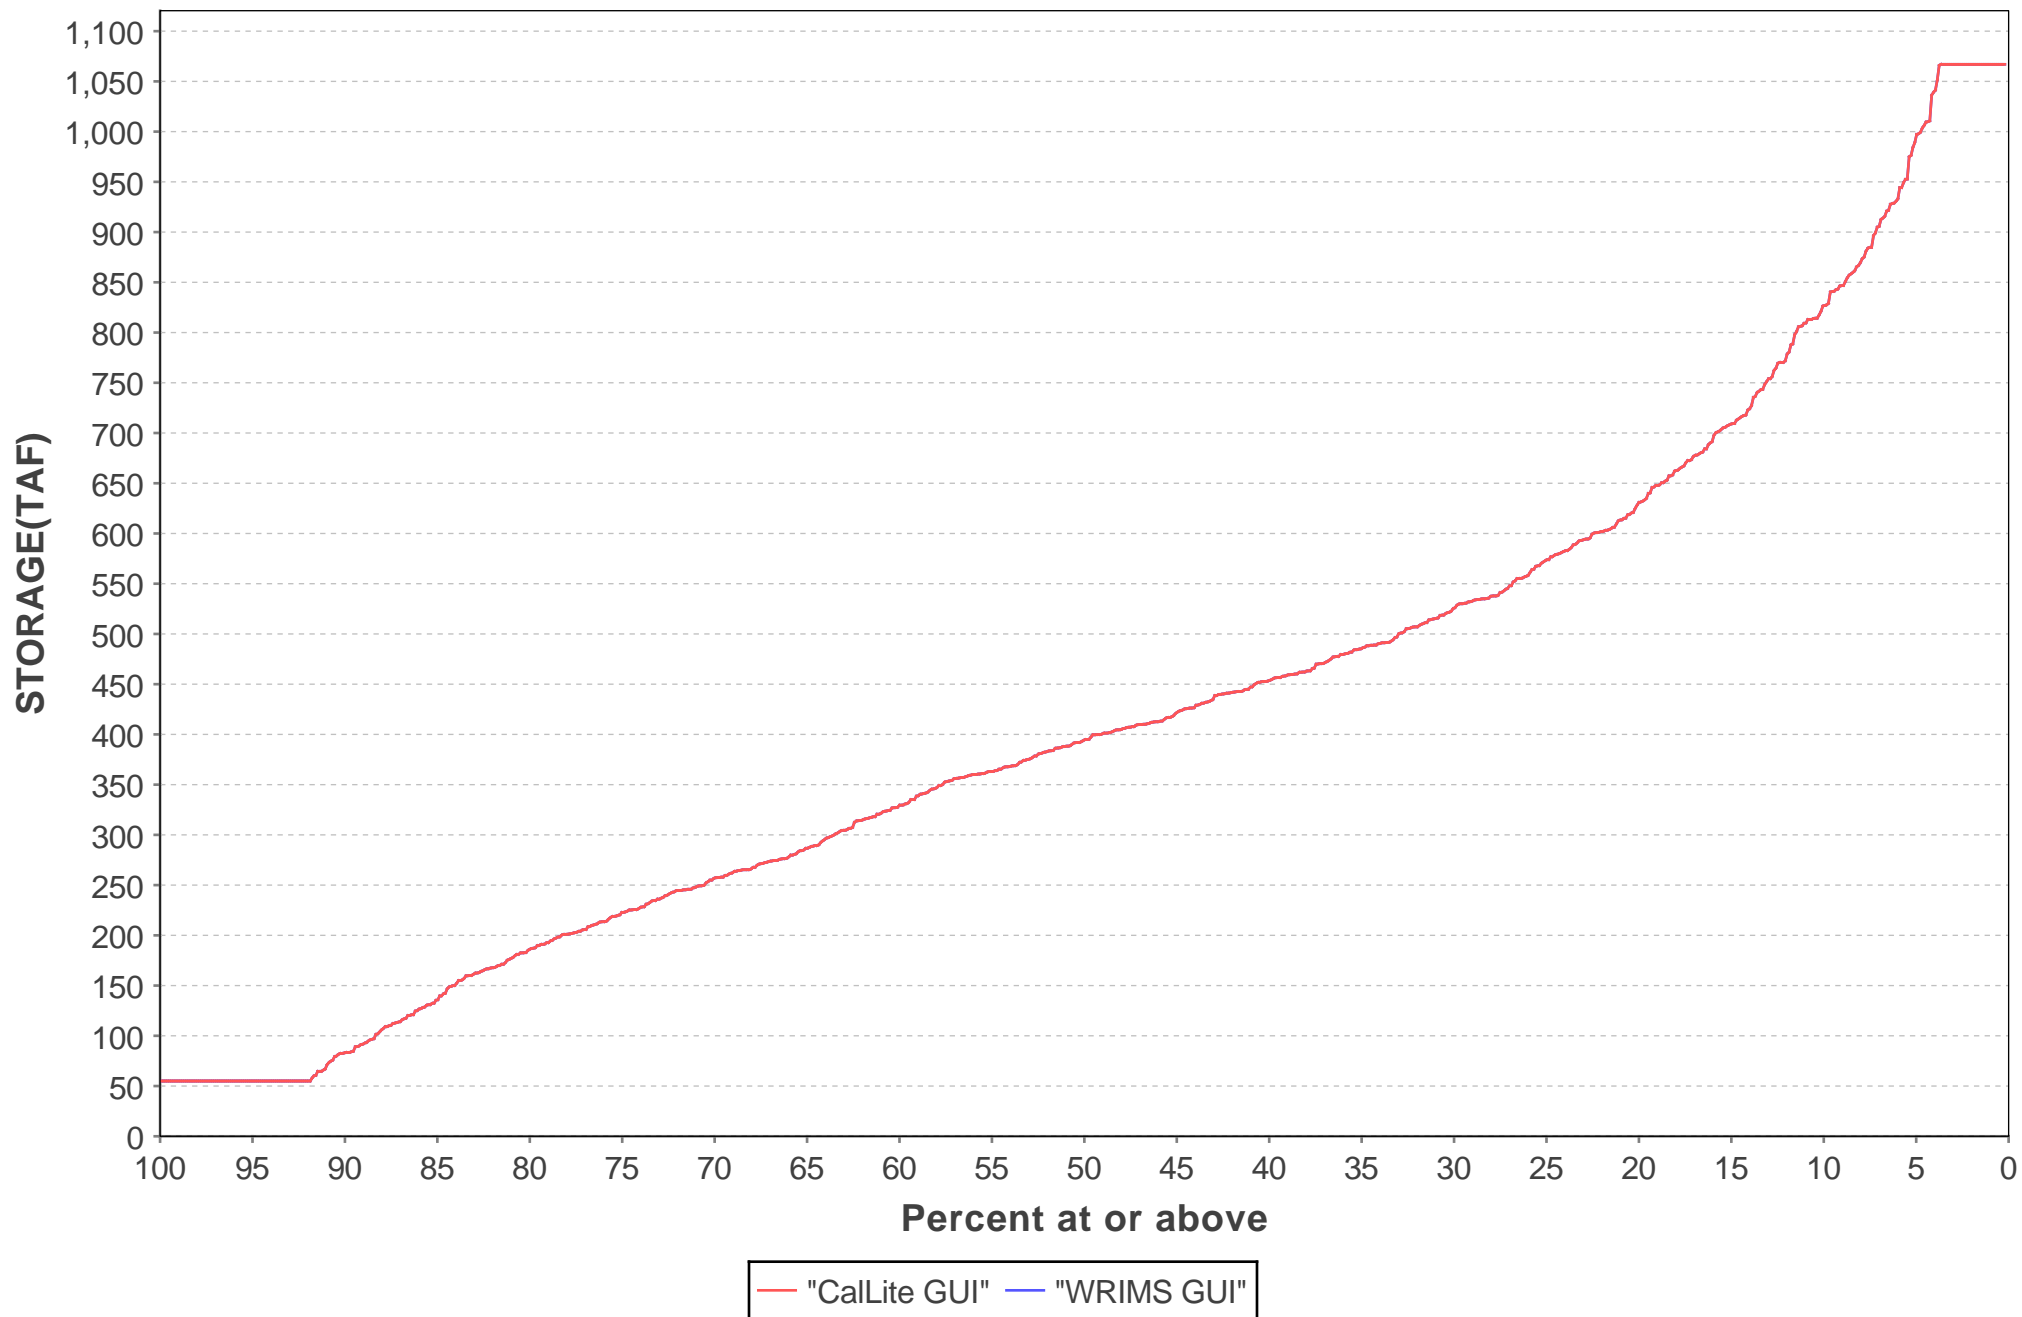


# Average Sacramento R @ Keswick

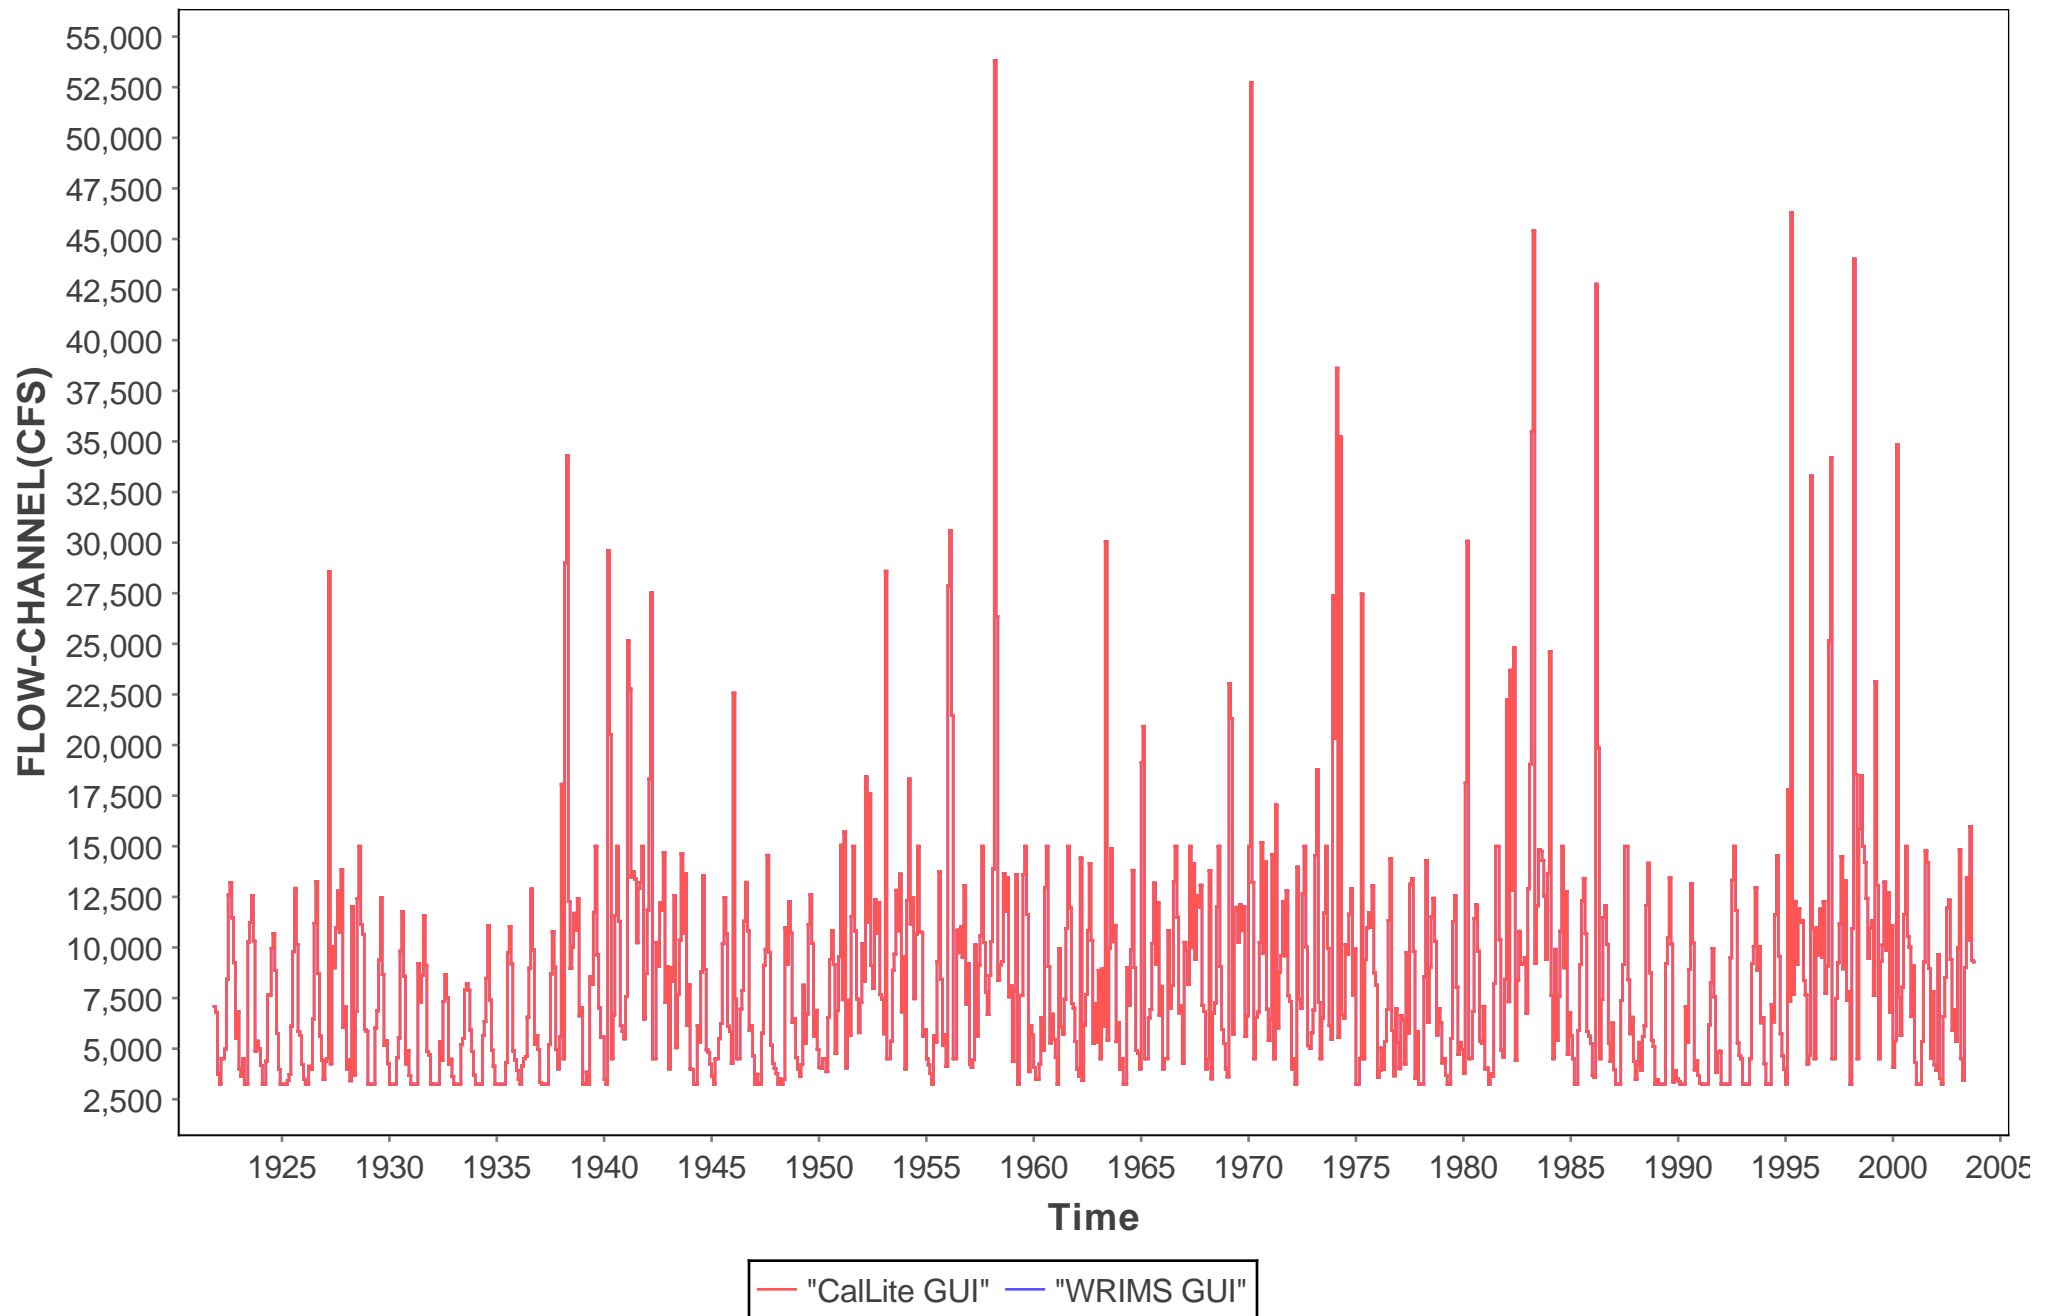


# Average Delta Inflow

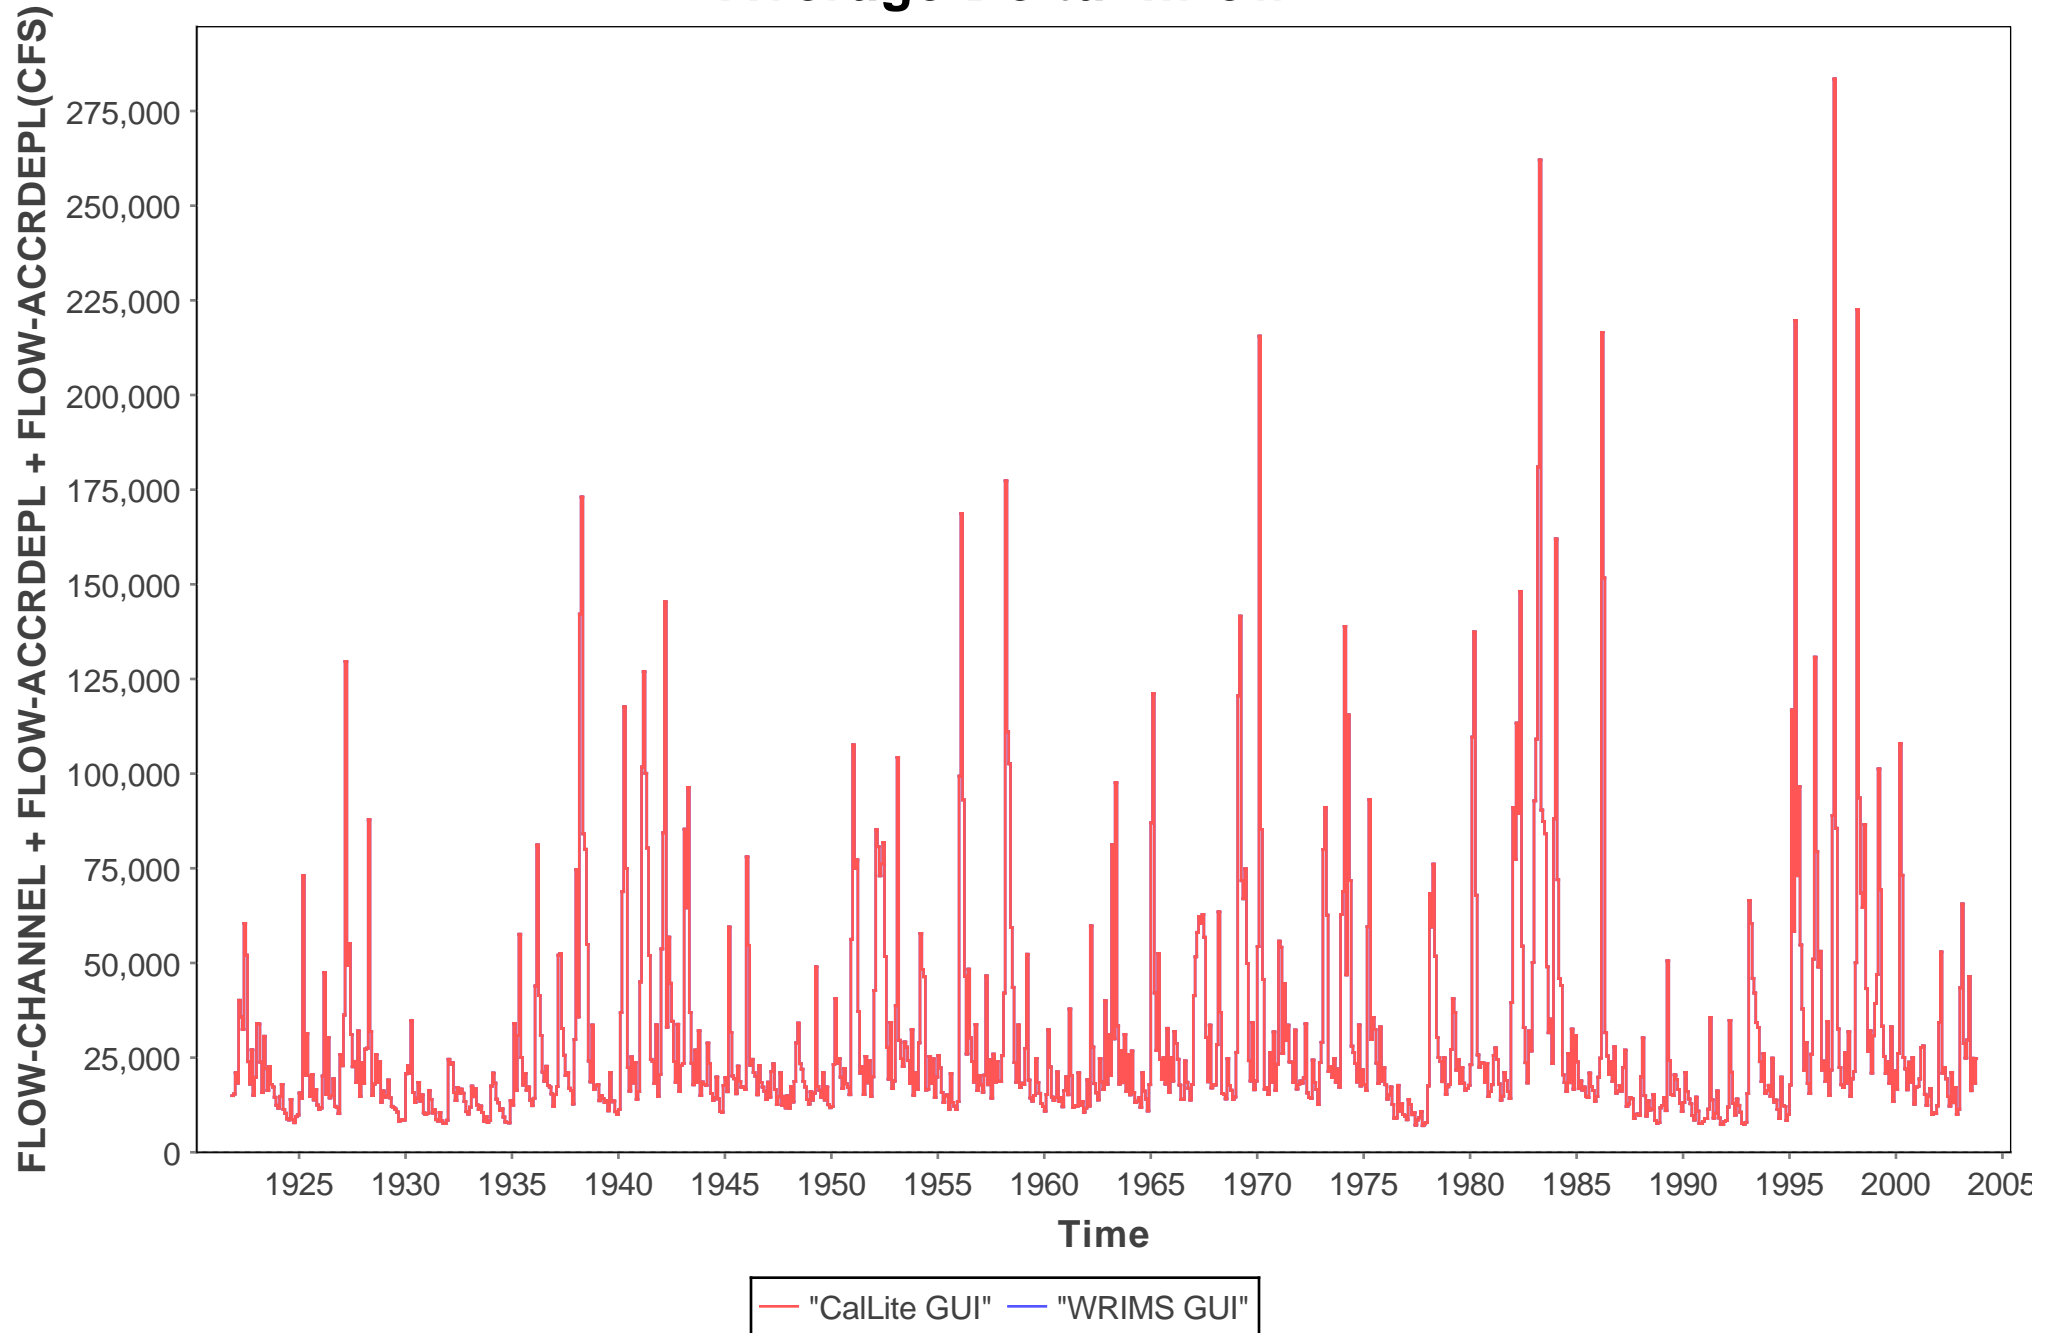


# Average SWP SOD Deliveries

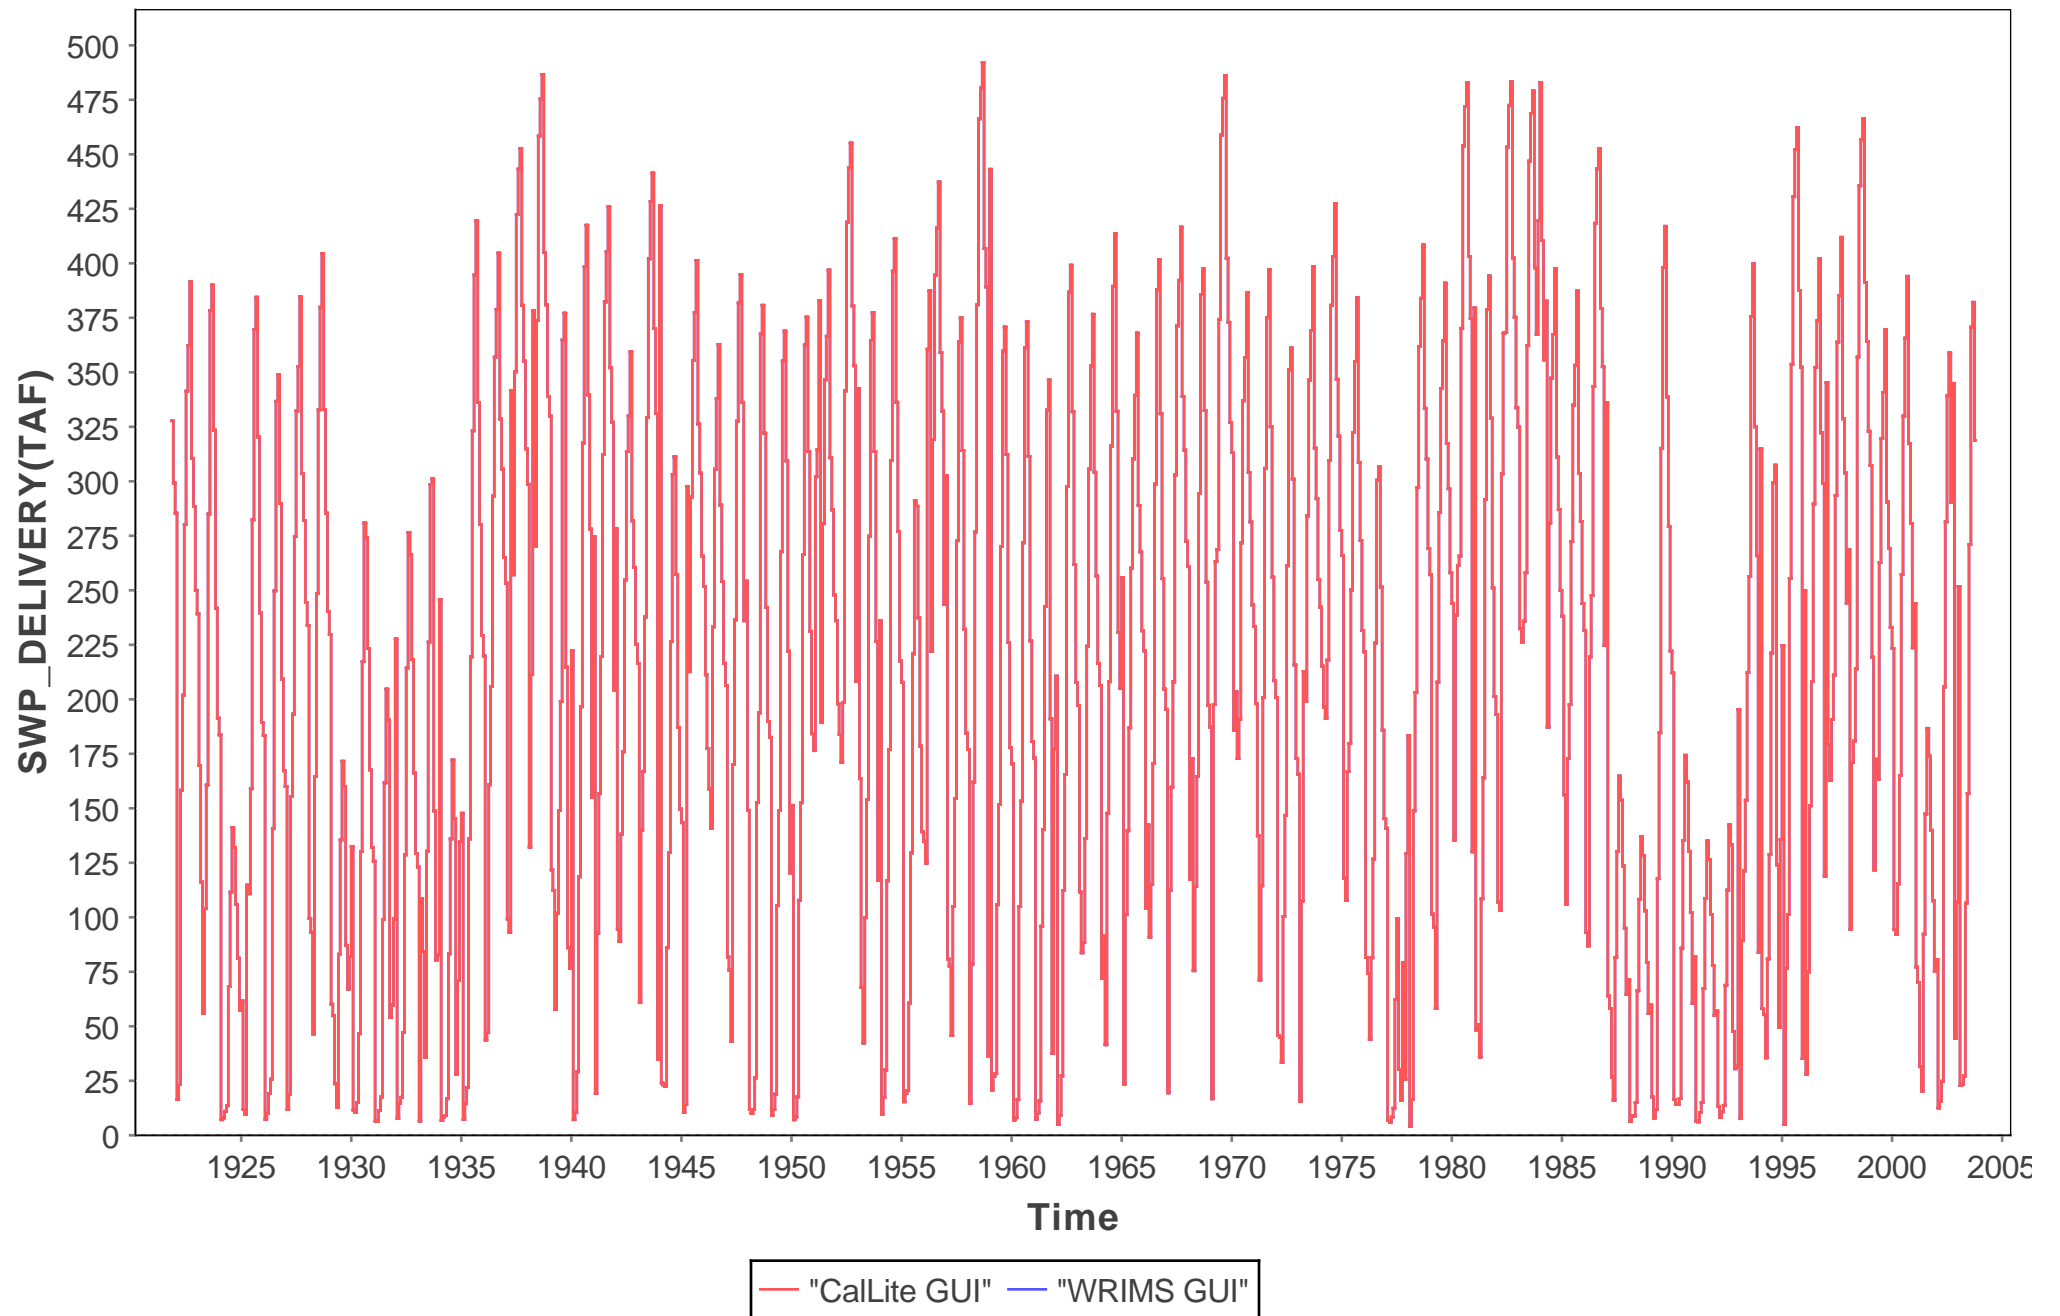


# Exceedance SWP SOD Deliveries

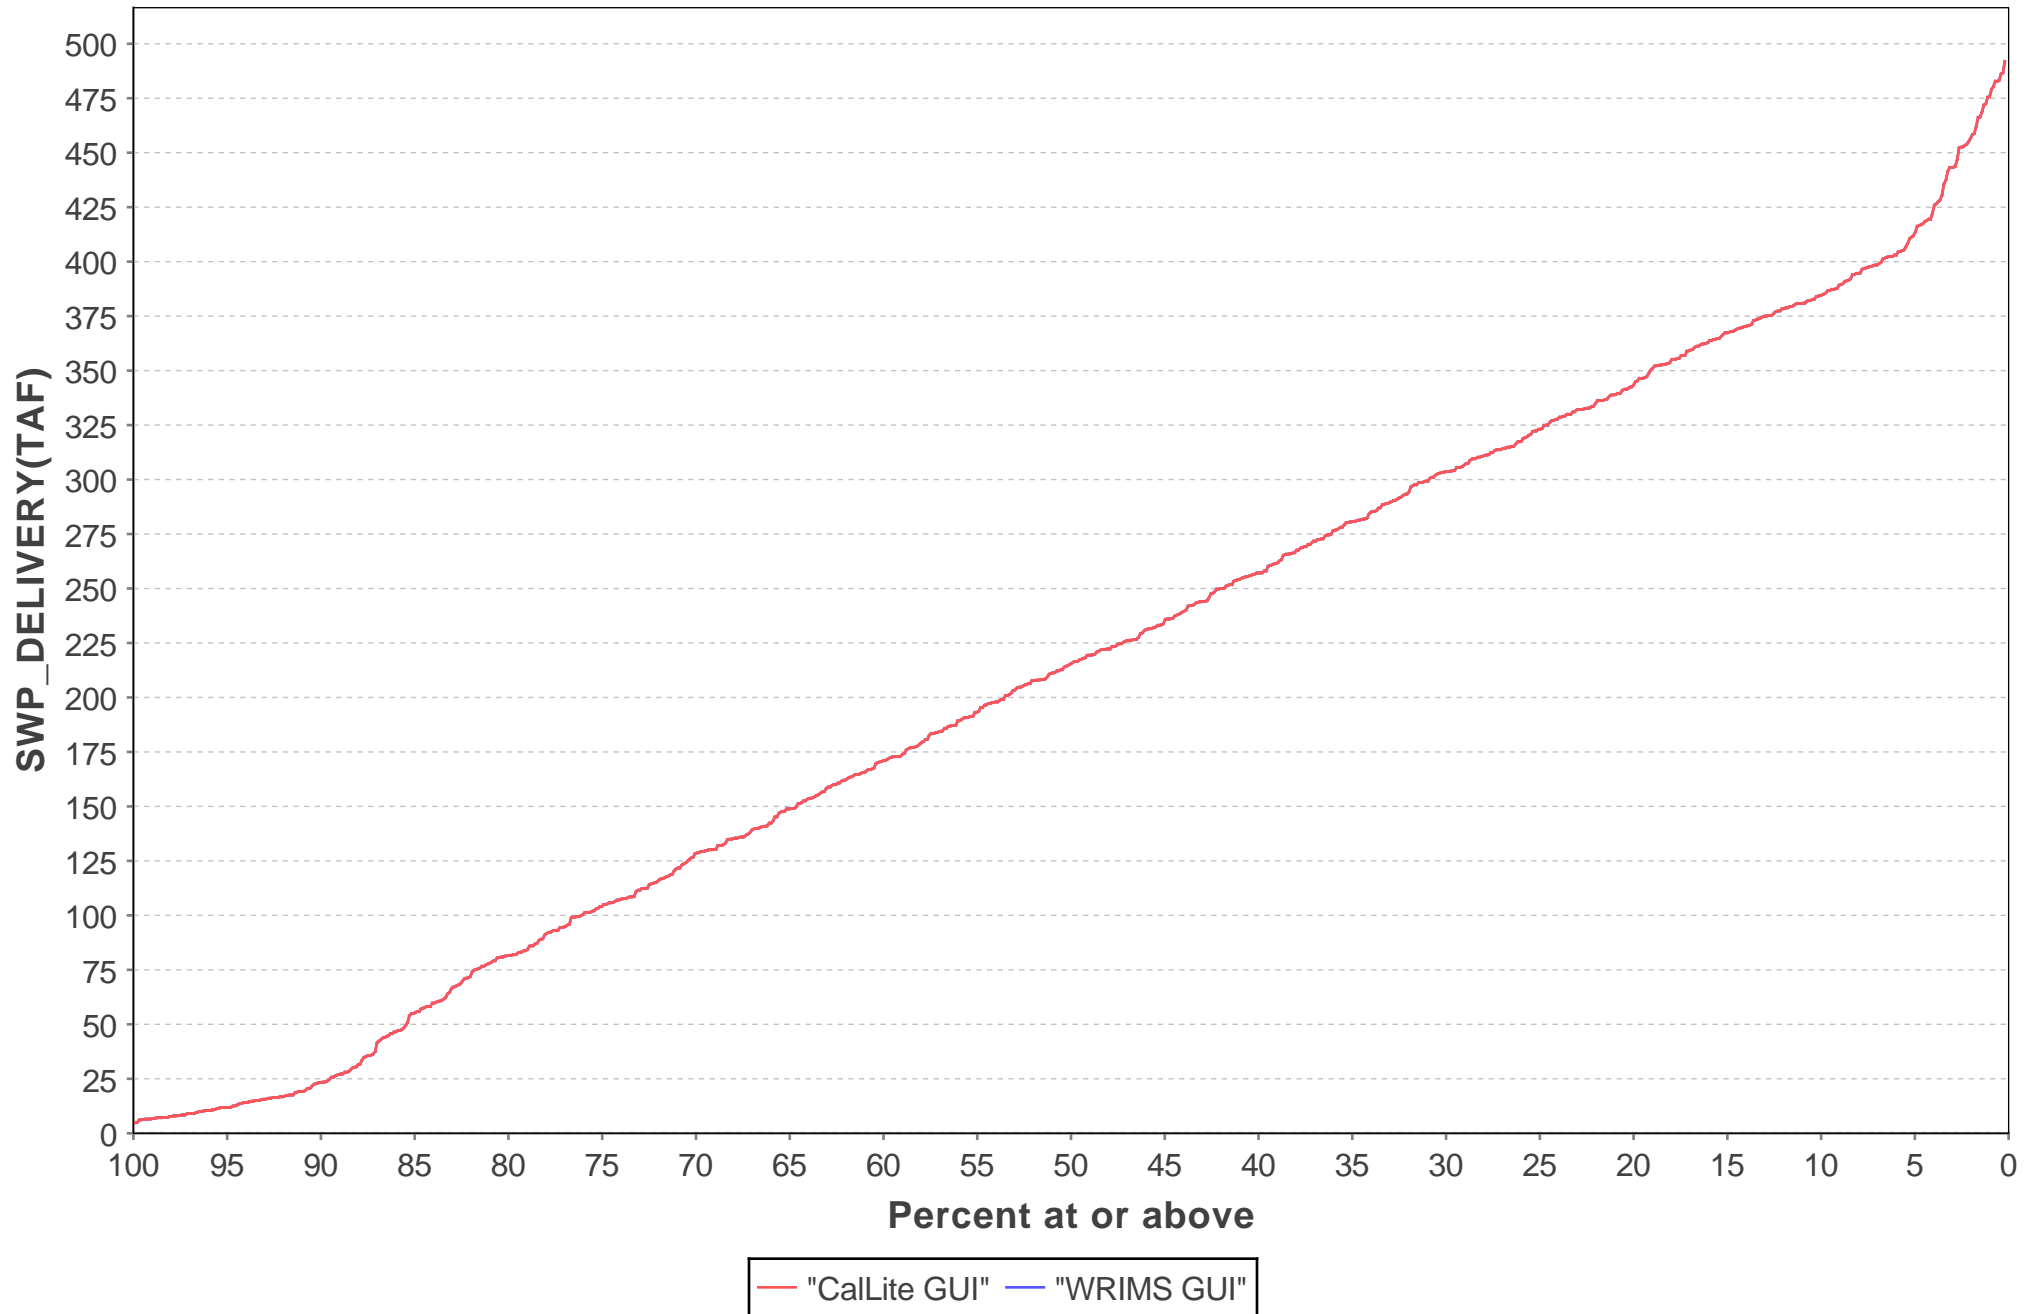


# Average CVP SOD Deliveries

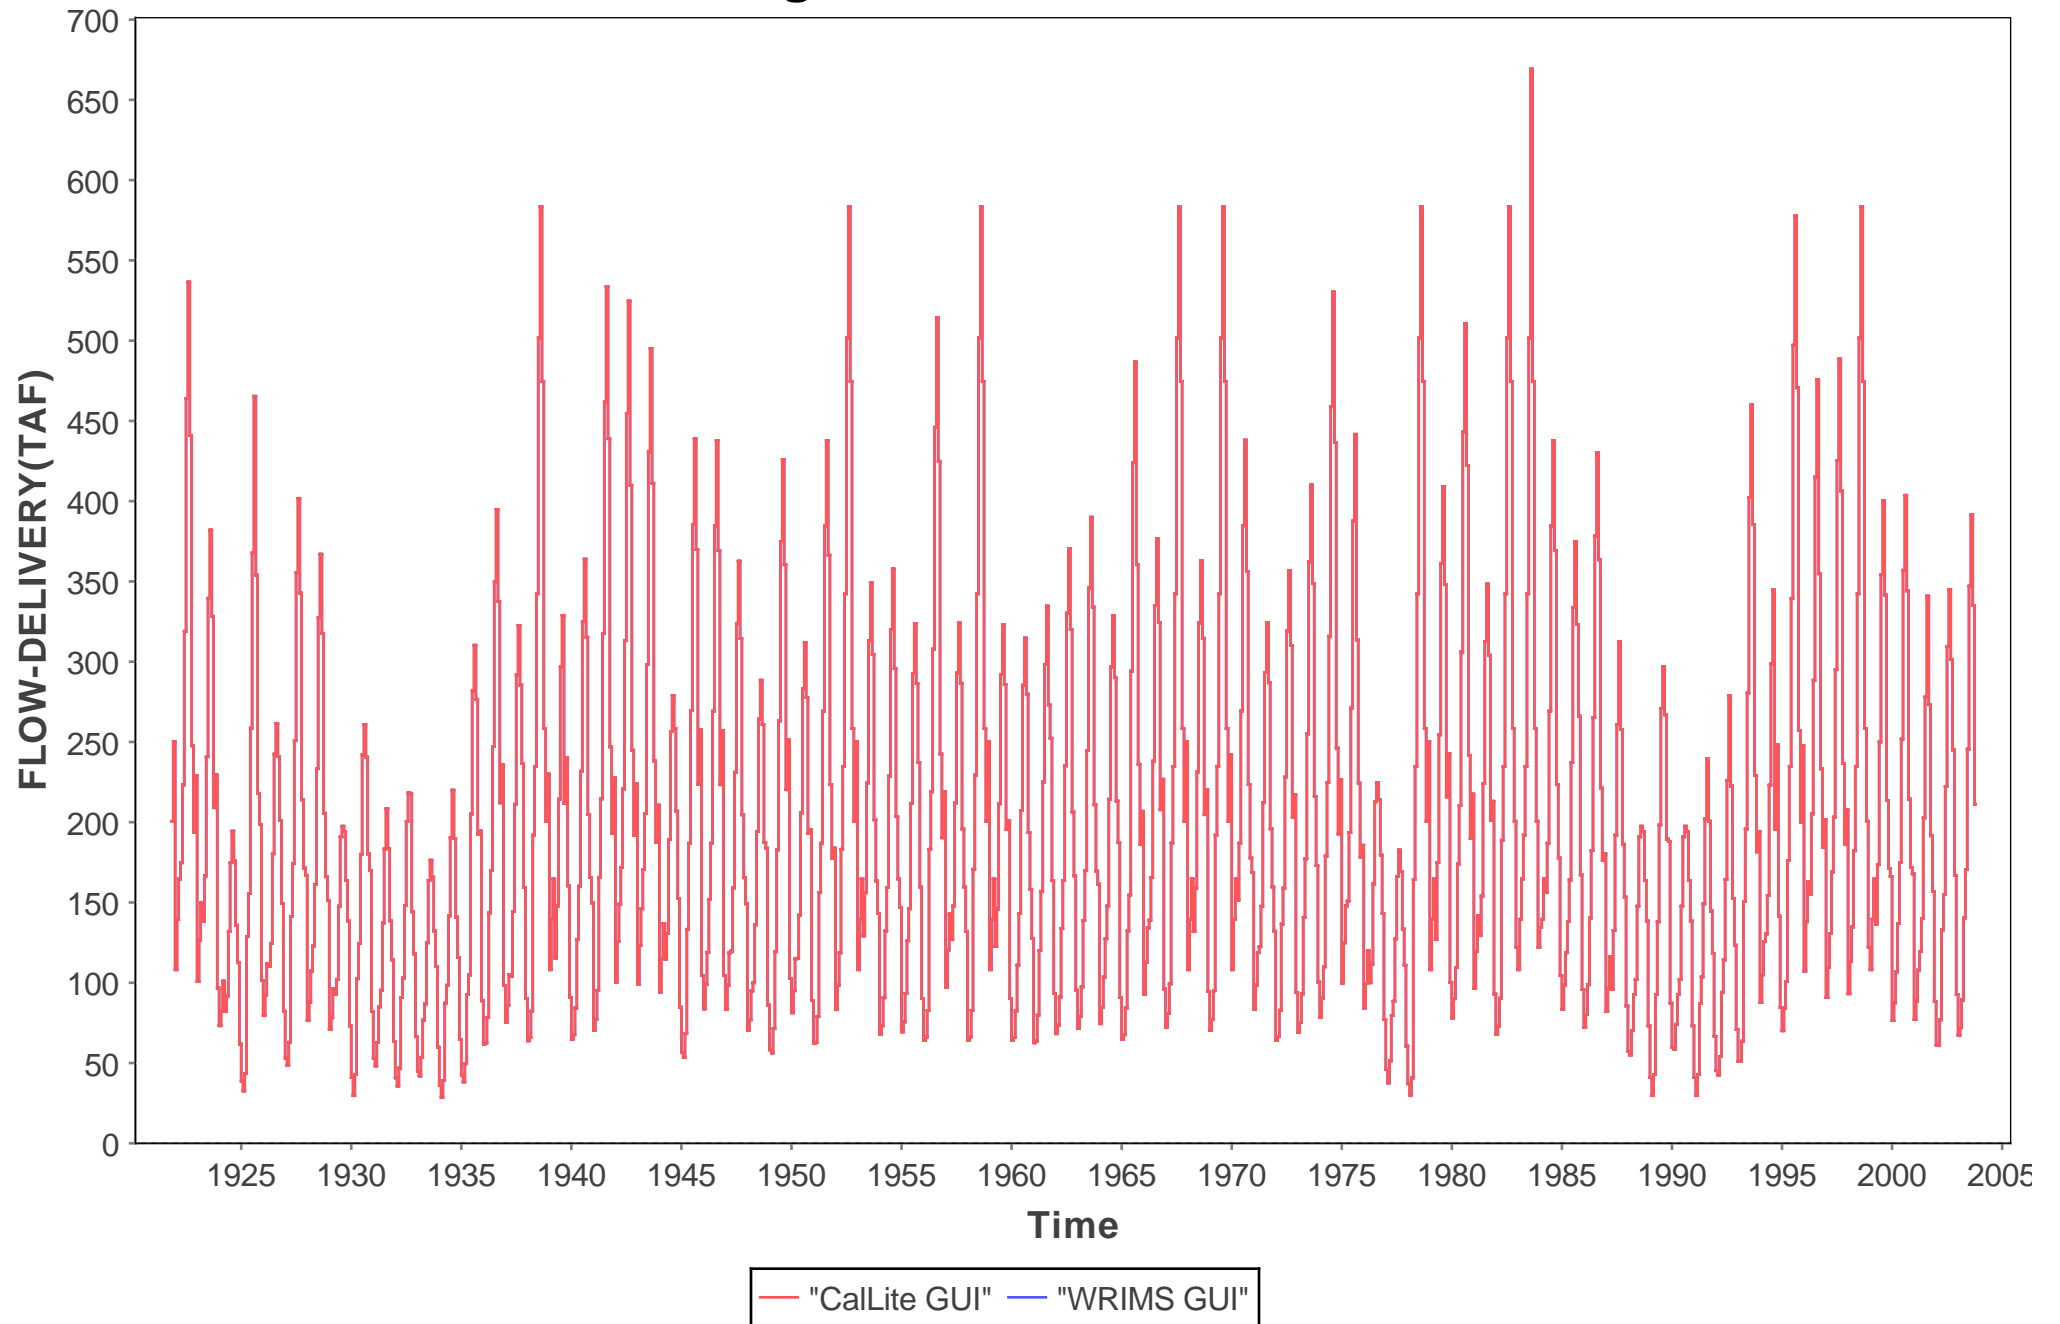

# Exceedance CVP SOD Deliveries

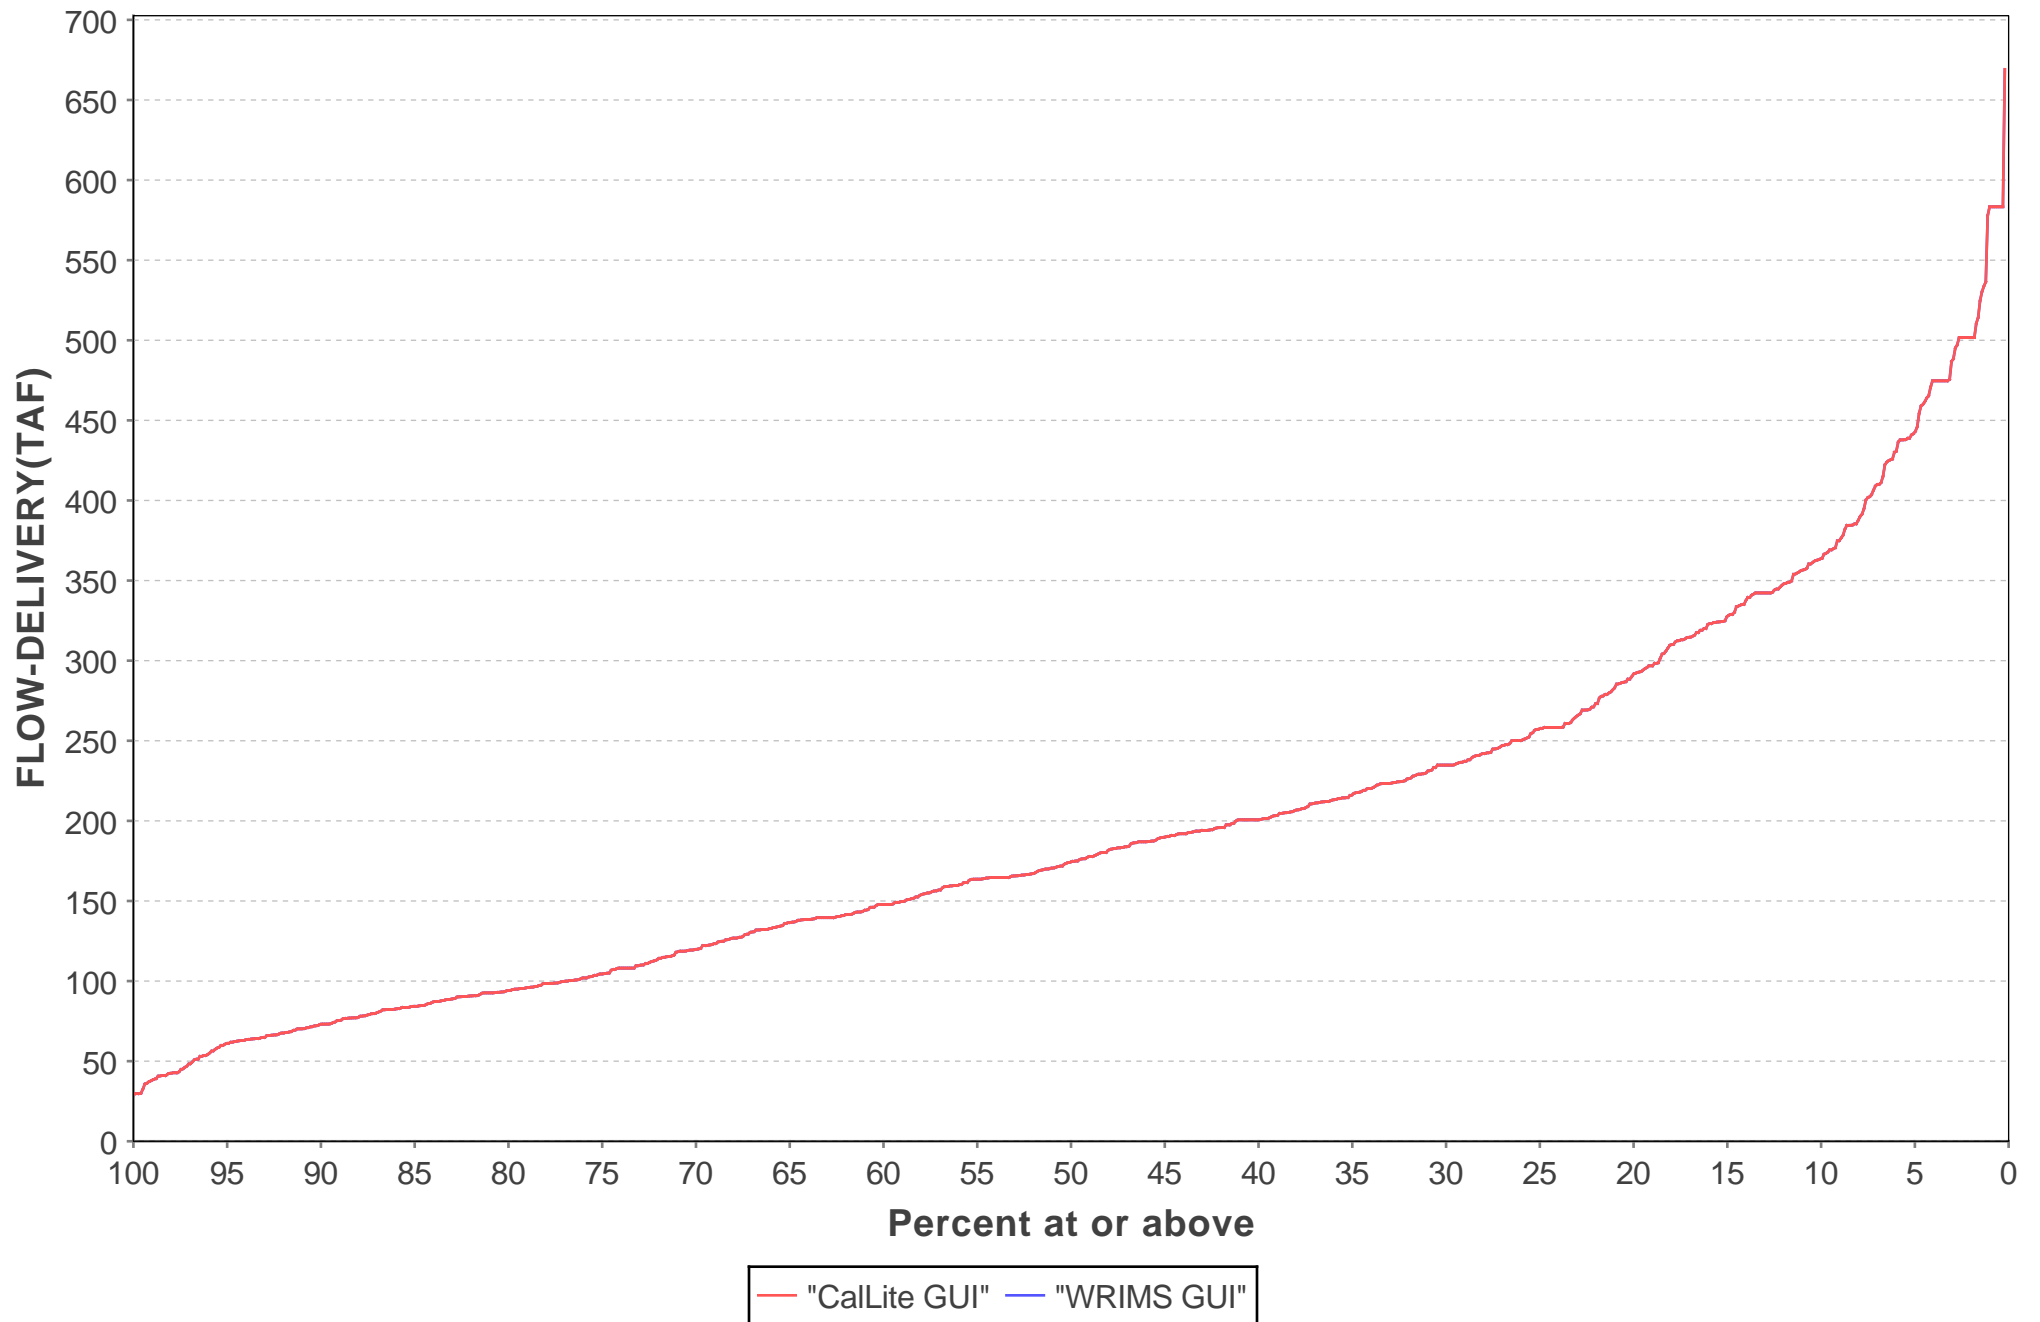


# Exceedance SWP Table A Allocation

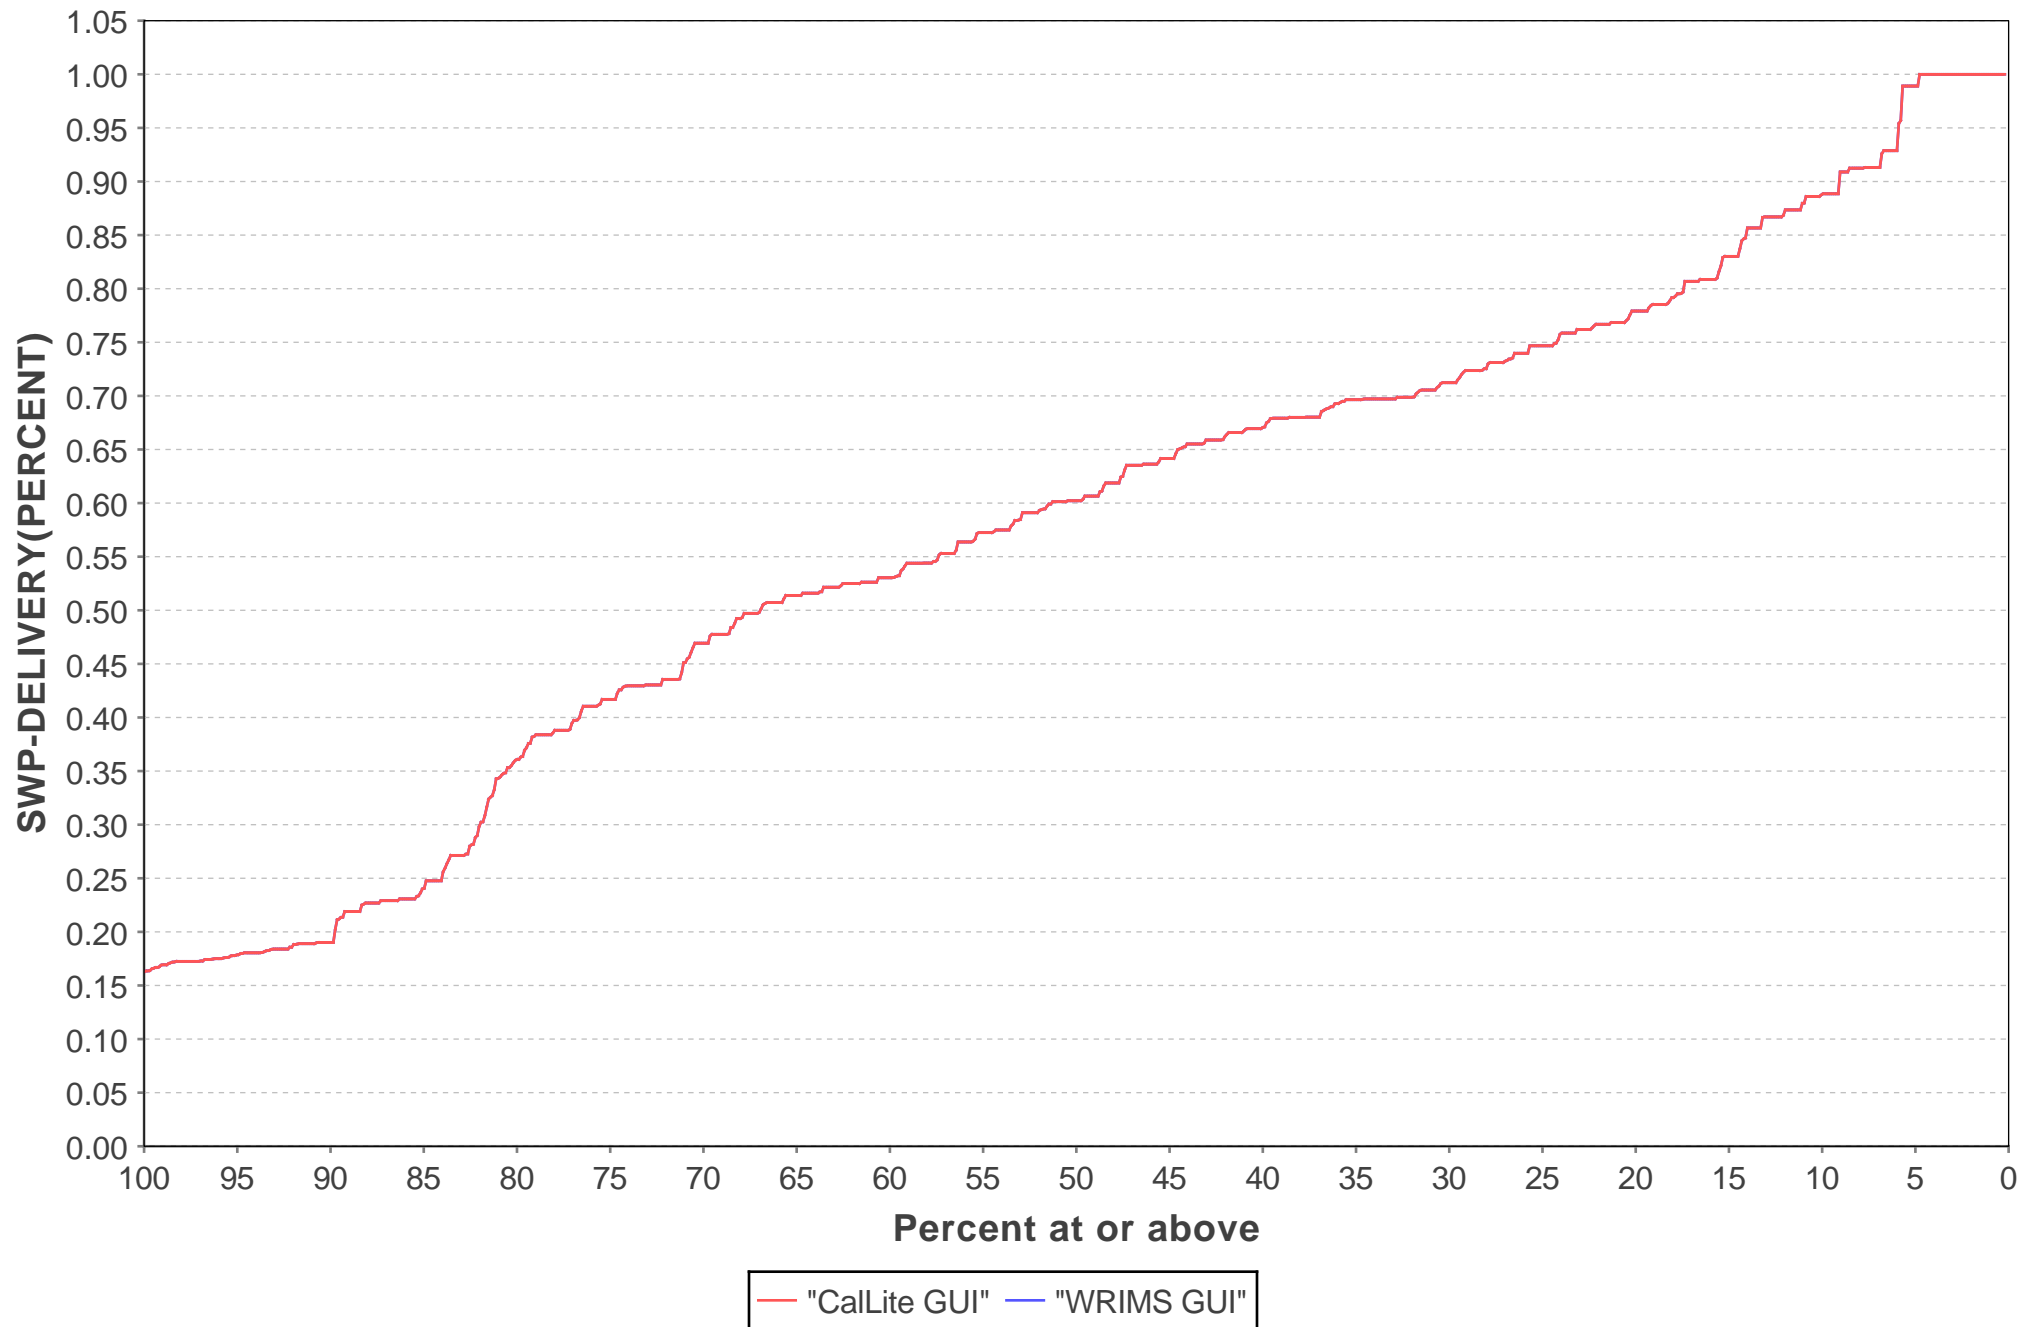




# Exceedance CVP SOD AG Allocation

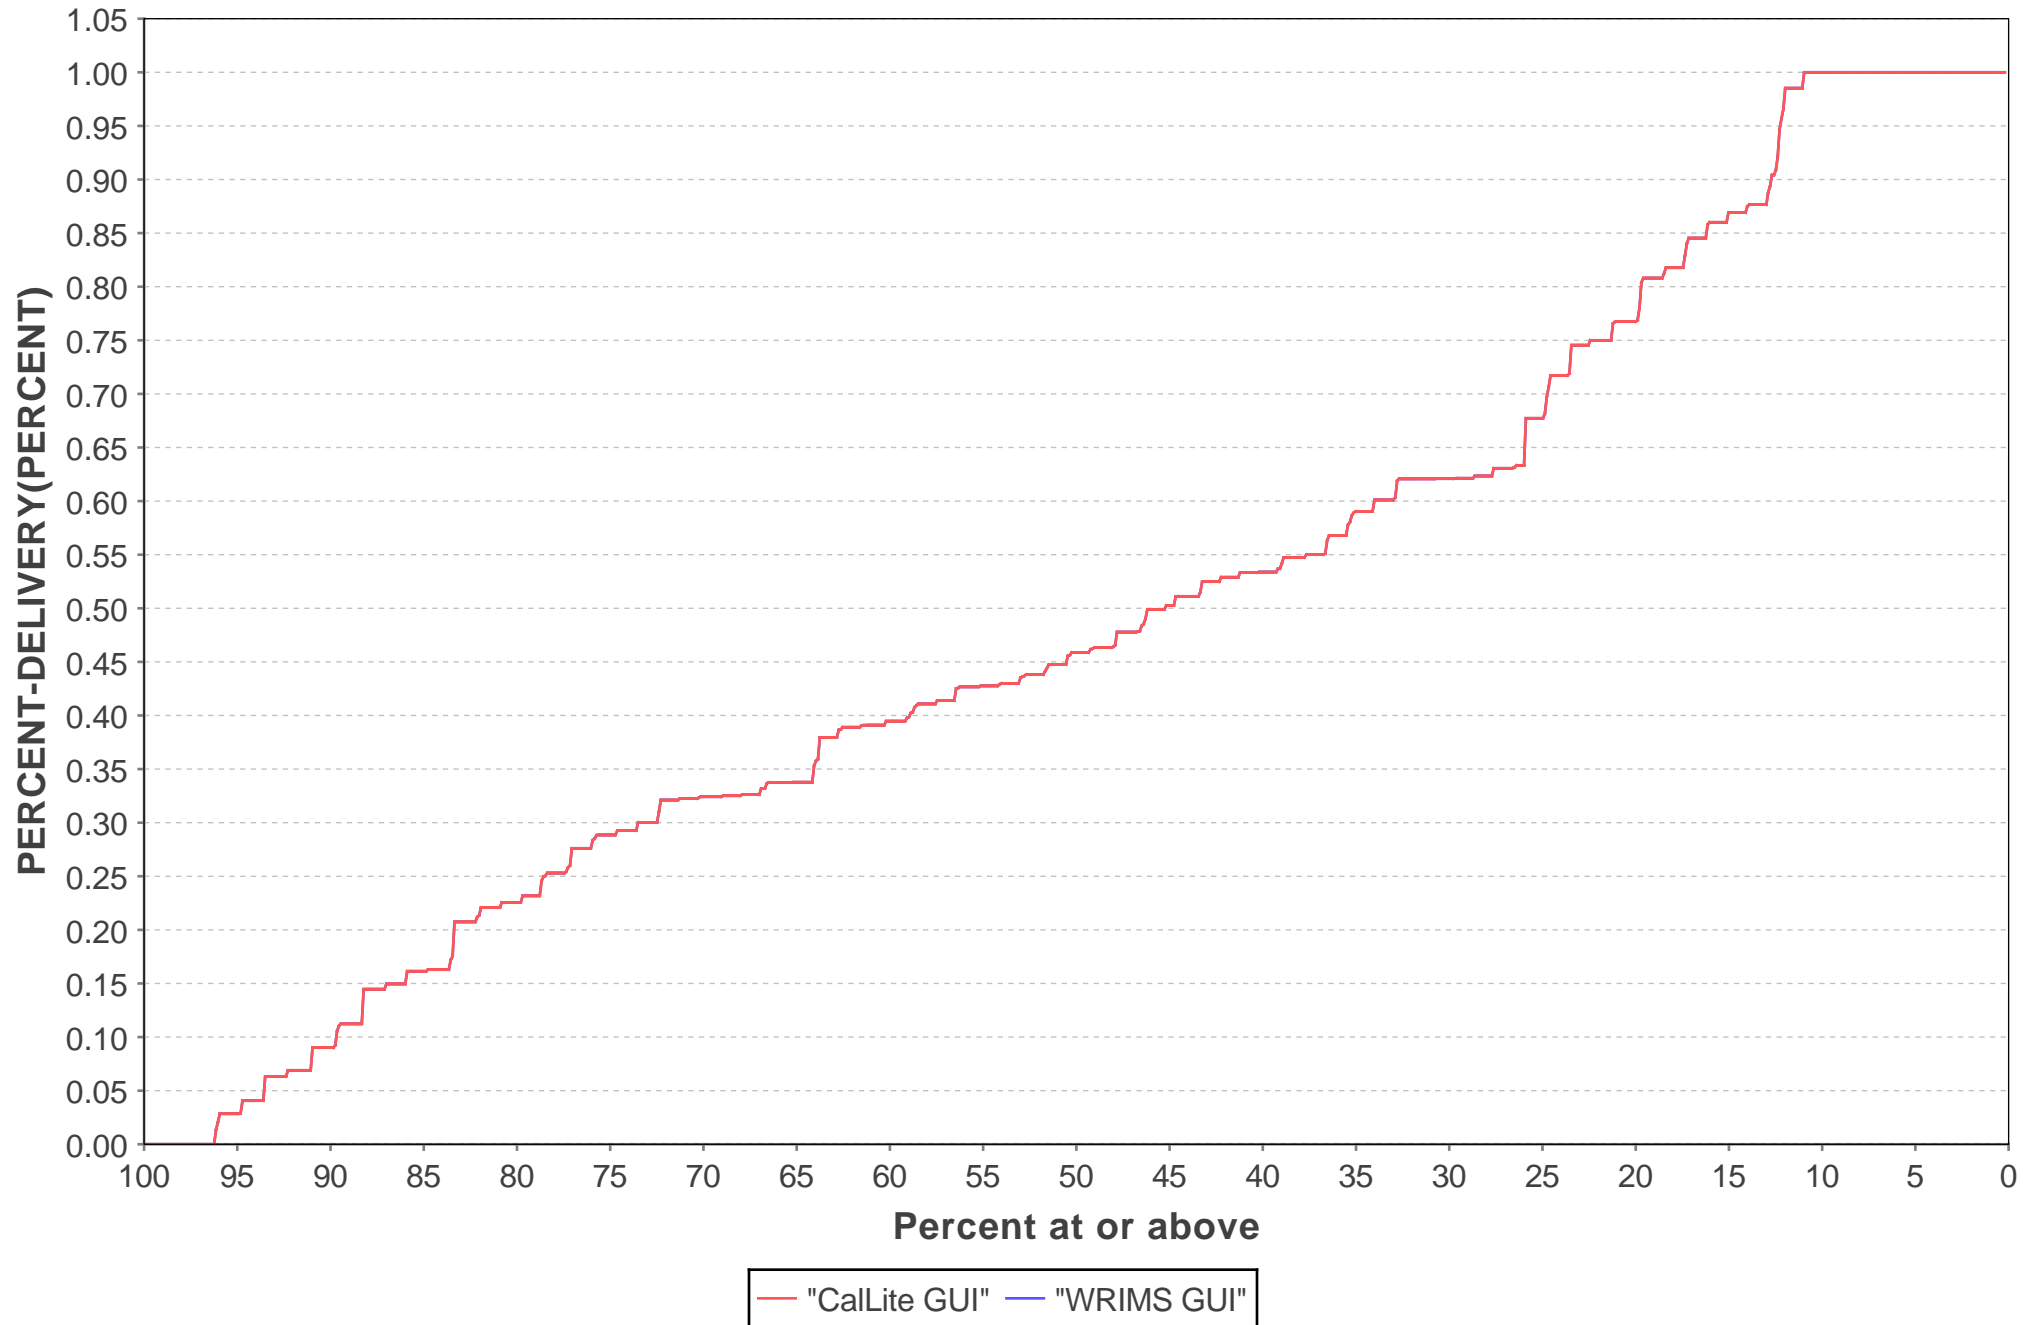

# Average X2 Position

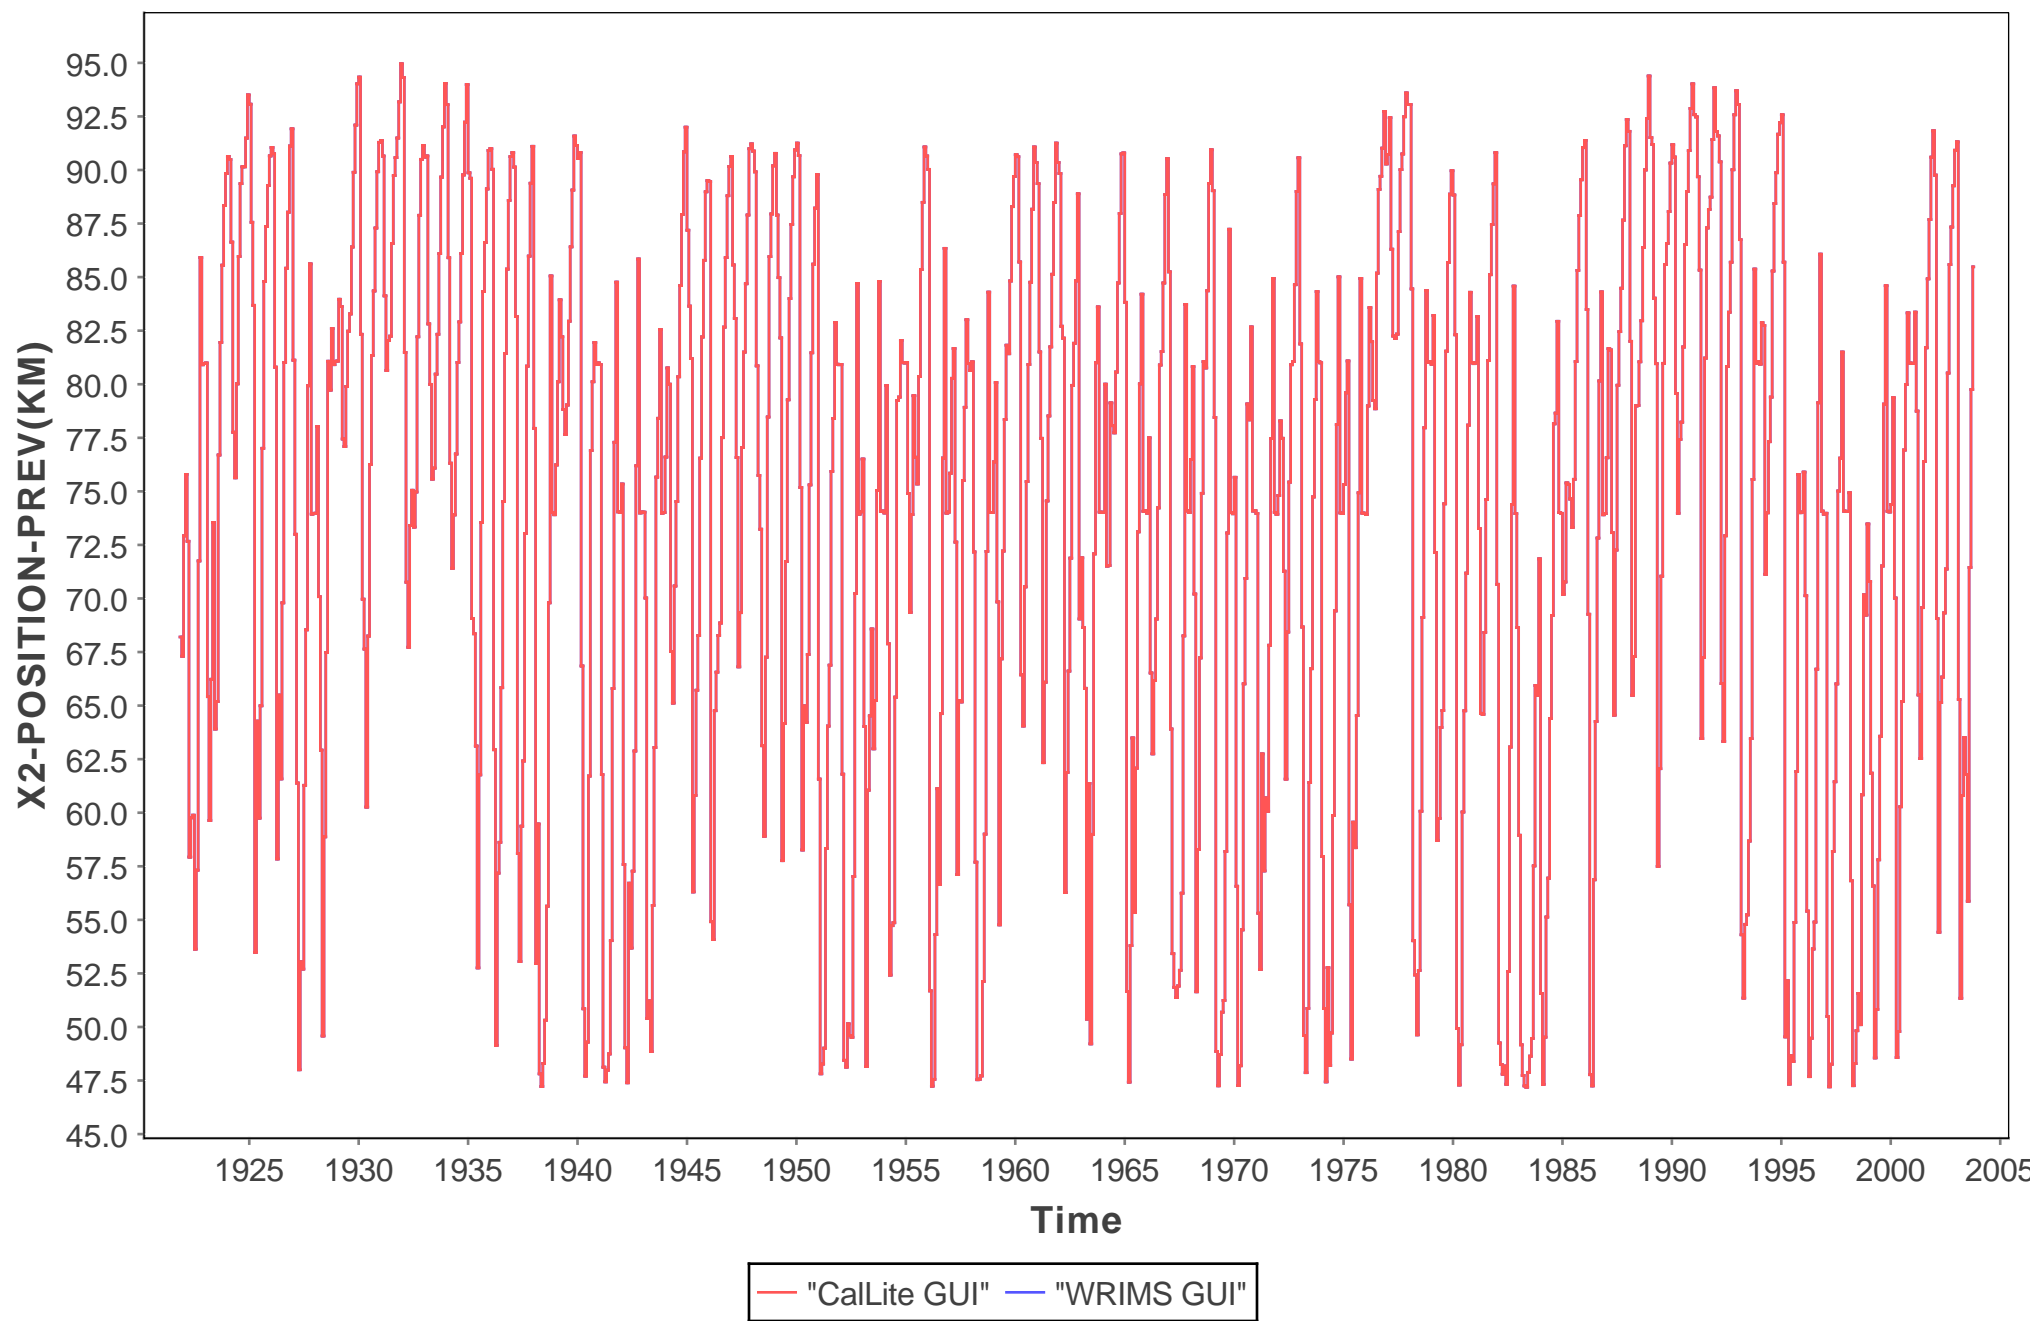

# Average Rock Slough EC

