

System Water Balance Report: "WRIMS GUI" vs "CalLite GUI"

Author:


Generated on 06-May-2013

System Flow Comparison: "WRIMS GUI" vs "CalLite GUI"


Comparison of CalLite GUI D1641 (R589) to Holly's 3/19/2013 results

	1922-2003				1929-1934				1987-1992			
	"WRIMS GUI"	"CalLite GUI"	Diff	% Diff	"WRIMS GUI"	"CalLite GUI"	Diff	% Diff	"WRIMS GUI"	"CalLite GUI"	Diff	% Diff
River Flow												
Trinity R blw Lewiston	702	702	0	0	411	411	0	0	472	472	0	0
Trinity Export	528	528	0	0	366	366	0	0	432	432	0	0
Clear Cr blw Whiskeytown	125	125	0	0	98	98	0	0	112	112	0	0
Sacramento R @ Keswick	6244	6244	0	0	4022	4022	0	0	4471	4471	0	0
Sacramento R @ Wilkins Slough	6596	6596	0	0	4005	4005	0	0	4704	4704	0	0
Feather R blw Thermalito	3169	3169	0	0	1614	1614	0	0	1589	1589	0	0
American R blw Nimbus	2382	2382	0	0	1234	1234	0	0	1087	1087	0	0
Delta Inflow	21553	21553	0	0	9861	9861	0	0	10381	10381	0	0
Sacramento R @ Hood	15578	15578	0	0	8209	8209	0	0	9015	9015	0	0
Yolo Bypass	2284	2284	0	0	100	100	0	0	141	141	0	0
Mokelumne R	666	666	0	0	206	206	0	0	155	155	0	0
San Joaquin R d/s Vernalis	3024	3024	0	0	1346	1346	0	0	1071	1071	0	0
Delta Outflow	10167	10167	0	0	936	936	0	0	1485	1485	0	0
Delta Outflow for X2 and NDO	4456	4456	0	0	4177	4177	0	0	3895	3895	0	0
Delta Exports	5957	5957	0	0	3576	3576	0	0	3761	3761	0	0
Banks SWP	3419	3419	0	0	2018	2018	0	0	2010	2010	0	0
Banks CVP	73	73	0	0	15	15	0	0	33	33	0	0
Jones	2465	2465	0	0	1543	1543	0	0	1717	1717	0	0
SWP SOD Deliveries	3406	3406	0	0	2001	2001	0	0	2009	2009	0	0
Table A (Incl. Article 56)	3036	3036	0	0	1762	1762	0	0	1859	1859	0	0
Article 21	241	241	0	0	202	202	0	0	103	103	0	0
Article 56	128	128	0	0	37	37	0	0	46	46	0	0
CVP SOD Deliveries	2645	2645	0	0	1525	1525	0	0	1841	1841	0	0


Exceedance Trinirty Storage (Sept)

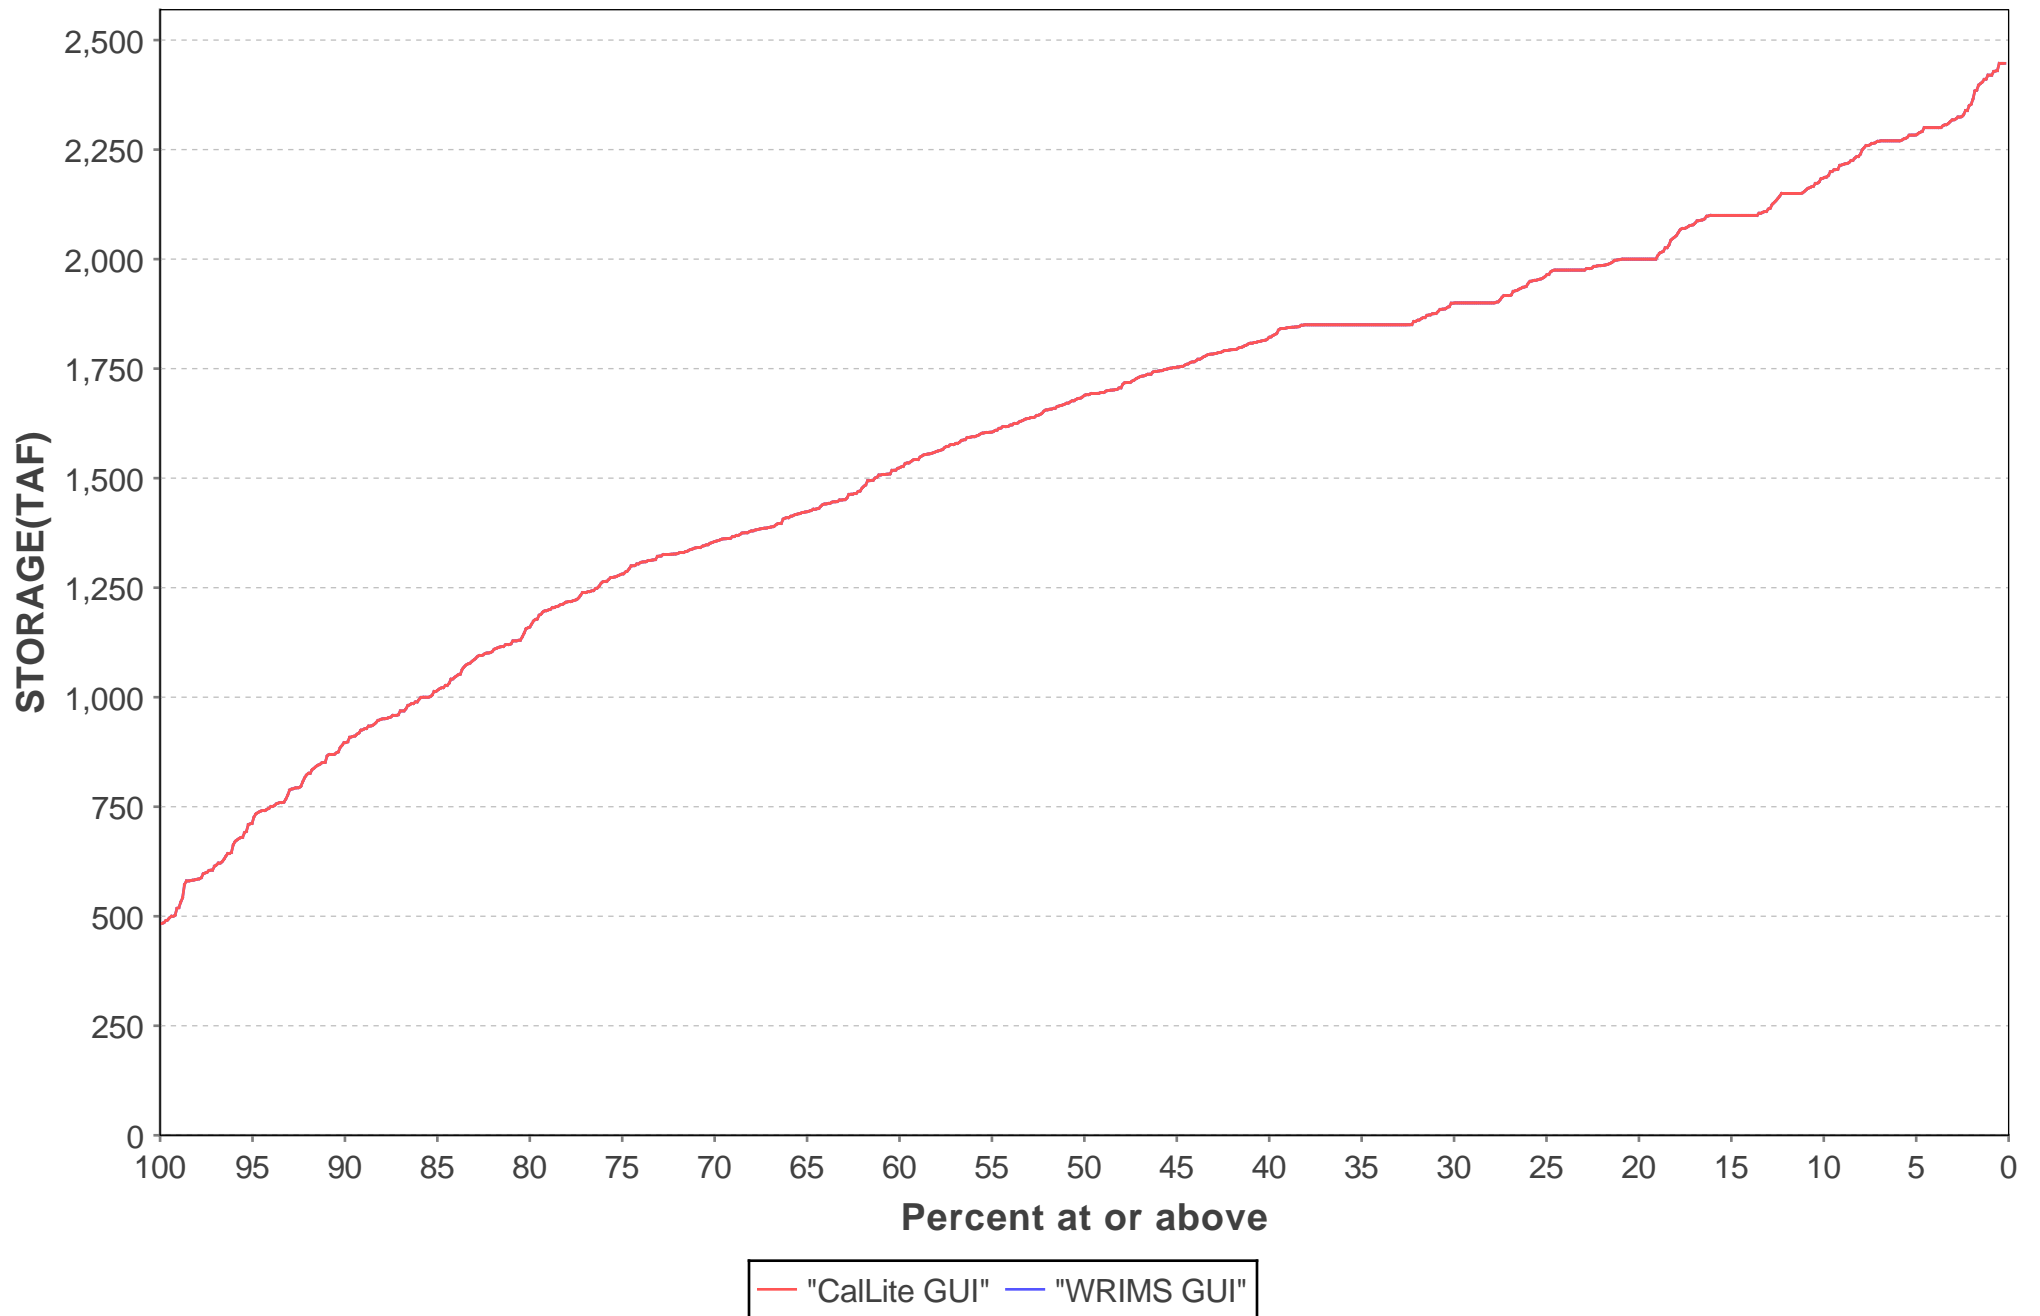


Exceedance Shasta Storage (Sept)

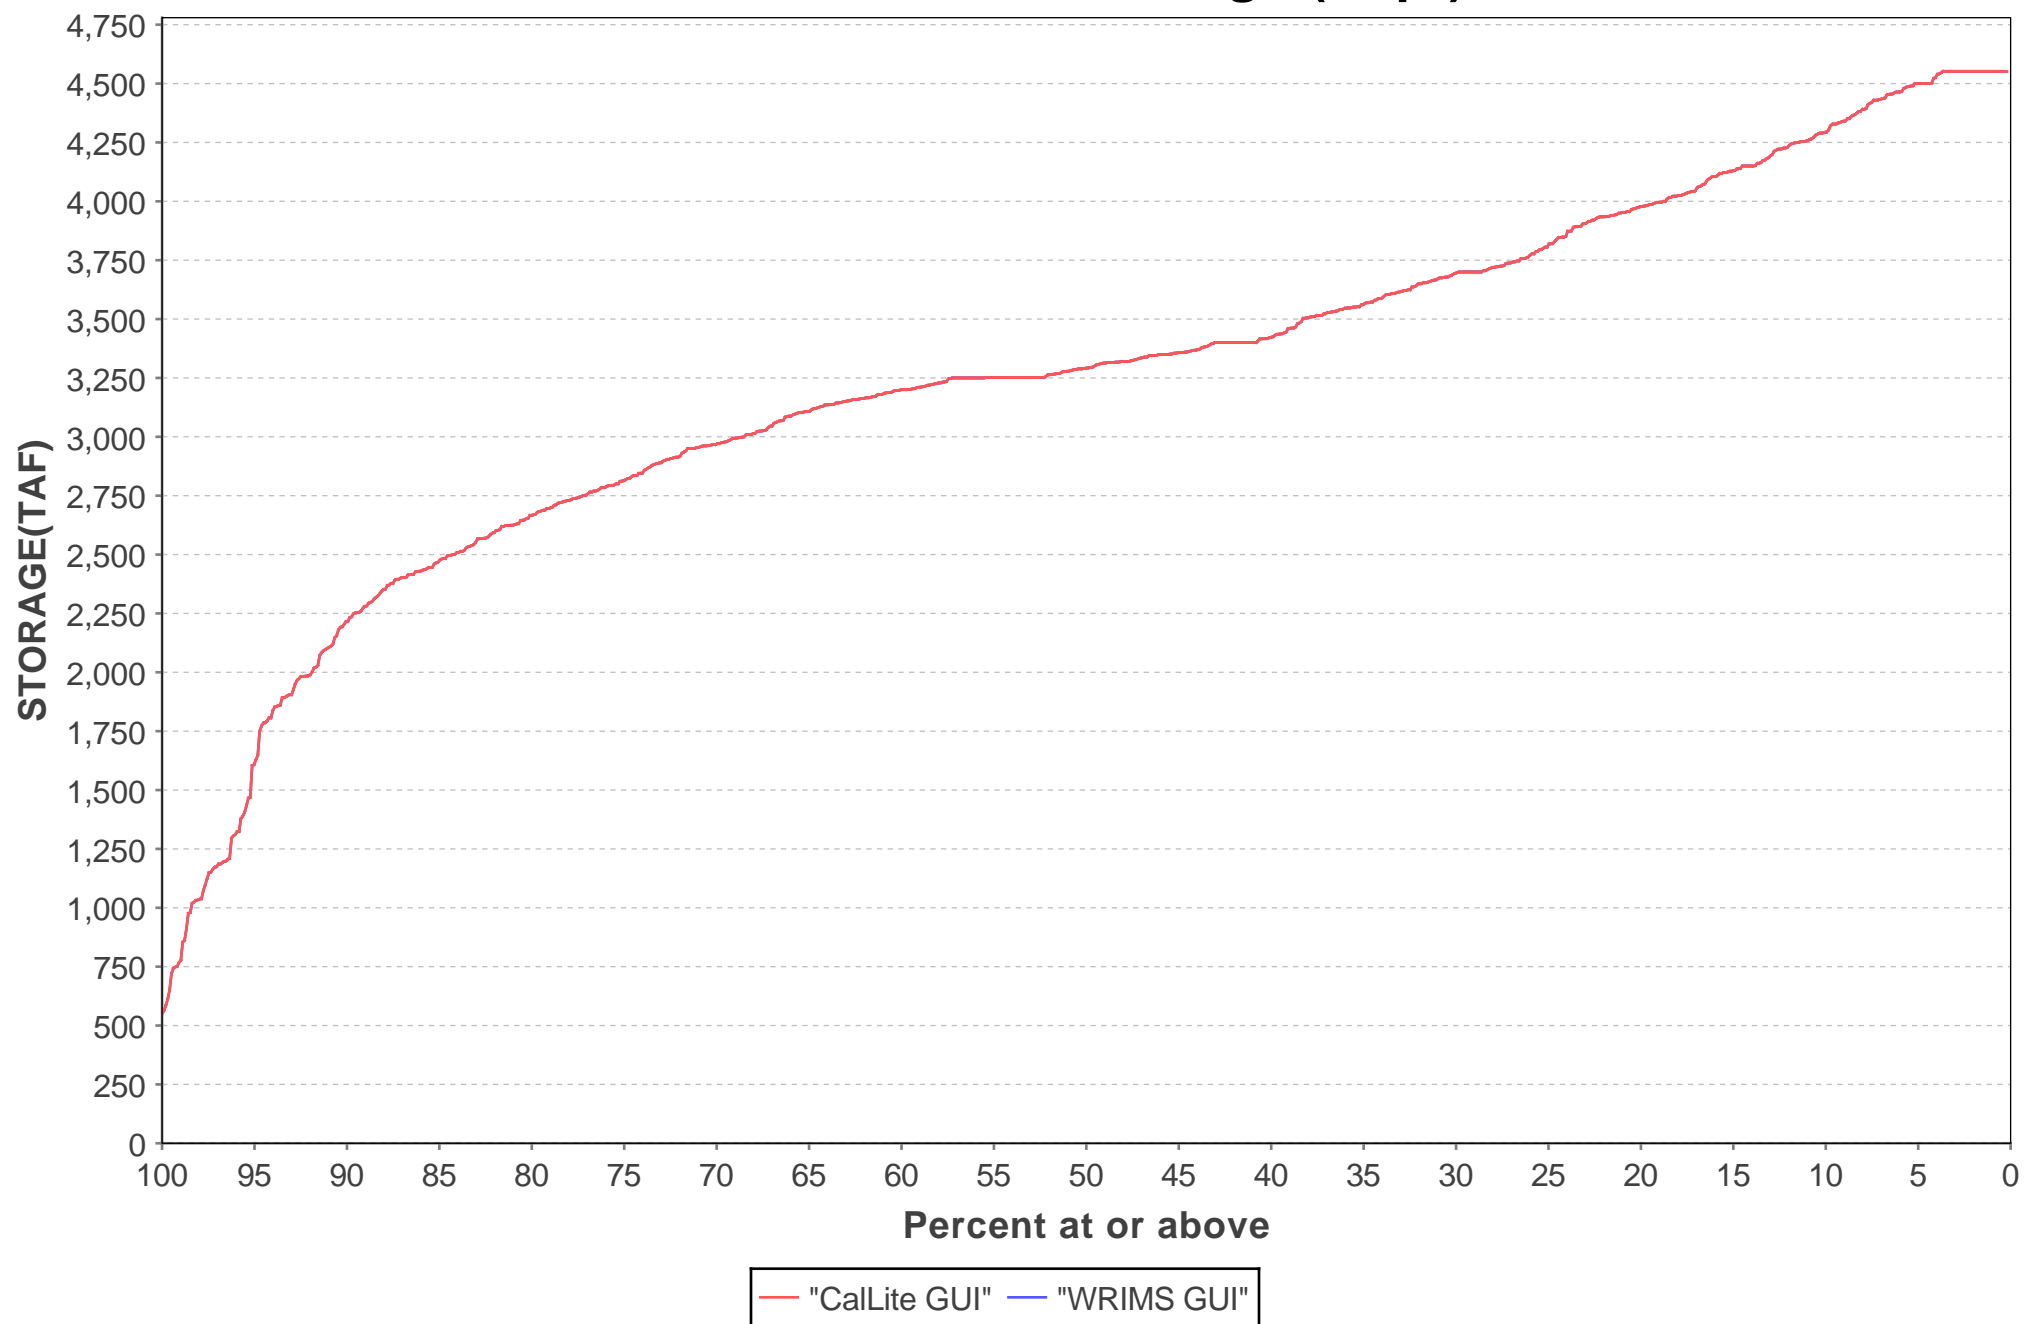


Exceedance FolSom Storage (Sept)

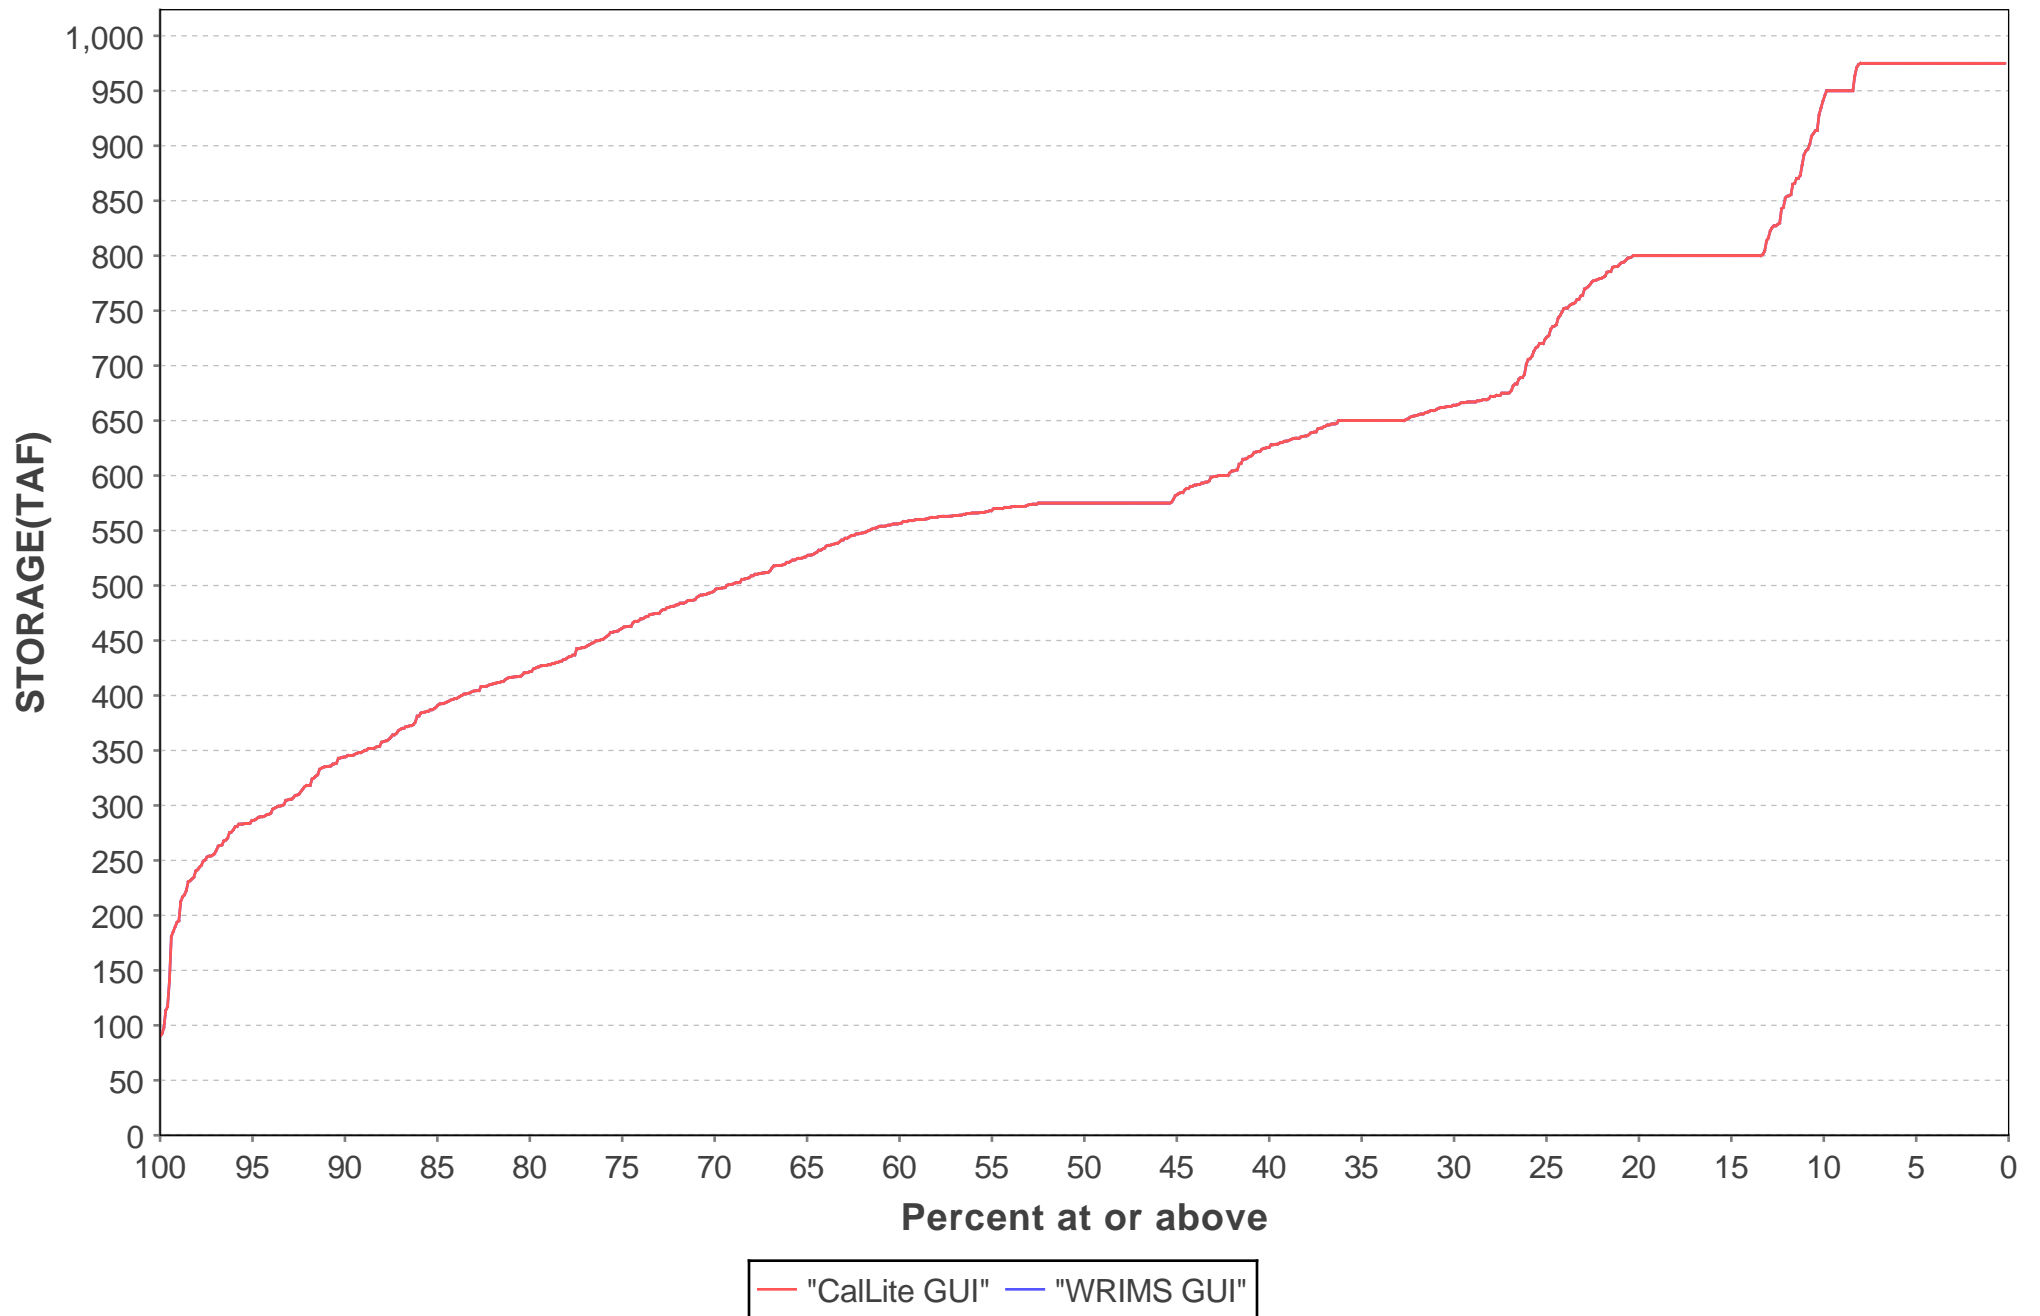


Exceedance NOD Storage (Sept)

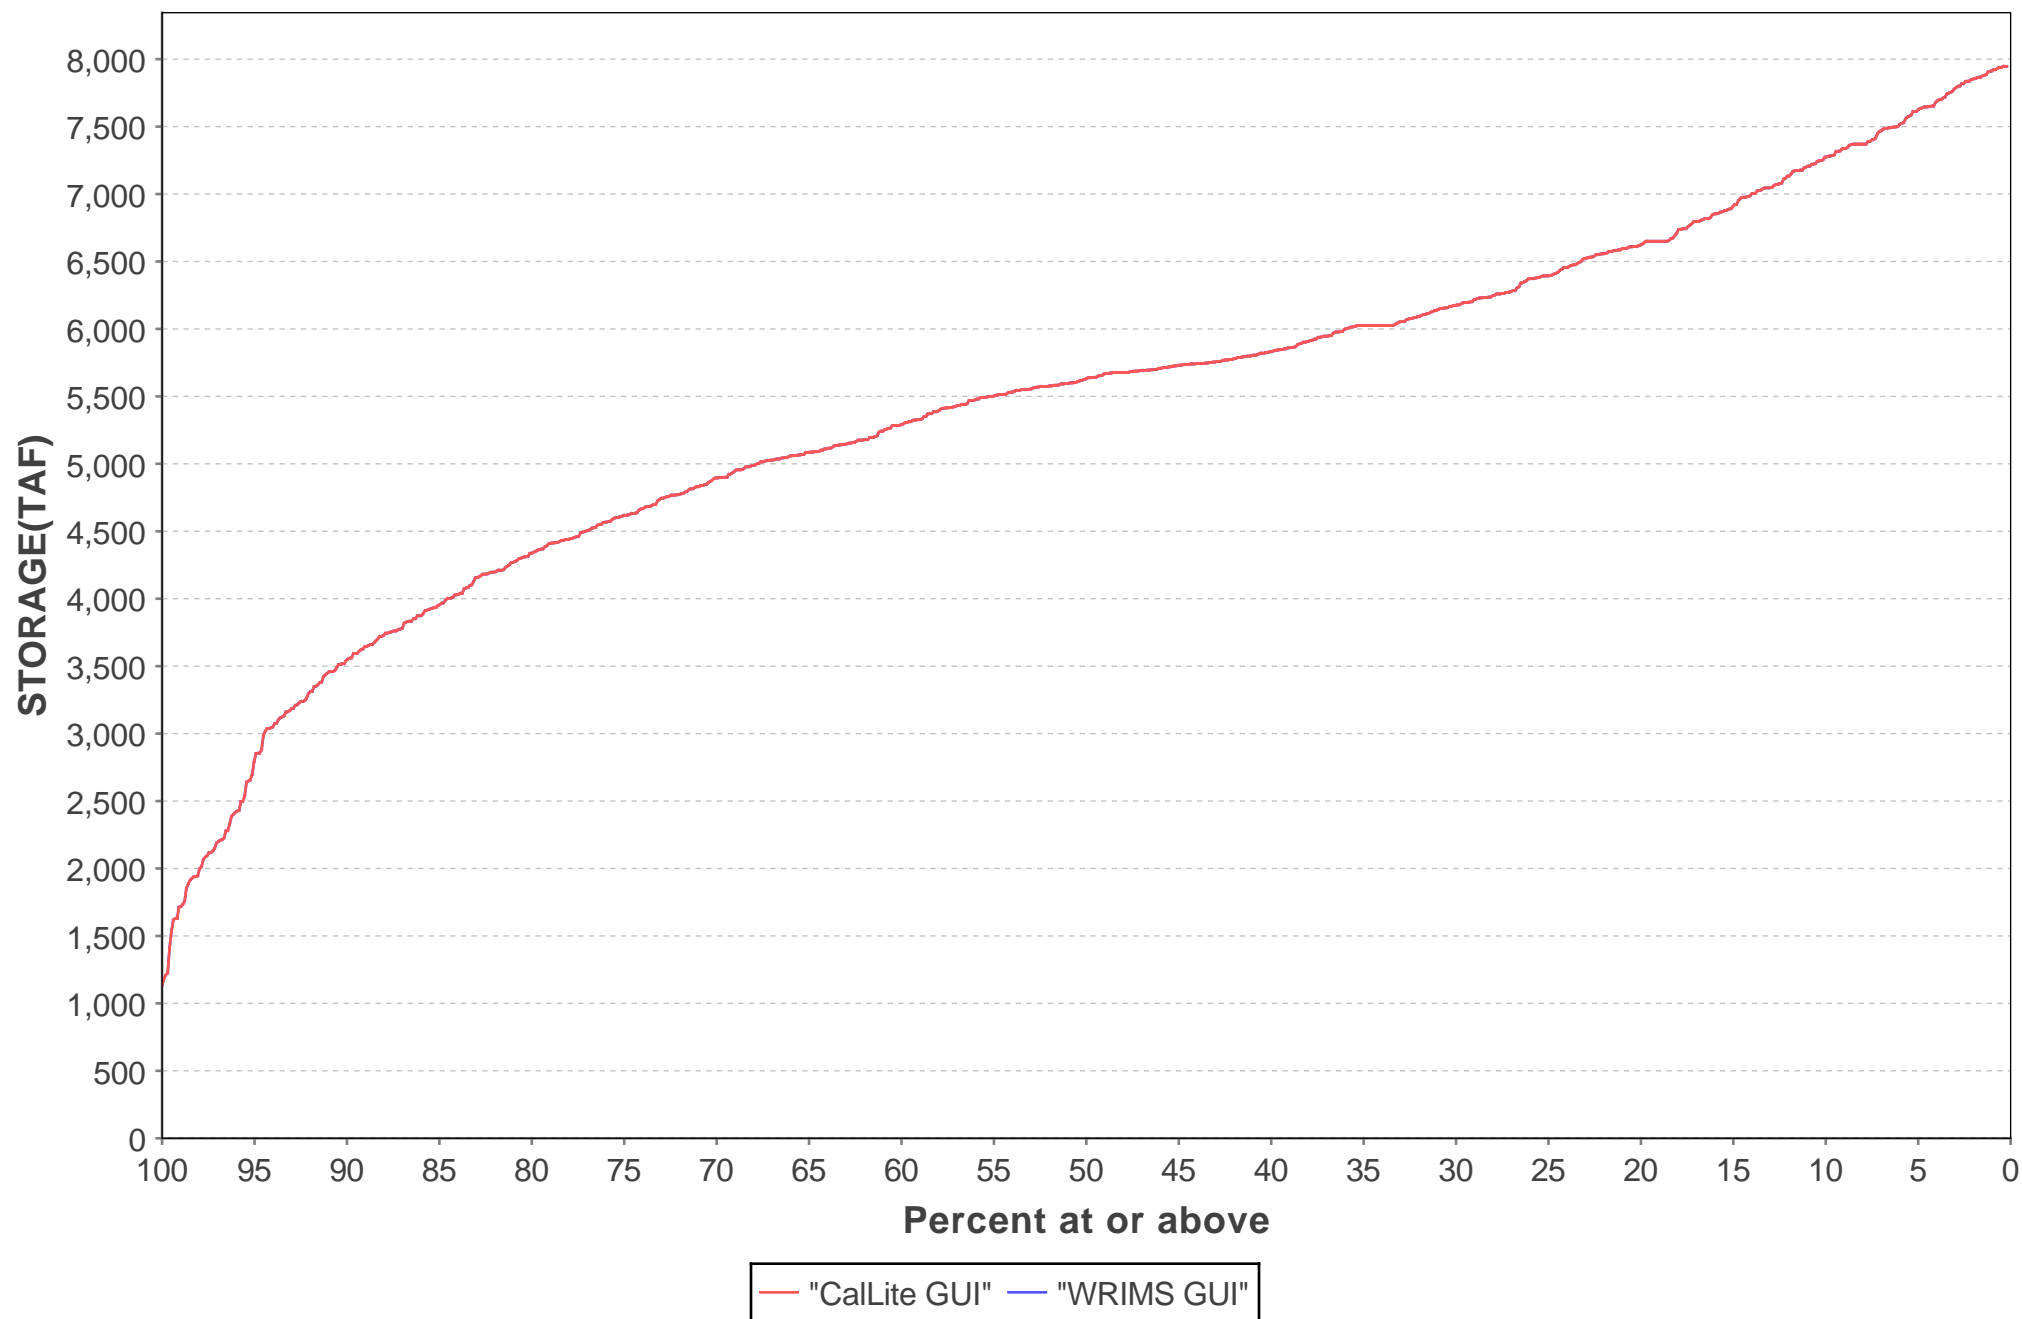


Exceedance Oroville Storage (Sept)

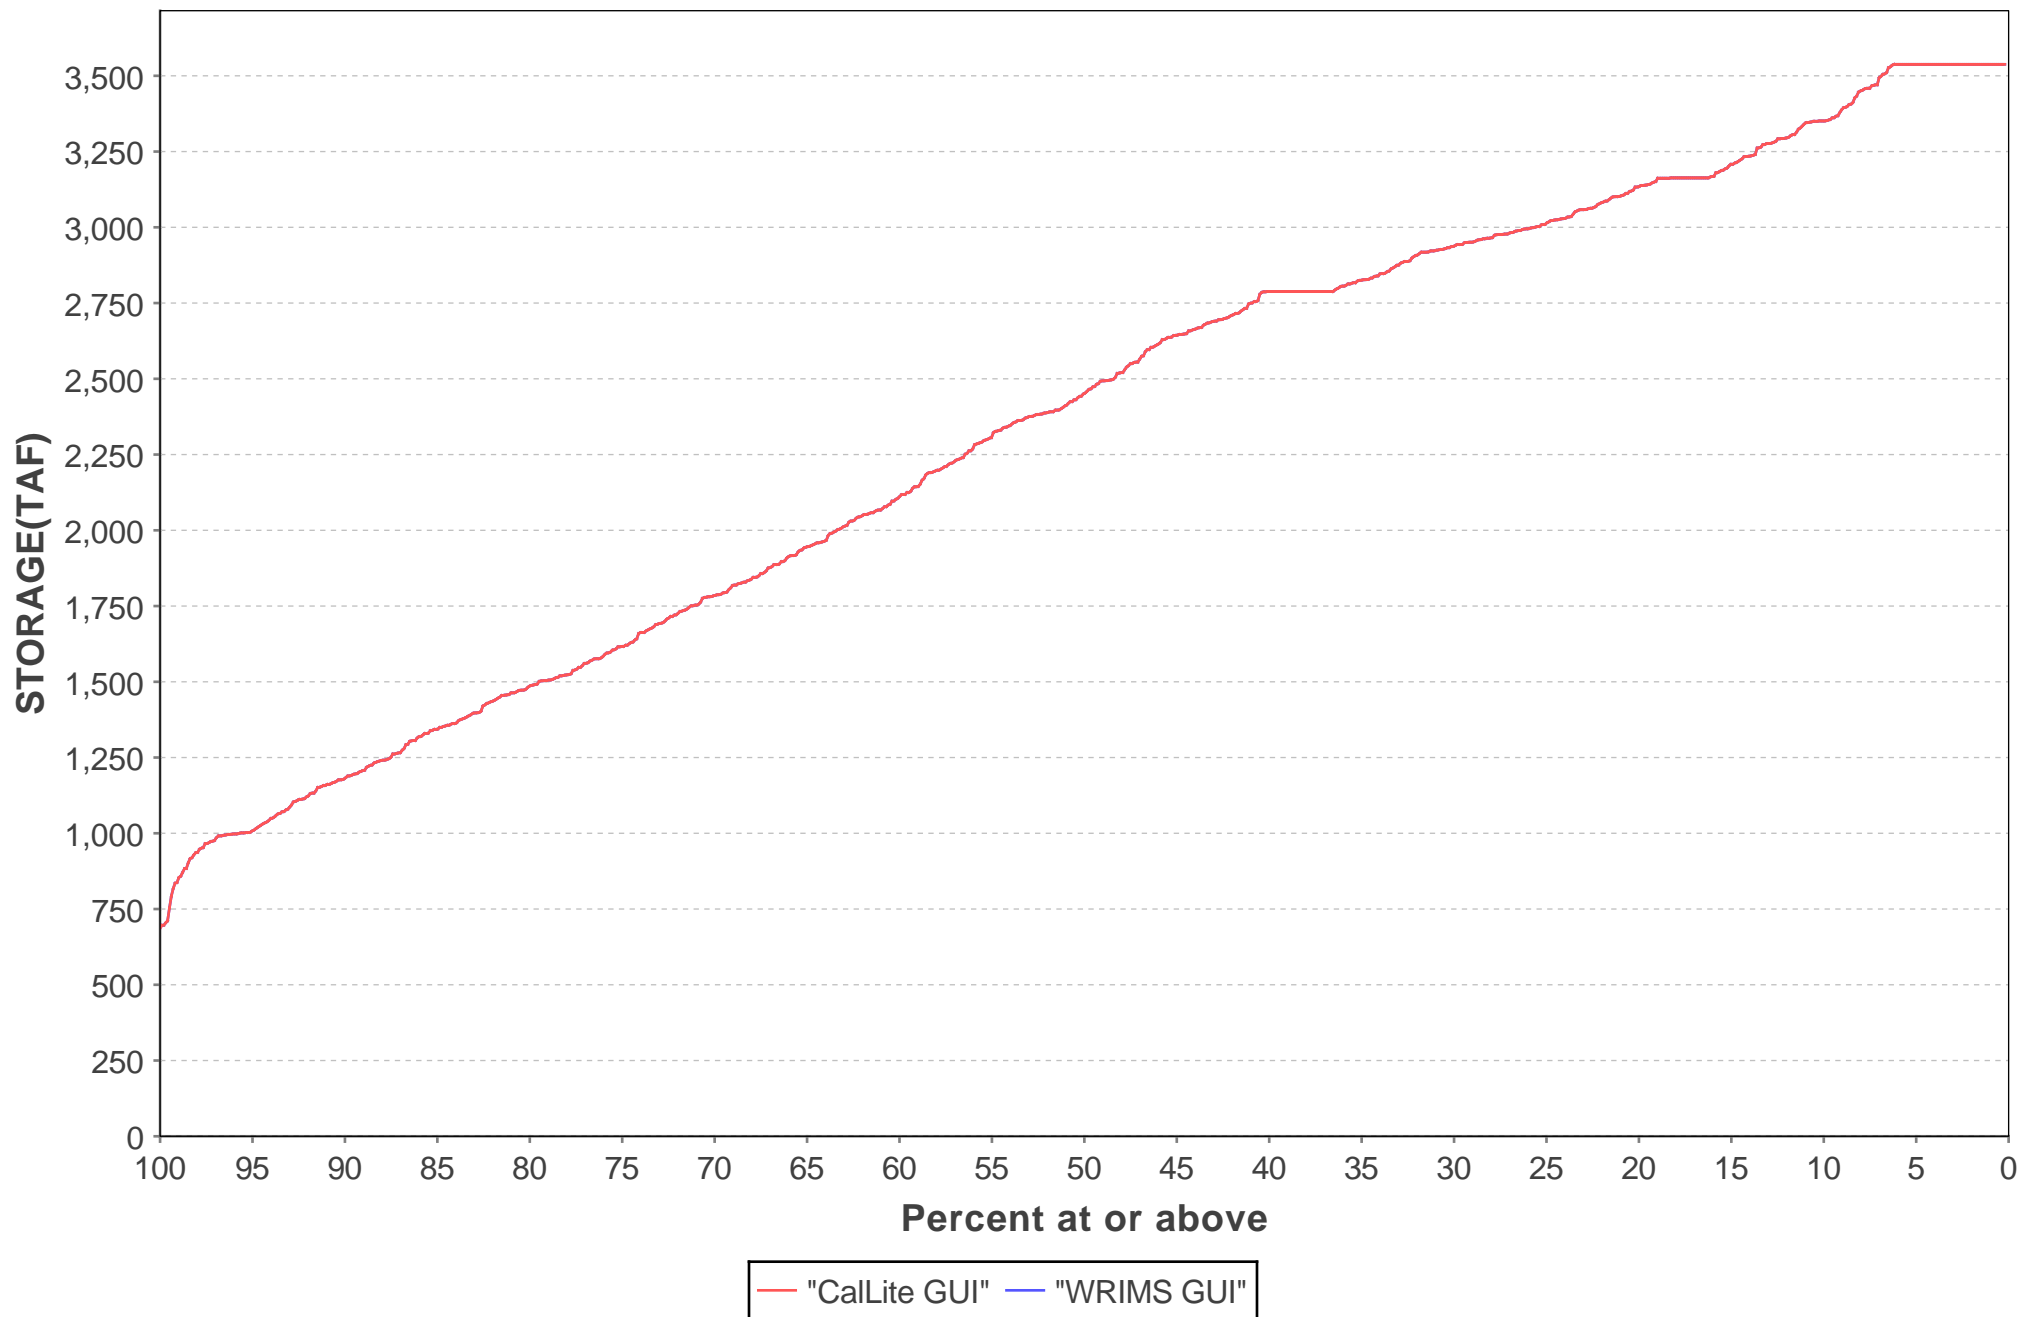


Exceedance CVP SanLuis Storage (Sept)

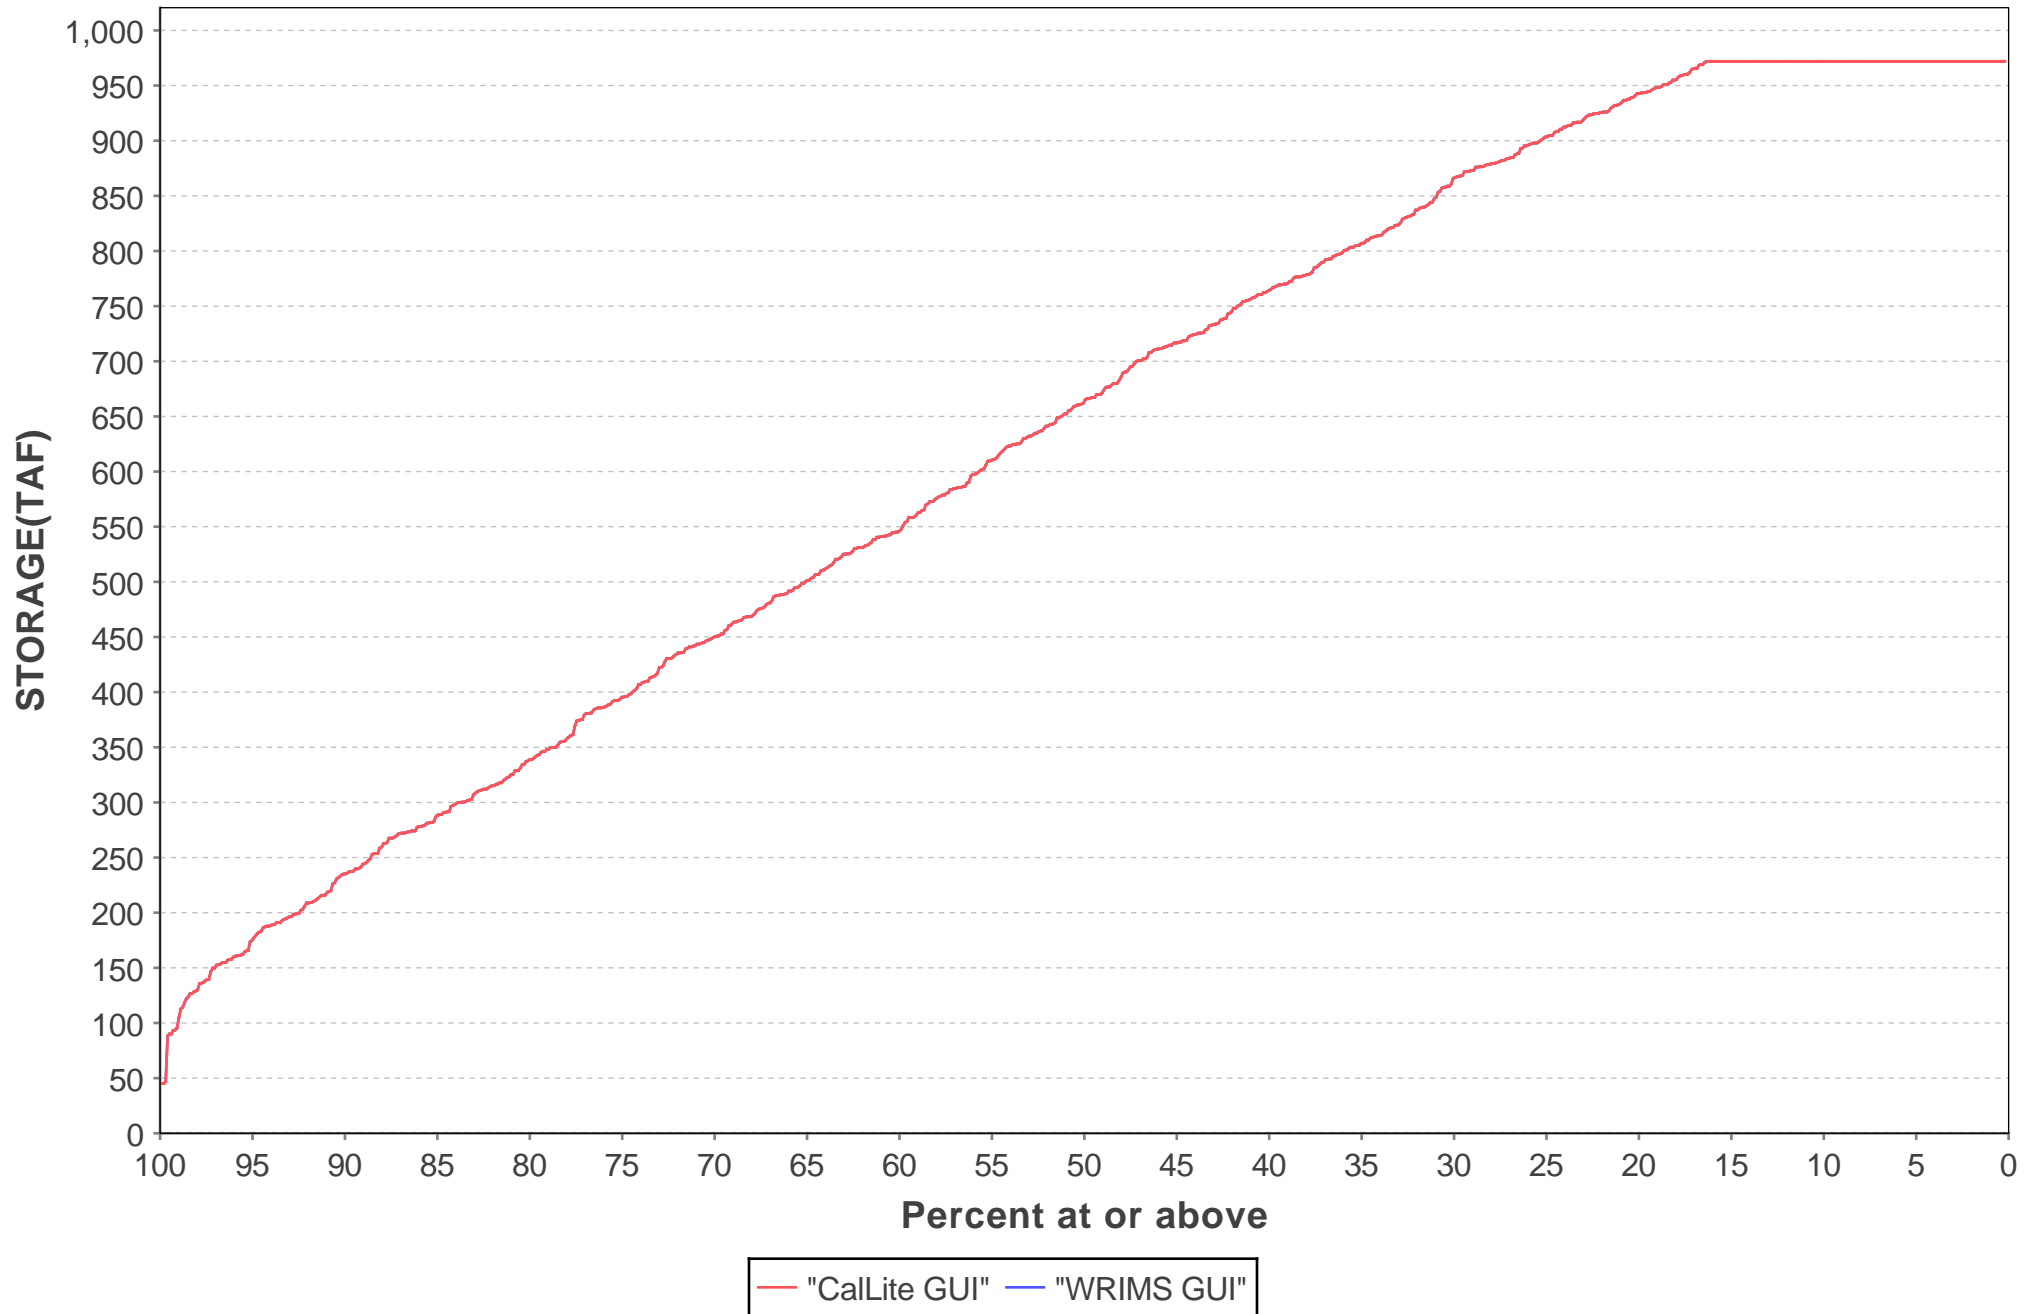


Exceedance SWP SanLuis Storage (Sept)

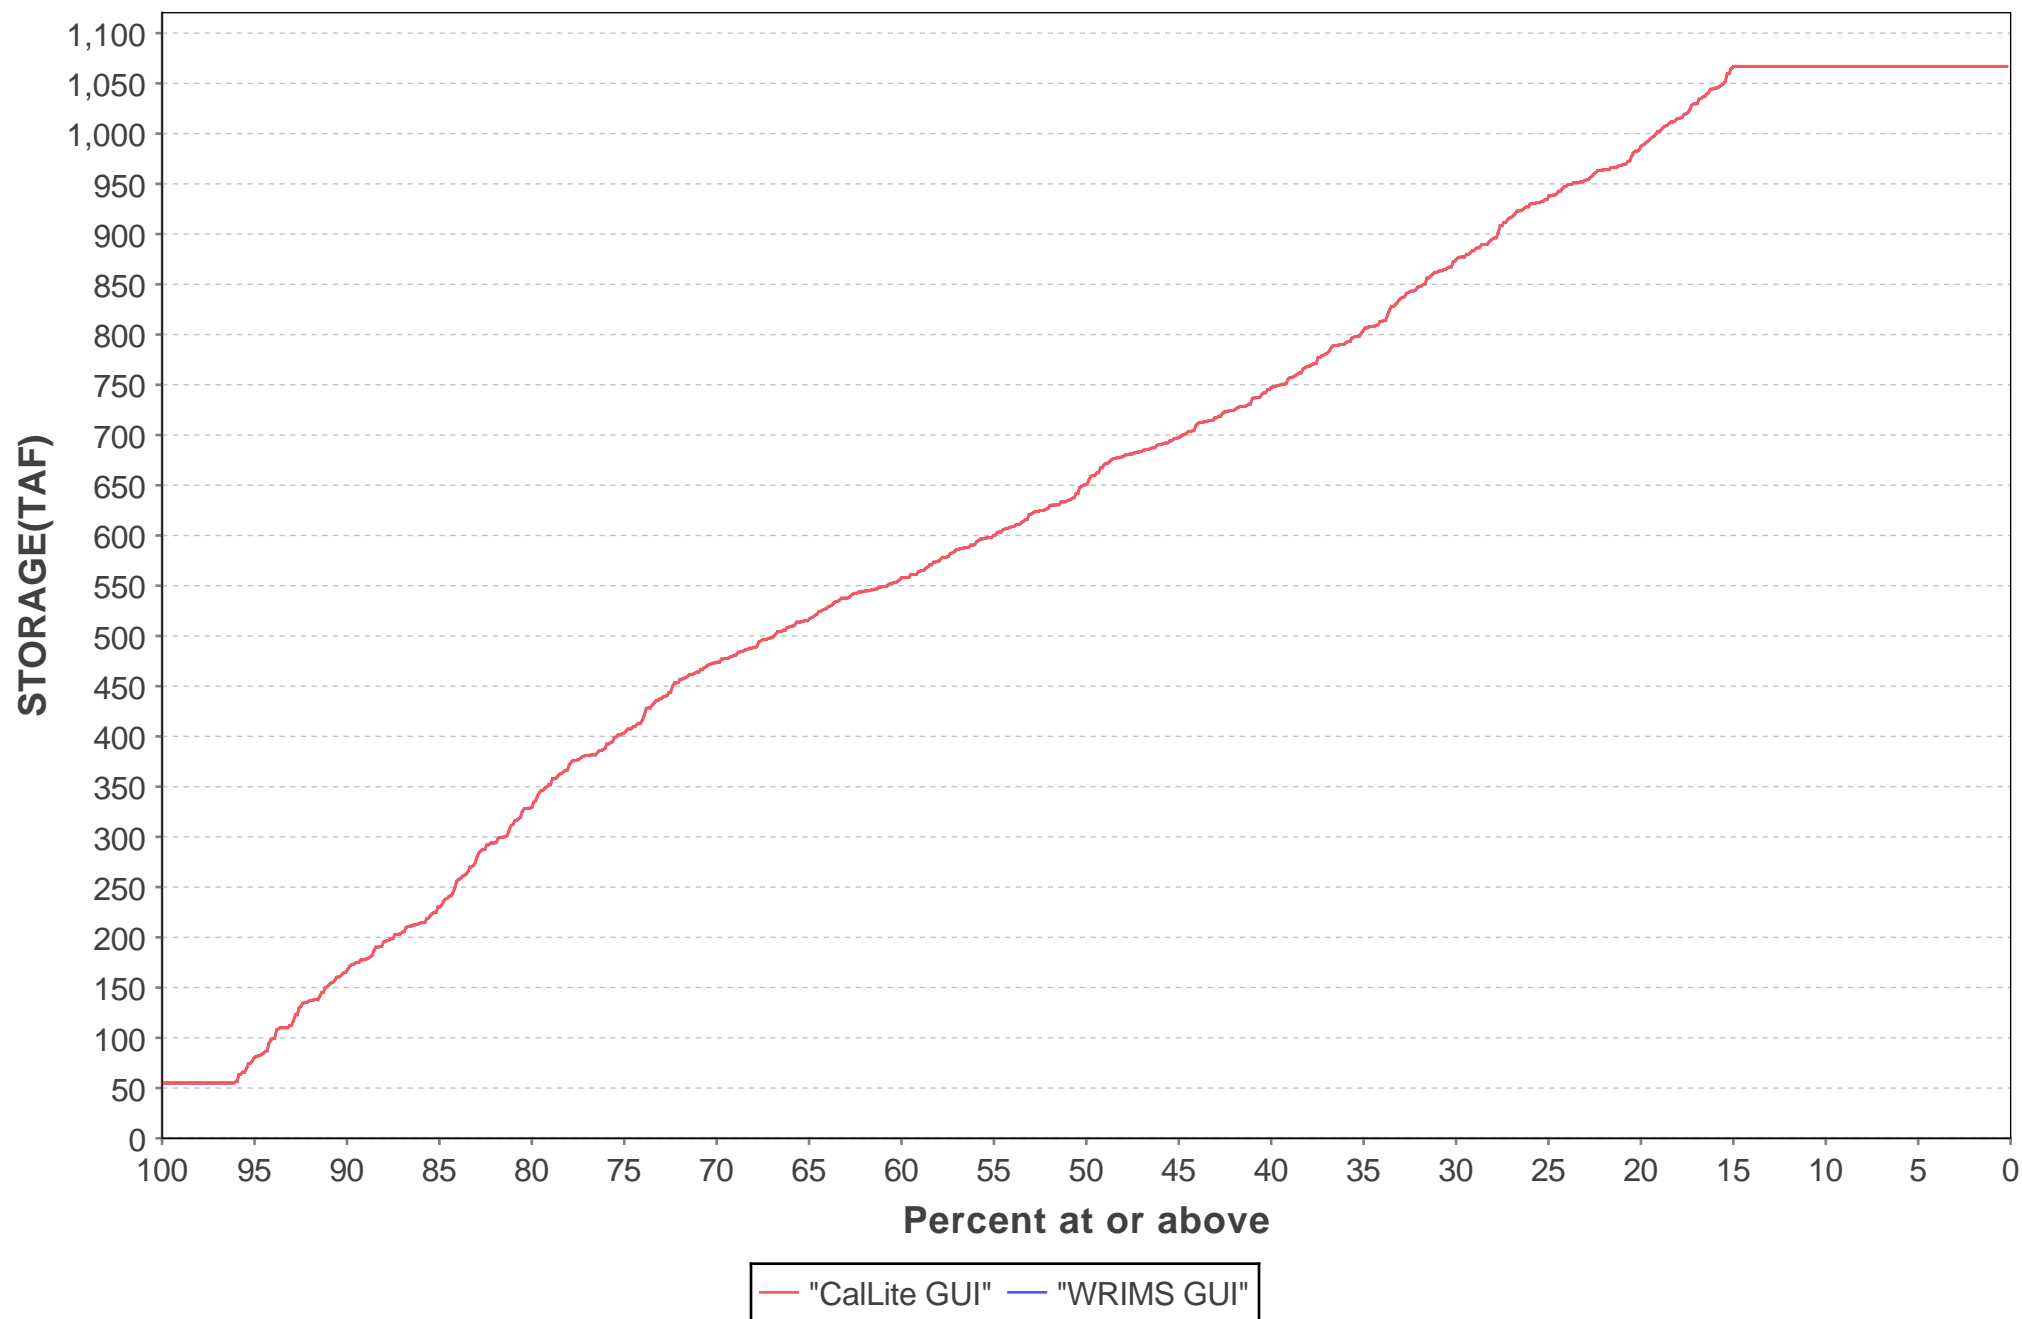


Average Sacramento R @ Keswick

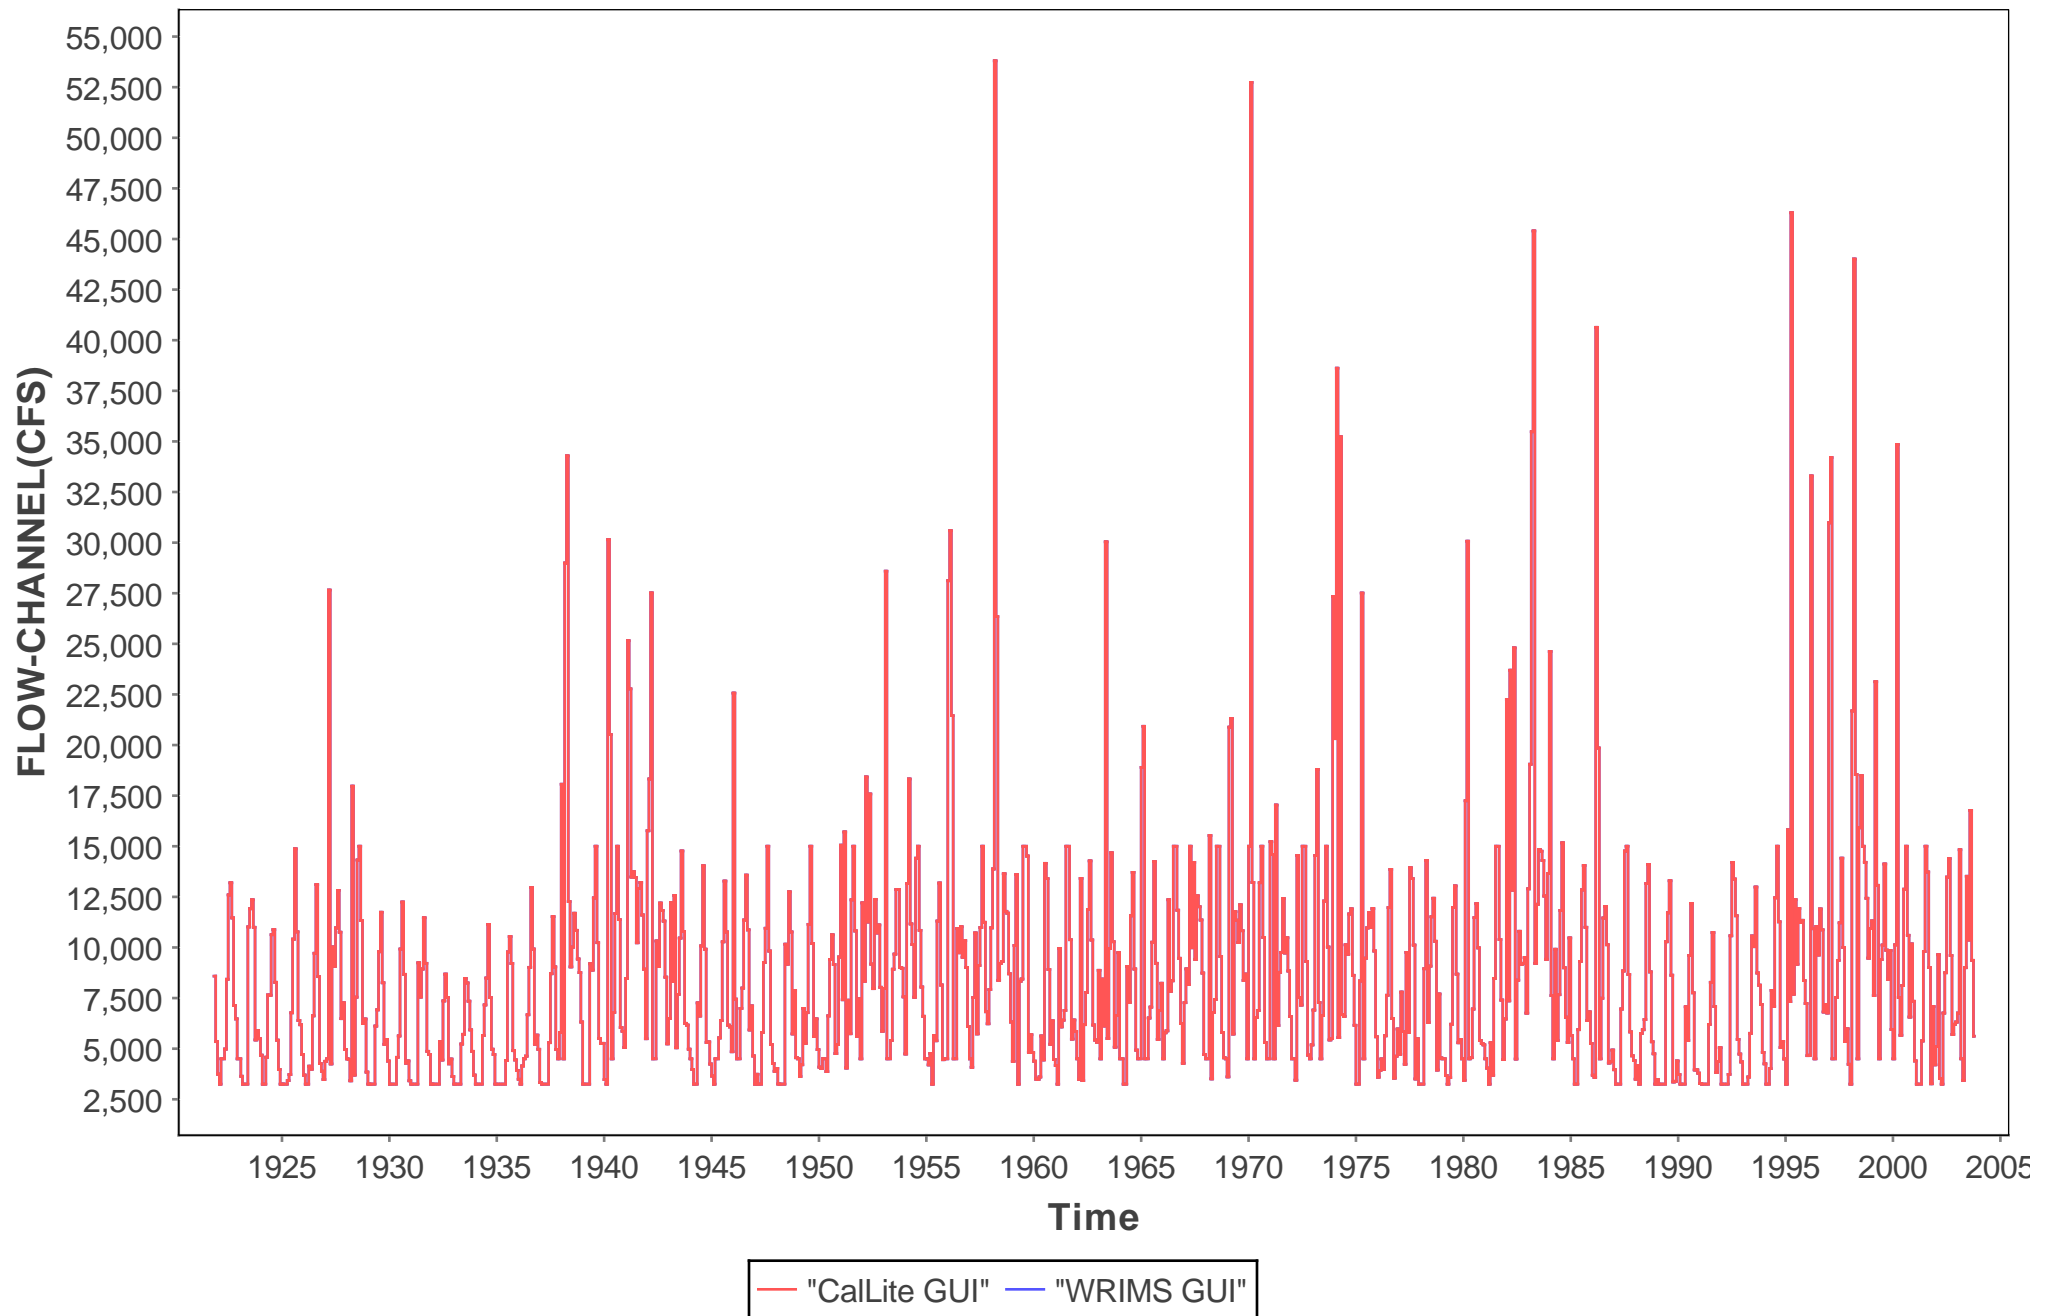


Average Delta Inflow

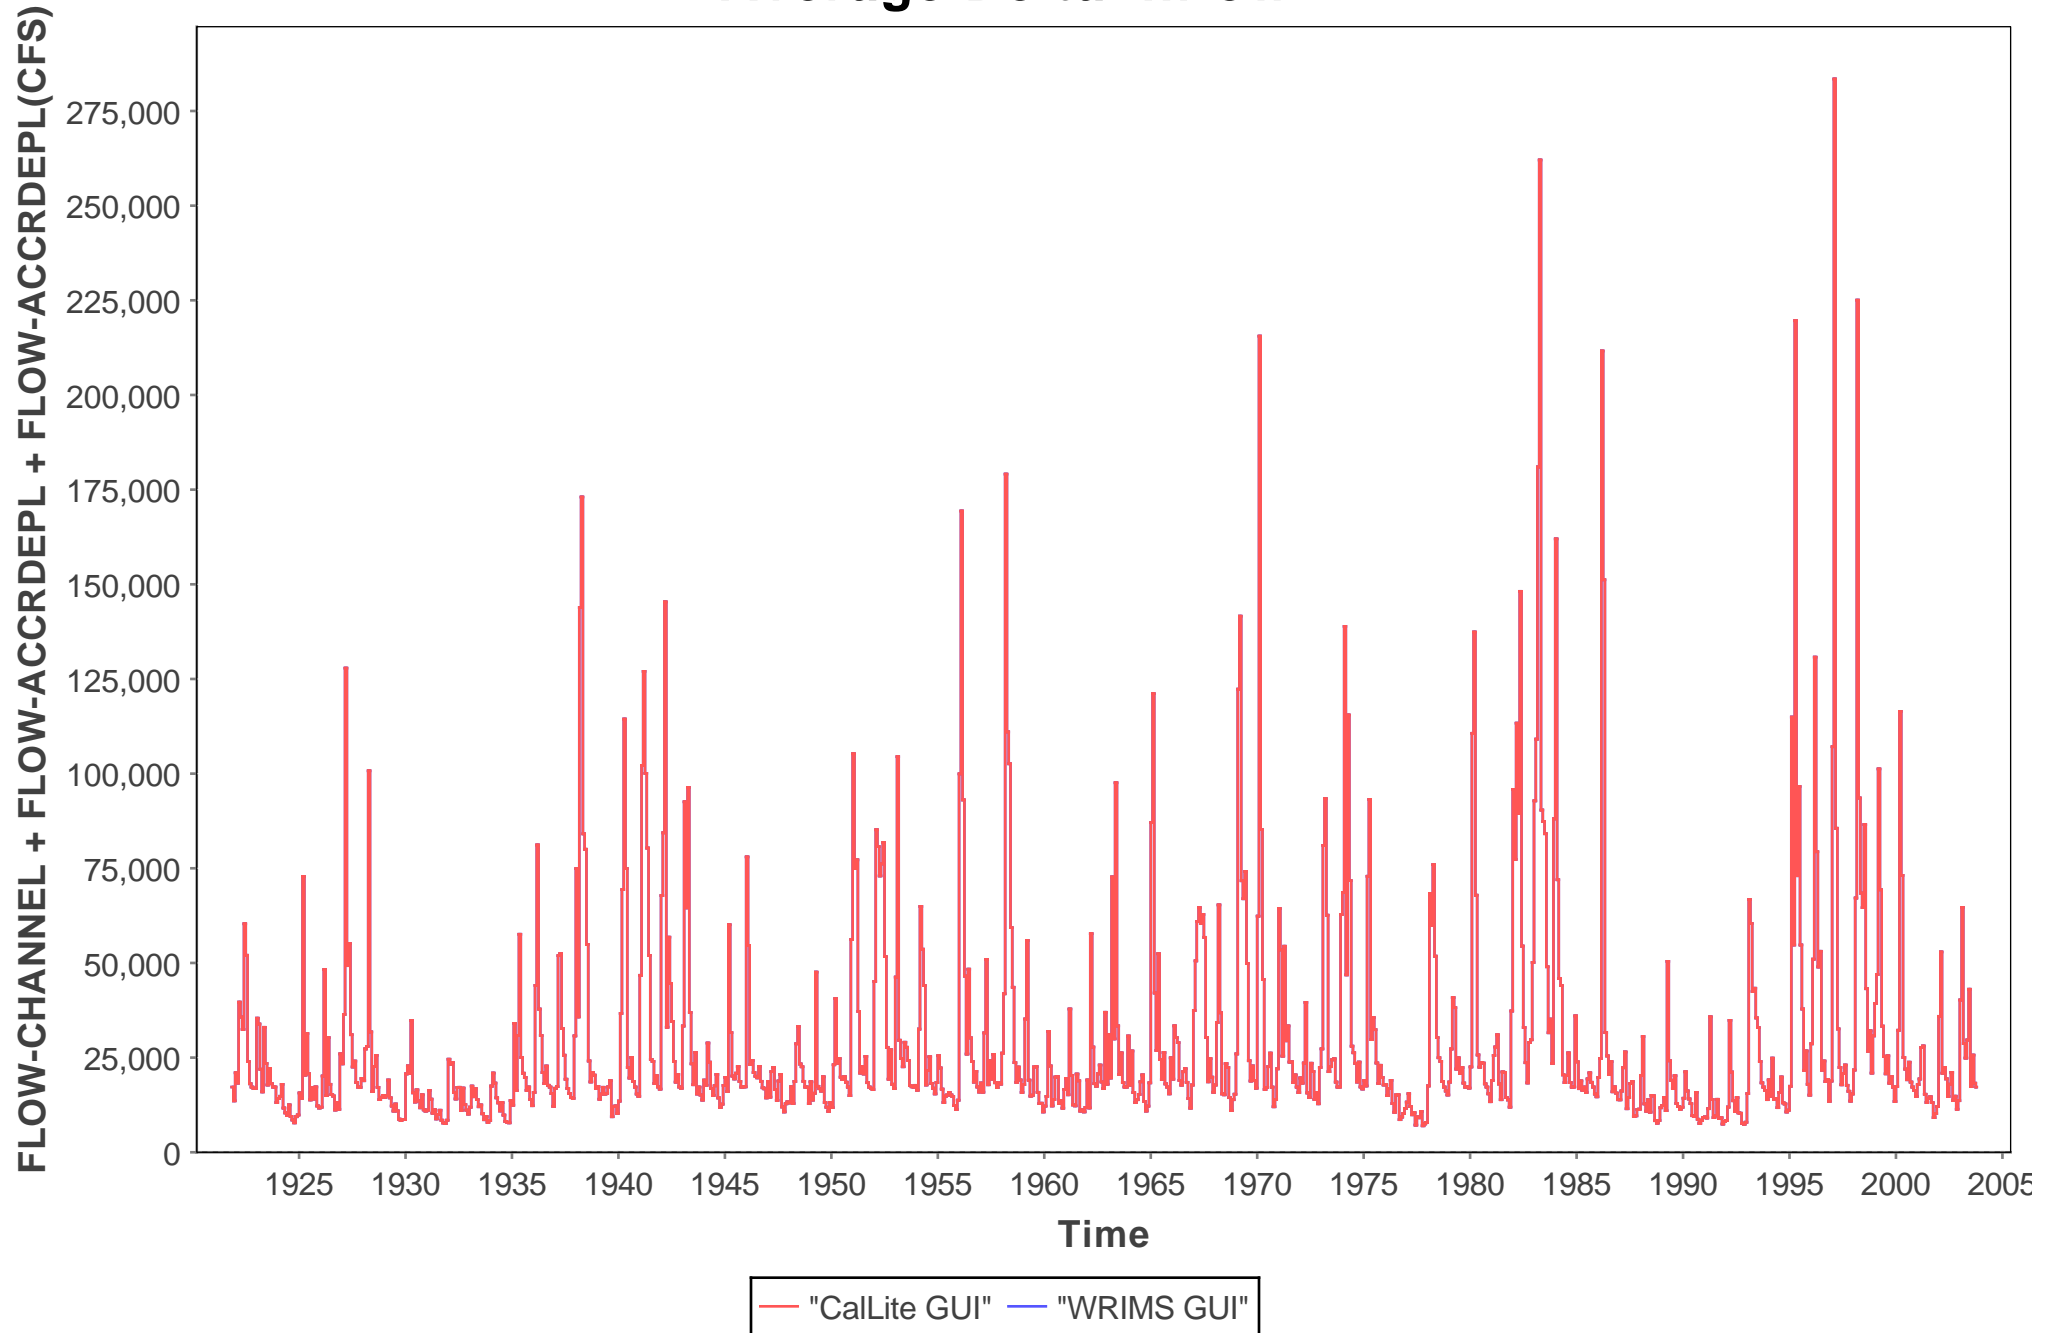


Average SWP SOD Deliveries

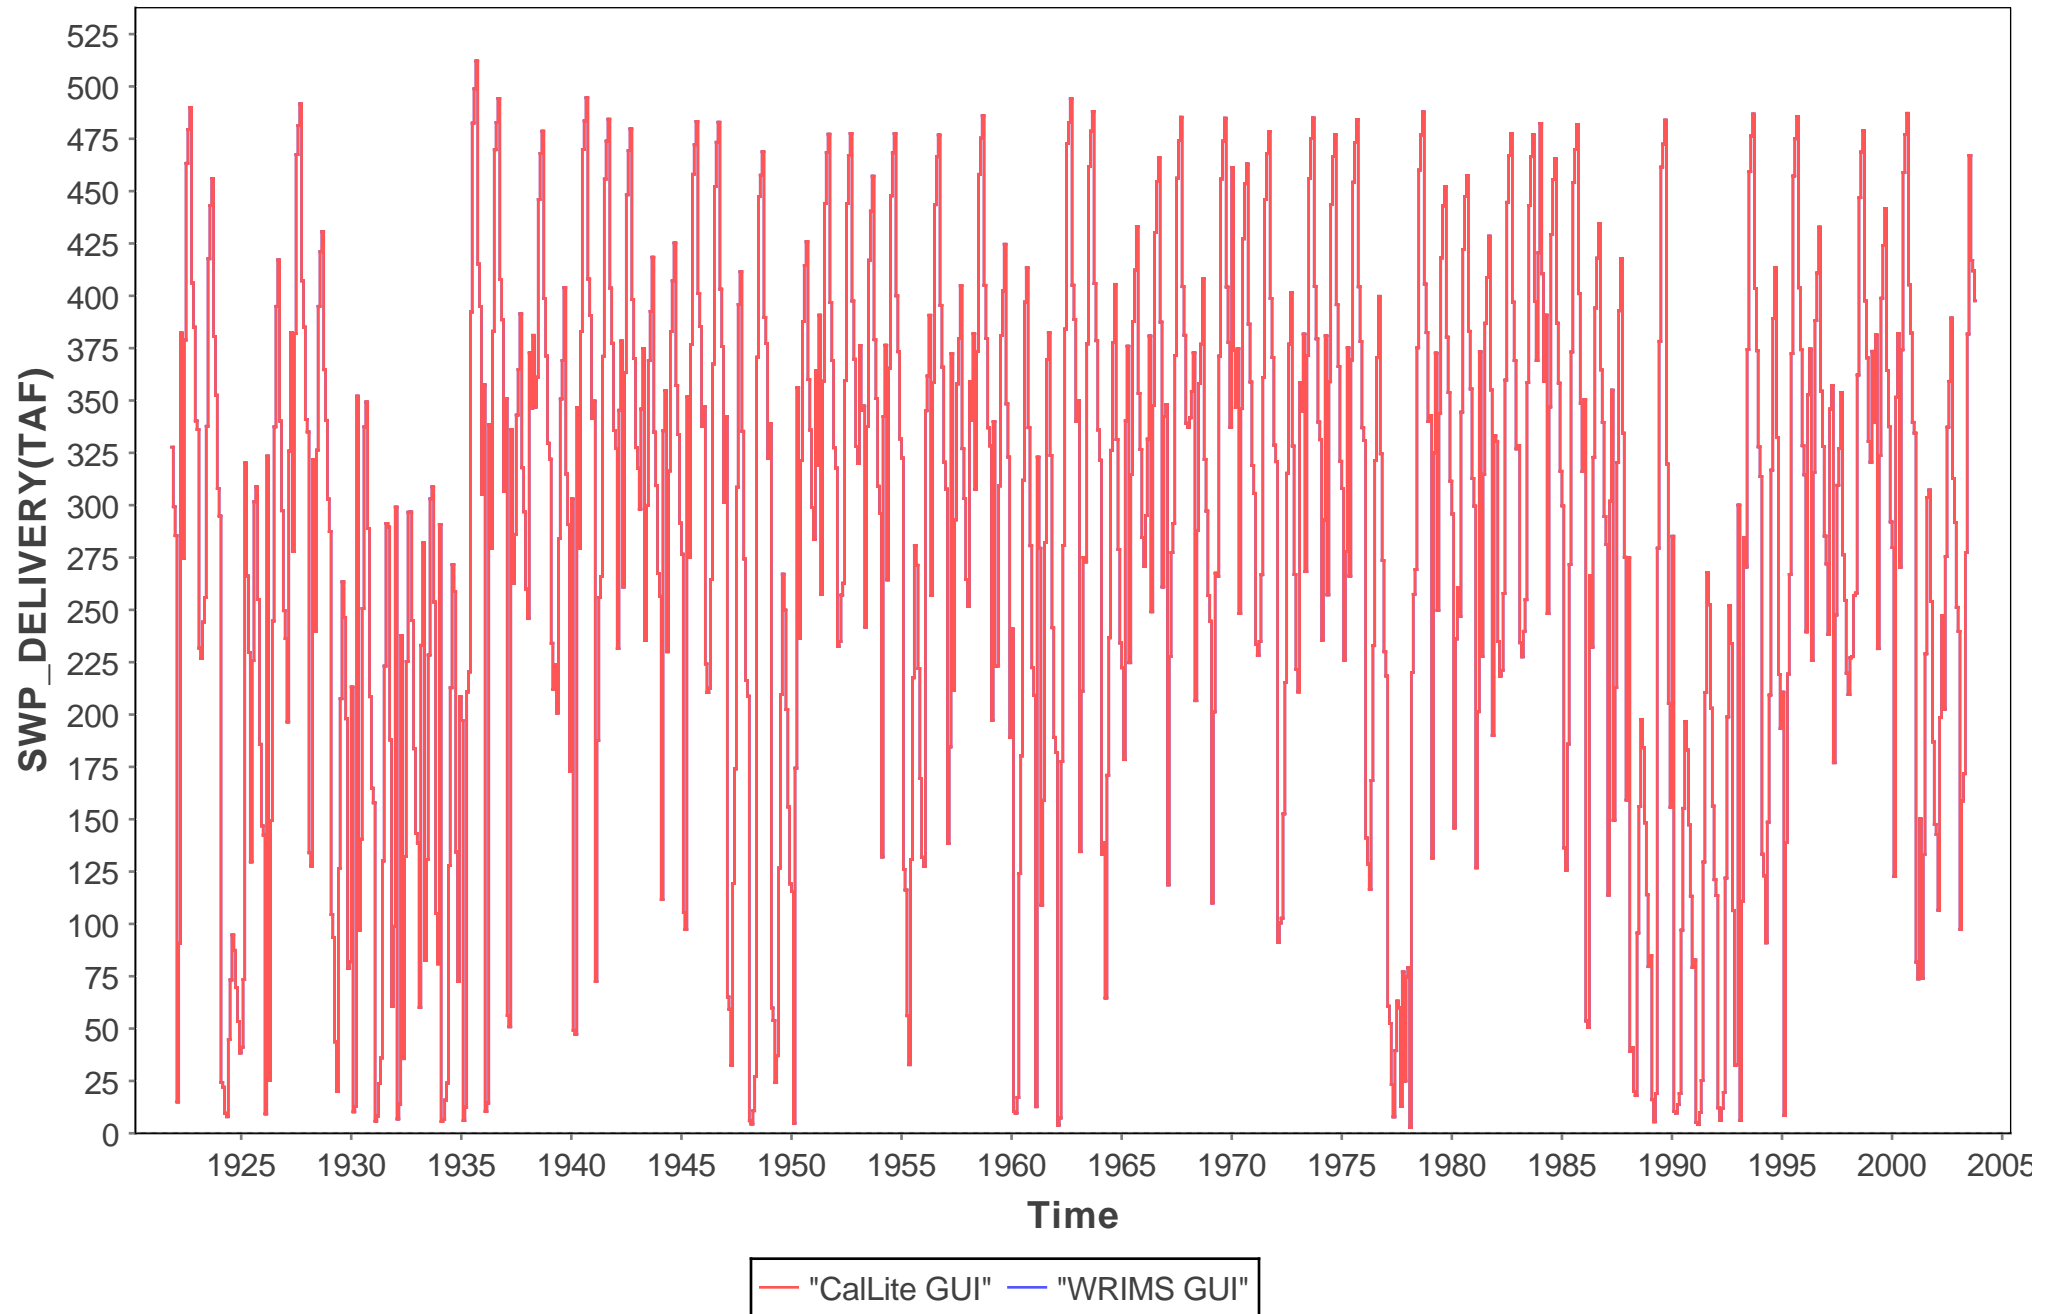


Exceedance SWP SOD Deliveries

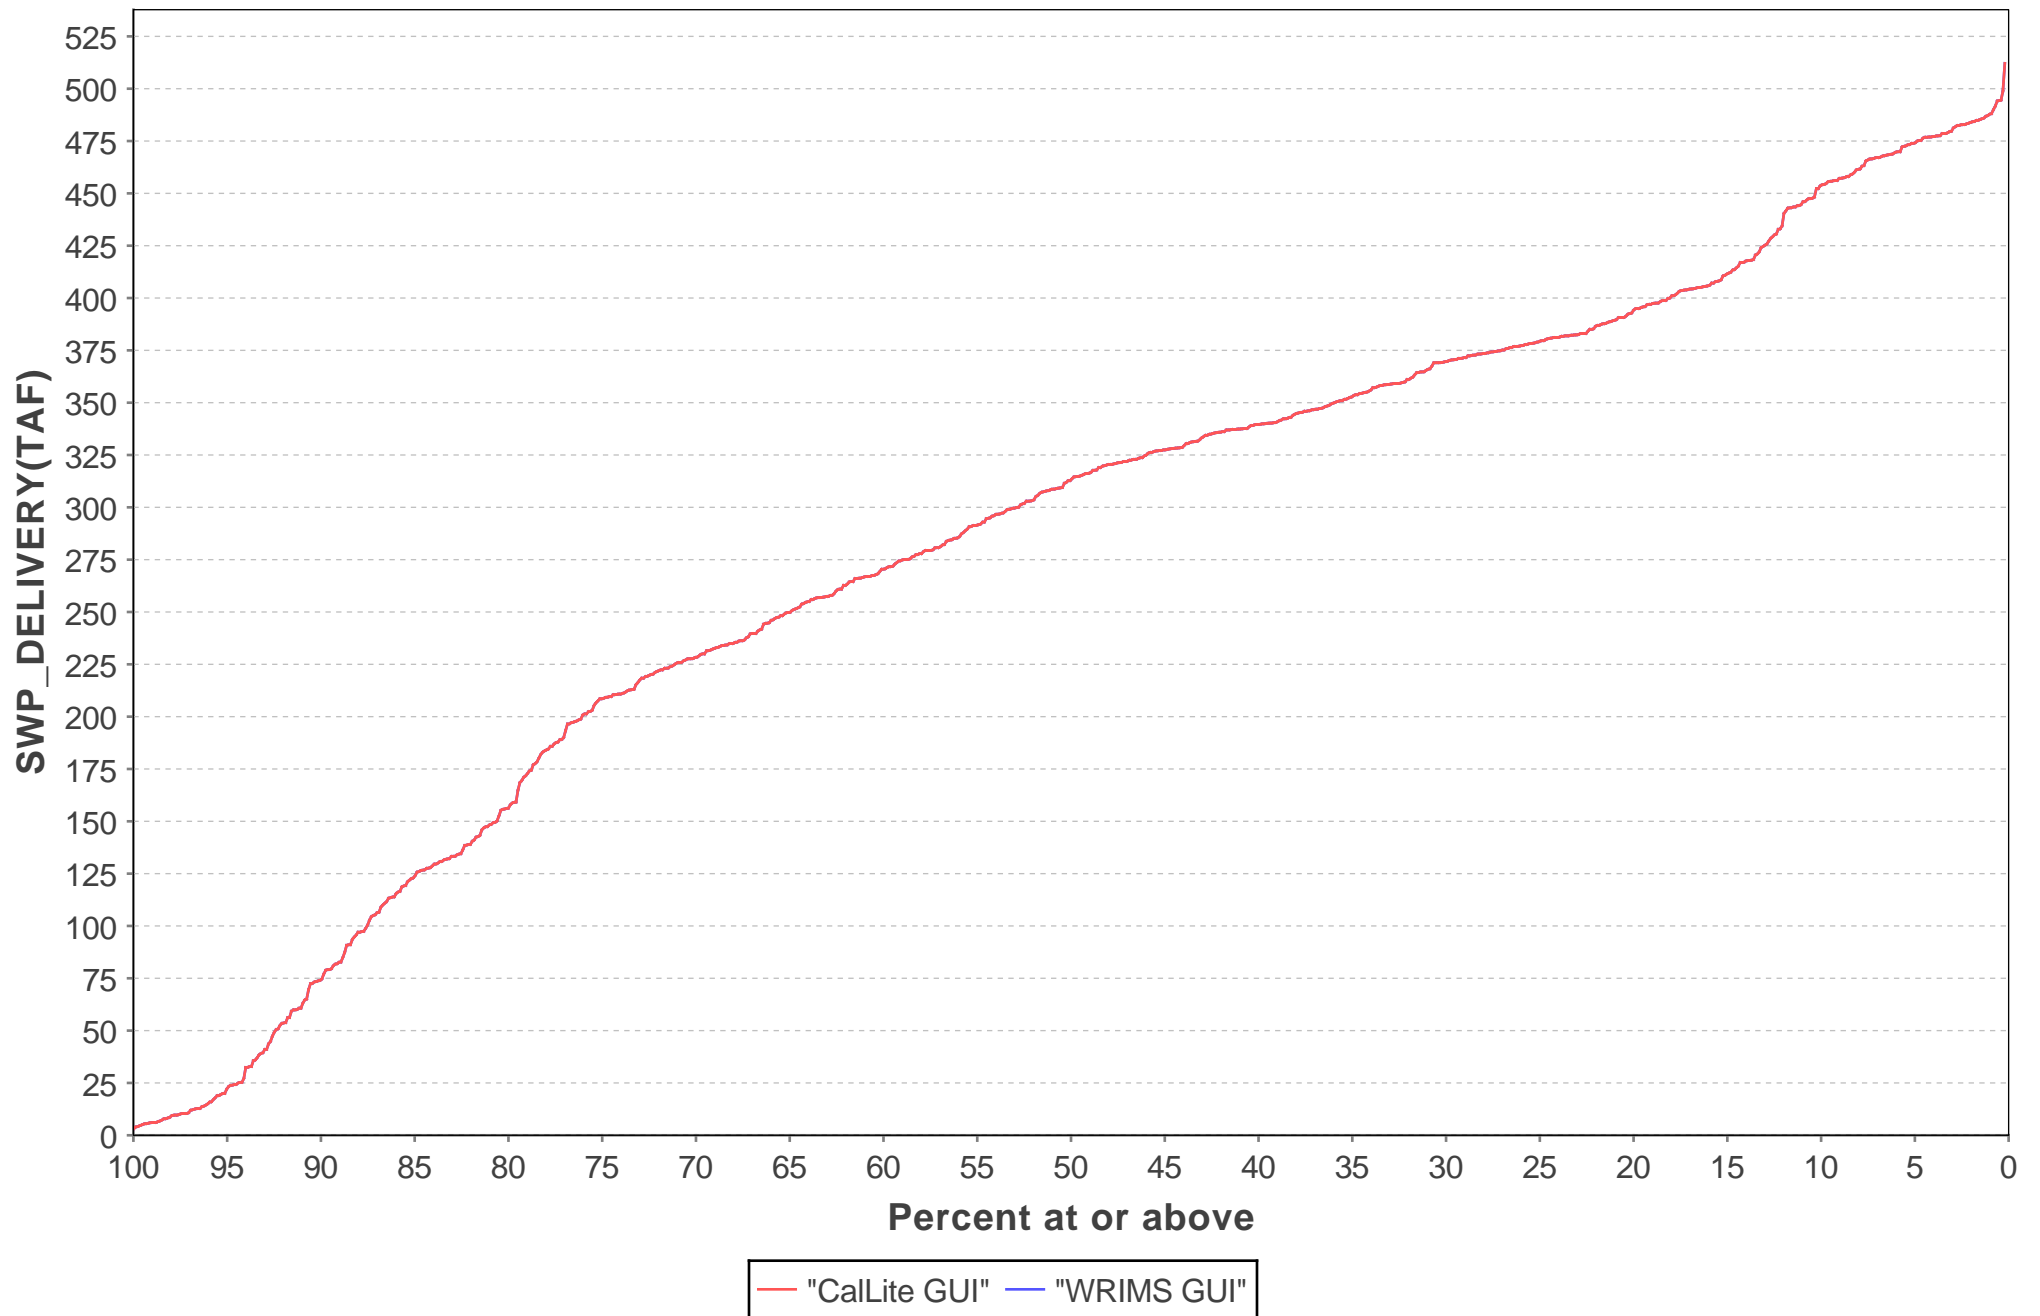


Average CVP SOD Deliveries

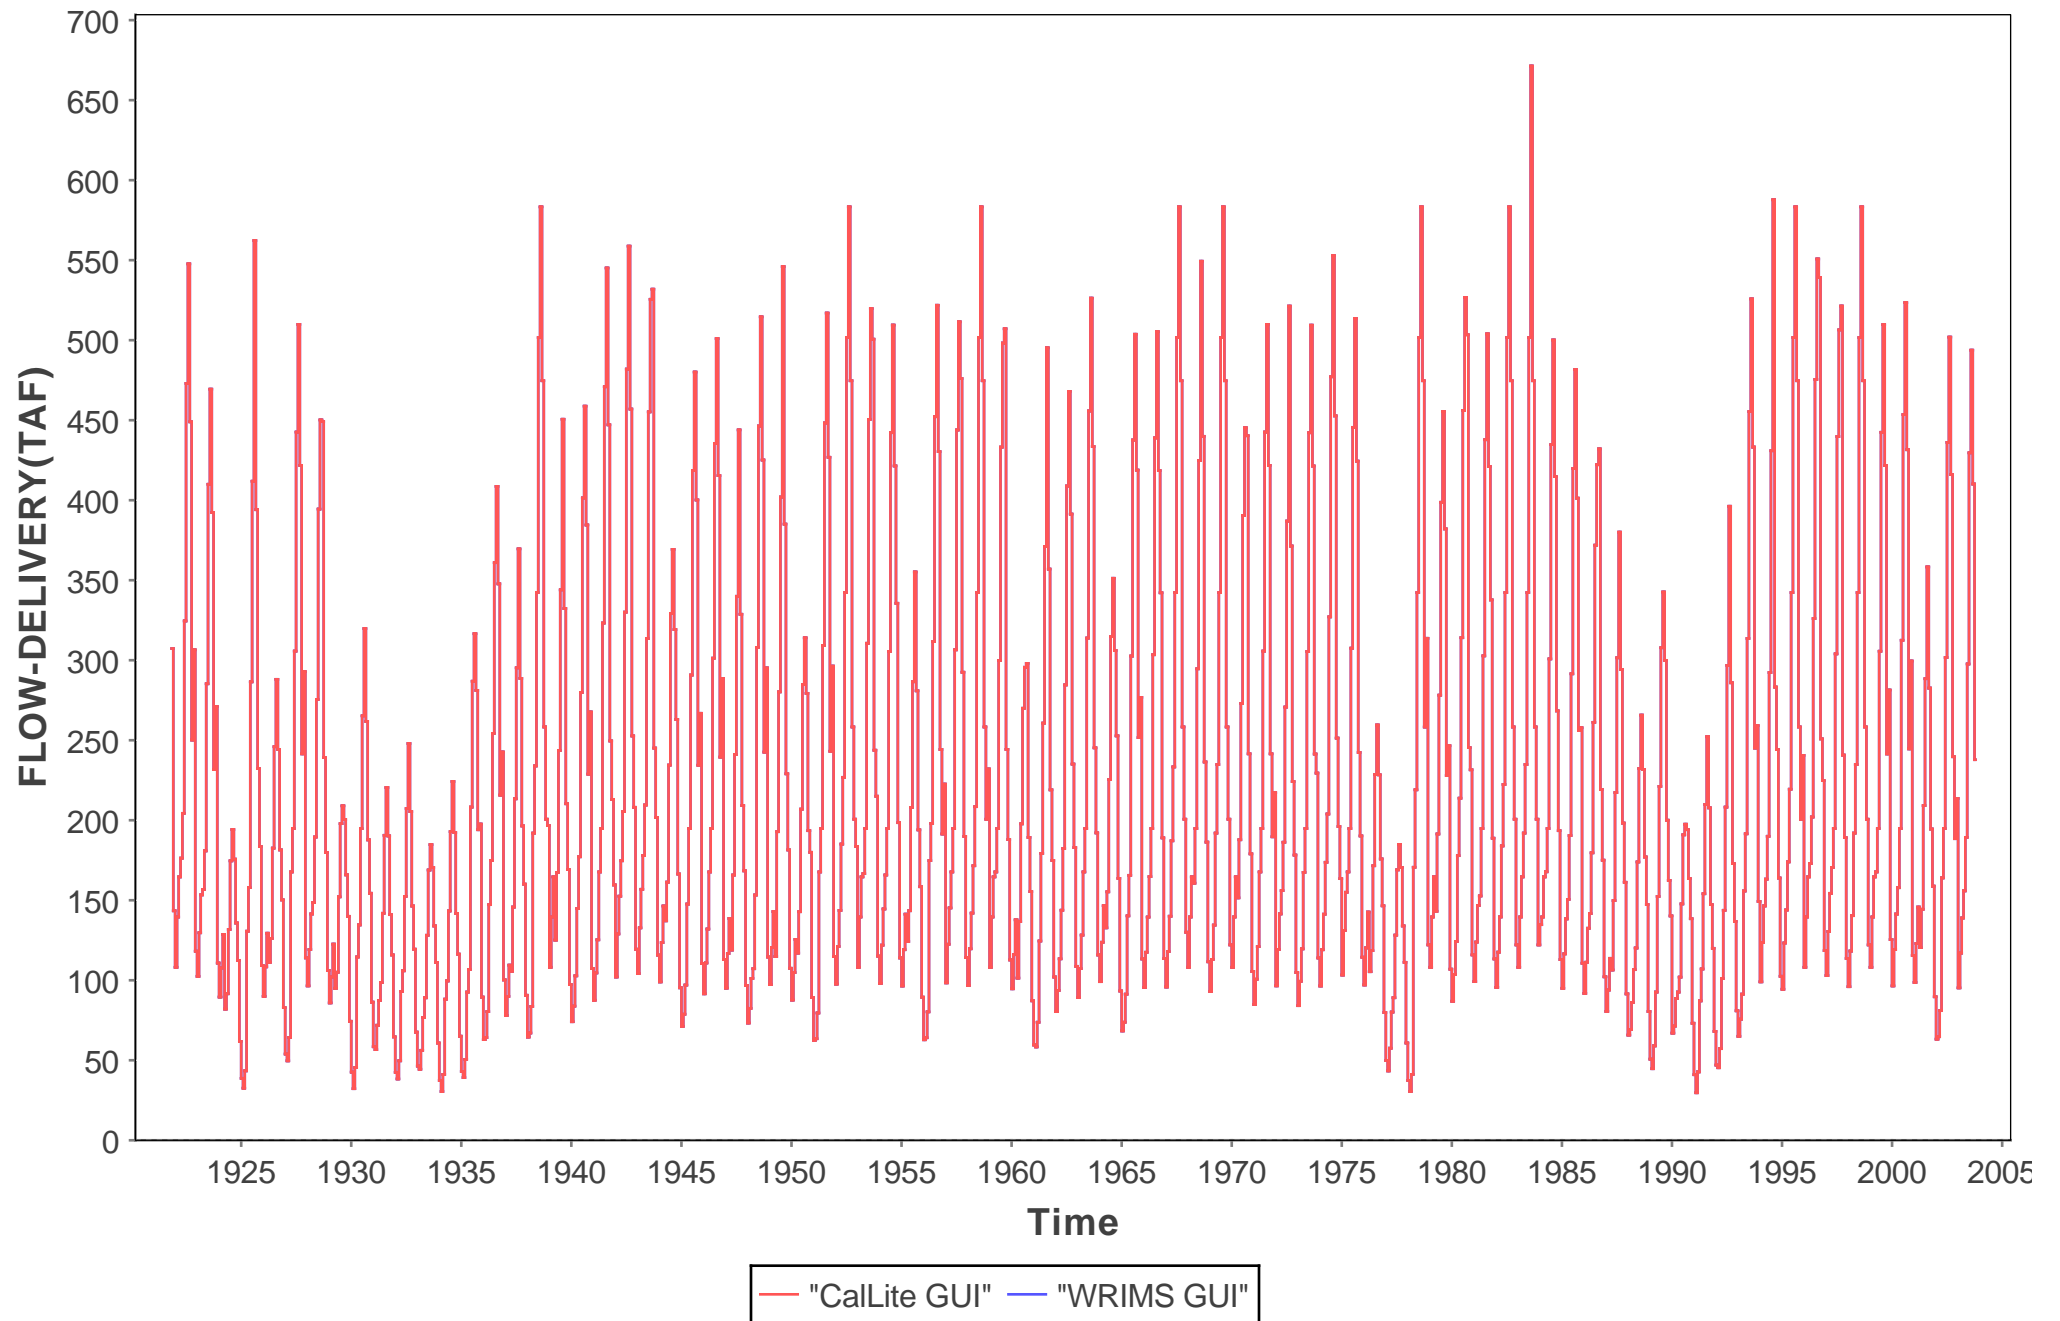


Exceedance CVP SOD Deliveries

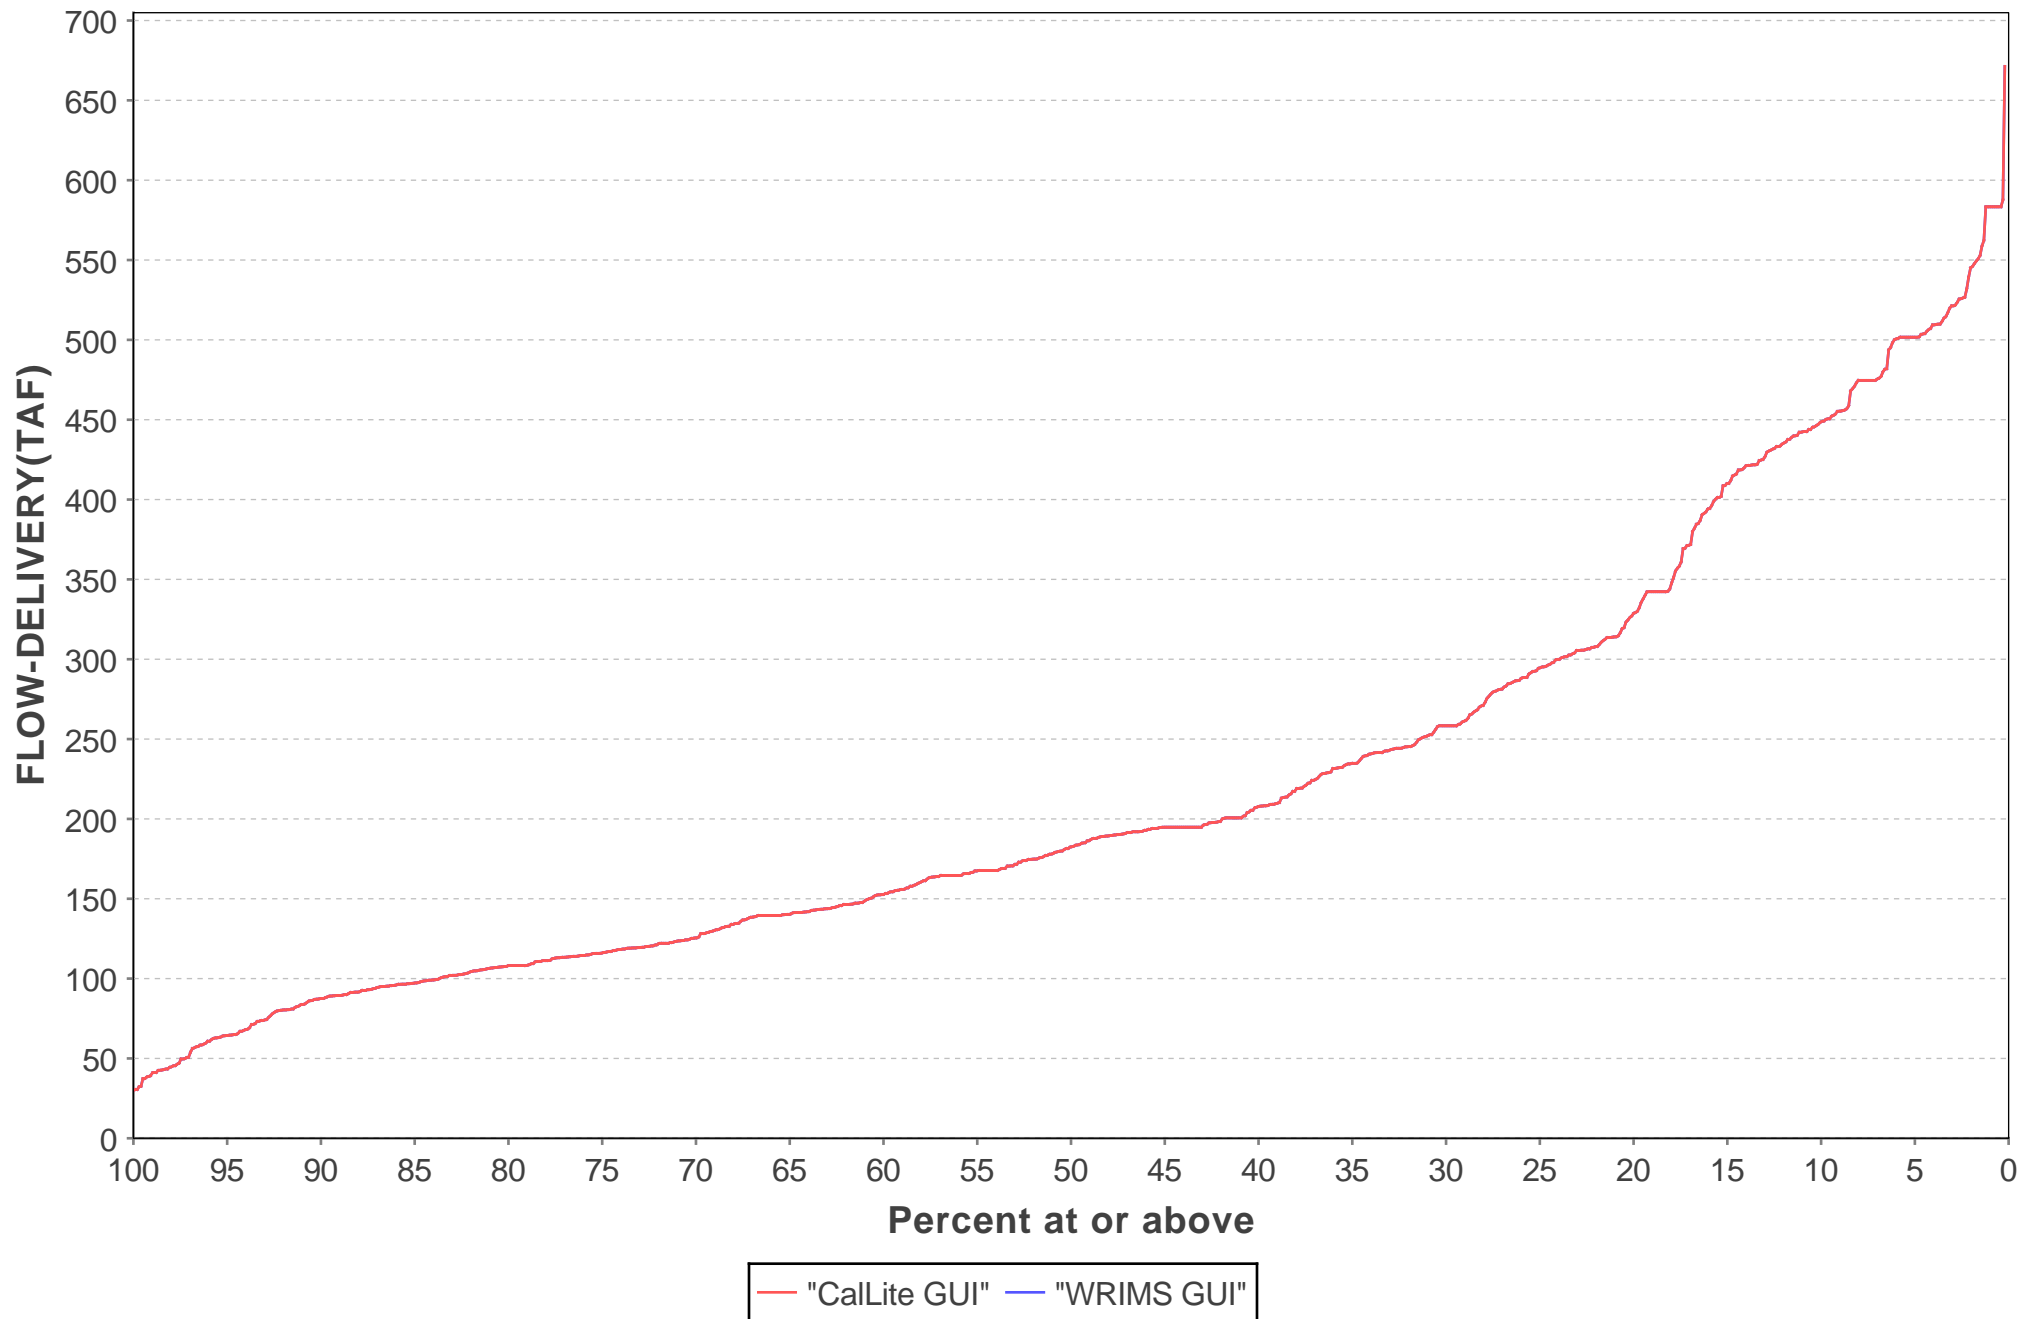


Exceedance SWP Table A Allocation

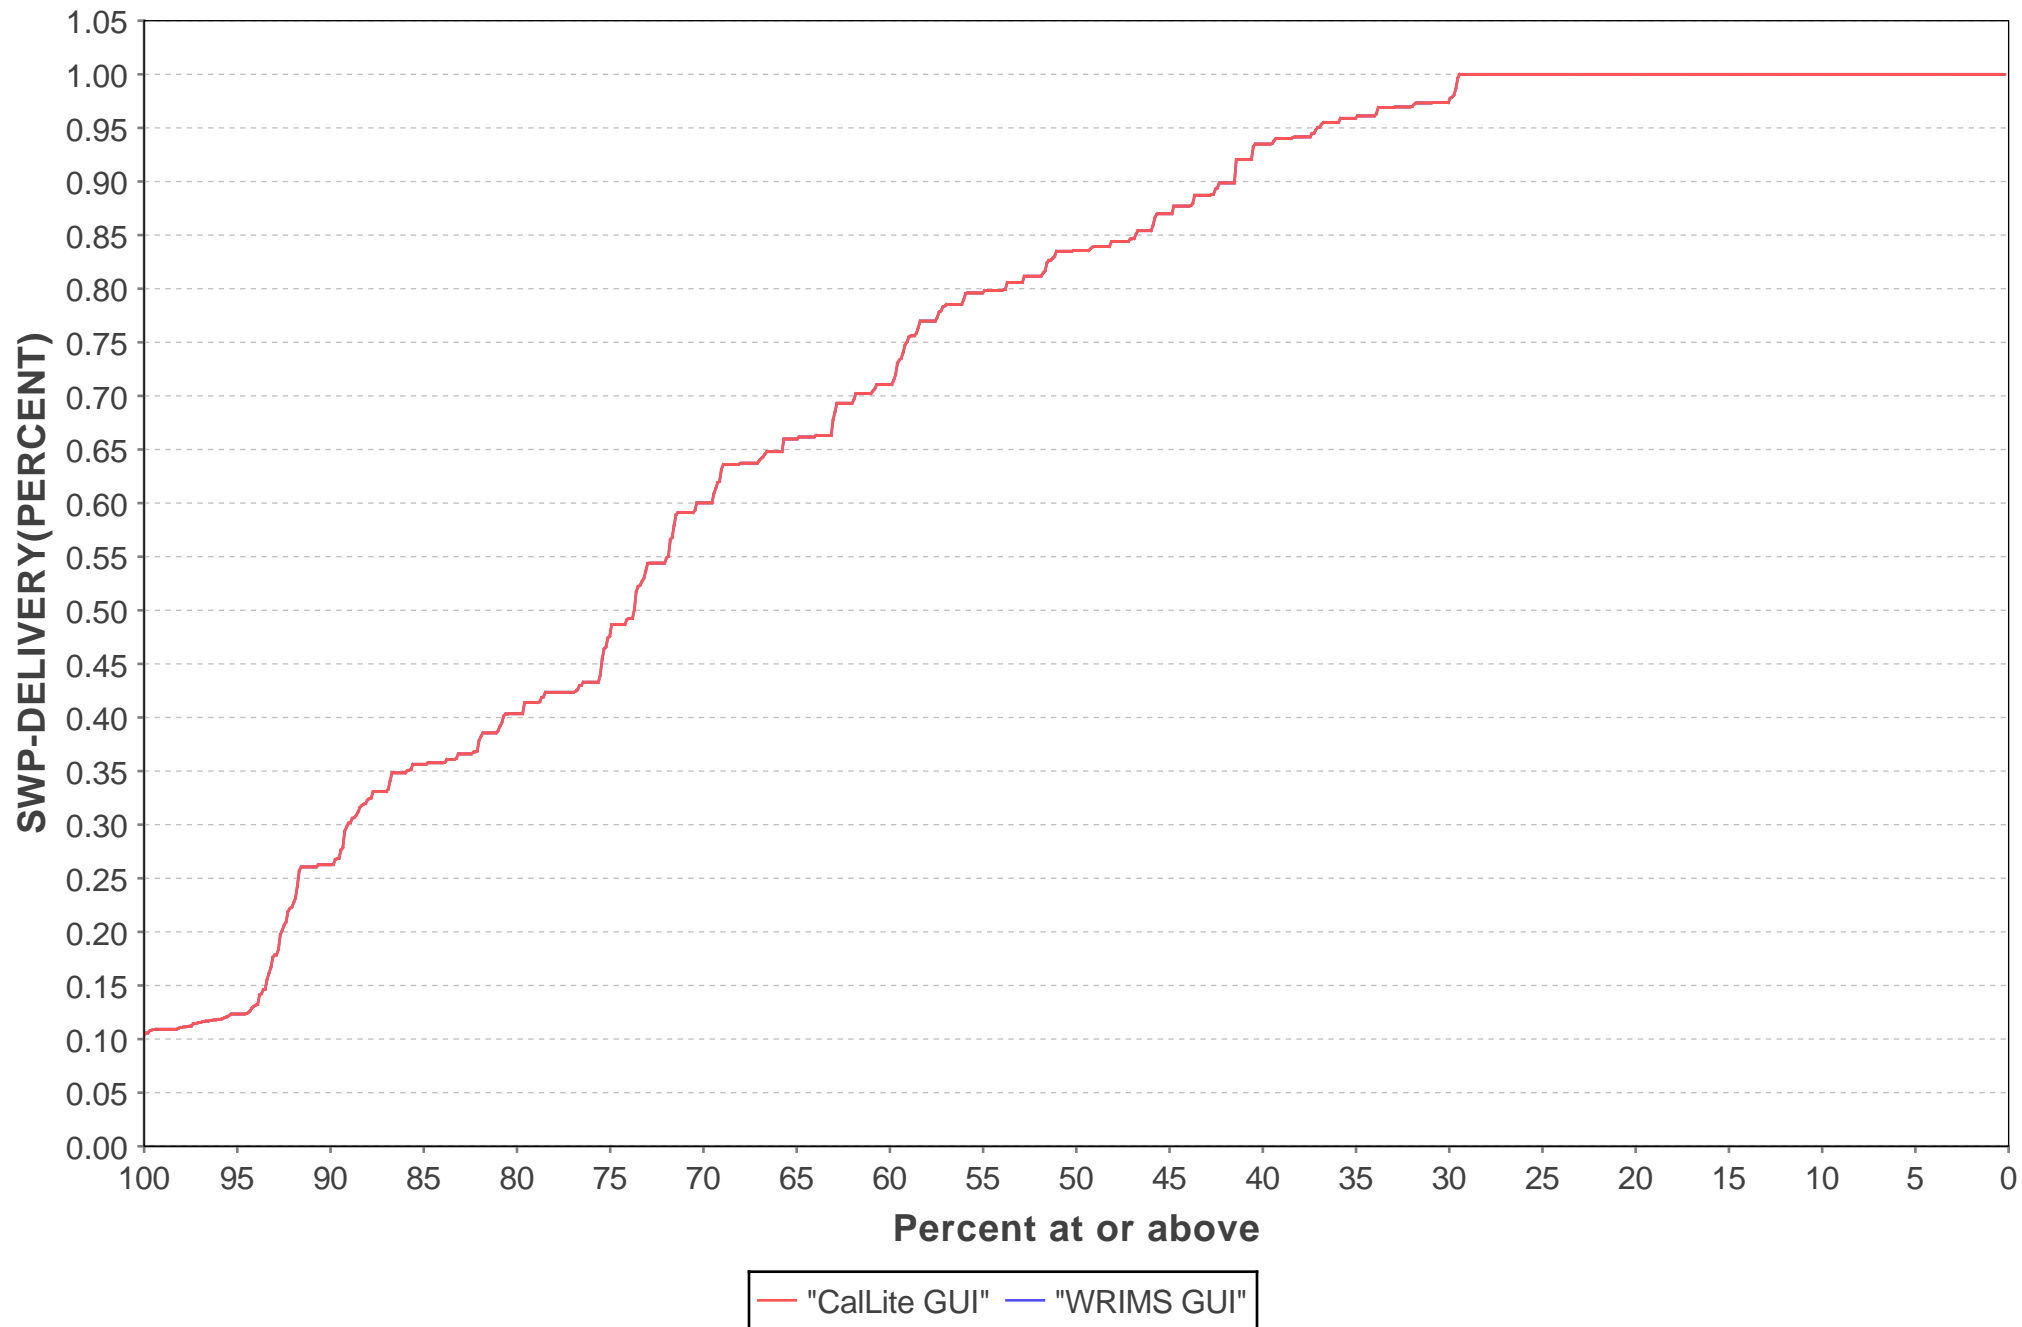

Exceedance CVP SOD AG Allocation

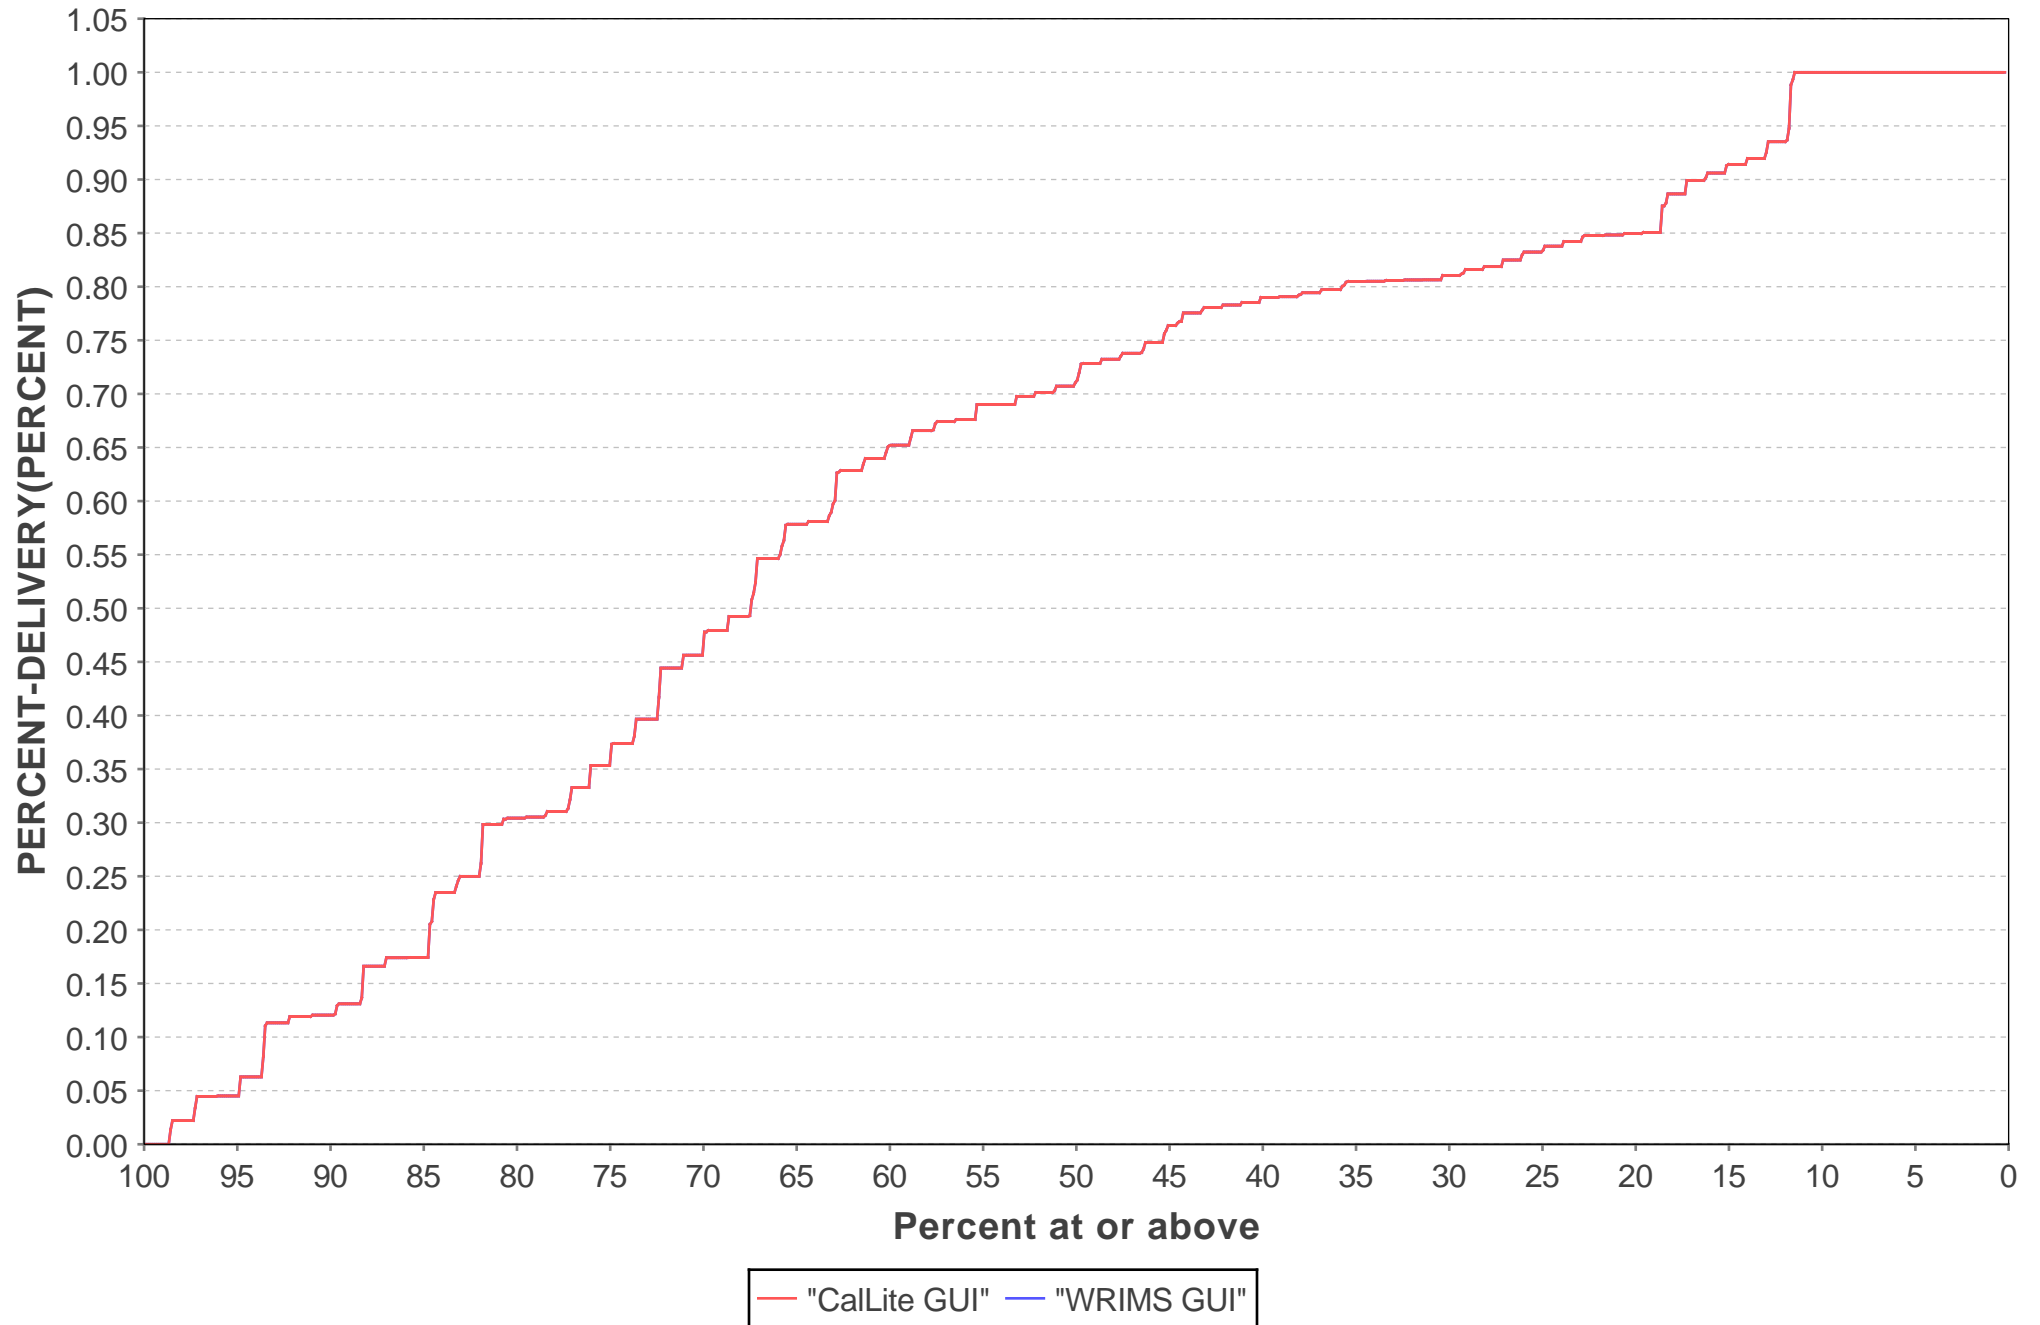

Average X2 Position

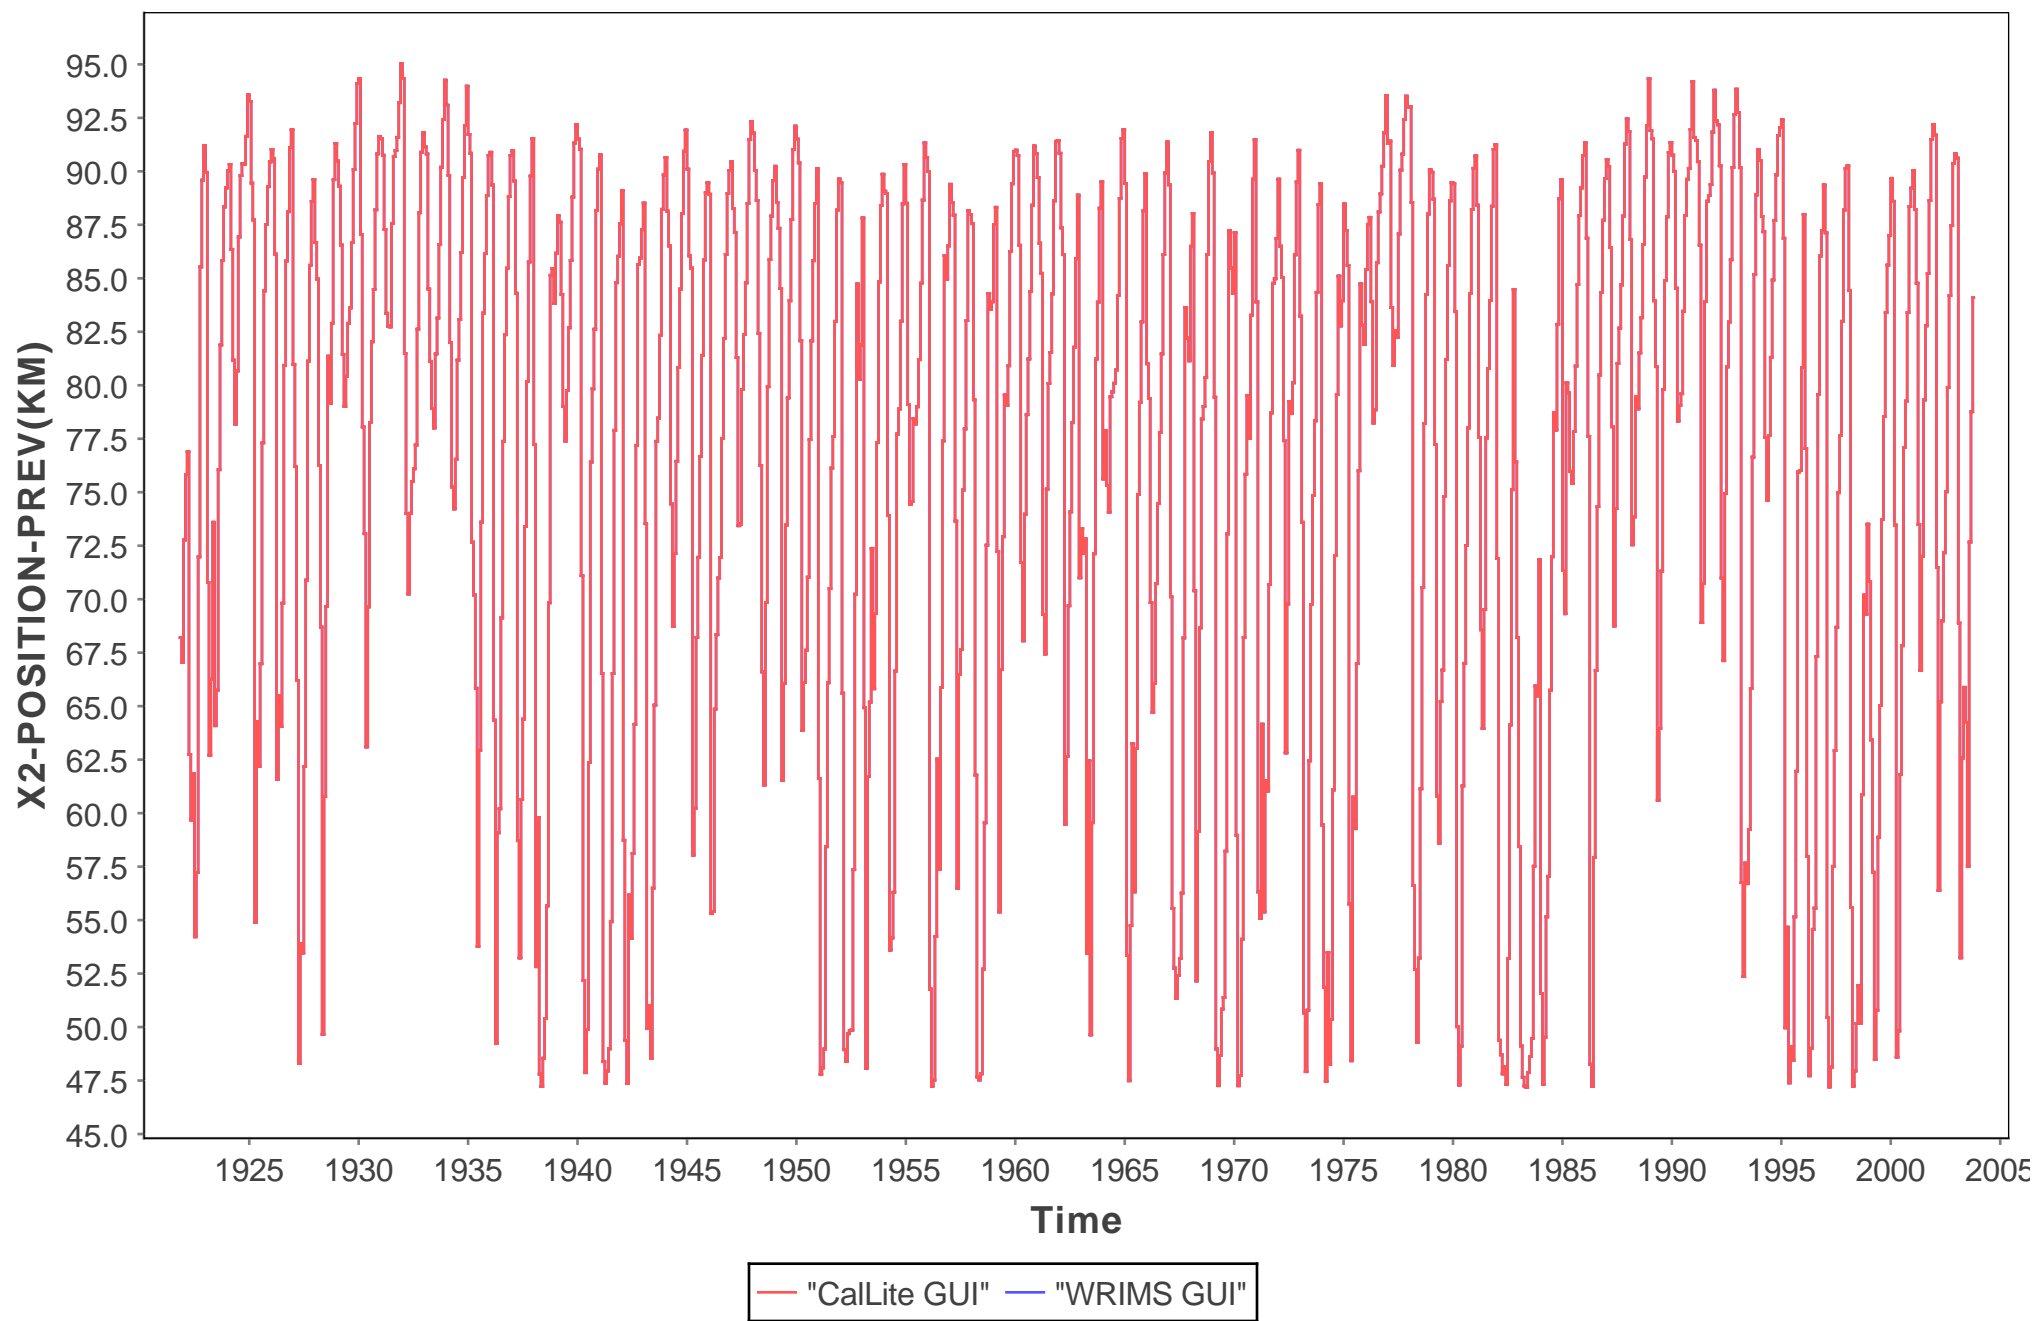

Average Rock Slough EC

