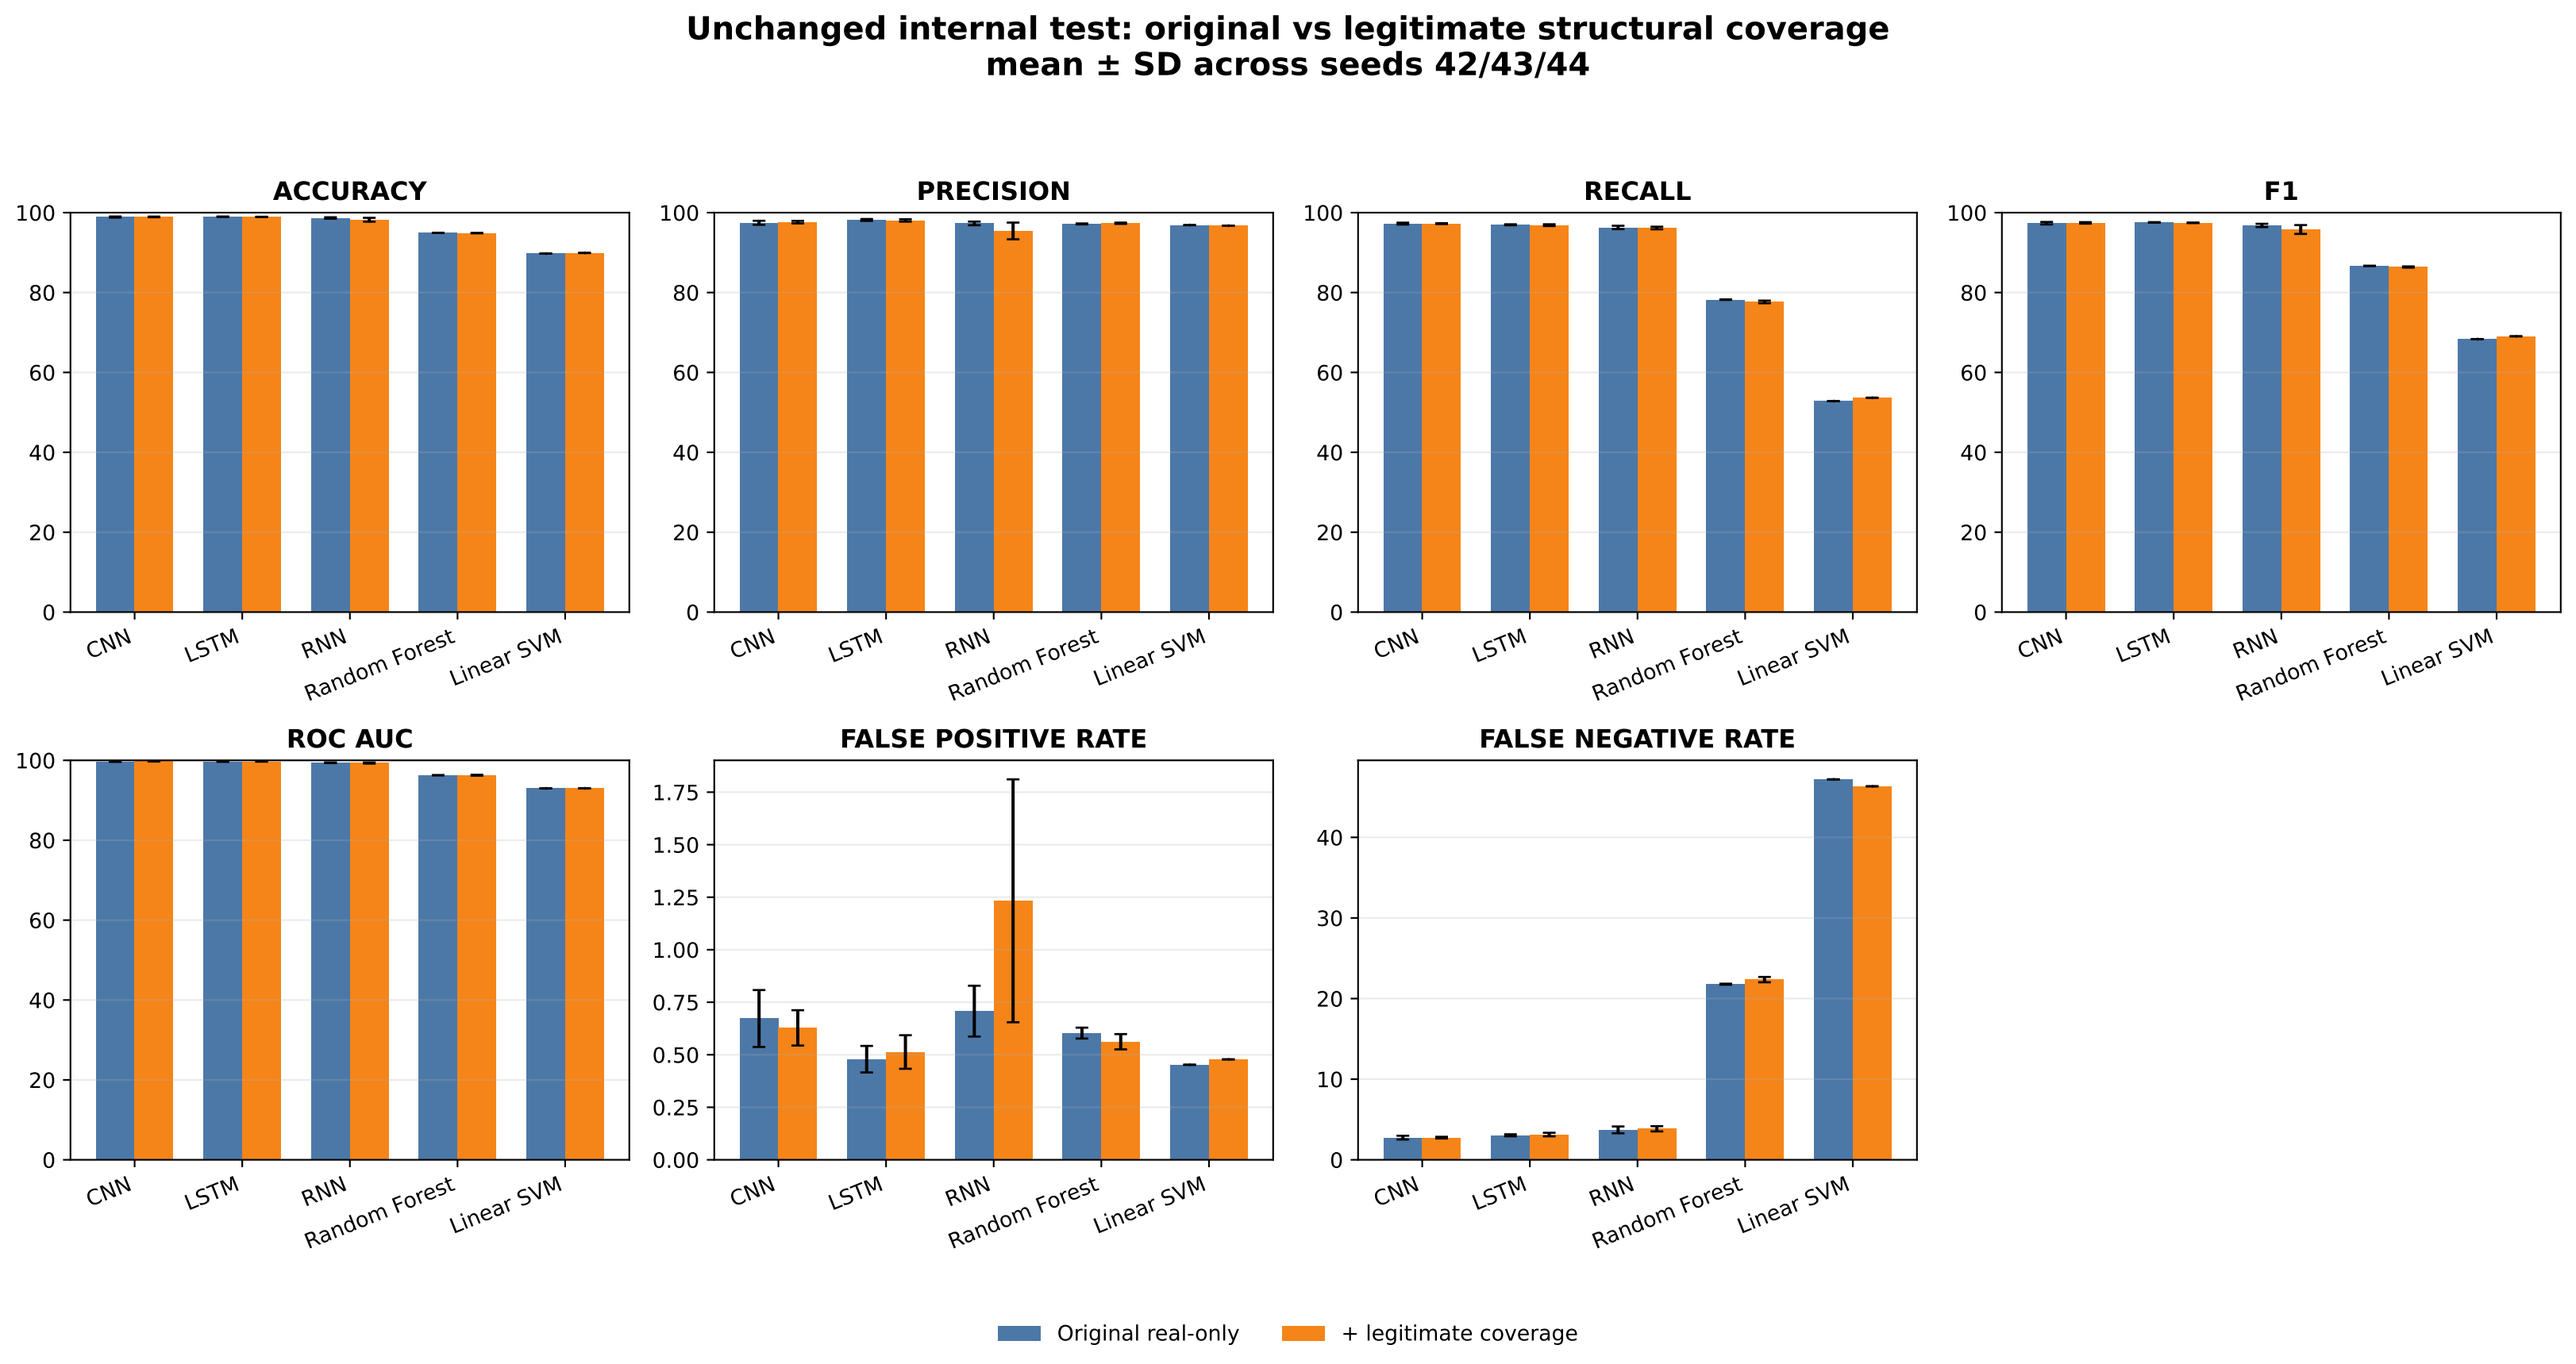
Unchanged internal test: original vs legitimate structural coverage
mean ± SD across seeds 42/43/44
ACCURACY
PRECISION
RECALL
F1
ROC AUC
FALSE POSITIVE RATE
FALSE NEGATIVE RATE
CNN
LSTM
RNN
Random Forest
Linear SVM
Original real-only
+ legitimate coverage