



EDENSPRITE GROUP LTD

Heating Performance Report

Heating Performance & Cost Insight Report

Client / Site	clients2.torry@yandiyatechnologies.com
Site Code	clients2.torry@yandiyatechnologies.com
Reporting Period	01 Feb 2026, 00:00 to 02 Feb 2026, 23:59
Tariff Used	£0.2700 / kWh
Generated	25 Mar 2026, 12:08

Prepared by Edensprite Group Ltd



Heating Performance Report

Generated: 25 Mar 2026, 12:08

Client / Site: clients2.torry@yandiyatechnologies.com

Site Code: clients2.torry@yandiyatechnologies.com

Account Email: -

Period: 01 Feb 2026, 00:00 to 02 Feb 2026, 23:59

Tariff: £0.2700 / kWh

Executive Summary

Key site-wide figures and issues identified during the selected reporting period.

Devices Analysed

116

Total Runtime

1042h 33m 24s

Total Estimated Cost

£281.49

Total Estimated kWh

1042.56

Average Runtime / Device

8.99 hrs

Average Temperature

21.25°C

Key Findings

- RM15 STAT was the highest-cost room in this reporting period at £12.82.
- RM15 STAT recorded the longest runtime at 47.48 hours.
- 17 devices showed no heating activity and should be reviewed if usage was expected.

Site-wide KPIs

Performance

Total State Changes	4669
Total Observed Hours	5223.69
Total Unknown Hours	157.74
Overall ON %	19.96%
Overall OFF %	77.02%
Overall UNKNOWN %	3.02%
Average Cost / Device	£2.43

Highlights


Highest Cost Room	RM15 STAT
Highest Cost Value	£12.82
Longest Runtime Room	RM15 STAT
Longest Runtime Value	47.48 hrs
Coldest Average Room	RM15 STAT
Coldest Average Temp	18.27°C
Hottest Average Room	Assister Shower T-FF-BR Stat
Hottest Average Temp	23.53°C

Graphical Overview

Top Heating Cost by Room

This chart shows the rooms or devices with the highest estimated heating cost during the selected reporting period.

Longer bars indicate higher estimated cost. The highest-cost rooms should normally be reviewed first when looking for savings opportunities.

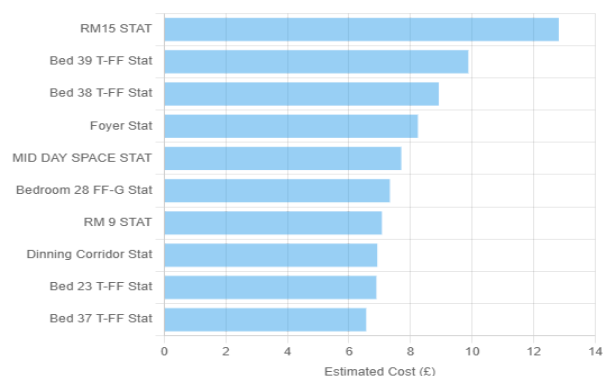


Takeaway: RM15 STAT, Bed 39 T-FF Stat, Bed 38 T-FF Stat were the main heating cost drivers in this period.

Longest Runtime by Room

This chart shows which rooms or devices were calling for heat for the longest amount of time.

Longer runtime can indicate high demand, long schedules, poor heat retention, or inefficient operation.

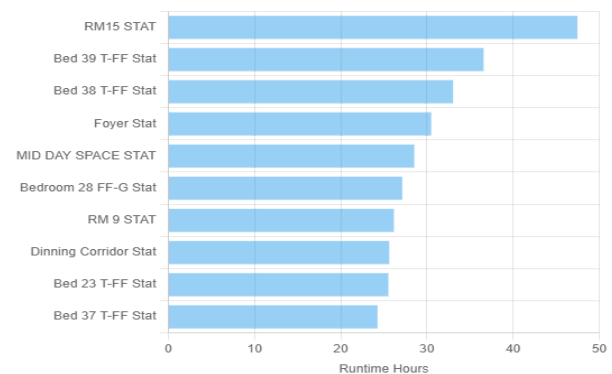


Takeaway: RM15 STAT recorded the longest runtime at 47.48 hours.

Average Temperature by Room

This chart compares the average recorded temperature across rooms or devices during the reporting period.

Higher temperatures are not always better. Rooms that are both warm and heavily used may be using more heat than necessary, while cool rooms with high runtime may deserve investigation.

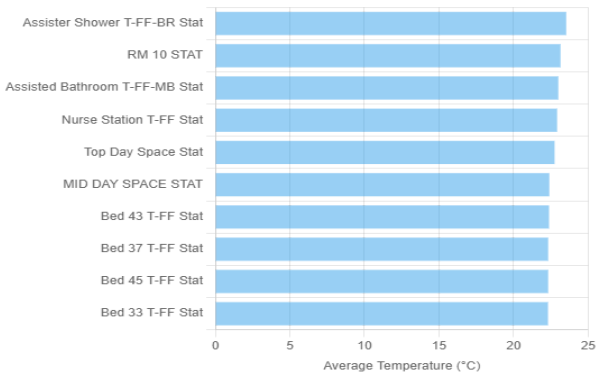


Takeaway: Assister Shower T-FF-BR Stat was the warmest average room at 23.53°C, while RM15 STAT was the coolest at 18.27°C.

Device Status Overview

This chart shows how many devices fall into each automatically assigned status group.

This gives a quick overview of system health. Devices marked as High usage, Potential inefficiency, Check data, or No activity should usually be reviewed first.

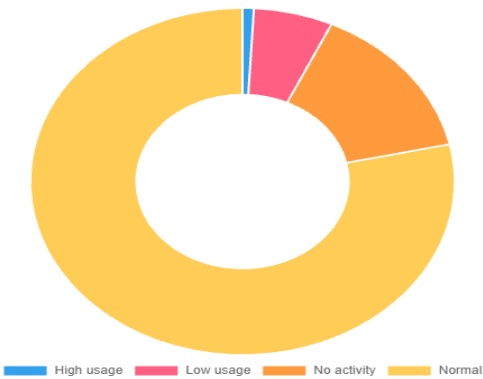


Takeaway: 99 devices had at least one flag or issue requiring review.

Runtime vs Average Temperature

This chart compares runtime hours against average room temperature for each device.

Rooms toward the bottom-right of the chart are the most important to review. These are rooms with long runtime but relatively low average temperature, which may indicate heat loss, undersized heaters, or inefficient operation.

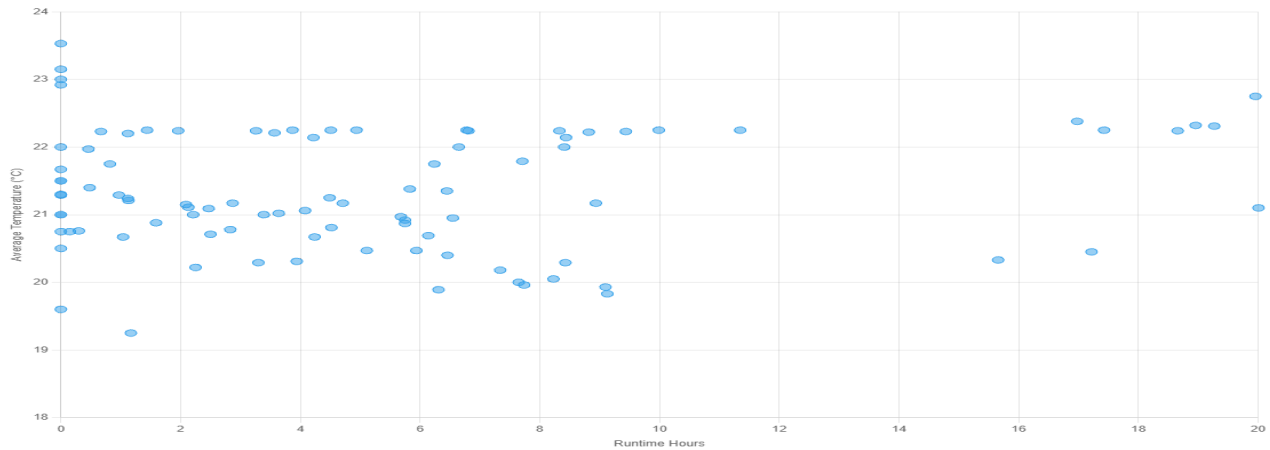

Takeaway: No strong inefficiency outlier was automatically identified from the runtime-versus-temperature relationship.


Rooms to Review from this Chart

Room / Device	Runtime (hrs)	Avg Temp	Cost	Status
RM15 STAT	47.48	18.27°C	£12.82	High usage
Bed 39 T-FF Stat	36.59	21.64°C	£9.88	Normal
Bed 38 T-FF Stat	33.05	22.20°C	£8.92	Normal
Foyer Stat	30.51	19.73°C	£8.24	Normal
Bedroom 28 FF-G Stat	27.15	21.00°C	£7.33	Normal

Share of Total Cost

This chart shows how much of the total estimated heating cost came from the top cost-driving rooms, with the remainder grouped as Other.

If a small number of rooms make up a large share of cost, those rooms are the best place to focus early cost-reduction efforts.

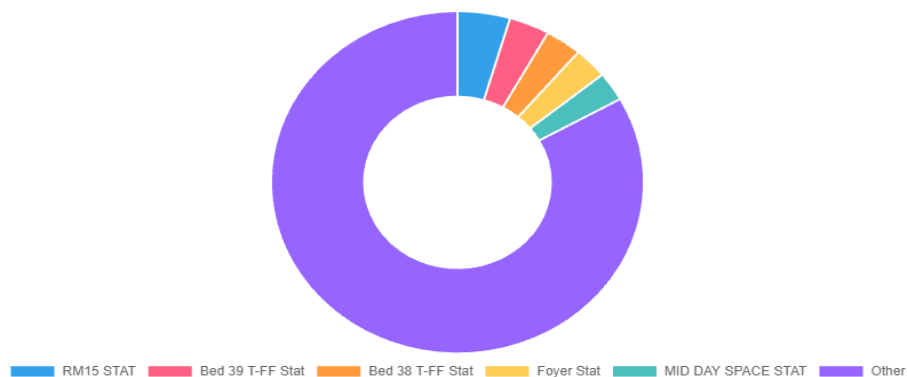

Takeaway: RM15 STAT contributed the largest individual share of estimated heating cost.

Top Cost Drivers

Rank	Room / Device	Runtime (hrs)	kWh	Cost	Avg Temp	Runtime %	% of Total Cost	Status
1	RM15 STAT	47.48	47.48	£12.82	18.27°C	100.00%	4.55%	High usage
2	Bed 39 T-FF Stat	36.59	36.59	£9.88	21.64°C	76.71%	3.51%	Normal
3	Bed 38 T-FF Stat	33.05	33.05	£8.92	22.20°C	68.90%	3.17%	Normal
4	Foyer Stat	30.51	30.51	£8.24	19.73°C	63.94%	2.93%	Normal
5	MID DAY SPACE STAT	28.54	28.54	£7.70	22.40°C	61.17%	2.74%	Normal

Longest Runtime Devices

Rank	Room / Device	Runtime	Runtime %	Cost	Avg Temp	State Changes	Status
1	RM15 STAT	47h 28m 36s	100.00%	£12.82	18.27°C	0	High usage
2	Bed 39 T-FF Stat	36h 35m 32s	76.71%	£9.88	21.64°C	98	Normal
3	Bed 38 T-FF Stat	33h 2m 48s	68.90%	£8.92	22.20°C	85	Normal
4	Foyer Stat	30h 30m 38s	63.94%	£8.24	19.73°C	106	Normal
5	MID DAY SPACE STAT	28h 32m 13s	61.17%	£7.70	22.40°C	67	Normal

Inactive / Low-use Devices

Room / Device	Runtime (hrs)	Unknown (hrs)	State Changes	Avg Temp	Reason
Assisted Bathroom B-GF-BR Stat	0.00	0.00	0	21.30°C	no_runtime
Assisted Bathroom FF-G-BL Stat	0.82	0.00	11	21.75°C	low_usage
ASSISTED BATHROOM STAT	0.00	0.00	0	0.00°C	no_runtime
Assisted Bathroom T-FF-MB Stat	0.00	36.55	0	23.00°C	no_runtime
Assisted Bathroom T-FF-MT Stat	0.00	33.45	0	20.75°C	no_runtime

Room / Device	Runtime (hrs)	Unknown (hrs)	State Changes	Avg Temp	Reason
Assister Shower T-FF-BR Stat	0.00	47.80	0	23.53°C	no_runtime
Bed 32 T-FF Stat	0.67	0.00	10	22.23°C	low_usage
Bedroom 11 B-GF Stat	0.30	0.00	4	20.76°C	low_usage
Bedroom 17 FF-G Stat	0.00	0.00	0	21.00°C	no_runtime
Bedroom 18 FF-G Stat	0.15	0.00	2	20.75°C	low_usage
Bedroom 23 FF-G Stat	0.00	0.00	0	19.60°C	no_runtime
BOTTOM CORRIDOR STAT	0.00	0.00	0	21.50°C	no_runtime
Corridor (Day Lounge) Stat	0.00	0.00	0	21.00°C	no_runtime
Corridor 2 (Dinning) Stat	0.48	0.00	2	21.40°C	low_usage
Corridor Bottom lounge Stat	0.00	0.00	0	21.50°C	no_runtime
Dining Room B-GF-TR Stat	0.46	0.00	2	21.97°C	low_usage
Dinning 1st/F Stat	0.00	0.00	0	21.29°C	no_runtime
Hairdresser B-GF Stat	0.00	0.00	0	0.00°C	no_runtime
Middle Corridor Stat	0.00	0.00	0	21.67°C	no_runtime
Nurse Station T-FF Stat	0.00	39.95	0	22.92°C	no_runtime
RM 10 STAT	0.00	0.00	0	23.15°C	no_runtime
RM1 STAT	0.97	0.00	2	21.29°C	low_usage
RM15 STAT	47.48	0.00	0	18.27°C	no_state_changes
SAU2AG1_GW-001E5E013A14-SQ610_WB_-001E5E09090A3C54	0.00	0.00	0	22.00°C	no_runtime
Stairwell T-FF-TR Stat	0.00	0.00	0	20.50°C	no_runtime

Full Device Breakdown

Room / Device	Runtime	Runtime %	Off (hrs)	Unknown (hrs)	State Changes	Avg Temp	kWh	Cost	Status	Flags
Assisted Bathroom B-GF-BR Stat	0h 0m 0s	0.00%	44.94	0.00	0	21.30°C	0.00	£0.00	No activity	1
Assisted Bathroom FF-G-BL Stat	0h 49m 18s	9.21%	8.10	0.00	11	21.75°C	0.82	£0.22	Low usage	1

Room / Device	Runtime	Runtime %	Off (hrs)	Unknown (hrs)	State Changes	Avg Temp	kWh	Cost	Status	Flags
Assisted Bathroom SF-M Stat	3h 34m 8s	7.53%	43.82	0.00	39	22.21°C	3.57	£0.96	Normal	1
ASSISTED BATHROOM STAT	0h 0m 0s	0.00%	0.00	0.00	0	0.00°C	0.00	£0.00	No activity	1
Assisted Bathroom T-FF-MB Stat	0h 0m 0s	0.00%	0.00	36.55	0	23.00°C	0.00	£0.00	No activity	2
Assisted Bathroom T-FF-MT Stat	0h 0m 0s	0.00%	0.00	33.45	0	20.75°C	0.00	£0.00	No activity	2
Assister Shower T-FF-BR Stat	0h 0m 0s	0.00%	0.00	47.80	0	23.53°C	0.00	£0.00	No activity	2
Bed 23 T-FF Stat	25h 32m 12s	53.33%	22.34	0.00	60	20.80°C	25.54	£6.89	Normal	1
Bed 24 T-FF Stat	9h 26m 13s	19.94%	37.90	0.00	83	22.23°C	9.44	£2.55	Normal	1
Bed 25 T-FF Stat	4h 56m 31s	10.31%	43.01	0.00	57	22.25°C	4.94	£1.33	Normal	1
Bed 26 T-FF Stat	22h 18m 28s	46.56%	25.60	0.00	93	22.25°C	22.31	£6.02	Normal	1
Bed 27 T-FF Stat	1h 6m 55s	2.38%	45.65	0.00	10	21.24°C	1.12	£0.30	Normal	0
Bed 28 T-FF Stat	6h 48m 23s	14.30%	40.80	0.00	71	22.24°C	6.81	£1.84	Normal	1
Bed 29 T-FF Stat	8h 26m 34s	17.69%	39.28	0.00	75	22.14°C	8.44	£2.28	Normal	1
Bed 30 T-FF Stat	2h 15m 11s	4.72%	45.48	0.00	29	20.22°C	2.25	£0.61	Normal	1
Bed 32 T-FF Stat	0h 40m 29s	1.43%	46.51	0.00	10	22.23°C	0.67	£0.18	Low usage	1
Bed 33 T-FF Stat	19h 16m 4s	40.39%	28.44	0.00	63	22.31°C	19.27	£5.20	Normal	1
Bed 34 T-FF Stat	1h 57m 20s	4.08%	45.92	0.00	22	22.24°C	1.96	£0.53	Normal	1
Bed 35 T-FF Stat	3h 15m 29s	6.79%	44.74	0.00	35	22.24°C	3.26	£0.88	Normal	1
Bed 36 T-FF Stat	20h 53m 30s	43.95%	26.64	0.00	71	21.29°C	20.89	£5.64	Normal	1
Bed 37 T-FF Stat	24h 17m 5s	50.63%	23.68	0.00	110	22.32°C	24.28	£6.56	Normal	1
Bed 38 T-FF Stat	33h 2m 48s	68.90%	14.92	0.00	85	22.20°C	33.05	£8.92	Normal	1
Bed 39 T-FF Stat	36h 35m 32s	76.71%	11.11	0.00	98	21.64°C	36.59	£9.88	Normal	1

Room / Device	Runtime	Runtime %	Off (hrs)	Unknown (hrs)	State Changes	Avg Temp	kWh	Cost	Status	Flags
Bed 41 T-FF Stat	23h 0m 47s	48.05%	24.88	0.00	100	21.75°C	23.01	£6.21	Normal	1
Bed 42 T-FF Stat	17h 25m 30s	36.56%	30.23	0.00	42	22.25°C	17.43	£4.70	Normal	1
Bed 43 T-FF Stat	16h 58m 59s	35.59%	30.73	0.00	24	22.38°C	16.98	£4.59	Normal	1
Bed 44 T-FF Stat	18h 39m 47s	39.07%	29.10	0.00	50	22.24°C	18.66	£5.04	Normal	1
Bed 45 T-FF Stat	18h 57m 24s	39.56%	28.96	0.00	52	22.32°C	18.96	£5.12	Normal	1
Bedroom 1 B-GF Stat	5h 6m 47s	10.75%	42.43	0.00	44	20.47°C	5.11	£1.38	Normal	1
Bedroom 10 B-GF Stat	5h 56m 10s	12.39%	41.96	0.00	52	20.47°C	5.94	£1.60	Normal	1
Bedroom 11 B-GF Stat	0h 18m 16s	0.65%	46.31	0.00	4	20.76°C	0.30	£0.08	Low usage	1
Bedroom 12 B-GF Stat	5h 45m 6s	12.09%	41.81	0.00	48	20.87°C	5.75	£1.55	Normal	1
Bedroom 12A B-GF Stat	22h 57m 12s	49.66%	23.27	0.00	39	20.21°C	22.95	£6.20	Normal	1
Bedroom 14 B-GF Stat	3h 17m 47s	6.88%	44.62	0.00	26	20.29°C	3.30	£0.89	Normal	1
Bedroom 15 B-GF Stat	7h 39m 13s	15.97%	40.28	0.00	78	20.00°C	7.65	£2.07	Normal	1
Bedroom 16 B-GF Stat	23h 31m 19s	49.30%	24.19	0.00	94	20.27°C	23.52	£6.35	Normal	1
Bedroom 17 B-GF Stat	8h 13m 35s	17.27%	39.40	0.00	44	20.05°C	8.23	£2.22	Normal	1
Bedroom 17 FF-G Stat	0h 0m 0s	0.00%	41.03	0.00	0	21.00°C	0.00	£0.00	No activity	1
Bedroom 18 B-GF Stat	6h 32m 48s	13.68%	41.31	0.00	56	20.95°C	6.55	£1.77	Normal	1
Bedroom 18 FF-G Stat	0h 8m 46s	0.31%	47.29	0.00	2	20.75°C	0.15	£0.04	Low usage	1
Bedroom 19 B-GF Stat	7h 20m 7s	15.33%	40.52	0.00	68	20.18°C	7.34	£1.98	Normal	1
Bedroom 19 FF-G Stat	3h 23m 13s	7.42%	42.28	0.00	17	21.00°C	3.39	£0.91	Normal	0
Bedroom 2 B-GF Stat	9h 5m 55s	19.00%	38.80	0.00	82	19.93°C	9.10	£2.46	Normal	1
Bedroom 20 B-GF Stat	2h 28m 10s	5.20%	45.01	0.00	28	21.09°C	2.47	£0.67	Normal	1

Room / Device	Runtime	Runtime %	Off (hrs)	Unknown (hrs)	State Changes	Avg Temp	kWh	Cost	Status	Flags
Bedroom 20 FF-G Stat	5h 49m 53s	12.24%	41.82	0.00	22	21.38°C	5.83	£1.57	Normal	1
Bedroom 21 B-GF Stat	23h 18m 46s	48.72%	24.54	0.00	66	20.97°C	23.31	£6.29	Normal	1
Bedroom 21 FF-G Stat	1h 2m 19s	2.17%	46.85	0.00	8	20.67°C	1.04	£0.28	Normal	0
Bedroom 22 B-GF Stat	5h 40m 57s	11.97%	41.81	0.00	64	20.97°C	5.68	£1.53	Normal	1
Bedroom 22 FF-G Stat	8h 56m 37s	18.67%	38.95	0.00	66	21.17°C	8.94	£2.41	Normal	1
Bedroom 23 FF-G Stat	0h 0m 0s	0.00%	47.78	0.00	0	19.60°C	0.00	£0.00	No activity	1
Bedroom 24 FF-G Stat	2h 52m 22s	5.99%	45.07	0.00	32	21.17°C	2.87	£0.78	Normal	1
Bedroom 25 FF-G Stat	4h 42m 38s	9.93%	42.75	0.00	41	21.17°C	4.71	£1.27	Normal	1
Bedroom 26 FF-G Stat	4h 29m 7s	9.41%	43.17	0.00	37	21.25°C	4.49	£1.21	Normal	1
Bedroom 27 FF-G Stat	23h 33m 24s	49.33%	24.20	0.00	41	21.17°C	23.56	£6.36	Normal	1
Bedroom 28 FF-G Stat	27h 8m 47s	56.78%	20.66	0.00	90	21.00°C	27.15	£7.33	Normal	1
Bedroom 3 B-GF Stat	5h 44m 58s	12.06%	41.94	0.00	52	20.92°C	5.75	£1.55	Normal	1
Bedroom 31 FF-G Stat	3h 56m 18s	8.25%	43.79	0.00	36	20.31°C	3.94	£1.06	Normal	1
Bedroom 31 Stat	6h 46m 56s	14.19%	41.02	0.00	81	22.25°C	6.78	£1.83	Normal	1
Bedroom 4 B-GF Stat	6h 8m 14s	12.83%	41.71	0.00	46	20.69°C	6.14	£1.66	Normal	1
Bedroom 46 SF-M Stat	4h 5m 2s	8.69%	42.93	0.00	37	21.06°C	4.08	£1.10	Normal	1
Bedroom 47 SF-M Stat	2h 5m 28s	4.44%	45.05	0.00	24	21.15°C	2.09	£0.56	Normal	1
Bedroom 48 SF-M Stat	4h 13m 21s	8.88%	43.30	0.00	54	22.14°C	4.22	£1.14	Normal	1
Bedroom 49 SF-M Stat	23h 50m 46s	49.79%	24.05	0.00	98	22.22°C	23.85	£6.44	Normal	1
Bedroom 5 B-GF Stat	3h 52m 27s	8.09%	44.03	0.00	49	22.25°C	3.87	£1.05	Normal	1
Bedroom 50 SF-M Stat	9h 59m 24s	20.83%	37.96	0.00	90	22.25°C	9.99	£2.70	Normal	1

Room / Device	Runtime	Runtime %	Off (hrs)	Unknown (hrs)	State Changes	Avg Temp	kWh	Cost	Status	Flags
Bedroom 51 SF-M Stat	1h 10m 28s	2.49%	45.95	0.00	11	19.25°C	1.17	£0.32	Normal	0
Bedroom 6 B-GF Stat	4h 30m 26s	9.47%	43.10	0.00	62	22.25°C	4.51	£1.22	Normal	1
Bedroom 7 B-GF Stat	21h 3m 55s	44.28%	26.51	0.00	73	22.25°C	21.07	£5.69	Normal	1
Bedroom 8 B-GF Stat	8h 49m 16s	18.53%	38.78	0.00	97	22.22°C	8.82	£2.38	Normal	1
Bedroom 9 B-GF Stat	8h 25m 51s	17.65%	39.33	0.00	80	20.29°C	8.43	£2.28	Normal	1
BOTTOM CORRIDOR STAT	0h 0m 0s	0.00%	47.18	0.00	0	21.50°C	0.00	£0.00	No activity	1
Circulation SF-M-B Stat	8h 24m 54s	17.53%	39.58	0.00	68	22.00°C	8.41	£2.27	Normal	1
Circulation SF-M-MT Stat	1h 8m 1s	2.48%	44.58	0.00	13	21.21°C	1.13	£0.31	Normal	0
Corridor (Day Lounge) Stat	0h 0m 0s	0.00%	30.65	0.00	0	21.00°C	0.00	£0.00	No activity	1
Corridor 1 (Dinning) Stat	4h 31m 7s	9.46%	43.26	0.00	32	20.81°C	4.52	£1.22	Normal	1
Corridor 2 (Dinning) Stat	0h 28m 45s	1.55%	30.49	0.00	2	21.40°C	0.48	£0.13	Low usage	1
Corridor Bottom lounge Stat	0h 0m 0s	0.00%	46.95	0.00	0	21.50°C	0.00	£0.00	No activity	1
Corridor FF-G-BL Stat	6h 14m 13s	60.32%	4.10	0.00	14	21.75°C	6.24	£1.68	Normal	0
Corridor Right Stat	6h 38m 50s	13.95%	41.01	0.00	55	22.00°C	6.65	£1.79	Normal	1
Corridor Top lounge Stat	1h 7m 20s	2.37%	46.23	0.00	16	22.20°C	1.12	£0.30	Normal	0
Day Lounge Stat	11h 20m 49s	23.69%	36.55	0.00	79	22.25°C	11.35	£3.06	Normal	1
Day Space T-FF-BR Stat	1h 26m 25s	3.03%	46.10	0.00	13	22.25°C	1.44	£0.39	Normal	0
DaySpace SF-M Stat	9h 7m 55s	19.17%	38.50	0.00	75	19.83°C	9.13	£2.47	Normal	1
Dining Room B-GF-TR Stat	0h 27m 27s	0.96%	47.16	0.00	2	21.97°C	0.46	£0.12	Low usage	1
Dinning 1st/F Stat	0h 0m 0s	0.00%	41.81	0.00	0	21.29°C	0.00	£0.00	No activity	1
Dinning Corridor Stat	25h 38m 28s	53.76%	22.05	0.00	57	22.00°C	25.64	£6.92	Normal	1

Room / Device	Runtime	Runtime %	Off (hrs)	Unknown (hrs)	State Changes	Avg Temp	kWh	Cost	Status	Flags
Dinning Room T-FF-TR Stat	8h 19m 32s	17.43%	39.43	0.00	83	22.24°C	8.33	£2.25	Normal	1
Disabled Toilet Stat	1h 35m 30s	4.29%	35.50	0.00	13	20.88°C	1.59	£0.43	Normal	0
Disabled W/C B-GF-BR Stat	21h 1m 14s	44.45%	26.27	0.00	30	20.90°C	21.02	£5.68	Normal	1
Escape Stair B-GF-TR Stat	17h 13m 1s	35.88%	30.77	0.00	50	20.45°C	17.22	£4.65	Normal	1
Foyer Stat	30h 30m 38s	63.94%	17.21	0.00	106	19.73°C	30.51	£8.24	Normal	1
Hairdresser B-GF Stat	0h 0m 0s	0.00%	0.00	0.00	0	0.00°C	0.00	£0.00	No activity	1
Manager B-GF Stat	7h 42m 19s	16.10%	40.15	0.00	78	21.79°C	7.71	£2.08	Normal	1
MID DAY SPACE STAT	28h 32m 13s	61.17%	18.11	0.00	67	22.40°C	28.54	£7.70	Normal	1
Middle Corridor Stat	0h 0m 0s	0.00%	41.90	0.00	0	21.67°C	0.00	£0.00	No activity	1
Nurse Station T-FF Stat	0h 0m 0s	0.00%	0.00	39.95	0	22.92°C	0.00	£0.00	No activity	2
Reception B-GF-BR Stat	2h 7m 36s	4.60%	44.10	0.00	18	21.11°C	2.13	£0.57	Normal	0
RM 10 STAT	0h 0m 0s	0.00%	47.63	0.00	0	23.15°C	0.00	£0.00	No activity	1
RM 11 STAT	2h 12m 19s	4.61%	45.64	0.00	12	21.00°C	2.21	£0.60	Normal	0
RM 12 STAT	4h 14m 7s	9.34%	41.13	0.00	17	20.67°C	4.24	£1.14	Normal	0
RM 14 STAT	6h 18m 26s	13.42%	40.71	0.00	13	19.89°C	6.31	£1.70	Normal	0
RM 16 STAT	22h 2m 42s	45.99%	25.89	0.00	42	20.79°C	22.05	£5.95	Normal	1
RM 2 STAT	6h 27m 44s	13.56%	41.18	0.00	20	20.40°C	6.46	£1.74	Normal	1
RM 3 STAT	2h 50m 5s	6.13%	43.44	0.00	7	20.78°C	2.83	£0.77	Normal	0
RM 4 STAT	7h 44m 22s	16.24%	39.93	0.00	18	19.96°C	7.74	£2.09	Normal	0
RM 6 STAT	6h 26m 42s	13.48%	41.37	0.00	36	21.35°C	6.45	£1.74	Normal	1
RM 7 STAT	20h 0m 51s	41.77%	27.90	0.00	42	21.10°C	20.01	£5.40	Normal	1

Room / Device	Runtime	Runtime %	Off (hrs)	Unknown (hrs)	State Changes	Avg Temp	kWh	Cost	Status	Flags
RM 8 STAT	2h 29m 56s	5.42%	43.60	0.00	15	20.71°C	2.50	£0.67	Normal	0
RM 9 STAT	26h 10m 38s	54.69%	21.69	0.00	30	21.50°C	26.18	£7.07	Normal	1
RM1 STAT	0h 58m 14s	2.06%	46.25	0.00	2	21.29°C	0.97	£0.26	Low usage	1
RM15 STAT	47h 28m 36s	100.00%	0.00	0.00	0	18.27°C	47.48	£12.82	High usage	0
SAU2AG1_GW-001E5E013A14-SQ610_WB_-001E5E09090A3C54	0h 0m 0s	0.00%	46.63	0.00	0	22.00°C	0.00	£0.00	No activity	1
Shower Room B-GF-TR	3h 38m 13s	7.59%	44.27	0.00	28	21.02°C	3.64	£0.98	Normal	1
Stairwell SF-M-TR Stat	15h 39m 53s	32.70%	32.25	0.00	125	20.33°C	15.66	£4.23	Normal	1
Stairwell T-FF-TR Stat	0h 0m 0s	0.00%	26.69	0.00	0	20.50°C	0.00	£0.00	No activity	1
Top Day Space Stat	19h 57m 38s	42.29%	27.24	0.00	62	22.75°C	19.96	£5.39	Normal	1

Temperature Insights

Warmest Rooms

- Assister Shower T-FF-BR Stat — 23.53°C
- RM 10 STAT — 23.15°C
- Assisted Bathroom T-FF-MB Stat — 23.00°C

Coollest Rooms

- RM15 STAT — 18.27°C
- Bedroom 51 SF-M Stat — 19.25°C
- Bedroom 23 FF-G Stat — 19.60°C

Insights

- Assister Shower T-FF-BR Stat recorded the highest average temperature at 23.53°C.
- RM15 STAT recorded the lowest average temperature at 18.27°C.

Recommendations

- **Inspect inactive or non-operating devices** (medium / maintenance)
Devices showing no runtime should be checked to confirm whether they were intentionally unused or whether a control, hardware, or data issue is present.
- **Review devices with frequent switching** (medium / controls_review)
Frequent ON/OFF changes may indicate unstable control behaviour, aggressive setpoints, or room conditions causing repeated cycling.
- **Improve confidence in rooms with unknown-state periods** (medium / data_quality)
Some devices contain unknown runtime periods. These rooms should be reviewed carefully before making major energy decisions based only on this report.

Data Quality & Assumptions

Assumptions

- Cost calculations currently assume a 1 kW power draw per device.
- Estimated costs are based on the tariff entered when the report was generated.
- Null running_state values are treated as no state change and inherit the previous known state.

Data Quality Notes

- Devices with significant unknown-state periods should be reviewed carefully before making major operational decisions.
- A device with no runtime may indicate no heating demand, a control issue, a hardware issue, or limited reporting during the selected period.

Coverage Summary

Devices with Unknown Periods	4
Devices with No Runtime	17
Devices with Limited Data	6
Overall Unknown Hours	157.74