IXOM

CalCheq
CALIBRATION · INTELLIGENCE · RELIABILITY

# CALIBRATION HISTORY REPORT

Ref: RPT-202604-PT-9300

Issued: 18 Apr 2026

## INSTRUMENT SUMMARY

| | | | |
|---|---|---|---|
| Tag Number: | **PT-9300** | Type: | **Pressure** |
| Description: | **Boiler Pressure** | Range: | **0.00 to 650.00 kPa** |
| Area / Unit: | **Utilities / Boiler 1** | Tolerance: | **±0.50 Percent Span** |
| Manufacturer: | **Rosemount** | Cal Interval: | **365 days** |
| Model: | **3051** | Last Cal Date: | **01 Jan 2025** |
| Serial No.: | **—** | Next Due: | **01 Jan 2026** |

## PERFORMANCE SUMMARY

| Total Calibrations | As-Found Pass | As-Found Marginal | As-Found Fail |
|---|---|---|---|
| 5 | 1 | 0 | 4 |

**Overall As-Found Pass Rate: 20%**

## ERROR TREND ANALYSIS

**As-Found Maximum Error Trend (% Span) — Green = Pass zone | Amber = Marginal zone | Red = Fail zone**

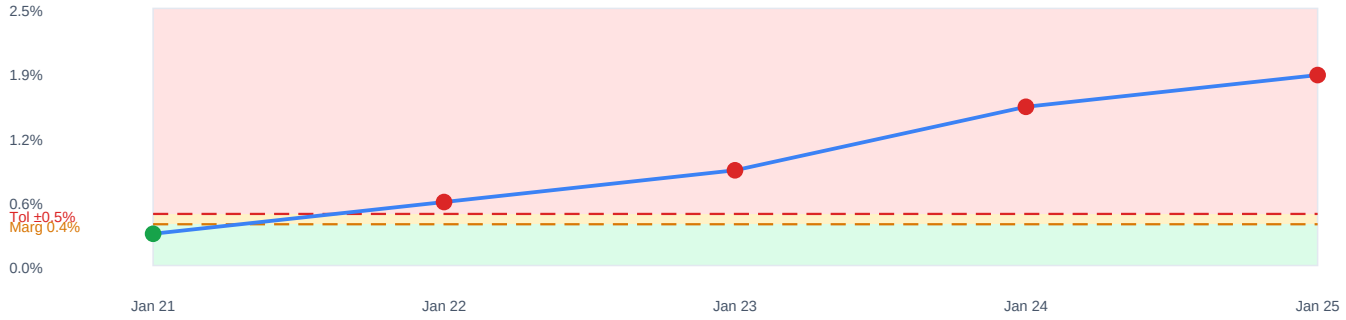


## CALIBRATION HISTORY (ALL RECORDS)

| Date | Type | Technician | As Found | As Left | Max Error % | Adj. | Status | Cert Ref |
|---|---|---|---|---|---|---|---|---|
| 01 Jan 2025 | Corrective | Nathan Fish | FAIL | PASS | 1.85% | Yes | Approved | CAL-202501-DA784F4D |
| 01 Jan 2024 | Routine | Nathan Fish | FAIL | PASS | 1.54% | Yes | Approved | CAL-202401-FA2D6F0A |
| 01 Jan 2023 | Routine | Nathan Fish | FAIL | PASS | 0.92% | Yes | Approved | CAL-202301-DA390A04 |
| 01 Jan 2022 | Routine | Nathan Fish | FAIL | PASS | 0.62% | Yes | Approved | CAL-202201-A6786926 |
| 01 Jan 2021 | Routine | Nathan Fish | PASS | NOT_REQUIRED | 0.31% | No | Approved | CAL-202101-692074FC |



*Safety Critical (SIS): Records retained per IEC 61511-1:2016 / AS 61511.1:2021. Prepared per AS ISO 9001:2016. Do not reproduce except in full.*

## INSTRUMENT & CALIBRATION DETAILS

| | | | |
|---|---|---|---|
| Tag Number: | **PT-9300** | Reference Standard: | **N/A** |
| Calibration Date: | **01 Jan 2025** | Standard Serial: | **N/A** |
| Type: | **Corrective** | Certificate No.: | **N/A** |
| Technician: | **Nathan Fish** | Cert Expiry: | **—** |
| Work Order: | **N/A** | Approved By: | **Nathan Fish** |

## TEST DATA

**Calibration Scale: LRV = 0.00 kPa | URV = 650.00 kPa | Span = 650.00 kPa | Output: 4_20ma**

| Pt | % Input | Input (kPa) | Expected Output | As-Found Output | Error (units) | Error % Span | AF Result | As-Left Output | AL Error % | AL Result |
|---|---|---|---|---|---|---|---|---|---|---|
| 1 | 0% | 0.00 | 0.00 | 0.50 | 0.50 | 0.08% | PASS | 0.00 | 0.00% | PASS |
| 2 | 25% | 162.50 | 162.50 | 163.00 | 0.50 | 0.08% | PASS | 162.50 | 0.00% | PASS |
| 3 | 50% | 325.00 | 325.00 | 329.00 | 4.00 | 0.62% | FAIL | 325.00 | 0.00% | PASS |
| 4 | 75% | 487.50 | 487.50 | 495.00 | 7.50 | 1.15% | FAIL | 487.50 | 0.00% | PASS |
| 5 | 100% | 650.00 | 650.00 | 662.00 | 12.00 | 1.85% | FAIL | 650.20 | 0.03% | PASS |

AS FOUND

**FAIL**

AS LEFT

**PASS**

## INSTRUMENT & CALIBRATION DETAILS

| | | | |
|---|---|---|---|
| Tag Number: | **PT-9300** | Reference Standard: | **N/A** |
| Calibration Date: | **01 Jan 2024** | Standard Serial: | **N/A** |
| Type: | **Routine** | Certificate No.: | **N/A** |
| Technician: | **Nathan Fish** | Cert Expiry: | **—** |
| Work Order: | **N/A** | Approved By: | **Nathan Fish** |

## TEST DATA

**Calibration Scale: LRV = 0.00 kPa | URV = 650.00 kPa | Span = 650.00 kPa | Output: 4_20ma**

| Pt | % Input | Input (kPa) | Expected Output | As-Found Output | Error (units) | Error % Span | AF Result | As-Left Output | AL Error % | AL Result |
|---|---|---|---|---|---|---|---|---|---|---|
| 1 | 0% | 0.00 | 0.00 | 0.00 | 0.00 | 0.00% | PASS | 0.00 | 0.00% | PASS |
| 2 | 25% | 162.50 | 162.50 | 160.00 | -2.50 | -0.38% | PASS | 162.00 | -0.08% | PASS |
| 3 | 50% | 325.00 | 325.00 | 325.00 | 0.00 | 0.00% | PASS | 325.00 | 0.00% | PASS |
| 4 | 75% | 487.50 | 487.50 | 487.00 | -0.50 | -0.08% | PASS | 487.00 | -0.08% | PASS |
| 5 | 100% | 650.00 | 650.00 | 660.00 | 10.00 | 1.54% | FAIL | 650.00 | 0.00% | PASS |

AS FOUND

**FAIL**

AS LEFT

**PASS**

## INSTRUMENT & CALIBRATION DETAILS

| | | | |
|---|---|---|---|
| Tag Number: | **PT-9300** | Reference Standard: | **N/A** |
| Calibration Date: | **01 Jan 2023** | Standard Serial: | **N/A** |
| Type: | **Routine** | Certificate No.: | **N/A** |
| Technician: | **Nathan Fish** | Cert Expiry: | **—** |
| Work Order: | **N/A** | Approved By: | **Nathan Fish** |

## TEST DATA

**Calibration Scale: LRV = 0.00 kPa | URV = 650.00 kPa | Span = 650.00 kPa | Output: 4_20ma**

| Pt | % Input | Input (kPa) | Expected Output | As-Found Output | Error (units) | Error % Span | AF Result | As-Left Output | AL Error % | AL Result |
|---|---|---|---|---|---|---|---|---|---|---|
| 1 | 0% | 0.00 | 0.00 | 0.00 | 0.00 | 0.00% | PASS | 0.00 | 0.00% | PASS |
| 2 | 25% | 162.50 | 162.50 | 162.00 | -0.50 | -0.08% | PASS | 162.00 | -0.08% | PASS |
| 3 | 50% | 325.00 | 325.00 | 325.00 | 0.00 | 0.00% | PASS | 325.00 | 0.00% | PASS |
| 4 | 75% | 487.50 | 487.50 | 487.00 | -0.50 | -0.08% | PASS | 487.00 | -0.08% | PASS |
| 5 | 100% | 650.00 | 650.00 | 656.00 | 6.00 | 0.92% | FAIL | 650.00 | 0.00% | PASS |

AS FOUND

**FAIL**

AS LEFT

**PASS**

## INSTRUMENT & CALIBRATION DETAILS

| | | | |
|---|---|---|---|
| Tag Number: | **PT-9300** | Reference Standard: | **N/A** |
| Calibration Date: | **01 Jan 2022** | Standard Serial: | **N/A** |
| Type: | **Routine** | Certificate No.: | **N/A** |
| Technician: | **Nathan Fish** | Cert Expiry: | **—** |
| Work Order: | **N/A** | Approved By: | **Nathan Fish** |

## TEST DATA

**Calibration Scale: LRV = 0.00 kPa | URV = 650.00 kPa | Span = 650.00 kPa | Output: 4_20ma**

| Pt | % Input | Input (kPa) | Expected Output | As-Found Output | Error (units) | Error % Span | AF Result | As-Left Output | AL Error % | AL Result |
|---|---|---|---|---|---|---|---|---|---|---|
| 1 | 0% | 0.00 | 0.00 | 0.00 | 0.00 | 0.00% | PASS | 0.00 | 0.00% | PASS |
| 2 | 25% | 162.50 | 162.50 | 162.00 | -0.50 | -0.08% | PASS | 162.00 | -0.08% | PASS |
| 3 | 50% | 325.00 | 325.00 | 325.00 | 0.00 | 0.00% | PASS | 325.00 | 0.00% | PASS |
| 4 | 75% | 487.50 | 487.50 | 487.00 | -0.50 | -0.08% | PASS | 487.00 | -0.08% | PASS |
| 5 | 100% | 650.00 | 650.00 | 654.00 | 4.00 | 0.62% | FAIL | 650.00 | 0.00% | PASS |

AS FOUND

**FAIL**

AS LEFT

**PASS**

## INSTRUMENT & CALIBRATION DETAILS

| | | | |
|---|---|---|---|
| Tag Number: | **PT-9300** | Reference Standard: | **N/A** |
| Calibration Date: | **01 Jan 2021** | Standard Serial: | **N/A** |
| Type: | **Routine** | Certificate No.: | **N/A** |
| Technician: | **Nathan Fish** | Cert Expiry: | **—** |
| Work Order: | **N/A** | Approved By: | **Nathan Fish** |

## TEST DATA

**Calibration Scale: LRV = 0.00 kPa | URV = 650.00 kPa | Span = 650.00 kPa | Output: 4_20ma**

| Pt | % Input | Input (kPa) | Expected Output | As-Found Output | Error (units) | Error % Span | AF Result | As-Left Output | AL Error % | AL Result |
|---|---|---|---|---|---|---|---|---|---|---|
| 1 | 0% | 0.00 | 0.00 | 0.00 | 0.00 | 0.00% | PASS | — | — | NOT_REQUIRED |
| 2 | 25% | 162.50 | 162.50 | 162.00 | -0.50 | -0.08% | PASS | — | — | NOT_REQUIRED |
| 3 | 50% | 325.00 | 325.00 | 325.00 | 0.00 | 0.00% | PASS | — | — | NOT_REQUIRED |
| 4 | 75% | 487.50 | 487.50 | 487.50 | 0.00 | 0.00% | PASS | — | — | NOT_REQUIRED |
| 5 | 100% | 650.00 | 650.00 | 652.00 | 2.00 | 0.31% | PASS | — | — | NOT_REQUIRED |

AS FOUND

**PASS**

AS LEFT

**NOT_REQUIRED**