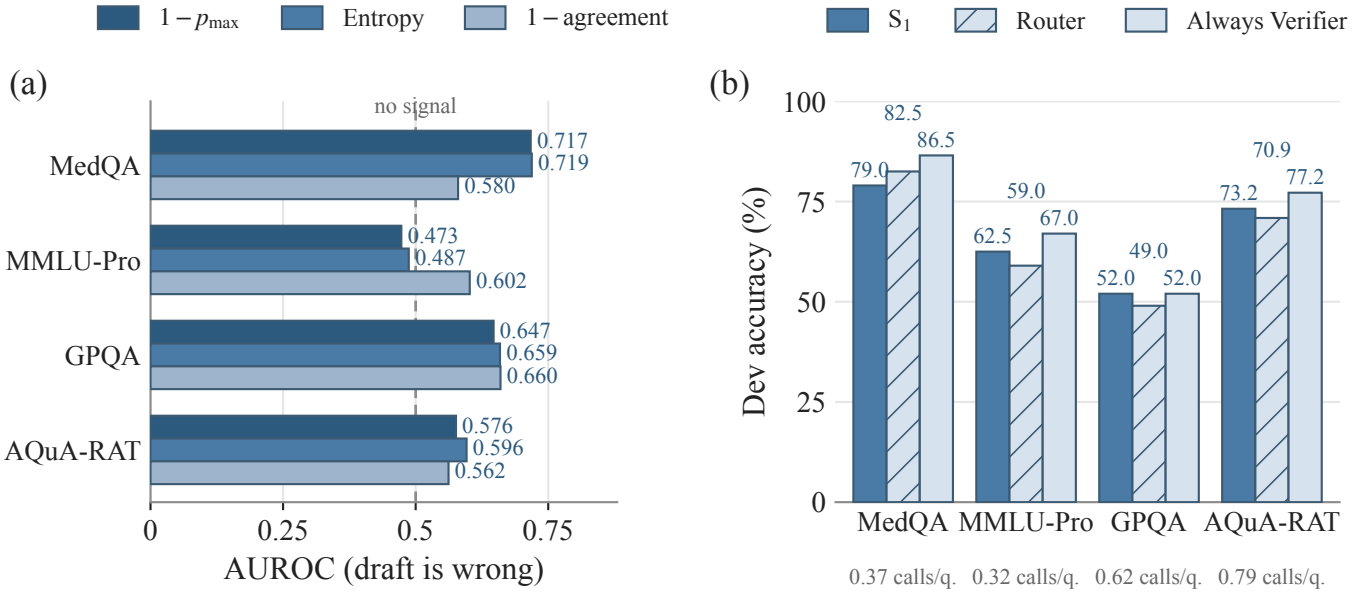

S_1 on the dev pools (MedQA/MMLU-Pro 200, GPQA 100, AQuA 254). Router: call the Verifier when the draft-letter confidence is below a threshold chosen to match S_1's call rate.
(a) AUROC of each signal for predicting that the draft is wrong; 0.5 = no signal. (b) Dev accuracy at S_1's call rate (shown under each benchmark); the router uses $1 - p_{max}$.