



Temporal response preservation for additional PEFT

Training: preserve the frozen model's response to a suffix-level probe

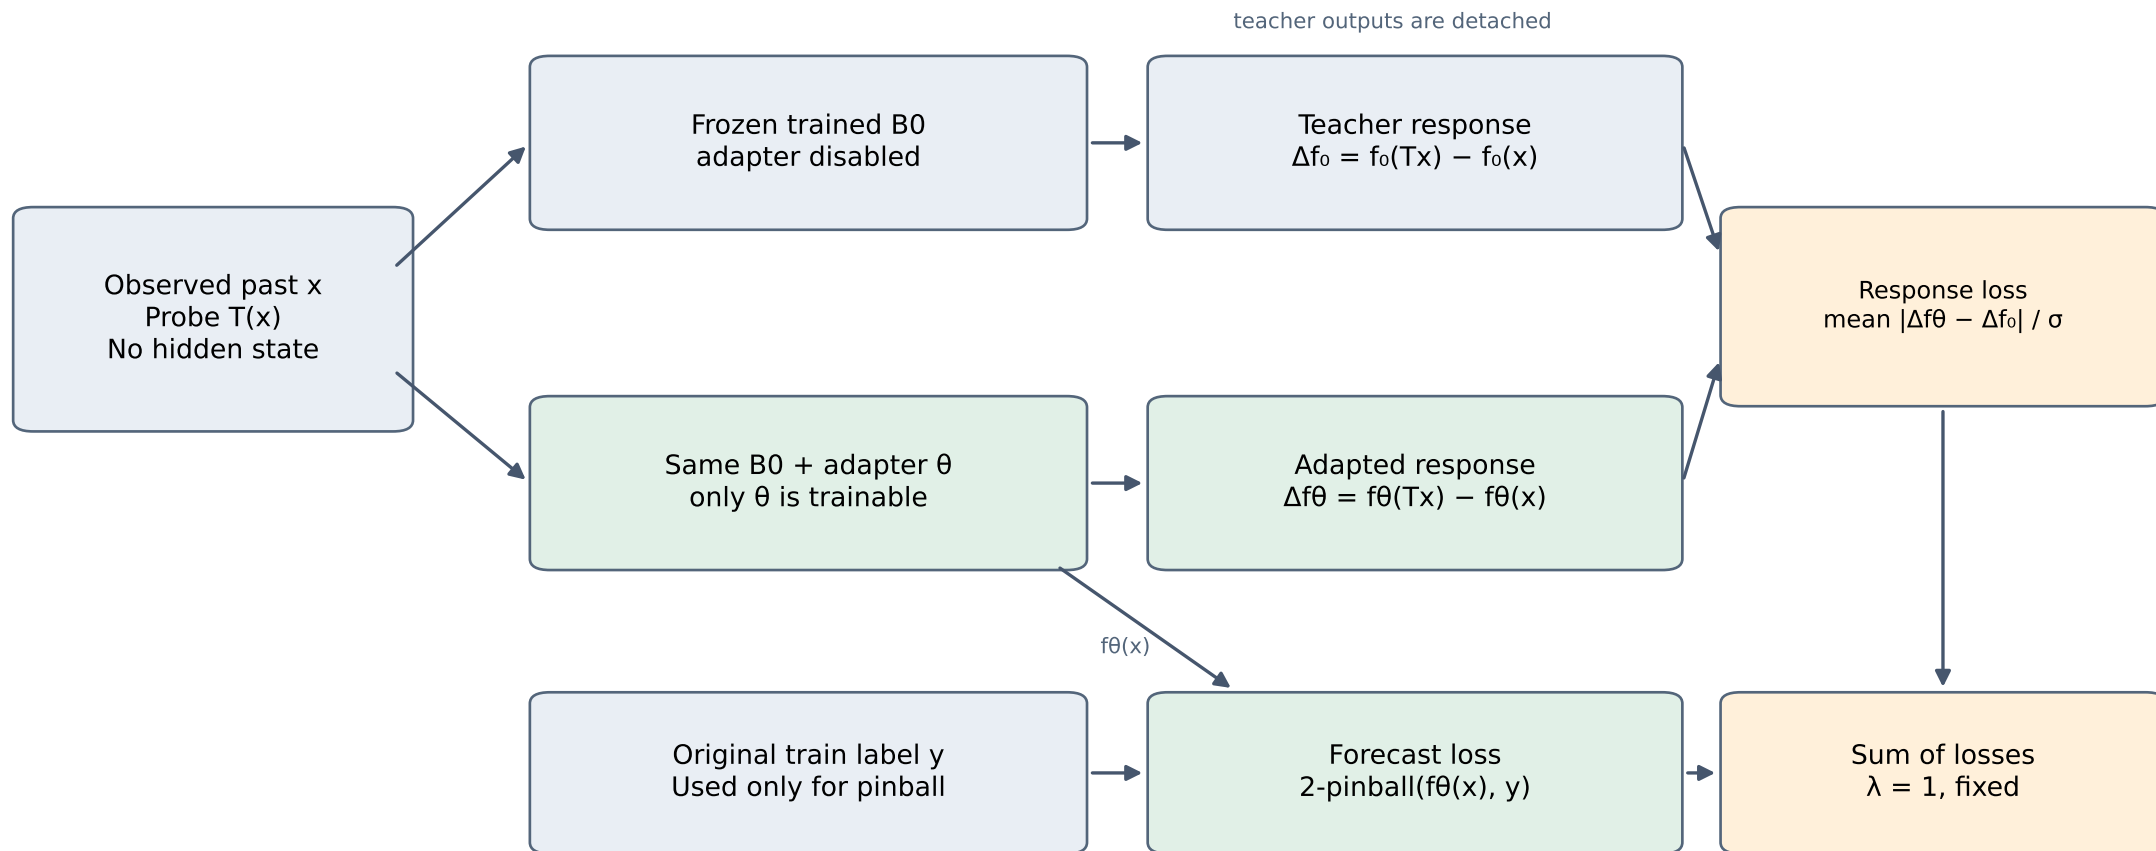

Inference: one ordinary adapter forward; no teacher probe

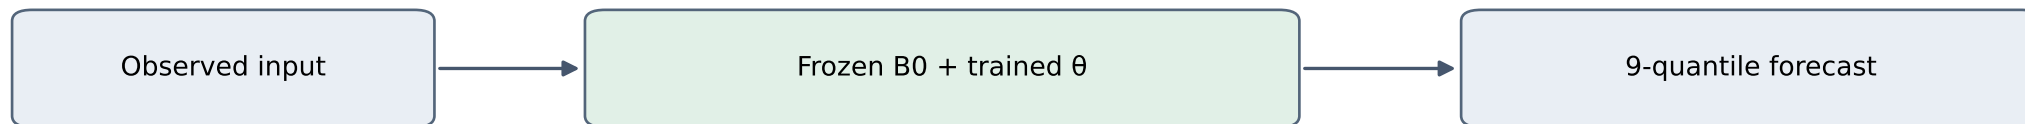

Method under evaluation. This schematic does not establish accuracy gains or novelty.