


K2bU3R3 rack inlet temperature: the oscillation DAMPS in 3-D -- ratio 0.420 against a registered DAMPS threshold of 0.5 or below

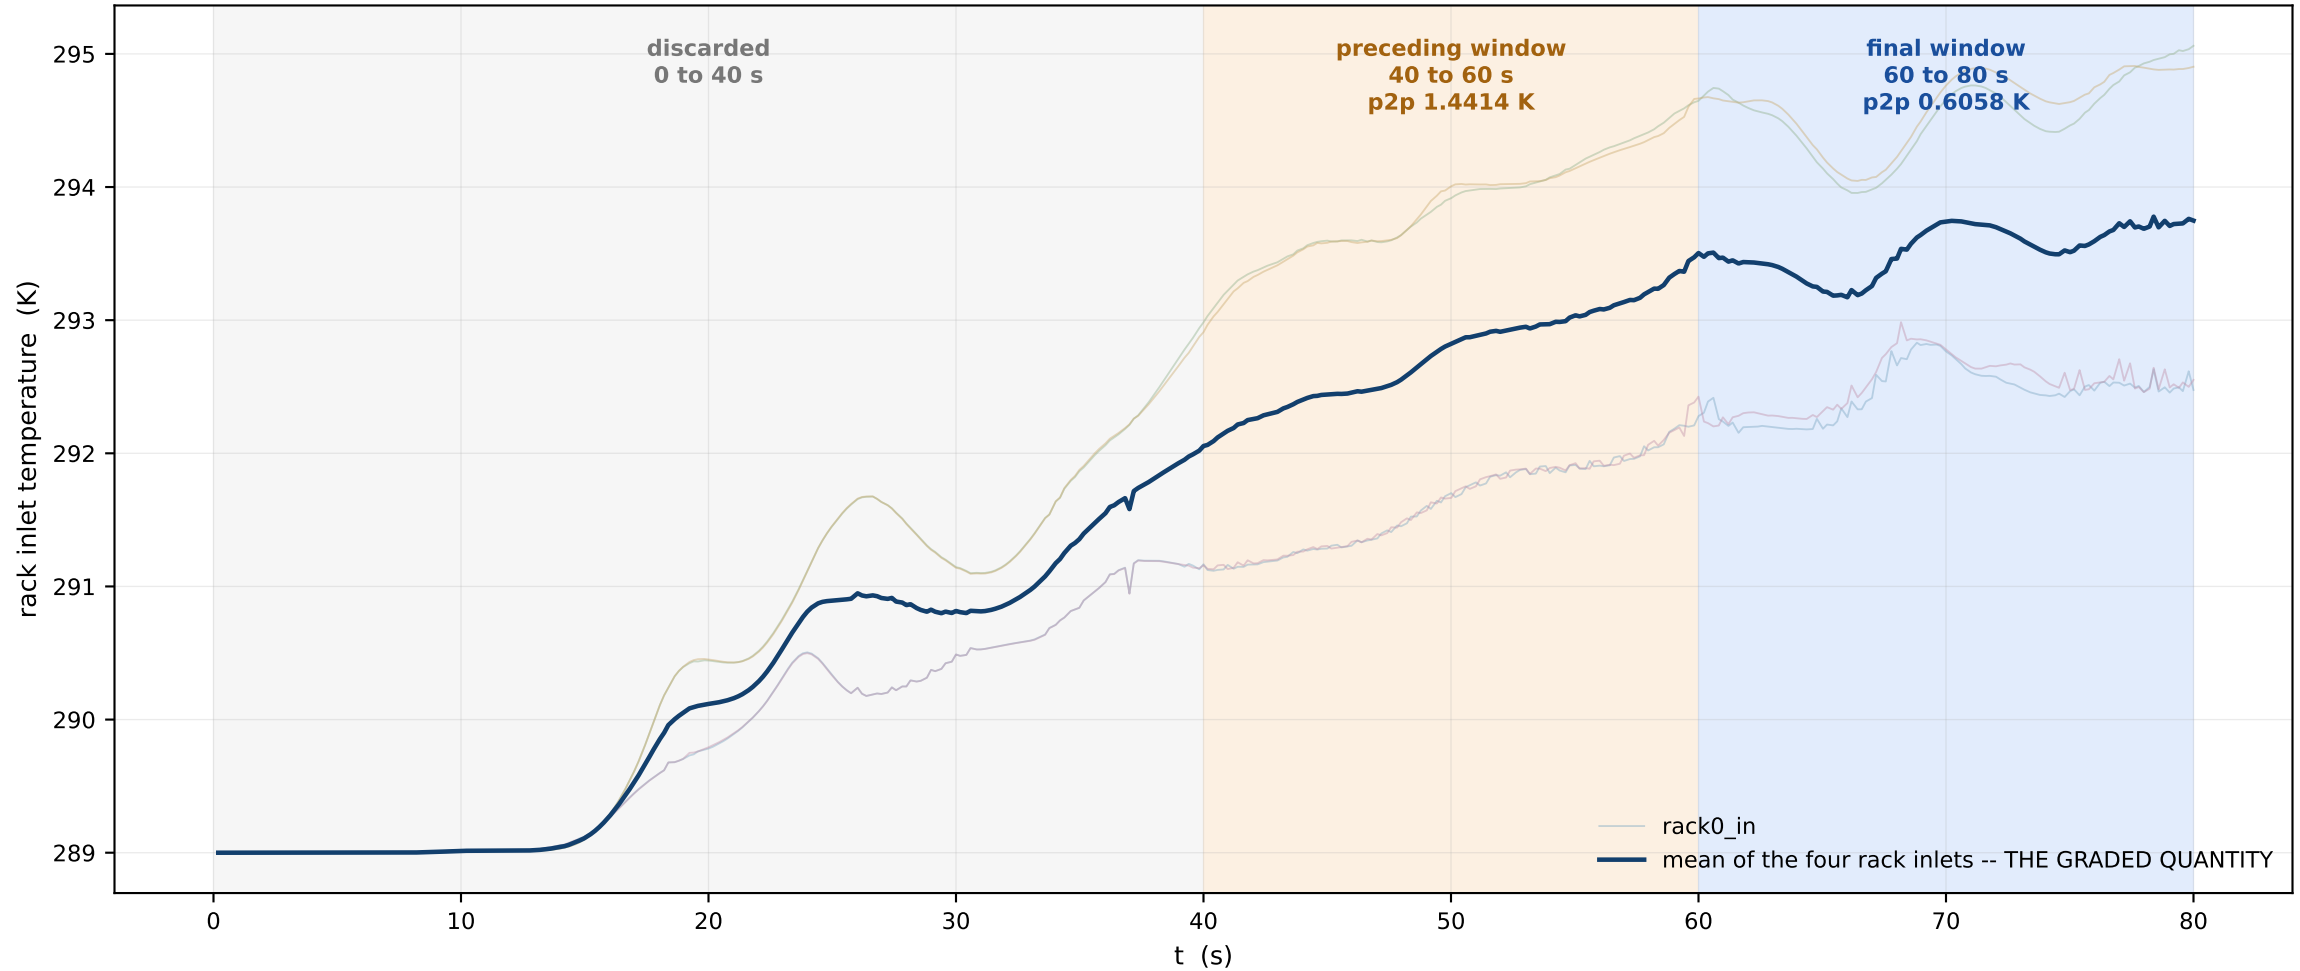

Gate, fixed before the run: $p2p \geq 0.3 \text{ K}$ AND $\text{ratio} \geq 0.8$ = SURVIVES ; $p2p \leq 0.1 \text{ K}$ OR $\text{ratio} \leq 0.5$ = DAMPS. Measured ratio 0.420, so DAMPS.

The 2-D slice sustained a limit cycle of period 6.000 s. That 2-D finding STANDS as true of the 2-D slice; what this case changes is its extrapolation to 3-D.

K2bU3R3_D59 ; 137000 cells ; buoyantBoussinesqPimpleFoam ; GATE REACHED

Room 3.6 x 3.5 x 2.7 m ; 4 racks ; OPEN row ends ; graded quantity is the mean of the four rack inlet temperatures