


p-value calibration under the null ($\tau = 0$)

ECDF vs. Uniform(0,1) reference (dashed). Each panel: one of 5 omni_hetero() tests. Mock scaffold: reps = 20.

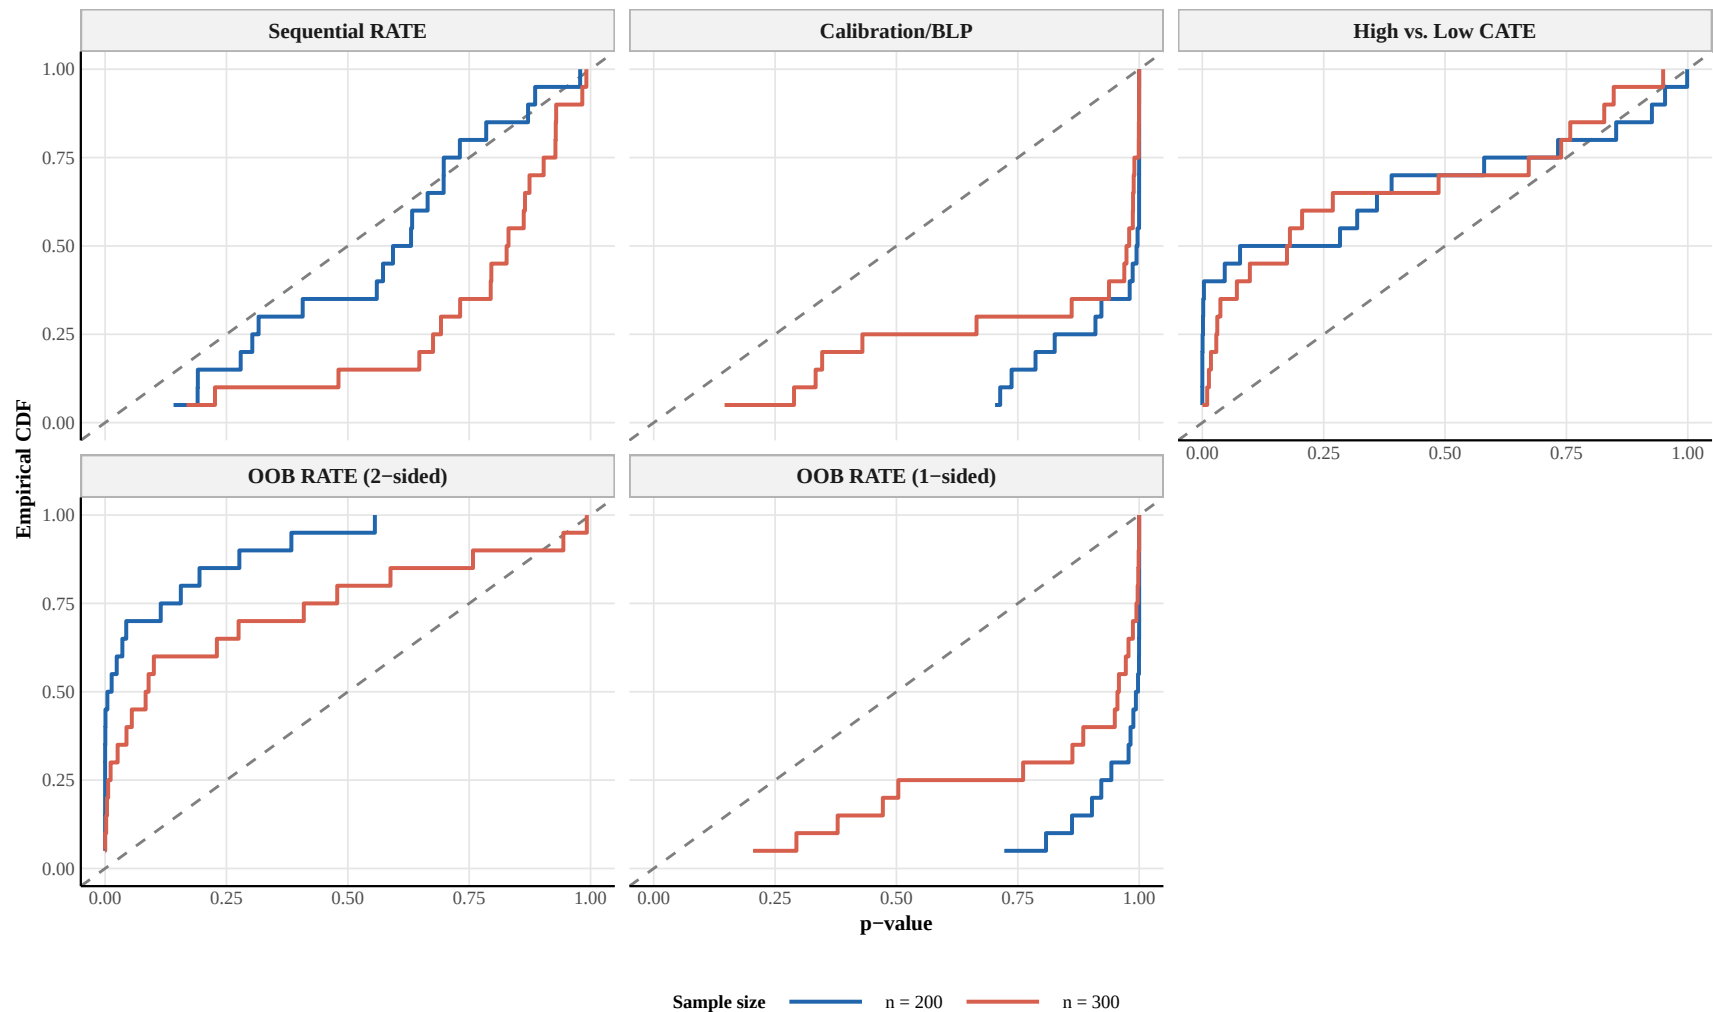

Note: Ideal calibration follows the dashed 45-degree line. Curves bowing above the diagonal indicate anti-conservative tests (excess null rejections); curves below indicate conservative tests. OOB RATE (2-sided) is doc