


Rejection rate by DGP and sample size

Dotted horizontal line: nominal alpha = 5%. Error bars: 95% MC CI. Mock scaffold: reps = 20, MC SE at p=0.05 approx 4.9%.

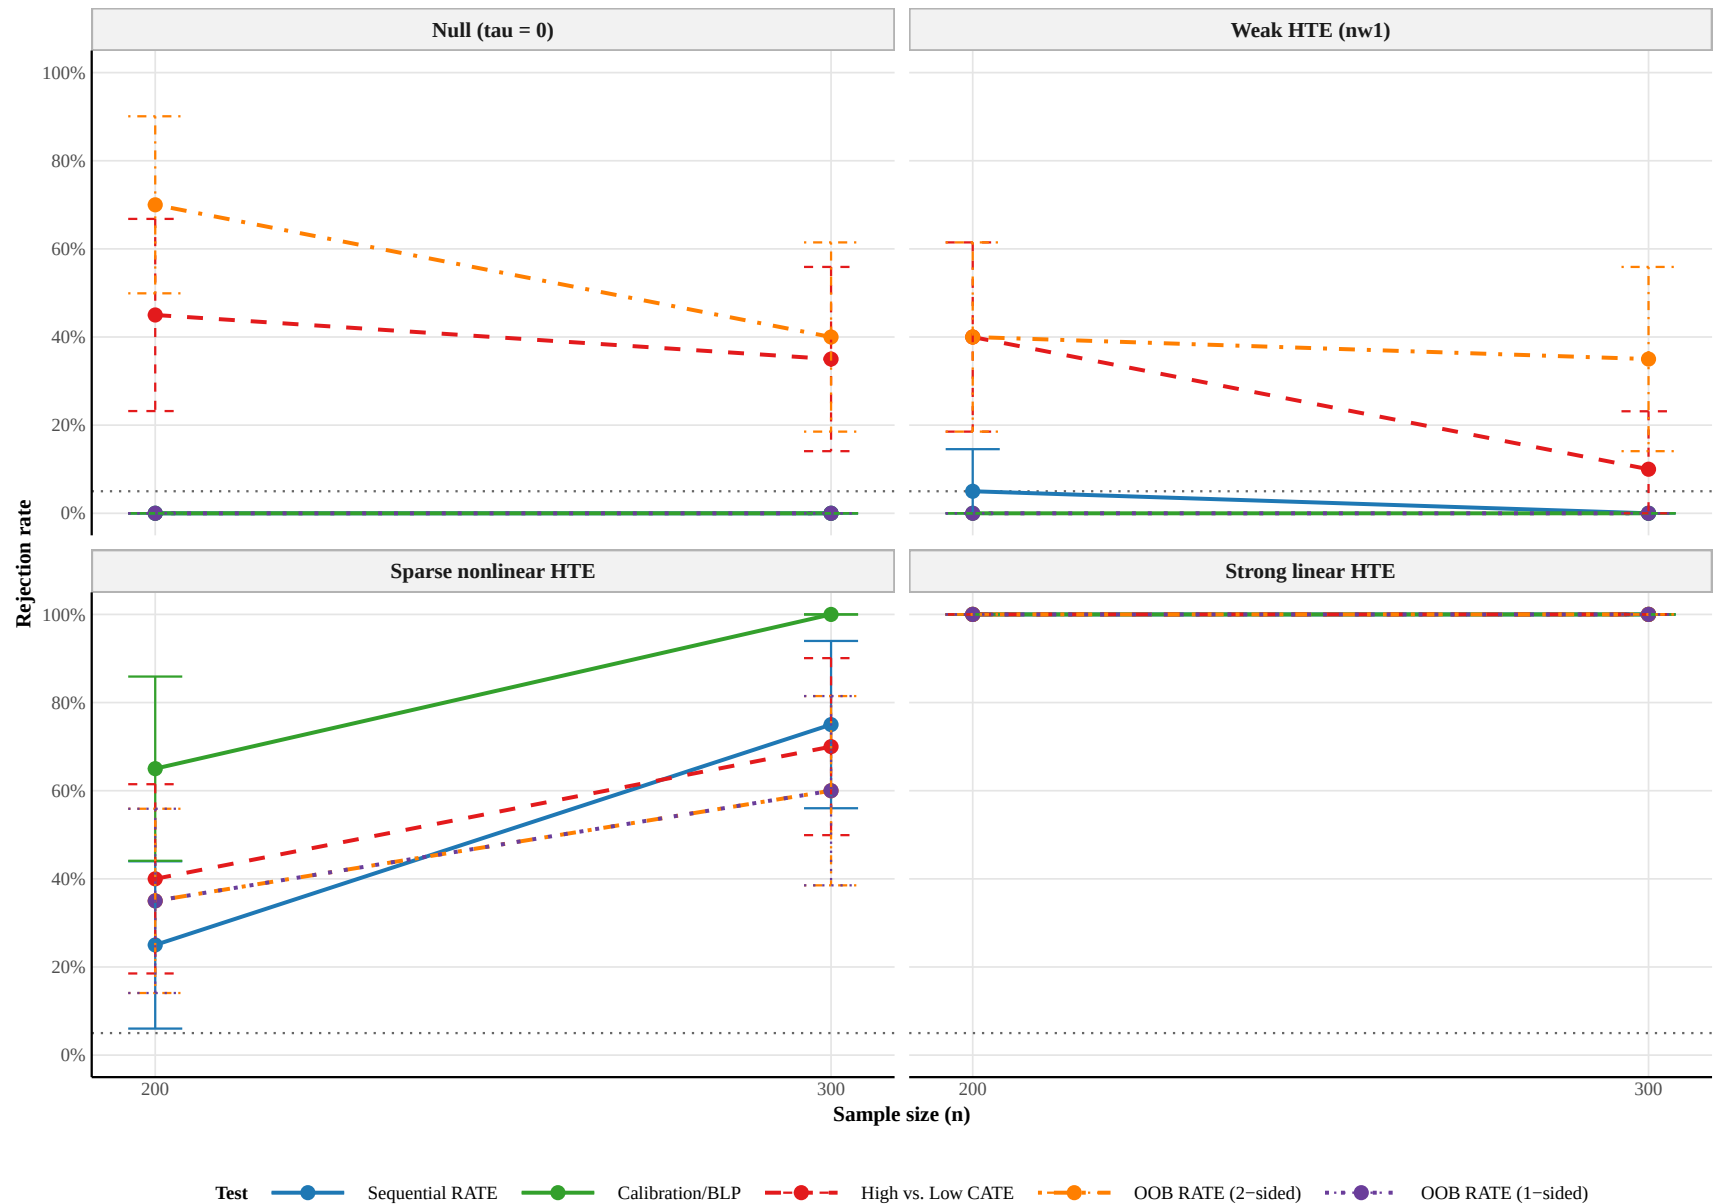

Note: With reps = 20, the 95% MC confidence interval at p = 0.05 spans [0%, 14.9%]. Differences between tests are not interpretable at this replication count. Top-left (Null) panel shows type-I error; remaining panels