


Power vs. signal strength: nw1 DGP, n = 300

sigma.tau controls CATE variation in the nw1 DGP. Dotted line: nominal alpha = 5%. Error bars: 95% MC CI. reps = 20; MC SE ~ 4.9% at p = 0.05.

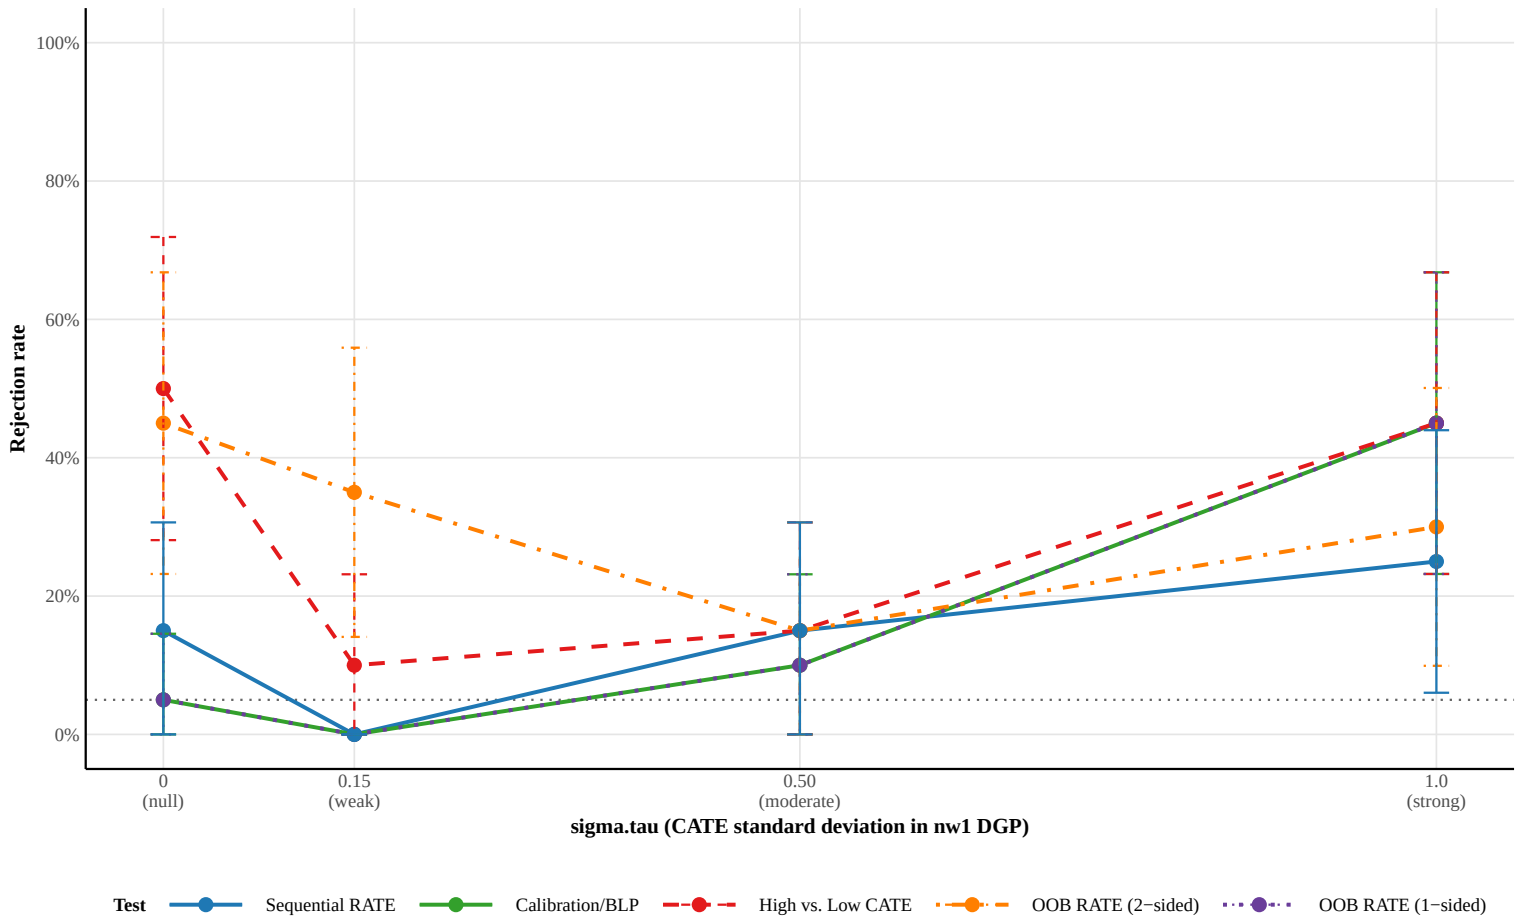

Note: sigma.tau = 0 is the null-equivalent for nw1. Leftmost points show type-I error; rightward points show power. Preferred tests (solid lines): Sequential RATE and Calibration/BLP. Heurist