



Summary

Scan Name	ATEAM-913-KG_72-PRE
Date Prepared	2022-03-24 18:49:28.743029
VDP (%)	20.0
Mean Specific Ventilation (mL/mL)	0.1
Tidal Volume (mL)	304.448
Ventilation Heterogeneity (%)	66.59
Ventilation Heterogeneity - Small Scale (%)	38.4
Ventilation Heterogeneity - Large Scale (%)	46.04


Ventilation Frequency Distribution

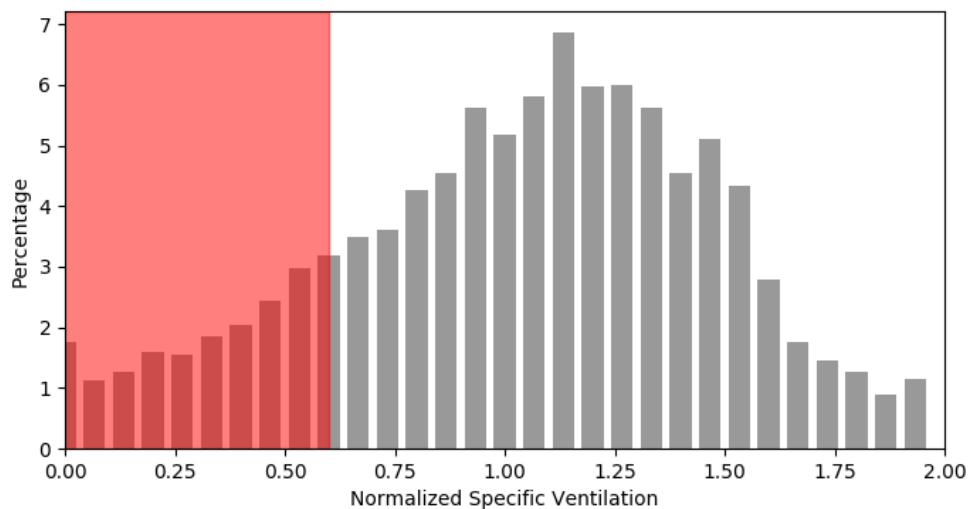


Regional Ventilation Visualization (Peak Inspiration)

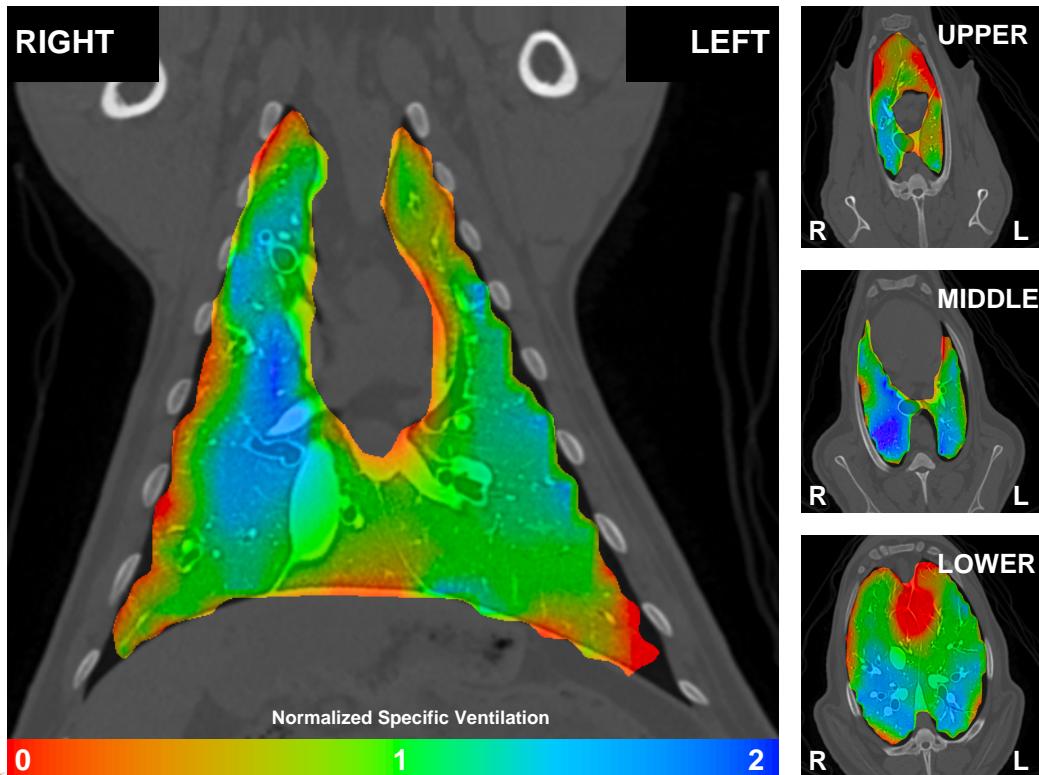

Regional Ventilation Visualization (Peak Inspiration) - Axial Slices Page 1








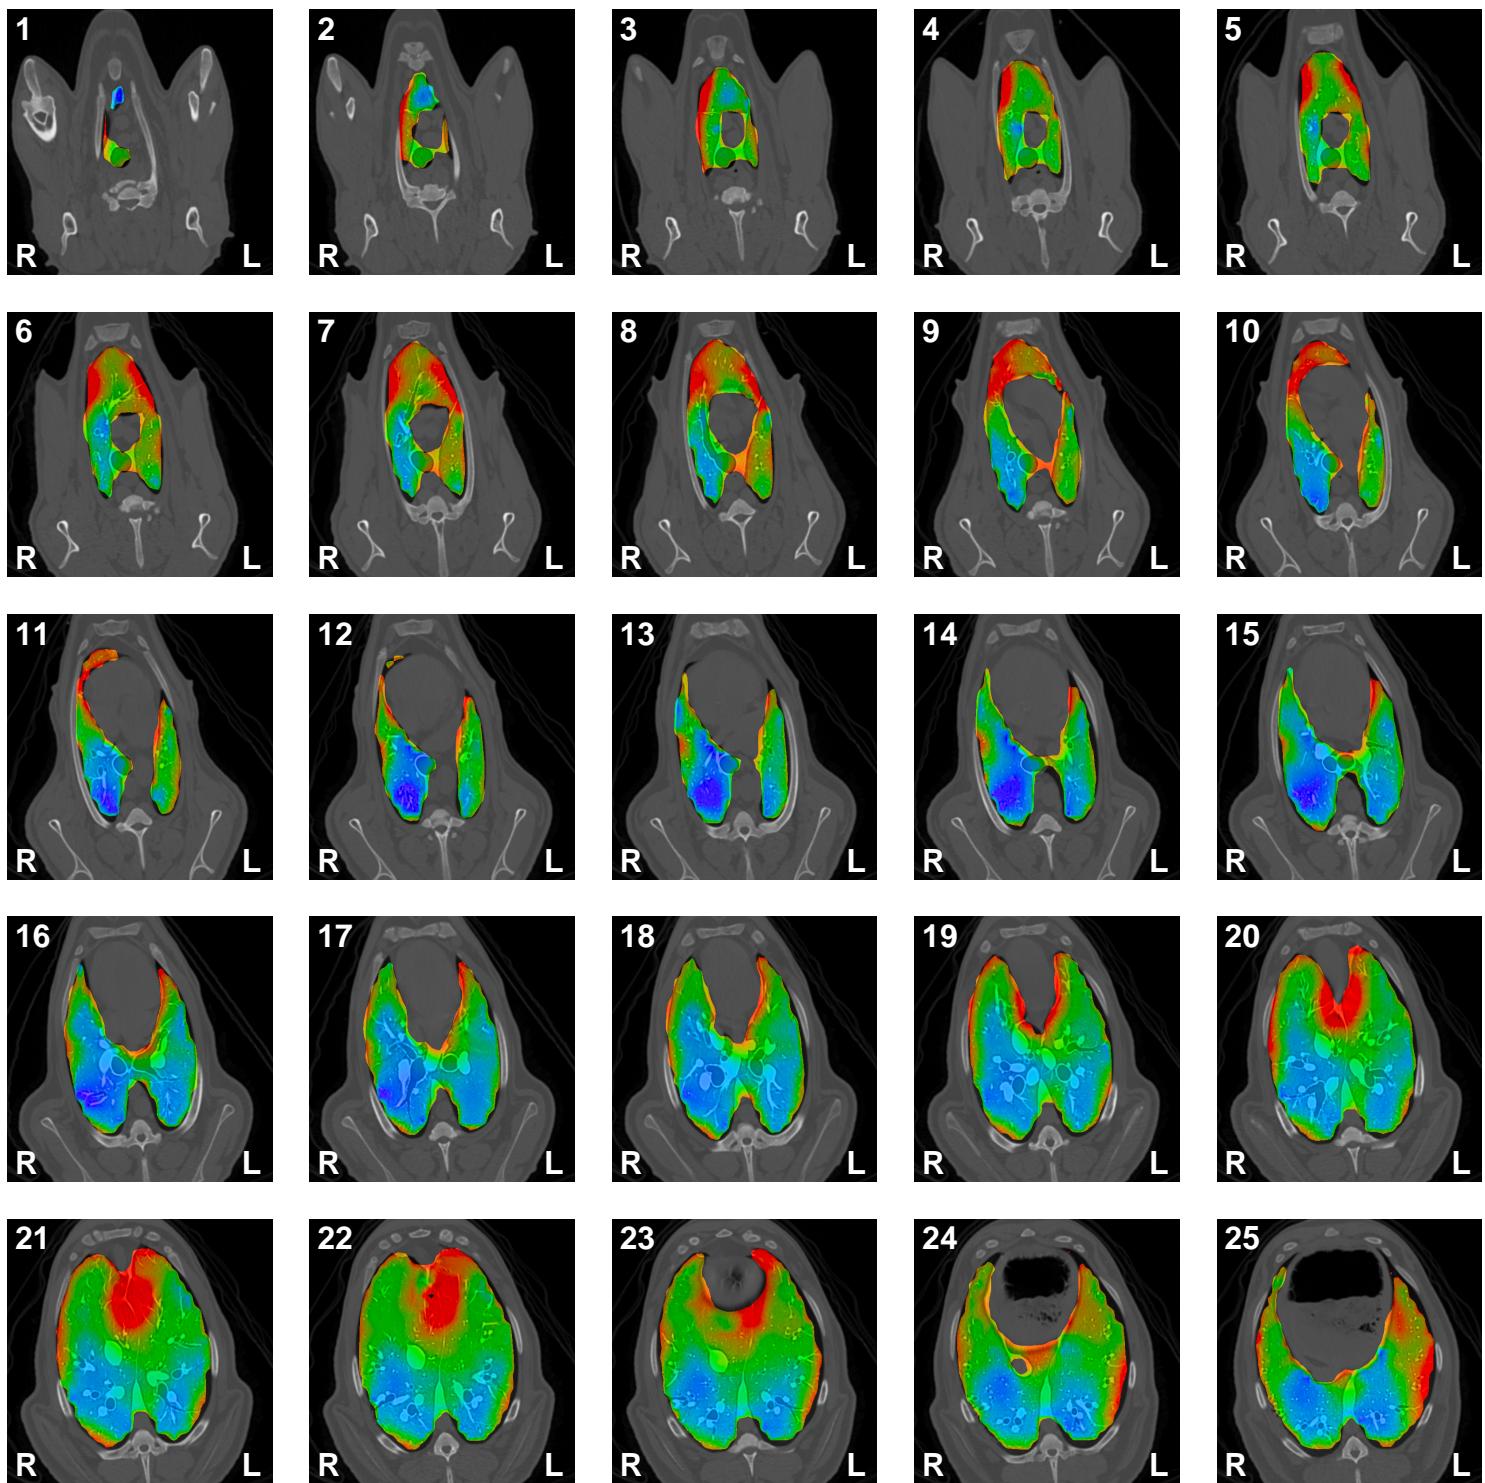


Regional Ventilation Visualization (Peak Inspiration) - Coronal Slices

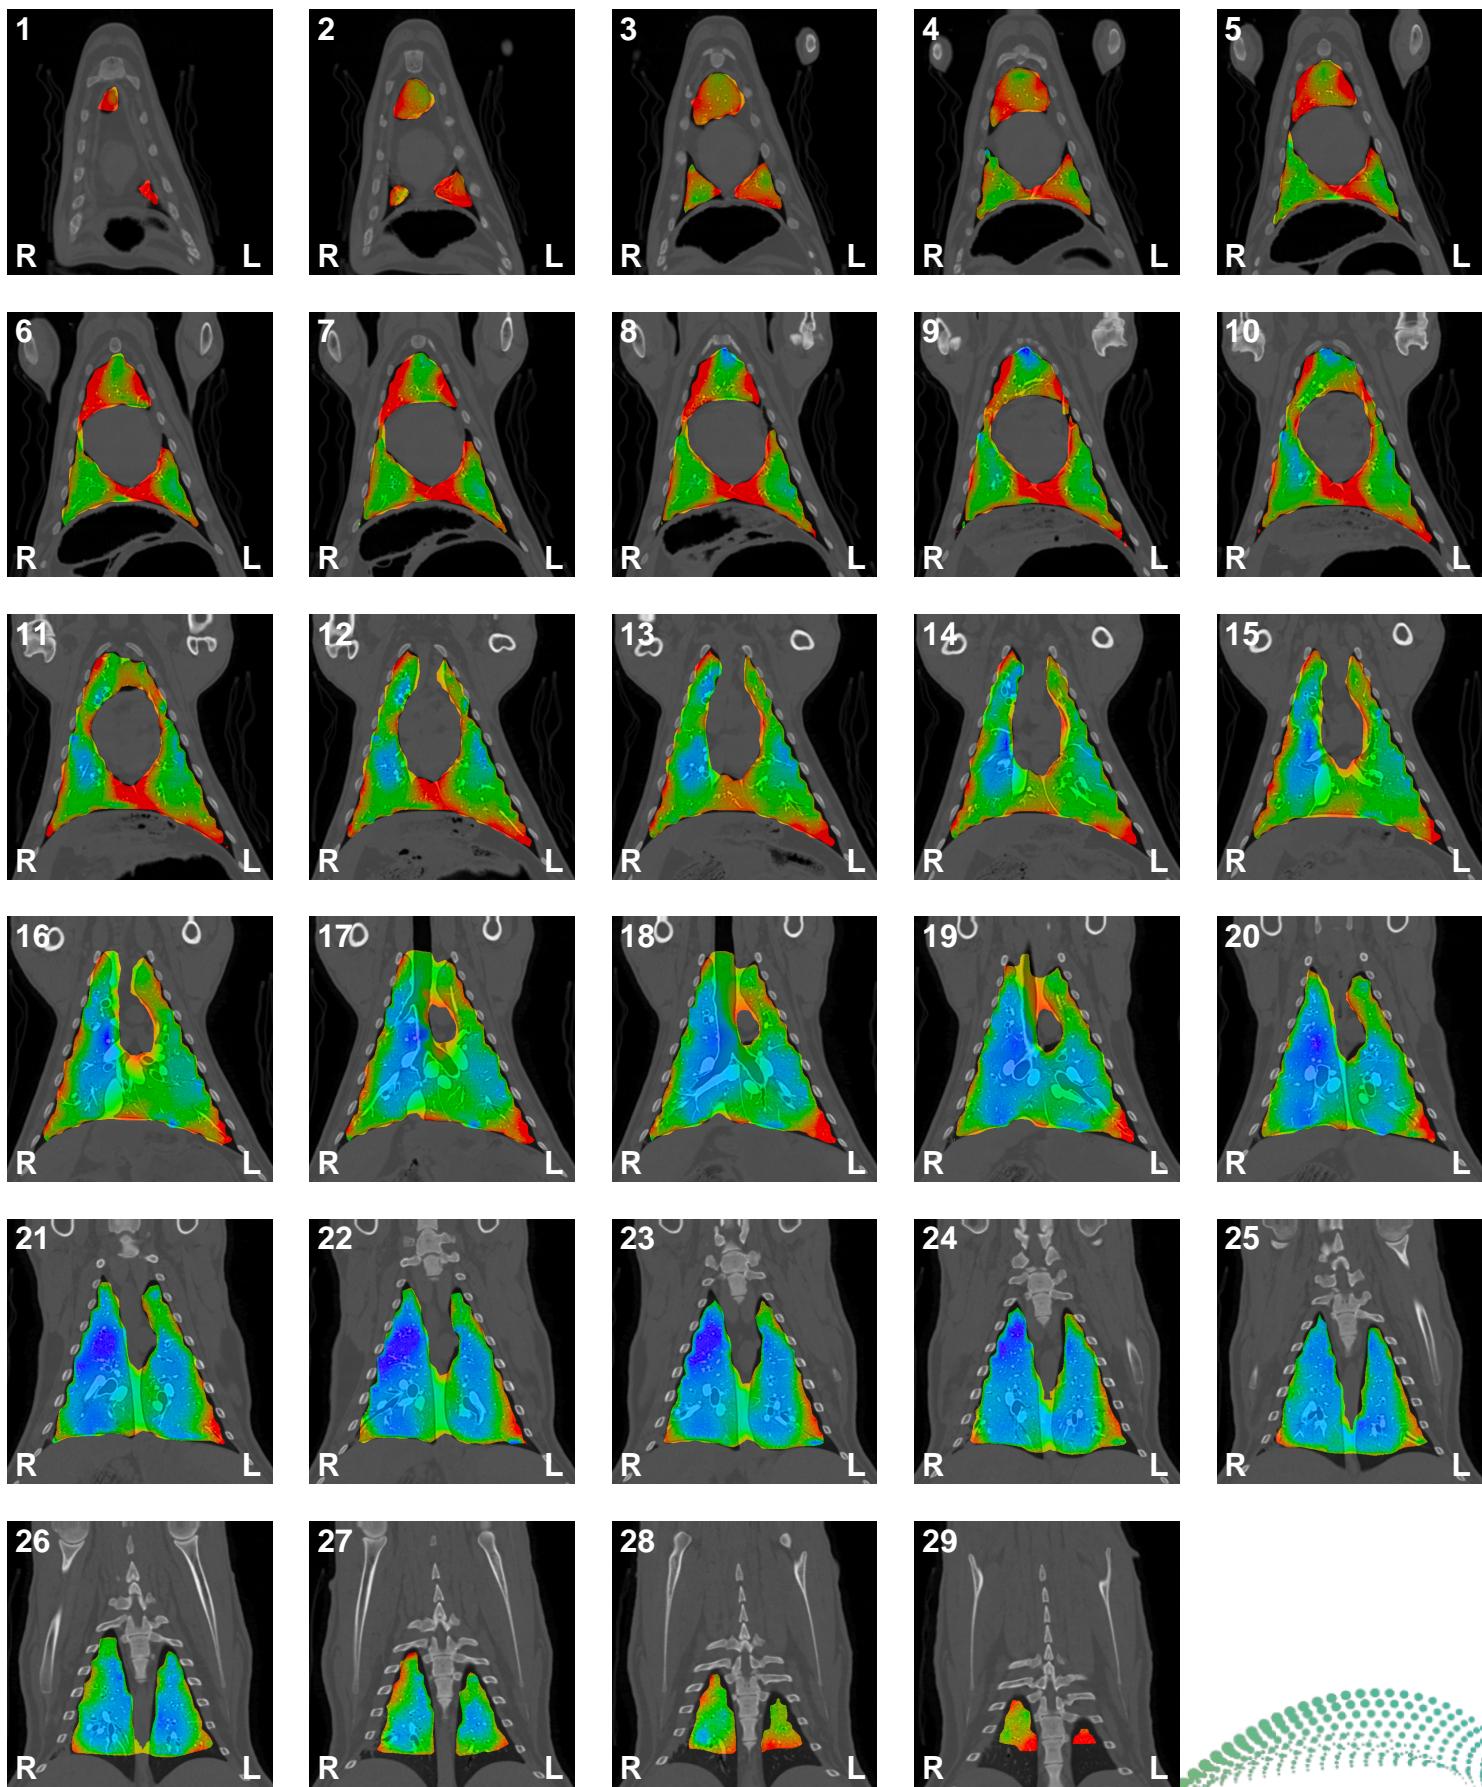

Slice Spacing = 8.0 mm

Coronal Mid-plane: Regional Ventilation Visualizations Across Phase Points (PP)

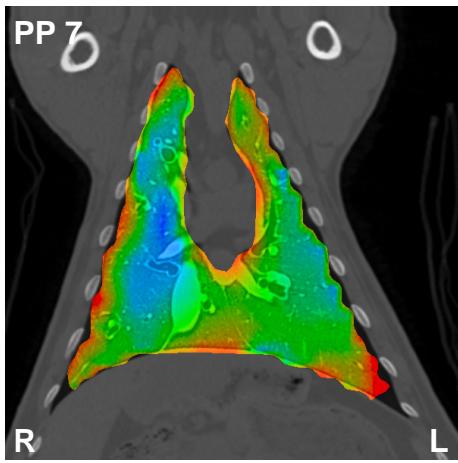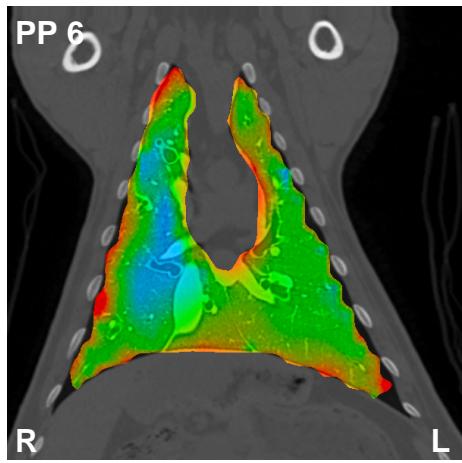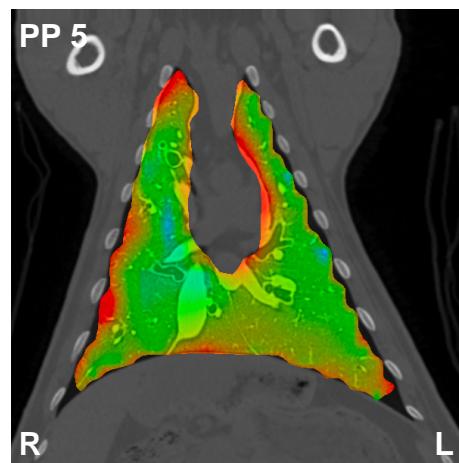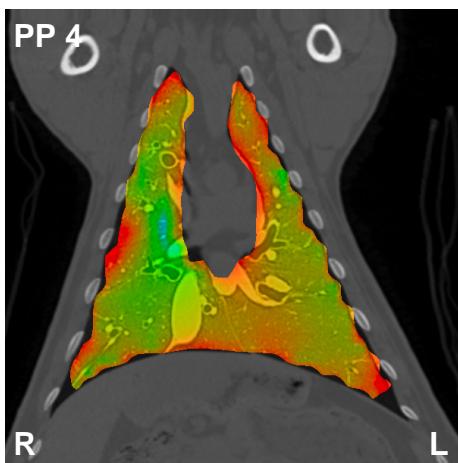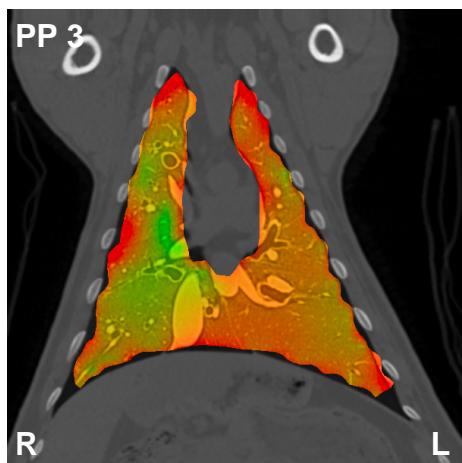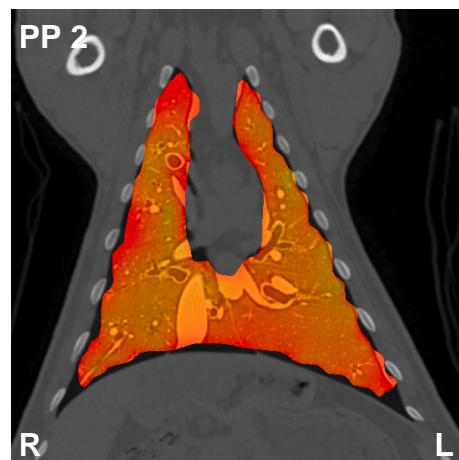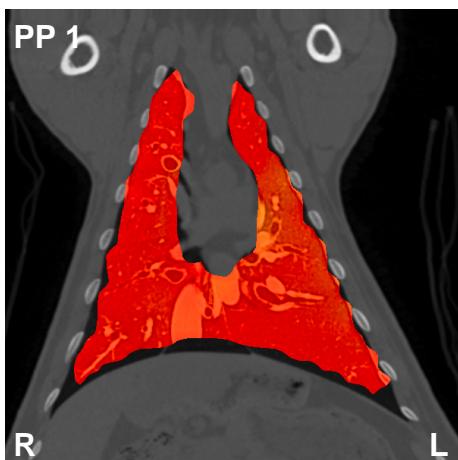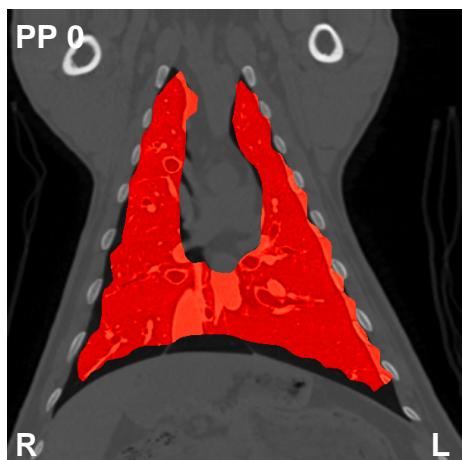

CT Acquisition Date: 20211007

Fluoro Acquisition Date: 20211007

Dataset: ATEAM-913-KG_72-PRE Build: dawson-m103 Config Version: v1.3.2