

Green Park Co-op Housing Society

Building: YUCCA · Tank: Overhead Tank 1

Society	Green Park Co-op Housing Society	Building	YUCCA
Tank	Overhead Tank 1	Generated	Tue, Sep 29, 2026, 22:10
Period	Last 7 days, Sep 22, 2026 - Sep 29, 2026	Device	ESP8266 NodeMCU, firmware 2.6.0, watertank-3f2a.local
Tank setup	1,000 L, empty at 120.0 cm, full at 25.0 cm		

SUMMARY

NOW

82%

motor off

LAST FILL

+275 L

Tue 18:30 · 20 min

EMPTY -> FULL TAKES

~ 1 h 12 min

average of 16 fills

MOTOR TODAY

36 min

2 fill(s) · 7-day avg 35 min

USED TODAY

476 L

yesterday 495 L

BUSIEST HOUR

08:00–09:00


57 L per day

LAST NIGHT


Possible leak

-31 L between 01:00–05:00

LEVEL HISTORY, LAST 7 DAYS

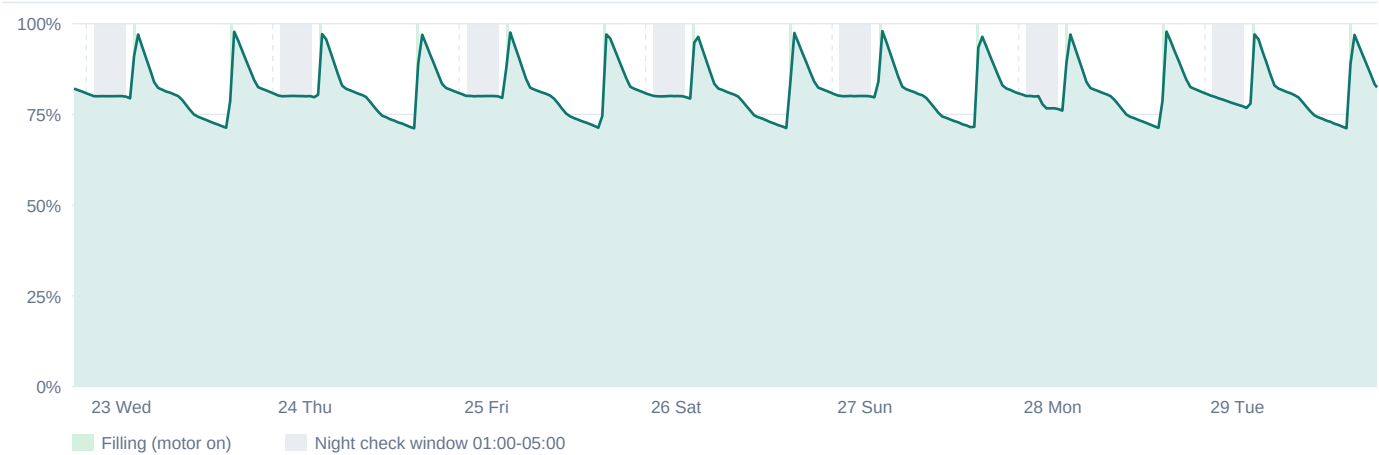


MOTOR RUN TIME PER DAY

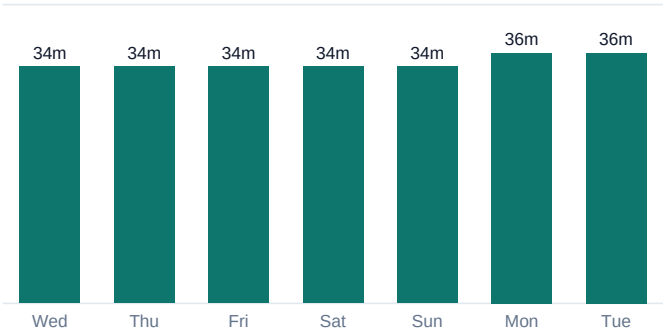


Total 4 h 02 min in 14 fills

WATER USED PER DAY

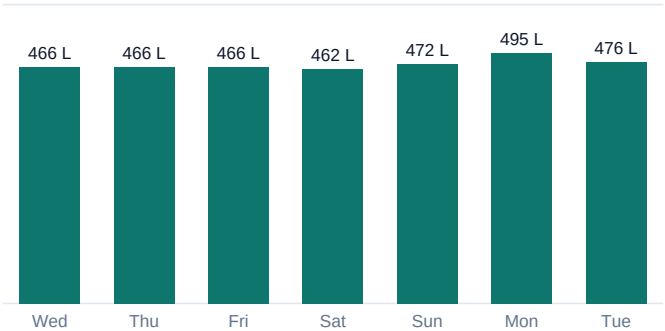

Total 3,303 L, average 472 L per day

USAGE BY HOUR OF DAY

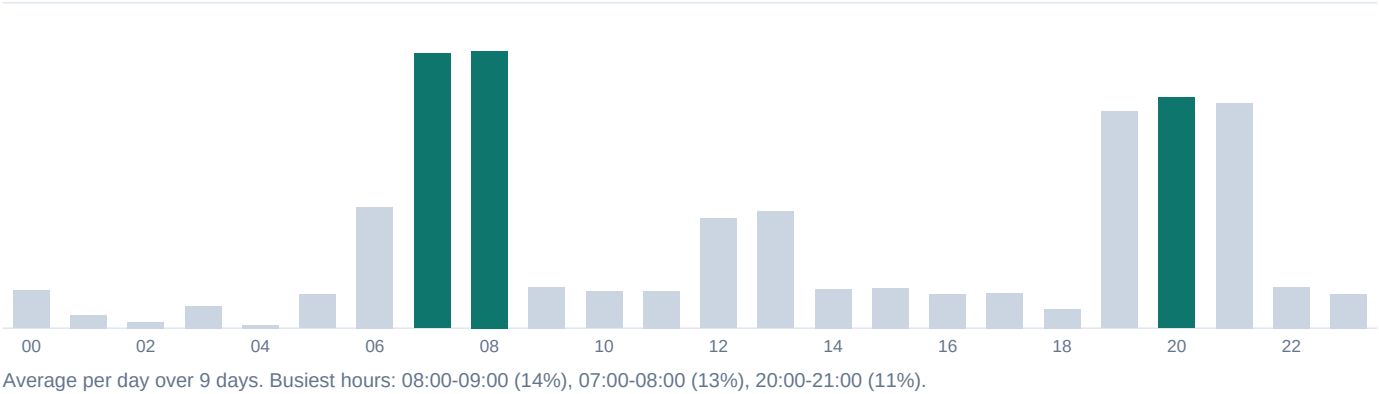

NIGHT LEAK CHECK

Night	Change	Per hour	Result
Tue, Sep 29	-31 L	8 L	Possible leak
Mon, Sep 28	-36 L	9 L	Water used (one drop)
Sun, Sep 27	-2 L	1 L	OK
Sat, Sep 26	+1 L	0 L	OK
Fri, Sep 25	-1 L	0 L	OK
Thu, Sep 24	+3 L	1 L	OK
Wed, Sep 23	+1 L	0 L	OK

Level change between 01:00 and 05:00. Possible leak: a steady drop of 1.5 cm (16 L) or more with no fill running. Water used (one drop): most of the drop within one hour, like a tap or flush.

RECENT FILLS (MOTOR RUNS)

Started	Duration	Added	Rise speed
Tue, Sep 29, 2026, 18:30	20 min	+275 L	1.31 cm/min
Tue, Sep 29, 2026, 06:00	16 min	+222 L	1.32 cm/min
Mon, Sep 28, 2026, 18:30	20 min	+275 L	1.31 cm/min
Mon, Sep 28, 2026, 06:00	16 min	+226 L	1.34 cm/min
Sun, Sep 27, 2026, 18:30	20 min	+275 L	1.31 cm/min
Sun, Sep 27, 2026, 06:00	14 min	+193 L	1.31 cm/min
Sat, Sep 26, 2026, 18:30	20 min	+275 L	1.31 cm/min
Sat, Sep 26, 2026, 06:00	14 min	+193 L	1.31 cm/min
Fri, Sep 25, 2026, 18:30	20 min	+275 L	1.31 cm/min
Fri, Sep 25, 2026, 06:00	14 min	+193 L	1.31 cm/min

HOW THESE NUMBERS ARE CALCULATED

- Level is measured by the ultrasonic sensor and recorded every 2 minutes.
- Filling (motor on): the level rises faster than 0.5 cm/min. Fills under 3 minutes or 3 cm are ignored. Every fill is counted as the motor.
- Water used: level drops outside fills, ignoring changes smaller than the sensor noise.
- Litres use the tank capacity of 1,000 L and assume straight tank walls.