

NIST Special Publication 1019-5

# Fire Dynamics Simulator (Version 5) User's Guide

Kevin McGrattan  
Bryan Klein  
Simo Hostikka  
Jason Floyd

In cooperation with:  
VTT Technical Research Centre of Finland



NIST Special Publication 1019-5

# Fire Dynamics Simulator (Version 5) User's Guide

Kevin McGrattan

Bryan Klein

*NIST Building and Fire Research Laboratory  
Gaithersburg, Maryland, USA*

Simo Hostikka

*VTT Technical Research Centre of Finland  
Espoo, Finland*

Jason Floyd

*Hughes Associates, Inc.  
Baltimore, Maryland, USA*

September 17, 2008

FDS Version 5.2

*SVNRepository Revision : 2395*



U.S. Department of Commerce  
*Carlos M. Gutierrez, Secretary*

National Institute of Standards and Technology  
*James M. Turner, Acting Director*

Certain commercial entities, equipment, or materials may be identified in this document in order to describe an experimental procedure or concept adequately. Such identification is not intended to imply recommendation or endorsement by the National Institute of Standards and Technology, nor is it intended to imply that the entities, materials, or equipment are necessarily the best available for the purpose.

**National Institute of Standards and Technology Special Publication 1019-5**  
**Natl. Inst. Stand. Technol. Spec. Publ. 1019-5, 190 pages (October 2007)**  
**CODEN: NSPUE2**

U.S. GOVERNMENT PRINTING OFFICE  
WASHINGTON: 2007

---

For sale by the Superintendent of Documents, U.S. Government Printing Office  
Internet: [bookstore.gpo.gov](http://bookstore.gpo.gov) – Phone: (202) 512-1800 – Fax: (202) 512-2250  
Mail: Stop SSOP, Washington, DC 20402-0001

# Preface

This Guide describes how to use the Fire Dynamics Simulator (FDS). Most of the content pertains to version 5, although some features have been added since the release of FDS 5.0. The current version is 5.2.

Note that this Guide does not provide the background theory for FDS. A three volume set of companion documents, referred to collectively as the FDS Technical Reference Guide [1], contains details about the governing equations and numerical methods, model verification, and experimental validation. The FDS User's Guide contains limited information on how to operate Smokeview, the companion visualization program for FDS. Its full capability is described in the "User's Guide for Smokeview Version 5" [2].



# Disclaimer

The US Department of Commerce makes no warranty, expressed or implied, to users of the Fire Dynamics Simulator (FDS), and accepts no responsibility for its use. Users of FDS assume sole responsibility under Federal law for determining the appropriateness of its use in any particular application; for any conclusions drawn from the results of its use; and for any actions taken or not taken as a result of analyses performed using these tools.

Users are warned that FDS is intended for use only by those competent in the fields of fluid dynamics, thermodynamics, combustion, and heat transfer, and is intended only to supplement the informed judgment of the qualified user. The software package is a computer model that may or may not have predictive capability when applied to a specific set of factual circumstances. Lack of accurate predictions by the model could lead to erroneous conclusions with regard to fire safety. All results should be evaluated by an informed user.

Throughout this document, the mention of computer hardware or commercial software does not constitute endorsement by NIST, nor does it indicate that the products are necessarily those best suited for the intended purpose.





# About the Authors

**Kevin McGrattan** is a mathematician in the Building and Fire Research Laboratory of NIST. He received a bachelors of science degree from the School of Engineering and Applied Science of Columbia University in 1987 and a doctorate at the Courant Institute of New York University in 1991. He joined the NIST staff in 1992 and has since worked on the development of fire models, most notably the Fire Dynamics Simulator.

**Simo Hostikka** is a Senior Research Scientist at VTT Technical Research Centre of Finland. He received a master of science (technology) degree in 1997 and a doctorate in 2008 from the Department of Engineering Physics and Mathematics of the Helsinki University of Technology. He is the principal developer of the radiation and solid phase sub-models within FDS.

**Jason Floyd** is a Senior Engineer at Hughes Associates, Inc., in Baltimore, Maryland. He received a bachelors of science degree and a doctorate from the Nuclear Engineering Program of the University of Maryland. After graduating, he won a National Research Council Post-Doctoral Fellowship at the Building and Fire Research Laboratory of NIST, where he developed the combustion algorithm within FDS. He is currently funded by NIST under grant 60NANB5D1205 from the Fire Research Grants Program (15 USC 278f). He is the principal developer of the multi-parameter mixture fraction combustion model and control logic within FDS.

**Bryan Klein** is an Information Technology Specialist in the Building and Fire Research Laboratory of NIST. Before coming to NIST, Bryan worked for five years with Western Fire Center, Inc., performing a wide range of activities including fire modeling, data acquisition programming, and quantitative fire measurements. His current focus is on FDS development and user support, along with experimental model validation work.



# Acknowledgments

The Fire Dynamics Simulator, in various forms, has been under development for almost 25 years. However, the publicly released software has only existed since 2000. Since its first release, continued improvements have been made to the software based largely on feedback from its users. Included here are some who made important contributions.

At NIST, thanks to Dan Madrzykowski, Doug Walton, Bob Vettori, Dave Stroup, Steve Kerber and Nelson Bryner, who have used FDS and Smokeview as part of several investigations of fire fighter line of duty deaths. As part of these studies, they have provided valuable information on the model's usability and accuracy when compared to large scale measurements made during fire reconstructions.

The US Nuclear Regulatory Commission has provided financial support for the maintenance and development of FDS, along with valuable insights into how fire models are used as part of probabilistic risk assessments of nuclear facilities. Special thanks to Mark Salley and Jason Dreisbach of NRC, and Francisco Joglar of SAIC.

The Society of Fire Protection Engineers (SFPE) sponsors a training course on the use of FDS and Smokeview. Chris Wood of ArupFire, Dave Sheppard of the US Bureau of Alcohol, Tobacco and Firearms (ATF), and Doug Carpenter of Combustion Science and Engineering developed the materials for the course, along with Morgan Hurley of the SFPE.

Prof. David McGill of Seneca College, Ontario, Canada has conducted a remote-learning course on the use of FDS, and he has also maintained a web site that has provided valuable suggestions from users.

Prof. Ian Thomas of Victoria University has also presented short courses on the use of FDS in Australia. His students have also performed some validation work on compartment fires.

Prof. Charles Fleischmann and his students at the University of Canterbury, New Zealand, have provided valuable assistance in improving the documentation and usability of the model.

James White Jr. of the Western Fire Center has provided valuable feedback on how to improve the functionality of the model in the area of forensic science.

Paul Hart of Swiss Re, GAP Services, and Pravinray Gandhi of Underwriters Laboratories provided useful suggestions about water droplet transport on solid objects.

Finally, on the following pages is a list of individuals and organizations who have volunteered their time and effort to "beta test" FDS and Smokeview prior to its official release. Their contribution is invaluable because there is simply no other way to test all of the various features of the model.

| <b>FDS 5 Beta Testers</b> |   |
|---------------------------|---|
| Nick Agnew                | Maunsell, Australia   |
| Camille Azzi              | Universities of Glasgow and Strathclyde, Scotland                         |
| Matthew Bilson            | Maunsell, Australia   |
| George Braga              | Federal District Fire Department, Brazil                                  |
| Keith Calder              | Senez Reed Calder Engineering, Canada                                     |
| Steven Chi Heng Lam       | Hoare Lea Fire Engineering, UK  |
| Doo Chan Choi             | Rolf Jensen & Associates, Inc., USA                                       |
| Marco Cigolini            | Italferr spa, Italy   |
| John Cutonilli            | Hughes Associates, Inc., USA  |
| Sylvain Desanghere        | CTICM (Centre Technique Industriel de la Construction Métallique), France |
| Montu L. Das              | Gage-Babcock & Associates, USA and Canada                                 |
| Franck Didieux            | Laboratoire National de Métrologie et d'Essais (LNE), France              |
| Johannes Dimyadi          | AstraVision-Solutions, New Zealand  |
| Bill Ferrante             | Roosevelt Fire District, USA  |
| Paul Fuss                 | NIST, USA   |
| Ralf Galster              | Ing. Büro für Brandschutz Riesener, Germany                               |
| Andreas Gerndt            | University of Louisiana, USA  |
| Emanuele Gissi            | Corpo Nazionale dei Vigili del Fuoco, Comando Prov. di Genova, Italy      |
| Simon J. Ham              | Fire Safety Engineering Consultants Ltd., UK                              |
| Paul Hart                 | Swiss Re, GAP Services, USA   |
| Hsiao, Li Kai (Gary)      | Fire Bureau, Taipei, Taiwan   |
| Hu Zhi-Xin                | University of Maryland, USA   |
| Ilya N. Karkin            | SITIS Ltd., Russia  |
| Susanne Kilian            | hhpberlin, Fire Safety Engineers, Germany                                 |
| Sung Chan Kim             | School of Mechanical Engineering, Chung Ang University, Korea             |
| Pierre-Louis Lamballais   | Flashover-Backdraft, France   |
| A. Leonardi               | StIL (Studio di Ingegneria Leonardi), Italy                               |
| Davy Leroy                | Arup Fire, UK   |
| Yunlong Liu               | Parsons Brinckerhof, Australia  |
| Timothy Liu               | Locke Carey Fire Consultants, UK  |
| Dave McGill               | Seneca College, Ontario, Canada   |
| Ken Miller                | Las Vegas Fire & Rescue, USA  |
| Stephan B. Miller         | Mr. 3D Computer Graphics and the University of Houston Downtown, USA      |
| Pete Muir                 | Safe Consulting, UK   |
| Stephen Olenick           | Combustion Science & Engineering, Inc., USA                               |
| Kristopher Overholt       | University of Houston Downtown, USA                                       |
| PENG Wei                  | State Key Laboratory of Fire Science, China                               |
| Andrew Purchase           | Maunsell, Australia   |
| Christian Rogsch          | University of Wuppertal, Germany  |
| Michael Roth              | RWDI, Canada  |
| Ahmed Salem               | Alexandria University, Egypt  |
| Robert Schmidt            | Combustion Science & Engineering, Inc., USA                               |
| Joe Skaggs                | CASE Forensics, USA   |
| Piotr Smardz              | Ahearne Fire Engineering Consultants, Ireland                             |

|                       |  |
|-----------------------|--|
| Jamie Stern-Gottfried | Arup Fire, UK  |
| Boris Stock           | BFT Cognos GmbH, Germany                                     |
| Blair Stratton        | Beca, New Zealand  |
| Csaba Szilagyi        | Szolnok Fire Department, Hungary                             |
| Mahmood Tabaddor      | Underwriters Laboratories, USA                               |
| Charlie Thornton      | Thunderhead Engineering, USA                                 |
| Sebastian Ukleja      | University of Ulster, Northern Ireland                       |
| Giacomo Villi         | Dipartimento Fisica Tecnica (DfT) UNIPd, Italy               |
| Andreas Vischer       | RWTH Aachen University, Germany                              |
| Karl Wallasch         | Hoare Lea Fire Engineering, UK                               |
| Kaoru Wakatsuki       | National Research Institute of Fire and Disaster, Japan      |
| Joachim Wollstädt     | Ing. Büro für Brandschutz Riesener, Germany                  |
| Yang Shan-You         | State Key Laboratory of Fire Science, China                  |
| Matthias Zähringer    | Ing. Büro für Brandschutz Riesener, Germany                  |
| Robin Zevotek         | C&S Engineers, Life Safety Services, Syracuse, New York, USA |
|                       | GIDAI, University of Cantabria, Spain                        |



# Contents

|  |            |
|--|------------|
| <b>Preface</b>   | <b>i</b>   |
| <b>Disclaimer</b>  | <b>iii</b> |
| <b>About the Authors</b>   | <b>v</b>   |
| <b>Acknowledgments</b>   | <b>vii</b> |
| <br>   |            |
| <b>I Running FDS</b>   | <b>1</b>   |
| <br>   |            |
| <b>1 Introduction</b>  | <b>3</b>   |
| 1.1 Features of FDS . . . . .  | 3          |
| 1.2 What's New in FDS 5? . . . . .                                       | 4          |
| <br>   |            |
| <b>2 Getting Started</b>   | <b>7</b>   |
| 2.1 How to Acquire FDS and Smokeview . . . . .                           | 7          |
| 2.2 Computer Hardware Requirements . . . . .                             | 7          |
| 2.3 Computer Operating System (OS) and Software Requirements . . . . .   | 8          |
| <br>   |            |
| <b>3 Running FDS</b>   | <b>9</b>   |
| 3.1 Starting an FDS Calculation . . . . .                                | 9          |
| 3.1.1 Starting an FDS Calculation (Single Processor Version) . . . . .   | 9          |
| 3.1.2 Starting an FDS Calculation (Multiple Processor Version) . . . . . | 10         |
| 3.2 Monitoring Progress . . . . .  | 12         |
| <br>   |            |
| <b>4 User Support</b>  | <b>13</b>  |
| 4.1 The Version Number . . . . .   | 13         |
| 4.2 Common Error Statements . . . . .                                    | 14         |
| 4.3 Support Requests and Bug Tracking . . . . .                          | 15         |
| <br>   |            |
| <b>II Writing an FDS Input File</b>                                      | <b>17</b>  |
| <br>   |            |
| <b>5 The Basic Structure of an Input File</b>                            | <b>19</b>  |
| 5.1 Naming the Job . . . . .   | 19         |
| 5.2 Namelist Formatting . . . . .  | 19         |
| 5.3 Input File Structure . . . . .                                       | 20         |

|          |   |           |
|----------|---|-----------|
| <b>6</b> | <b>Setting the Bounds of Time and Space</b>   | <b>23</b> |
| 6.1      | Naming the Job: The <code>HEAD</code> Namelist Group (Table 13.6)   | 23        |
| 6.2      | Simulation Time: The <code>TIME</code> Namelist Group (Table 13.24)   | 23        |
| 6.3      | Computational Meshes: The <code>MESH</code> Namelist Group (Table 13.11)  | 25        |
| 6.3.1    | Two-Dimensional and Axially-Symmetric Calculations  | 25        |
| 6.3.2    | Multiple Meshes and Parallel Processing   | 26        |
| 6.3.3    | Mesh Alignment  | 27        |
| 6.3.4    | Mesh Stretching: The <code>TRNX</code> , <code>TRNY</code> and/or <code>TRNZ</code> Namelist Groups (Table 13.25) | 29        |
| 6.3.5    | Choosing the Right Mesh Dimensions  | 31        |
| 6.4      | Miscellaneous Parameters: The <code>MISC</code> Namelist Group (Table 13.12)                                      | 32        |
| 6.4.1    | Stopping and Restarting Calculations  | 33        |
| 6.4.2    | Special Topic: Defying Gravity  | 33        |
| 6.4.3    | Special Topic: Improving the Pressure Solver  | 34        |
| 6.4.4    | Special Topic: Restoring the Baroclinic Vorticity   | 34        |
| 6.4.5    | Special Topic: Stack Effect   | 35        |
| 6.4.6    | Special Topic: Large Eddy Simulation Parameters   | 35        |
| 6.4.7    | Special Topic: Numerical Stability Parameters   | 35        |
| 6.5      | Special Topic: Unusual Initial Conditions: The <code>INIT</code> Namelist Group (Table 13.8)                      | 37        |
| 6.6      | Special Topic: Setting Limits: The <code>CLIP</code> Namelist Group (Table 13.2)                                  | 37        |
| <b>7</b> | <b>Building the Model</b>   | <b>39</b> |
| 7.1      | Creating Obstructions: The <code>OBST</code> Namelist Group (Table 13.13)   | 39        |
| 7.1.1    | Non-rectangular Geometry and Sloped Ceilings  | 40        |
| 7.2      | Creating Voids: The <code>HOLE</code> Namelist Group (Table 13.7)   | 41        |
| 7.3      | Applying Surface Properties: The <code>VENT</code> Namelist Group (Table 13.26)                                   | 42        |
| 7.3.1    | Special <code>VENTs</code>  | 43        |
| 7.3.2    | Controlling <code>VENTs</code>  | 44        |
| 7.3.3    | Trouble-Shooting <code>VENTs</code>   | 44        |
| <b>8</b> | <b>Boundary Conditions</b>  | <b>45</b> |
| 8.1      | Basics  | 45        |
| 8.2      | Describing the Bounding Surfaces: The <code>SURF</code> Namelist Group (Table 13.22)                              | 46        |
| 8.2.1    | Specifying a Fire with a Known Heat Release Rate  | 46        |
| 8.2.2    | Simple Thermal Boundary Conditions  | 47        |
| 8.2.3    | Fans and other Velocity Boundary Conditions   | 47        |
| 8.2.4    | Species and Species Mass Flux Boundary Conditions   | 49        |
| 8.2.5    | Special Topic: Pressure Boundary Conditions   | 50        |
| 8.2.6    | Special Topic: Fires and Flows in the Outdoors  | 50        |
| 8.2.7    | Special Topic: A Radially-Spreading Fire  | 51        |
| 8.2.8    | Special Topic: Non-Planar Walls and Targets   | 51        |
| 8.3      | Pressure-Related Effects: The <code>ZONE</code> Namelist Group (Table 13.26)                                      | 53        |
| 8.3.1    | Leaks   | 53        |
| 8.3.2    | Fan Curves  | 54        |
| 8.4      | Describing Real Materials: The <code>MATL</code> Namelist Group   | 56        |
| 8.4.1    | Thermal Properties  | 57        |
| 8.4.2    | Pyrolysis Models  | 57        |
| 8.4.3    | Special topic: Yields of Gaseous Species ( <code>NU_GAS</code> )  | 61        |
| 8.4.4    | Special topic: Making Fuels Disappear ( <code>BURN_AWAY</code> )  | 62        |



|           |   |           |
|-----------|---|-----------|
| 8.4.5     | Special Topic: Initial and Backside Boundary Conditions . . . . .                     | 63        |
| 8.4.6     | Special Topic: Numerical Accuracy and Stability . . . . .                             | 63        |
| 8.5       | User-Specified Functions: The RAMP and TABL Namelist Groups . . . . .                 | 64        |
| 8.5.1     | Time-Dependent Functions . . . . .  | 64        |
| 8.5.2     | Temperature-Dependent Functions . . . . .   | 65        |
| 8.5.3     | Tabular Functions . . . . .   | 66        |
| 8.6       | Coloring Obstructions, Vents, Surfaces and Meshes . . . . .                           | 67        |
| 8.6.1     | Texture Mapping . . . . .   | 67        |
| <b>9</b>  | <b>Combustion and Radiation</b>   | <b>69</b> |
| 9.1       | Mixture Fraction Combustion: The REAC Namelist Group . . . . .                        | 69        |
| 9.1.1     | The Basics . . . . .  | 69        |
| 9.1.2     | Special Topic: Heat of Combustion . . . . .   | 71        |
| 9.1.3     | Special Topic: Flame Extinction . . . . .   | 72        |
| 9.1.4     | Special Topic: CO Production . . . . .  | 72        |
| 9.1.5     | Special Topic: Turbulent Combustion . . . . .   | 72        |
| 9.2       | Extra Gas Species: The SPEC Namelist Group . . . . .                                  | 74        |
| 9.3       | Finite-Rate Combustion . . . . .  | 76        |
| 9.4       | Radiation Transport: The RAD I Namelist Group . . . . .                               | 77        |
| <b>10</b> | <b>Particles and Droplets: The PART Namelist Group</b>                                | <b>79</b> |
| 10.1      | Basics . . . . .  | 79        |
| 10.2      | Controlling Particles and Droplets . . . . .  | 80        |
| 10.3      | Particle and Droplet Properties . . . . .   | 81        |
| 10.4      | Special Types of Particles and Droplets . . . . .                                     | 82        |
| 10.5      | Coloring Particles and Droplets . . . . .   | 83        |
| 10.6      | Special Topic: Droplet Fuel Sprays . . . . .  | 83        |
| 10.7      | Special Topic: Suppression by Water (Mixture Fraction Model Only) . . . . .           | 84        |
| <b>11</b> | <b>Devices and Control Logic</b>  | <b>87</b> |
| 11.1      | Device Location and Orientation: The DEVC Namelist Group (Table 13.4) . . . . .       | 87        |
| 11.2      | Device Output . . . . .   | 88        |
| 11.3      | Special Devices and their Properties: The PROP Namelist Group (Table 13.16) . . . . . | 88        |
| 11.3.1    | Sprinklers . . . . .  | 88        |
| 11.3.2    | Nozzles . . . . .   | 90        |
| 11.3.3    | Heat Detectors . . . . .  | 91        |
| 11.3.4    | Smoke Detectors . . . . .   | 91        |
| 11.3.5    | Beam Detection Systems . . . . .  | 92        |
| 11.3.6    | Aspiration Detection Systems . . . . .  | 92        |
| 11.4      | Basic Control Logic . . . . .   | 94        |
| 11.4.1    | Creating and Removing Obstructions . . . . .  | 94        |
| 11.4.2    | Activating and Deactivating Vents . . . . .   | 95        |
| 11.5      | Advanced Control Functions: The CTRL Namelist Group . . . . .                         | 96        |
| 11.5.1    | Control Functions: ANY, ALL, ONLY, and AT_LEAST . . . . .                             | 96        |
| 11.5.2    | Control Function: TIME_DELAY . . . . .  | 97        |
| 11.5.3    | Control Function: DEADBAND . . . . .  | 97        |
| 11.5.4    | Control Function: RESTART and KILL . . . . .  | 98        |
| 11.5.5    | Control Function: CUSTOM . . . . .  | 98        |

|           |   |            |
|-----------|---|------------|
| 11.5.6    | Combining Control Functions: A Pre-Action Sprinkler System . . . . .      | 99         |
| 11.5.7    | Combining Control Functions: A Dry Pipe Sprinkler System . . . . .        | 99         |
| <b>12</b> | <b>Output Data</b>  | <b>101</b> |
| 12.1      | Output Control Parameters: The DUMP Namelist Group . . . . .              | 101        |
| 12.2      | Output File Types . . . . .   | 103        |
| 12.2.1    | Device Output: The DEVC Namelist Group . . . . .                          | 103        |
| 12.2.2    | Quantities within Solids: The PROF Namelist Group . . . . .               | 104        |
| 12.2.3    | Animated Planar Slices: The SLCF Namelist Group . . . . .                 | 104        |
| 12.2.4    | Animated Boundary Quantities: The BNDF Namelist Group . . . . .           | 105        |
| 12.2.5    | Animated Isosurfaces: The ISOF Namelist Group . . . . .                   | 105        |
| 12.2.6    | Plot3D Static Data Dumps . . . . .  | 105        |
| 12.2.7    | SMOKE3D: Realistic Smoke and Fire . . . . .                               | 106        |
| 12.3      | Special Output Quantities . . . . .                                       | 107        |
| 12.3.1    | Heat Release Rate . . . . .   | 107        |
| 12.3.2    | Visibility and Obscuration . . . . .                                      | 108        |
| 12.3.3    | Layer Height and the Average Upper and Lower Layer Temperatures . . . . . | 108        |
| 12.3.4    | The True Gas Temperature vs. the Measured Gas Temperature . . . . .       | 109        |
| 12.3.5    | Heat Fluxes and Thermal Radiation . . . . .                               | 109        |
| 12.3.6    | Droplet Output Quantities . . . . .                                       | 110        |
| 12.3.7    | Interfacing with Structural Models . . . . .                              | 110        |
| 12.3.8    | Useful Solid Phase Outputs . . . . .                                      | 111        |
| 12.3.9    | Spatially-Integrated Outputs . . . . .                                    | 111        |
| 12.3.10   | Wind and the Pressure Coefficient . . . . .                               | 113        |
| 12.4      | Extracting Numbers from the Output Data Files . . . . .                   | 114        |
| 12.5      | Summary of Output Quantities . . . . .                                    | 115        |
| <b>13</b> | <b>Alphabetical List of Input Parameters</b>                              | <b>119</b> |
| 13.1      | BNDF (Boundary File Parameters) . . . . .                                 | 120        |
| 13.2      | CLIP (MIN/MAX Clipping Parameters) . . . . .                              | 120        |
| 13.3      | CTRL (Control Function Parameters) . . . . .                              | 120        |
| 13.4      | DEVC (Device Parameters) . . . . .  | 121        |
| 13.5      | DUMP (Output Parameters) . . . . .  | 121        |
| 13.6      | HEAD (Header Parameters) . . . . .  | 122        |
| 13.7      | HOLE (Obstruction Cutout Parameters) . . . . .                            | 122        |
| 13.8      | INIT (Initial Conditions) . . . . .                                       | 123        |
| 13.9      | ISOF (Isosurface Parameters) . . . . .                                    | 123        |
| 13.10     | MATL (Material Properties) . . . . .                                      | 123        |
| 13.11     | MESH (Mesh Parameters) . . . . .  | 124        |
| 13.12     | MISC (Miscellaneous Parameters) . . . . .                                 | 124        |
| 13.13     | OBST (Obstruction Parameters) . . . . .                                   | 126        |
| 13.14     | PART (Lagrangian Particles/Droplets) . . . . .                            | 126        |
| 13.15     | PROF (Wall Profile Parameters) . . . . .                                  | 127        |
| 13.16     | PROP (Device Properties) . . . . .  | 127        |
| 13.17     | RADI (Radiation Parameters) . . . . .                                     | 128        |
| 13.18     | RAMP (Ramp Function Parameters) . . . . .                                 | 129        |
| 13.19     | REAC (Reaction Parameters) . . . . .                                      | 129        |
| 13.20     | SLCF (Slice File Parameters) . . . . .                                    | 130        |

|            |  |            |
|------------|--|------------|
| 13.21      | SPEC (Species Parameters)  | 130        |
| 13.22      | SURF (Surface Properties)  | 131        |
| 13.23      | TABL (Table Parameters)  | 132        |
| 13.24      | TIME (Time Parameters)   | 132        |
| 13.25      | TRNX, TRNY, TRNZ (MESH Transformations)  | 133        |
| 13.26      | VENT (Vent Parameters)   | 133        |
| 13.27      | ZONE (Pressure Zone Parameters)  | 134        |
| <b>14</b>  | <b>Conversion of Old Input Files to FDS 5</b>                                    | <b>135</b> |
| 14.1       | Numerical Domain Parameters: GRID and PDIM                                       | 135        |
| 14.2       | Obstructions, Vents, and Holes: OBST, VENT, and HOLE                             | 135        |
| 14.3       | Surface Parameters: SURF   | 135        |
| 14.4       | Reaction Parameters: REAC  | 136        |
| 14.5       | Device Parameters: SPRK, SMOD, HEAT, THCP  | 137        |
| <b>III</b> | <b>Sample Calculations</b>   | <b>139</b> |
| <b>15</b>  | <b>Basic Hydrodynamics</b>   | <b>141</b> |
| 15.1       | Axially-Symmetric Helium Plume ( <b>helium_2d</b> )                              | 141        |
| 15.2       | Sawtooth ( <b>sawtooth</b> )   | 142        |
| 15.3       | Pressure Boundaries ( <b>pressure_boundary</b> )                                 | 143        |
| <b>16</b>  | <b>Thermodynamics</b>  | <b>145</b> |
| 16.1       | Pressure Rise in a Sealed Enclosure ( <b>pressure_rise</b> )                     | 146        |
| 16.2       | Leaks and Fans in a Sealed Enclosure ( <b>leak_test</b> and <b>leak_test_2</b> ) | 147        |
| 16.3       | Fan Curves ( <b>fan_test</b> )   | 148        |
| 16.4       | Stack Effect ( <b>stack_effect</b> )   | 149        |
| <b>17</b>  | <b>Combustion</b>  | <b>151</b> |
| 17.1       | A Simple Under-Ventilated Compartment Fire ( <b>door_crack</b> )                 | 151        |
| 17.2       | Testing the “Burn-Away” Feature ( <b>box_burn_away</b> )                         | 152        |
| <b>18</b>  | <b>Detectors</b>   | <b>153</b> |
| 18.1       | Aspiration Detector ( <b>beam_detector</b> )                                     | 153        |
| 18.2       | Aspiration Detector ( <b>aspiration_detector</b> )                               | 154        |
| <b>19</b>  | <b>Droplets and Sprays</b>   | <b>155</b> |
| 19.1       | Water Droplet Evaporation ( <b>water_evaporation</b> )                           | 155        |
| 19.2       | Measuring Water Flux ( <b>bucket_test</b> )                                      | 156        |
| 19.3       | Complex Spray Patterns ( <b>bucket_test_2</b> )                                  | 157        |
| <b>20</b>  | <b>General Functionality</b>   | <b>159</b> |
| 20.1       | Creating and Removing HOLES and OBSTructions ( <b>create_remove</b> )            | 159        |
| <b>21</b>  | <b>Materials</b>   | <b>161</b> |
| 21.1       | Testing Solid Phase Properties   | 161        |
| 21.2       | Pyrolysis Samples  | 163        |
| 21.2.1     | A Simple Thermoplastic ( <b>thermoplastic</b> )                                  | 163        |

|  |                |
|--|----------------|
| 21.2.2 A Charring Solid ( <b>charring_solid</b> ) . . . . .          | 165            |
| <b>22 Sample Fires</b>   | <b>167</b>     |
| 22.1 A Couch Fire ( <b>couch</b> ) . . . . .                         | 168            |
| 22.2 Flame Spread along a Cable Tray ( <b>cable_tray</b> ) . . . . . | 169            |
| 22.3 A Liquid Fuel Spray Burner ( <b>spray_burner</b> ) . . . . .    | 170            |
| <br><b>IV Working with the FDS Source Code</b>                       | <br><b>173</b> |
| <b>23 Compiling FDS</b>  | <b>175</b>     |
| 23.1 FDS Source Code . . . . .                                       | 175            |
| <b>24 Output File Formats</b>  | <b>177</b>     |
| 24.1 Diagnostic Output . . . . .                                     | 177            |
| 24.2 Heat Release Rate and Related Quantities . . . . .              | 178            |
| 24.3 Device Output Data . . . . .                                    | 178            |
| 24.4 Control Output Data . . . . .                                   | 179            |
| 24.5 Gas Mass Data . . . . .   | 179            |
| 24.6 Mixture Fraction State Relations . . . . .                      | 179            |
| 24.7 Slice Files . . . . .   | 179            |
| 24.8 Plot3D Data . . . . .   | 180            |
| 24.9 Boundary Files . . . . .  | 181            |
| 24.10 Particle Data . . . . .  | 181            |
| 24.11 Profile Files . . . . .  | 182            |
| 24.12 3-D Smoke File Format . . . . .                                | 182            |
| 24.13 Isosurface File Format . . . . .                               | 183            |
| <br><b>Bibliography</b>  | <br><b>185</b> |
| <br><b>Index</b>   | <br><b>187</b> |

# List of Figures

|     |  |    |
|-----|--|----|
| 6.1 | An example of a multiple-mesh geometry. . . . .  | 26 |
| 6.2 | Rules concerning alignment of meshes. . . . .  | 28 |
| 6.3 | Piecewise-Linear Transformation. . . . .   | 29 |
| 6.4 | Polynomial Transformation. . . . .   | 29 |
| 8.1 | Fan curve corresponding to <code>VOLUME_FLUX=10</code> and <code>MAX_PRESSURE=500</code> . . . . . | 54 |



# List of Tables

|       |  |     |
|-------|--|-----|
| 5.1   | Namelist Group Reference Table . . . . .   | 22  |
| 8.1   | Sample of Color Definitions (A complete list is included on the website) . . . . . | 68  |
| 9.1   | Optional Gas Species . . . . .   | 75  |
| 11.1  | Suggested Values for Smoke Detector Model. . . . .                                 | 91  |
| 11.2  | Control function types for CTRL . . . . .  | 96  |
| 12.1  | Summary of all Output Quantities . . . . .   | 116 |
| 13.1  | Boundary File Parameters . . . . .   | 120 |
| 13.2  | MIN/MAX Clipping Parameters . . . . .  | 120 |
| 13.3  | Control Function Parameters . . . . .  | 120 |
| 13.4  | Device Parameters . . . . .  | 121 |
| 13.5  | Output Parameters . . . . .  | 121 |
| 13.6  | Header Parameters . . . . .  | 122 |
| 13.7  | Obstruction Cutout Parameters . . . . .  | 122 |
| 13.8  | Initial Conditions . . . . .   | 123 |
| 13.9  | Isosurface Parameters . . . . .  | 123 |
| 13.10 | Material Properties . . . . .  | 123 |
| 13.11 | Mesh Parameters . . . . .  | 124 |
| 13.12 | Miscellaneous Parameters . . . . .   | 124 |
| 13.13 | Obstruction Parameters . . . . .   | 126 |
| 13.14 | Lagrangian Particles/Droplets . . . . .  | 126 |
| 13.15 | Wall Profile Parameters . . . . .  | 127 |
| 13.16 | Device Properties . . . . .  | 127 |
| 13.17 | Radiation Parameters . . . . .   | 128 |
| 13.18 | Ramp Function Parameters . . . . .   | 129 |
| 13.19 | Reaction Parameters . . . . .  | 129 |
| 13.20 | Slice File Parameters . . . . .  | 130 |
| 13.21 | Species Parameters . . . . .   | 130 |
| 13.22 | Surface Properties . . . . .   | 131 |
| 13.23 | Table Parameters . . . . .   | 132 |
| 13.24 | Time Parameters . . . . .  | 132 |
| 13.25 | MESH Transformations . . . . .   | 133 |
| 13.26 | Vent Parameters . . . . .  | 133 |
| 13.27 | Pressure Zone Parameters . . . . .   | 134 |

23.1 Source Code Files . . . . . 176



**Part I**

**Running FDS**



# Chapter 1

## Introduction

The software described in this document, Fire Dynamics Simulator (FDS), is a computational fluid dynamics (CFD) model of fire-driven fluid flow. FDS solves numerically a form of the Navier-Stokes equations appropriate for low-speed, thermally-driven flow with an emphasis on smoke and heat transport from fires. The formulation of the equations and the numerical algorithm are contained the FDS Technical Reference Guide [1].

Smokeyview is a separate visualization program that is used to display the results of an FDS simulation. A detailed description of Smokeyview is found in the *User's Guide for Smokeyview Version 5* [2].

### 1.1 Features of FDS

The first version of FDS was publicly released in February 2000. To date, about half of the applications of the model have been for design of smoke handling systems and sprinkler/detector activation studies. The other half consist of residential and industrial fire reconstructions. Throughout its development, FDS has been aimed at solving practical fire problems in fire protection engineering, while at the same time providing a tool to study fundamental fire dynamics and combustion.

**Hydrodynamic Model** FDS solves numerically a form of the Navier-Stokes equations appropriate for low-speed, thermally-driven flow with an emphasis on smoke and heat transport from fires. The core algorithm is an explicit predictor-corrector scheme, second order accurate in space and time. Turbulence is treated by means of the Smagorinsky form of Large Eddy Simulation (LES). It is possible to perform a Direct Numerical Simulation (DNS) if the underlying numerical mesh is fine enough. LES is the default mode of operation.

**Combustion Model** For most applications, FDS uses a single step chemical reaction whose products are tracked via a two-parameter mixture fraction model. The mixture fraction is a conserved scalar quantity that represents the mass fraction of one or more components of the gas at a given point in the flow field. By default, two components of the mixture fraction are explicitly computed. The first is the mass fraction of unburned fuel and the second is the mass fraction of burned fuel (*i.e.* the mass of the combustion products that originated as fuel). A two-step chemical reaction with a three parameter mixture fraction decomposition can also be used with the first step being oxidation of fuel to carbon monoxide and the second step the oxidation of carbon monoxide to carbon dioxide. The three mixture fraction components for the two step reaction are unburned fuel, mass of fuel that has completed the first reaction step, and the mass of fuel that has completed the second reaction step. The mass fractions of all of the major reactants and products can be derived from the mixture fraction parameters by means of “state relations.” Lastly, a multiple-step finite rate model is also available.

**Radiation Transport** Radiative heat transfer is included in the model via the solution of the radiation transport equation for a gray gas, and in some limited cases using a wide band model. The equation is solved using a technique similar to finite volume methods for convective transport, thus the name given to it is the Finite Volume Method (FVM). Using approximately 100 discrete angles, the finite volume solver requires about 20 % of the total CPU time of a calculation, a modest cost given the complexity of radiation heat transfer. The absorption coefficients of the gas-soot mixtures are computed using RADCAL narrow-band model. Liquid droplets can absorb and scatter thermal radiation. This is important in cases involving mist sprinklers, but also plays a role in all sprinkler cases. The absorption and scattering coefficients are based on Mie theory.

**Geometry** FDS approximates the governing equations on a rectilinear mesh. Rectangular obstructions are forced to conform with the underlying mesh.

**Multiple Meshes** This is a term used to describe the use of more than one rectangular mesh in a calculation. It is possible to prescribe more than one rectangular mesh to handle cases where the computational domain is not easily embedded within a single mesh.

**Parallel Processing** It is possible to run an FDS calculation on more than one computer using the Message Passing Interface (MPI). Details can be found in Section 3.1.2.

**Boundary Conditions** All solid surfaces are assigned thermal boundary conditions, plus information about the burning behavior of the material. Heat and mass transfer to and from solid surfaces is usually handled with empirical correlations, although it is possible to compute directly the heat and mass transfer when performing a Direct Numerical Simulation (DNS).

## 1.2 What's New in FDS 5?

FDS 5 differs from previous versions in its treatment of solid boundaries and gas phase combustion. Among the more important changes are:

**Multi-Step Combustion** Previous versions of FDS have assumed only one gas phase reaction. Now, multiple-step reaction schemes are available to describe local extinction, CO production, among various other phenomena. The most important improvements to the combustion model are a more accurate heat release rate calculation, and a better treatment of local flame extinction.

**Material Layers** Past versions of FDS have assumed that solid boundaries consist of a single homogenous layer. Now, solid boundaries can be modeled with multiple layers of materials, with each material specified via a new namelist group called `MATL`. This change makes past input files obsolete.

**Command Line Format** FDS is still run from the command line, but the syntax is slightly different than in previous versions. See Section 3 for details.

**Database** Previous versions of FDS used a separate “database” file to store material and reaction parameters. This file is no longer available, and now all parameters must be specified within the input file.

**Device Descriptions** The method used to describe a device and/or sensor (Sprinkler, Heat Detector, Thermocouple, etc.) has changed. See Section 11.1 for more information on defining devices and their properties. Any device can be used to control sprinkler activation and the creation and removal of vents or obstacles.

**Sprinklers** The external sprinkler files used in previous versions are no longer used. All information about sprinklers and other fire-specific devices are conveyed in the input file. Sprinklers are now defined with the new method of describing devices mentioned above. See Section 11.1 for more information.

**Control Functions** A new group of input parameters is available to describe functions that control sprinkler activation, the creation and removal of vents or obstacles, and code execution (termination or dumping of restart files). See Section 11.5 for details.

**Numerical Mesh** Previous versions of FDS used separate input groups to define the numerical grid and the computational domain. Now the two groups have been merged into a single, simplified MESH namelist group. Namelist groups PDIM and GRID shall no longer be used in the input file. See Section 6.3 for more detail.

**Pressure Zones** It is possible in FDS 5 to declare individual regions in the computational domain to have background pressures different from ambient, allowing for calculations of leakage, fan curves, and so forth. See Section 8.3 for more details.

**Stack Effect and Atmospheric Stratification** Improvements have been made to better characterize a stratified atmosphere and the movement of air in a tall building due to temperature differences between inside and outside.

**Adiabatic Surface Temperature** A new output quantity has been added to facilitate using FDS output in thermal and mechanical finite element models. See Section 8.2.2 for more information.

**Development, Distribution and Formal User Support** Starting with FDS 5, an online, open-source development environment is being used for configuration management (code archiving, revision tracking, bug fixes, user suggestions, and so on). See Section 2.1 for more information.

**FDS Verification and Validation Information** Starting with FDS 5, more emphasis has been placed on maintaining a permanent collection of Verification and Validation cases. This improves the quality of each FDS update and release, as a standard test suite will now be used to insure that changes made to the source code do not degrade FDS output. This also provides users with a standard data set to verify their own installation of FDS and to compare the results that FDS is returning on their system to published data.



## Chapter 2

# Getting Started

FDS is a computer program that solves equations that describe the evolution of fire. It is a Fortran program that reads input parameters from a text file, computes a numerical solution to the governing equations, and writes user-specified output data to files. Smokeview is a companion program that reads FDS output files and produces animations on the computer screen. Smokeview has a simple menu-driven interface. FDS does not. However, there are various third-party programs that have been developed to generate the text file containing the input parameters needed by FDS.

This guide describes how to obtain FDS and Smokeview and how to use FDS. A separate document [2] describes how to use Smokeview. Other tools related to FDS and Smokeview can be found at the web site.

### 2.1 How to Acquire FDS and Smokeview

Detailed instructions on how to download executables, manuals, source-code and related utilities, can be found on the FDS-SMV Website <http://fire.nist.gov/fds> for more information. The typical FDS/Smokeview distribution consists of an installation package or compressed archive, which is available for MS Windows, Mac OS X, and Linux. For other operating systems, consult the web site.

If you ever want to keep an older version of FDS and Smokeview, copy the installation directory to some other place so that it is not overwritten during the updated installation.

### 2.2 Computer Hardware Requirements

FDS requires a fast CPU and a substantial amount of random-access memory (RAM) to run efficiently. For minimum specifications, the system should have a 1 GHz CPU, and at least 512 MB RAM. The CPU speed will determine how long the computation will take to finish, while the amount of RAM will determine how many mesh cells can be held in memory. A large hard drive is required to store the output of the calculations. It is not unusual for the output of a single calculation to consume more than 1 GB of storage space.

Most computers purchased within the past few years are adequate for running Smokeview with the caveat that additional memory (RAM) should be purchased to bring the memory size up to at least 512 MB. This is so the computer can display results without “swapping” to disk. For Smokeview it is also important to obtain a fast graphics card for the PC used to display the results of the FDS computations.

For Multi-Mesh calculations, the MPI version of FDS will operate over standard 100 Mbps networks. A Gigabit or 1000 Mbps network will further reduce latency and improve data transfer rates between nodes.

## 2.3 Computer Operating System (OS) and Software Requirements

The goal of making FDS and Smokeview publicly available has been to enable practicing fire protection engineers to perform fairly sophisticated fire simulations at a reasonable cost. Thus, FDS and Smokeview have been designed for computers running Microsoft Windows, Mac OS X, and various implementations of Unix/Linux.

**MS Windows** An installation package is available for Windows operating system. It is not recommended to run FDS/Smokeview under any version of MS Windows released prior to Windows 2000.

**Mac OS X** A Mac OS X FDS .zip archive is available for both the PowerPC and Intel architectures. Mac OS X 10.4.x or better is recommended, versions of OS X prior to 10.4.x are not officially supported. Users can always download the latest version of FDS source and compile FDS for other versions of OS X (See Appendix 23 for details).

**Unix, Linux** Unix, Linux users can run FDS and Smokeview by downloading the appropriate pre-compiled executables and installing them wherever they see fit. If the pre-compiled FDS executable does not work (usually because of library incompatibilities), the FDS source code can be downloaded and compiled using a Fortran 90 and C compiler (See Appendix 23 for details). If Smokeview does not work on the Linux or Unix workstation, you should use a Windows or Mac PC to view FDS output.

**FDS in Parallel** For those wishing to run FDS in parallel, MPI (Message Passing Interface) must be installed on each of the computers within the network that will be used for FDS computations. Information about installing MPI on different computer platforms is given on the FDS website. See the Development section of the website for more information.



## Chapter 3

# Running FDS

This chapter describes the procedure to run an FDS calculation. The primary requirement for any calculation is an FDS input file. The creation of an input file is covered in detail in Part II. If you are new to FDS and Smokeview, it is strongly suggested that you start with an existing data file, run it as is, and then make the appropriate changes to the input file for the desired scenario. Sample input files are included as part of the standard installation. By running a sample case, you become familiar with the procedure, learn how to use Smokeview, and ensure that your computer is up to the task before embarking on learning how to create new input files.

### 3.1 Starting an FDS Calculation

FDS can be run from the command prompt, or with a third party Graphical User Interface (GUI). In the discussion to follow, it is assumed that FDS is being run from the command prompt. FDS can be run on a single computer, using only one CPU, or it can be run on multiple computers and use multiple CPUs. For any operating system, there are two FDS executable files. The single CPU Windows executable is called **fds5.exe**. The parallel executable is called **fds5\_mpi.exe**. The letters “mpi” in the filename denote Message Passing Interface (MPI), which will be discussed below.

Note that the input file for both single and parallel versions of FDS are the same. In fact, it is recommended that before embarking on parallel processing, you should run your input file in serial mode to ensure that it is properly set up.

#### 3.1.1 Starting an FDS Calculation (Single Processor Version)

Sample input files are provided with the program for new users who are encouraged to first run a sample calculation before attempting to write an input file. Assuming that an input file called **job\_name.fds** exists in some directory, run the program either in a DOS or Unix command prompt as follows:

##### MS Windows

Open up a Command Prompt window (click Start, then Run, then type “cmd”), and change directories (“cd”) to where the input file for the case is located, then run the code by typing at the command prompt

```
fds5 job_name.fds
```

The character string `job_name` is usually designated within the input file as the `CHID`. It is recommended that the name of the input file and the `CHID` be the same so that all of the files associated with a given calculation have a consistent name. The progress of a simulation is indicated by diagnostic output that is written out onto the screen. Detailed diagnostic information is automatically written to a file **CHID.out**, where `CHID` is a character string, usually the same as `job_name`, designated in the input file.. Screen output can be redirected to a file via the alternative command

```
fds5 job_name.fds > job_name.err
```

## Mac OS X, Unix, Linux

Depending on the type of installation, you may need to set various path or environment variables in order to invoke FDS without a full path reference to the executable. The easiest way to do this is via an “alias” in your shell start-up script. For the example below, it is assumed that `fds5` is aliased to its full path name. You may also need to “`chmod + x`” to make the file executable. Once this is done, run FDS from the command line by typing:

```
fds5 job_name.fds
```

The input parameters are read from the file **job\_name.fds**, and error statements and other diagnostics are written out to the screen. To run the job in the background:

```
fds5 job_name.fds >& job_name.err &
```

Note that in the latter case, the screen output is stored in the file **job\_name.err** and the detailed diagnostics are saved automatically in a file **CHID.out**, where `CHID` is a character string, usually the same as `job_name`, designated in the input file. It is preferable to run jobs in the background so as to free the console for other uses.

### 3.1.2 Starting an FDS Calculation (Multiple Processor Version)

Running FDS across a network using multiple processors and multiple banks of memory (RAM) is more difficult than running the single processor version. More is required of the user to make the connections between the machines as seamless as possible. This involves creating accounts for a given user on each machine, sharing directories, increasing the speed of the network, making each machine aware of the others, *etc.* Some of these details are handled by the parallel-processing software, others are not. Undoubtedly the procedure will be simplified in years to come, but for the moment, parallel-processing is still relatively new and requires more expertise in terms of understanding both the operating system and the network connections of a given set of computers.

FDS uses MPI (Message-Passing Interface) [3] to allow multiple computers to run a single FDS job. The main idea is that you must break up the FDS domain into multiple meshes, and then the flow field in each mesh is computed by a different “process.” Note the subtle difference between these terms – a “process” does not have the same meaning as a “processor.” The former can be thought of as a “task” that you would see in the Windows Task Manager or by executing the “`top`” command on a Linux/Unix machine. The latter refers to the computer itself. A single processor may run multiple processes, for example. The computation on a given FDS mesh is thought of as an individual “process,” and MPI handles the transfer of information between these processes. Currently, each mesh is assigned its own process in a parallel calculation, although plans are underway to relax this restriction, allowing multiple meshes to be handled via a single process. In this way, large meshes can be computed on dedicated processors, while smaller meshes can be clustered together in a single process running on a single processor, without the need for MPI message passing between themselves.

Also note that FDS refers to its meshes by the numbers 1, 2, 3, and so on, whereas MPI refers to its processes by the numbers 0, 1, 2, and so on. Thus, Mesh 1 is assigned to Process 0; Mesh 2 to Process 1, and so on. As a user, you never actually number the meshes or the processes yourself, but error statements from FDS or from MPI might refer to the meshes or processes by number. As an example, if a five mesh FDS case is run in parallel, the first printout (usually to the screen unless otherwise directed) is:

```
Process 4 of 4 is running on fire65
Process 3 of 4 is running on fire64
Process 2 of 4 is running on fire63
Process 0 of 4 is running on fire61
Process 1 of 4 is running on fire62
Mesh 1 is assigned to Process 0
Mesh 2 is assigned to Process 1
Mesh 3 is assigned to Process 2
Mesh 4 is assigned to Process 3
Mesh 5 is assigned to Process 4
```

This means that 5 processes (numbered 0 to 4) have started on the computers named fire61, fire62, *etc.*, and that each mesh is being computed as an individual process on the individual computers. Each computer has its own memory (RAM), and MPI is the protocol by which information is passed from process to process during the calculation. Note that these computers may have multiple processors, and each processor may have multiple “cores.” You have control over how many processes get assigned to each computer, but you may or may not have control over how the processes are handled by a given computer. That depends on the operating system and the particular version of MPI. For example, fire62 happens to have two quad-core processors, and all five meshes could have been assigned to run as five processes all on fire62. Whether or not this is the best strategy is still a subject of research and heavily dependent on the technical specifications of the OS and hardware.

There are different implementations of MPI, much like there are different Fortran and C compilers. Each implementation is essentially a library of subroutines called from FDS that transfer data from one thread to another across a fast network. The format of the subroutine calls has been widely accepted in the community, allowing different vendors and organizations the freedom to develop better software while working within an open framework.

The way FDS is executed in parallel depends on which implementation of MPI has been installed. At NIST, the parallel version of FDS is presently run on Windows PCs connected by the Local Area Network (LAN, 100 Mbps) or on a cluster of Linux PCs linked together with a dedicated, fast (1000 Mbps) network. The Windows computers use MPICH2, a free implementation of MPI from Argonne National Laboratory, USA.

## MPICH2

With MPICH2, a parallel FDS calculation can be invoked either from the command line or by using a Graphical User Interface (GUI). After the MPICH2 libraries are installed on each computer and the necessary directories are shared, FDS is run using the command issued from one of the computers

```
mpiexec -file config.txt
```

where **config.txt** is a text file containing the name and location of the FDS executable, name of the FDS input file, the working directory, and the names of the various computers that are to run the job. For example, the **config.txt** file might look like this for a job run at NIST with computers named fire\_1, fire\_2, and fire\_3:

```
exe \\fire_1.nist.gov\NIST\FDS\fds5_mpi.exe job_name.fds
```

```
dir \\fire_1.nist.gov\Projects\  
hosts  
fire_1.nist.gov 2  
fire_2.nist.gov 1  
fire_3.nist.gov 2
```

The numbers following the “host” machines represent the number of threads to run on that particular machine. In this example, 5 threads are run for an FDS calculation that has 5 meshes. The `exe` and `dir` directories need to be shared, with the latter having read and write permissions.

All the computers must be able to access the executable and the working directory on `fire_1`. This is achieved under Windows by “sharing.” Under Unix/Linux and OS X, the process involves cross-mounting the file systems of the various machines.

## LAM-MPI

On the Linux cluster in the Building and Fire Research Lab at NIST, LAM-MPI, a free implementation from Indiana University, is installed.<sup>1</sup> With LAM/MPI, the computers to be used are linked prior to the actual execution of FDS with a separate command called a “`lamboot`.” FDS is then run using the command

```
mpirun -np 5 fds5_mpi job_name.fds
```

where the 5 indicates that 5 processors are to be used. In this case, the executable **`fds5_mpi`** is located in the working directory. To make the process run in the background

```
mpirun -np 5 fds5_mpi job_name.fds >& job_name.err &
```

The file **`job_name.err`** contains what is normally printed out to the screen.

Note that there are several other implementations of MPI, some free, some not. Support for the software varies, thus FDS has been designed to run under any of the more popular versions without too much user intervention. However, keep in mind that parallel processing is a relatively new area of computer science, and there are bound to be painful growth spurts in the years ahead.

## 3.2 Monitoring Progress

Diagnostics for a given calculation are written into a file called **`CHID.out`**. The CPU usage and simulation time are written here, so you can see how far along the program has progressed. At any time during a calculation, Smokeview can be run and the progress can be checked visually. To stop a calculation before its scheduled time, either kill the process, or preferably create a file in the same directory as the output files called **`CHID.stop`**. The existence of this file stops the program gracefully, causing it to dump out the latest flow variables for viewing in Smokeview.

Since calculations can be hours or days long, there is a restart feature in FDS. Details of how to use this feature are given in Section 6.4.1. Briefly, specify at the beginning of calculation how often a “restart” file should be saved. Should something happen to disrupt the calculation, like a power outage, the calculation can be restarted from the time the last restart file was saved.

It is also possible to control the stop time and the dumping of restart files by using control functions as described in Section 11.5.

---

<sup>1</sup><http://www.lam-mpi.org>

## Chapter 4

# User Support

It is not unusual over the course of a project to run into various problems, some related to FDS, some related to your computer. FDS is not a typical PC application. It is a serious calculation that pushes your computer's processor and memory to its limits. In fact, there are no hardwired bounds within FDS that prevent you from starting a calculation that is too much for your hardware. Even if your machine has adequate memory (RAM), you can still easily set up calculations that can require weeks or months to complete. It is difficult to predict at the start of a simulation just how long and how much memory will be required. Learn how to monitor the resource usage of your computer. Start with small calculations and build your way up.

Although many features in FDS are fairly mature, there are many that are not. FDS is used for practical engineering applications, but also for research in fire and combustion. As you become more familiar with the software, you will inevitably run into areas that are of current research interest. Indeed, burning a roomful of ordinary furniture is one of the most challenging applications of the model. So be patient, and learn to dissect a given scenario into its constitutive parts. For example, do not attempt to simulate a fire spreading through an entire floor of a building unless you have simulated the burning of the various combustibles with relatively small calculations. The examples described in Part III should help you to develop larger, more complicated simulations from smaller building blocks.

Along with the FDS User's Guide, there are resources available on the Internet. These include an "Issue Tracker," that allows you to report bugs, feature requests and ask specific clarifying questions, and "Group Discussions," which support more general topics than just specific problems. Before using these on-line resources, it is important to first try to solve your own problems by performing simple test calculations, or debugging your input file. The next few sections provide a list of error statements and suggestions on how to solve problems.

### 4.1 The Version Number

If you encounter problems with FDS, it is crucial that you submit, along with a description of the problem, the FDS version number. Each release of FDS comes with a version number like 5.2.6, where the first number is the *major* release, the second is the *minor* release, and the third is the *maintenance* release. Major releases occur every few years, and as the name implies dramatically change the functionality of the model. Minor releases occur every few months, and may cause minor changes in functionality. Release notes can help you decide whether the changes should effect the type of applications that you typically do. Maintenance releases are just bug fixes, and should not affect code functionality. To get the version number, just type the executable at the command prompt:

```
fds5
```

and the relevant information will appear, along with a date of compilation (useful to you) and a so-called SVN number (useful to us). The SVN number refers to the Subversion repository number of the source code. It allows us to go back in time and recover the exact source code files that were used to build that executable.

Simply get in the habit of checking the version number of your executable, periodically checking for new releases which might already have addressed your problem, and telling us what version you are using if you report a problem.

## 4.2 Common Error Statements

An FDS calculation may end before the user-prescribed time limit. Following is a list of common error statements and how to diagnose the problems:

**Input File Errors:** The most common errors in FDS are due to mis-typed input statements. These errors result in the immediate halting of the program and a statement like, “ERROR: Problem with the HEAD line.” For these errors, check the line in the input file named in the error statement. Make sure the parameter names are spelled correctly. Make sure that a / (forward slash) is put at the end of each namelist entry. Make sure that the right type of information is being provided for each parameter, like whether one real number is expected, or several integers, or whatever. Make sure there are no non-ASCII characters being used, as can sometimes happen when text is cut and pasted from other applications or word-processing software. Make sure zeros are zeros and O’s are O’s. Make sure 1’s are not !’s. Make sure apostrophes are used to designate character strings. Make sure the text file on a Unix/Linux machine was not created on a DOS machine, and *vice versa*. Make sure that all the parameters listed are still being used – new versions of FDS often drop or change parameters to force you to re-examine old input files.

**Numerical Instability Errors:** It is possible that during an FDS calculation the flow velocity at some location in the domain can increase due to numerical error causing the time step size to decrease to a point where logic in the code decides that the results are unphysical and stops the calculation with an error message in the file **CHID.out**. In these cases, FDS ends by dumping out one final Plot3D file giving the user some means by which to see where the error is occurring within the computational domain. Usually, a numerical instability can be identified by fictitiously large velocity vectors emanating from a small region within the domain. Common causes of such instabilities are mesh cells that have an aspect ratio larger than 2 to 1, high speed flow through a small opening, a sudden change in the heat release rate, or any number of sudden changes to the flow field. There are various ways to solve the problem, depending on the situation. Try to diagnose and fix the problem before reporting it. It is difficult for anyone but the originator of the input file to diagnose the problem.

**Inadequate Computer Resources:** The calculation might be using more RAM than the machine has, or the output files could have used up all the available disk space. In these situations, the computer may or may not produce an intelligible error message. Sometimes the computer is just unresponsive. It is the user’s responsibility to ensure that the computer has adequate resources to do the calculation. Remember, there is no limit to how big or how long FDS calculations can be – it depends on the resources of the computer. For any new simulation, try running the case with a modest-sized mesh, and gradually make refinements until the computer can no longer handle it. Then back off somewhat on the size of the calculation so that the computer can comfortably run the case. Trying to run with 90 % to 100 % of computer resources is risky. In fact, for a typical Windows PC with 4 GB RAM, only 2 GB will be available to FDS, based on user feedback.

**Run-Time Errors:** An error occurs either within the computer operating system or the FDS program. An error message is printed out by the operating system of the computer onto the screen or into the diagnostic output file. This message is most often unintelligible to most people, including the programmers, although occasionally one might get a small clue if there is mention of a specific problem, like “stack overflow,” “divide by zero,” or “file write error, unit=...” These errors may be caused by a bug in FDS, for example if a number is divided by zero, or an array is used before it is allocated, or any number of other problems. Before reporting the error to the Issue Tracker, try to systematically simplify the input file until the error goes away. This process usually brings to light some feature of the calculation responsible for the problem and helps in the debugging.

**File Writing Errors:** Occasionally, especially on Windows machines, FDS fails because it is not permitted to write to a file. A typical error statement reads:

```
forrtl: severe (47): write to READONLY file, unit 8598, file C:\Users\...\
```

The unit, in this case 8598, is just a number that FDS has associated with one of the output files. If this error occurs just after the start of the calculation, you can try adding the phrase

```
FLUSH_FILE_BUFFERS=.FALSE.
```

on the `DUMP` line of the input file (see Section 12.1). This will prevent FDS from attempting to flush the contents of the internal buffers, something it does to make it possible to view the FDS output in Smokeview during the FDS simulation.

**Poisson Initialization:** Sometimes at the very start of a calculation, an error appears stating that there is a problem with the “Poisson initialization.” The equation for pressure in FDS is known as the Poisson equation. The Poisson solver consists of large system of linear equations that must be initialized at the start of the calculation. Most often, an error in the initialization step is due to a mesh `IJK` dimension being less than 4 (except in the case of a two-dimensional calculation). It is also possible that something is fundamentally wrong with the coordinates of the computational domain. Diagnose the problem by checking the `MESH` lines in the input file.

## 4.3 Support Requests and Bug Tracking

Because FDS development is on-going, problems will inevitably occur with various routines and features. The developers need to know if a certain feature is not working, and reporting problems is encouraged. However, the problem must be clearly identified. The best way to do this is to simplify the input file as much as possible so that the bug can be diagnosed. Also, limit the bug reports to those features that clearly do not work. Physical problems such as fires that do not ignite, flames that do not spread, *etc.*, may be related to the mesh resolution or scenario formulation and need to be investigated first by the user before being reported. If an error message originates from the operating system as opposed to FDS, first investigate some of the more obvious possibilities, such as memory size, disk space, *etc.*

If that does not solve the problem, report the problem with as much information about the error message and circumstances related to the problem. The input file should be simplified as much as possible so that the bug occurs early in the calculation. Attach the simplified input file if necessary, following the instructions provided at the web site. In this way, the developers can quickly run the problem input file and hopefully diagnose the problem.

**NOTE:** Reports of specific problems, feature requests and enhancements should be posted to the Issue Tracker and not the Discussion Group.





## **Part II**

# **Writing an FDS Input File**



## Chapter 5

# The Basic Structure of an Input File

### 5.1 Naming the Job

The operation of FDS is based on a single input text<sup>1</sup> file containing parameters organized into *namelist*<sup>2</sup> groups. The input file provides FDS with all of the necessary information to describe the scenario. The input file is saved with a name such as **job\_name.fds**, where **job\_name** is any character string that helps to identify the simulation. If this same string is repeated under the `HEAD` namelist group within the input file, then all of the output files associated with the calculation will then have this common name.

There should be no blank spaces in the job name. Instead use the underscore character to represent a space. Using an underscore characters instead of a space also applies to the general practice of naming directories on your system.

Be aware that FDS will simply over-write the output files of a given case if its assigned name is the same. This is convenient when developing an input file because you save on disk space. Just be careful not to overwrite a calculation that you want to keep.

### 5.2 Namelist Formatting

Parameters are specified within the input file by using *namelist* formatted records. Each namelist record begins with the ampersand character “&” followed immediately by the name of the namelist group, then a comma-delimited list of the input parameters, and finally a forward slash “/”. For example, the line

```
&DUMP NFRAMES=1800, DT_HRR=10., DT_DEVC=10., DT_PROF=30. /
```

sets various values of parameters contained in the `DUMP` namelist group. The meanings of these various parameters will be explained in subsequent chapters. The namelist records can span multiple lines in the input file, but just be sure to end the record with a “/” or else the data will not be understood. Do not add anything to a namelist line other than the parameters and values appropriate for that group. Otherwise, FDS will stop immediately upon execution.

Parameters within a namelist record can be separated by either commas, spaces, or line breaks. It is a good idea to use commas or line breaks. Some machines do not recognize the spaces. Comments and notes can be written into the file so long as nothing comes before the & except a space and nothing comes between the ampersand & and the slash / except appropriate parameters corresponding to that particular namelist group.

---

<sup>1</sup>ASCII – American Standard Code for Information Interchange

<sup>2</sup>A *namelist* is a Fortran input record.

The parameters in the input file can be integers ( $T\_END=5400$ ), real numbers ( $CO\_YIELD=0.008$ ), groups of real numbers or integers ( $XYZ=6.04, 0.28, 3.65$ ) or ( $IJK=90, 36, 38$ ), character strings:

```
CHID='WTC_05_v5'
```

groups of character strings:

```
SURF_IDS='burner', 'STEEL', 'BRICK'
```

or logical parameters:

```
POROUS_FLOOR=.FALSE.
```

A logical parameter is either `.TRUE.` or `.FALSE.` – the periods are a Fortran convention. Character strings that are listed in this User's Manual must be copied exactly as written – the code is case sensitive and underscores *do* matter.

Most of the input parameters are simply real or integer scalars, like  $DT=0.02$ , but sometimes the inputs are multidimensional arrays. For example, when describing a particular solid surface, you need to express the mass fractions of multiple materials that are to be found in multiple layers. The input array `MATL_MASS_FRACTION(IL, IC)` is intended to convey to FDS the mass fraction of component `IC` of layer `IL`. For example, if the mass fraction of the second material of the third layer is 0.5, then write

```
MATL_MASS_FRACTION(3, 2)=0.5
```

To enter more than one mass fraction, use this notation:

```
MATL_MASS_FRACTION(1, 1:3)=0.5, 0.4, 0.1
```

which means that the first three materials of layer 1 have mass fractions of 0.5, 0.4, and 0.1, respectively. The notation `1:3` means array element 1 through 3, inclusive.

Note that character strings can be enclosed either by apostrophes or quotation marks. Be careful not to create the input file by pasting text from something other than a simple text editor, in which case the punctuation marks may not transfer properly into the text file.

## 5.3 Input File Structure

In general, the namelist records can be entered in any order in the input file, but it is a good idea to organize them in some systematic way. Typically, general information is listed near the top of the input file, and detailed information, like obstructions, devices, and so on, are listed below. FDS scans the entire input file each time it processes a particular namelist group. With some text editors, it has been noticed that the last line of the file is often not read by FDS because of the presence of an “end of file” character. To ensure that FDS reads the entire input file, add

```
&TAIL /
```

as the last line at the end of the input file. This completes the file from `&HEAD` to `&TAIL`. FDS does not even look for this last line. It just forces the “end of file” character past relevant input.

Another general rule of thumb when writing input files is to only add to the file parameters that are to change from their default value. That way, you can more easily distinguish between what you want and what FDS wants. Add comments liberally to the file, so long as these comments do not fall within the namelist records.

The general structure of an input file is shown below, with many lines of the original validation input file<sup>3</sup> removed for clarity.

---

<sup>3</sup>The actual input file, `WTC_05_v5.fds`, is part of the FDS Validation Suite

```

&HEAD CHID='WTC_05_v5', TITLE='WTC Phase 1, Test 5, FDS version 5' /
&MESH IJK=90,36,38, XB=-1.0,8.0,-1.8,1.8,0.0,3.82 /
&TIME T_END=5400. /
&MISC SURF_DEFAULT='MARINITE BOARD', TMPA=20., POROUS_FLOOR=.FALSE. /
&DUMP NFRAMES=1800, DT_HRR=10., DT_DEVC=10., DT_PROF=30. /

&REAC ID          = 'HEPTANE TO CO2'
      FYI          = 'Heptane, C_7 H_16'
      C            = 7.
      H            = 16.
      CO_YIELD     = 0.008 /
      SOOT_YIELD   = 0.015 /

&OBST XB= 3.5, 4.5,-1.0, 1.0, 0.0, 0.0, SURF_ID='STEEL FLANGE' /  Fire Pan
...
&SURF ID          = 'STEEL FLANGE'
      COLOR        = 'BLACK'
      MATL_ID      = 'STEEL'
      BACKING      = 'EXPOSED'
      THICKNESS    = 0.0063 /

...
&VENT MB='XMIN', SURF_ID='OPEN' /
...
&SLCF PBY=0.0, QUANTITY='TEMPERATURE', VECTOR=.TRUE. /
...
&BNDF QUANTITY='GAUGE HEAT FLUX' /
...
&DEVC XYZ=6.04,0.28,3.65, QUANTITY='oxygen', ID='EO2_FDS' /
...
&TAIL / End of file.

```

It is strongly recommended that when looking at a new scenario, first select a pre-written input file that resembles the case, make the necessary changes, then run the case at fairly low resolution to determine if the geometry is set up correctly. It is best to start off with a relatively simple file that captures the main features of the problem without getting tied down with too much detail that might mask a fundamental flaw in the calculation. Initial calculations ought to be meshed coarsely so that the run times are less than an hour and corrections can easily be made without wasting too much time. As you learn how to write input files, you will continually run and re-run your case as you add in complexity.

Table 5.1 provides a quick reference to all the namelist parameters and where you can find the reference to where it is introduced in the document and the table containing all of the keywords for each group.

Table 5.1: Namelist Group Reference Table

| Group Name | Namelist Group Description  | Reference Section | Parameter Table |
|------------|-----------------------------|-------------------|-----------------|
| BNDF       | Boundary File Output        | 12.2.4            | 13.1            |
| CTRL       | Control Function Parameters | 11.5              | 13.3            |
| DEVC       | Device Parameters           | 11.1              | 13.4            |
| DUMP       | Output Parameters           | 12.1              | 13.5            |
| HEAD       | Input File Header           | 6.1               | 13.6            |
| HOLE       | Obstruction Cutout          | 7.2               | 13.7            |
| INIT       | Initial Condition           | 6.5               | 13.8            |
| ISOF       | Isosurface File Output      | 12.2.5            | 13.9            |
| MATL       | Material Property           | 8.4               | 13.10           |
| MESH       | Mesh Parameters             | 6.3               | 13.11           |
| MISC       | Miscellaneous               | 6.4               | 13.12           |
| OBST       | Obstruction                 | 7.1               | 13.13           |
| PART       | Lagrangian Particle         | 10                | 13.14           |
| PROF       | Profile Output              | 12.2.2            | 13.15           |
| PROP       | Device Property             | 11.3              | 13.16           |
| RADI       | Radiation                   | 9.4               | 13.17           |
| RAMP       | Ramp Profile                | 8.5               | 13.18           |
| REAC       | Reactions                   | 9.1               | 13.19           |
| SLCF       | Slice File Output           | 12.2.3            | 13.20           |
| SPEC       | Species Parameters          | 9.2               | 13.21           |
| SURF       | Surface Properties          | 8.2               | 13.22           |
| TIME       | Simulation Time             | 6.2               | 13.24           |
| TRNX       | Mesh Stretching             | 6.3.4             | 13.25           |
| VENT       | Vent Parameters             | 7.3               | 13.26           |
| ZONE       | Pressure Zone Parameters    | 8.3               | 13.27           |

## Chapter 6

# Setting the Bounds of Time and Space

### 6.1 Naming the Job: The HEAD Namelist Group (Table 13.6)

The first thing to do when setting up an input file is to give the job a name. The name of the job is important because often a project involves numerous simulations in which case the names of the individual simulations can help organize the effort. The namelist group HEAD contains two parameters, as in this example:

```
&HEAD CHID='WTC_05_v5', TITLE='WTC Phase 1, Test 5, FDS version 5' /
```

CHID is a string of 30 characters or less used to tag the output files. If, for example, CHID='WTC\_05\_v5', it is convenient to name the input data file WTC\_05\_v5.fds so that the input file can be associated with the output files. No periods or spaces are allowed in CHID because the output files are tagged with suffixes that are meaningful to certain computer operating systems.

TITLE is a string of 60 characters or less that describes the simulation. It is simply descriptive text that is passed to various output files.

### 6.2 Simulation Time: The TIME Namelist Group (Table 13.24)

TIME is the name of a group of parameters time define the time duration of the simulation and the initial time step used to advance the solution of the discretized equations. Usually, only the duration of the simulation is required on this line, via the parameter T\_END (Time End). The default is 1 s. Note: TWFIN will still work but it has been deprecated, it is recommended that T\_END be used now instead.

For example, the following line will instruct FDS to run the simulation for 5400 seconds.

```
&TIME T_END=5400. /
```

If T\_END is set to zero, only the set-up work is performed, allowing you to quickly check the geometry in Smokeview.

If you want the timeline to start at a number other than zero, you can use the parameter T\_BEGIN (Time Begin) to specify the time written to file for the first timestep. This would be useful for matching timelines of experimental data or or video recordings.

This does not run any of the simulation prior to the T\_BEGIN value. It is only used to offset the reported starting time from zero.

Time based RAMPs are evaluated using the actual time if the RAMP activation time is the same as T\_BEGIN; otherwise, they are evaluated using the time from when the RAMP activates. Therefore, if you are setting T\_BEGIN in order to test a time based CTRL or DEVC that is ultimately linked to a RAMP, then you should set T\_BEGIN to be slightly less than the time the RAMP will activate. For example if you were testing a VENT that is to open at 10 s whose SURF\_ID uses a RAMP, T\_BEGIN should be set slightly less than 10 s.

The initial time step size can be specified with DT. This parameter is normally set automatically by dividing the size of a mesh cell by the characteristic velocity of the flow. During the calculation, the time step is adjusted so that the CFL (Courant, Friedrichs, Lewy) condition is satisfied. The default value of DT is  $5(\delta x \delta y \delta z)^{\frac{1}{3}} / \sqrt{gH}$  s, where  $\delta x$ ,  $\delta y$ , and  $\delta z$  are the dimensions of the smallest mesh cell,  $H$  is the height of the computational domain, and  $g$  is the acceleration of gravity.

If something sudden is to happen right at the start of a simulation, like a sprinkler activation, it is a good idea to set the initial time step to avoid a numerical instability caused by too large a time step. Experiment with different values of DT by monitoring the initial time step sizes recorded in the output file **job\_name.out**.

One additional parameter in the TIME group is SYNCHRONIZE, a logical flag (.TRUE. or .FALSE.) indicating that in a multi-mesh computation the time step for each mesh should be the same, thus ensuring that each mesh is processed each iteration. More details can be found in Section 6.3.2. The default value of SYNCHRONIZE is .TRUE.

Finally, if you want to prevent FDS from automatically changing the time step, set LOCK\_TIME\_STEP=.FALSE.

on the TIME line, in which case the specified time step, DT, will not be adjusted. This parameter is intended for diagnostic purposes only, for example, timing program execution. It can lead to numerical instabilities if the initial time step is set too high.



## 6.3 Computational Meshes: The MESH Namelist Group (Table 13.11)

All FDS calculations must be performed within a domain that is made up of rectilinear volumes called *meshes*. Each mesh is divided into rectangular *cells*, the number of which depends on the desired resolution of the flow dynamics. MESH is the namelist group that defines the computational domain. A mesh is a single right parallelepiped, *i.e.* a box. The coordinate system within a mesh conforms to the right hand rule. The origin point of a mesh is defined by the first, third and fifth values of the real number sextuplet, XB, and the opposite corner is defined by the second, fourth and sixth values. For example,

```
&MESH IJK=10,20,30, XB=0.0,1.0,0.0,2.0,0.0,3.0 /
```

defines a mesh that spans the volume starting at the origin and extending 1 m in the positive  $x$  direction, 2 m in the positive  $y$  direction, and 3 m in the positive  $z$  direction. The mesh is subdivided into uniform cells via the parameter IJK. In this example, the mesh is divided into 10 cm cubes. If it is desired that the mesh cells in a particular direction not be uniform in size, then the namelist groups TRNX, TRNY and/or TRNZ may be used to alter the uniformity of the mesh (See Section 6.3.4).

Any obstructions or vents that extend beyond the boundary of the mesh are cut off at the boundary. There is no penalty for defining objects outside of the mesh, and these objects will not appear in Smokeview either.

Note that it is best if the mesh cells resemble cubes, that is, the length, width and height of the cells ought to be roughly the same.

Because an important part of the calculation uses a Poisson solver based on Fast Fourier Transforms (FFTs) in the  $y$  and  $z$  directions, the second and third dimensions of the mesh should each be of the form  $2^l 3^m 5^n$ , where  $l$ ,  $m$  and  $n$  are integers. For example,  $64 = 2^6$ ,  $72 = 2^3 3^2$  and  $108 = 2^2 3^3$  are good mesh cell divisions, but 37, 99 and 109 are not. The first number of mesh cell divisions (the  $I$  in IJK) does not use FFTs and need not be given as a product of small numbers. However, you should experiment with different values of divisions to ensure that those that are ultimately used do not unduly slow down the calculation.

Here is a list of numbers between 1 and 1024 that can be factored down to 2's, 3's and 5's:

|     |     |     |     |     |     |     |     |     |      |      |     |     |     |     |
|-----|-----|-----|-----|-----|-----|-----|-----|-----|------|------|-----|-----|-----|-----|
| 2   | 3   | 4   | 5   | 6   | 8   | 9   | 10  | 12  | 15   | 16   | 18  | 20  | 24  | 25  |
| 27  | 30  | 32  | 36  | 40  | 45  | 48  | 50  | 54  | 60   | 64   | 72  | 75  | 80  | 81  |
| 90  | 96  | 100 | 108 | 120 | 125 | 128 | 135 | 144 | 150  | 160  | 162 | 180 | 192 | 200 |
| 216 | 225 | 240 | 243 | 250 | 256 | 270 | 288 | 300 | 320  | 324  | 360 | 375 | 384 | 400 |
| 405 | 432 | 450 | 480 | 486 | 500 | 512 | 540 | 576 | 600  | 625  | 640 | 648 | 675 | 720 |
| 729 | 750 | 768 | 800 | 810 | 864 | 900 | 960 | 972 | 1000 | 1024 |     |     |     |     |

### 6.3.1 Two-Dimensional and Axially-Symmetric Calculations

The governing equations solved in FDS are written in terms of a three dimensional Cartesian coordinate system. However, a two dimensional Cartesian or two dimensional cylindrical (axially-symmetric) calculation can be performed by setting the  $J$  in the IJK triplet to 1 on the MESH line. For axial symmetry, add CYLINDRICAL=.TRUE. to the MESH line, and the coordinate  $x$  is then interpreted as the radial coordinate  $r$ . No boundary conditions should be set at the planes  $y = YMIN = XB(3)$  or  $y = YMAX = XB(4)$ , nor at  $r = XMIN = XB(1)$  in an axially-symmetric calculation in which  $r = XB(1) = 0$ . For better visualizations, the difference between  $XB(4)$  and  $XB(3)$  should be small so that the Smokeview rendering appears to be in 2-D. An example of an axially-symmetric helium plume (**helium\_2d**) is given in the V&V Guide.

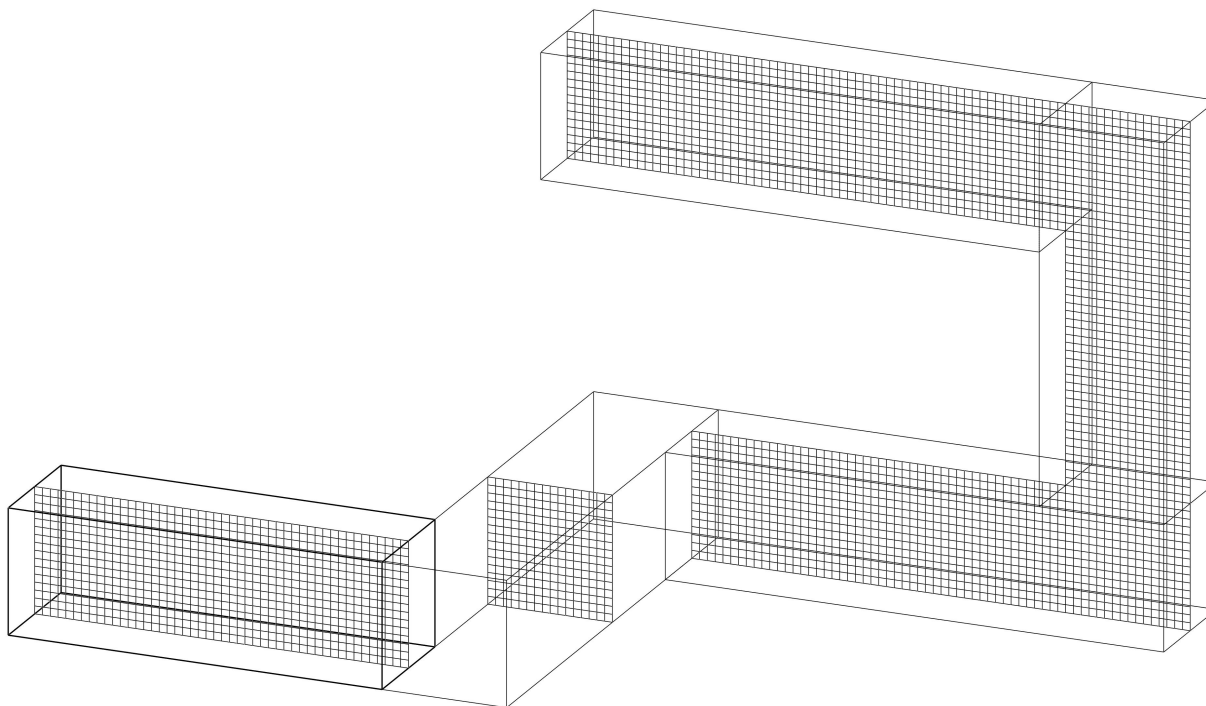


Figure 6.1: An example of a multiple-mesh geometry.

### 6.3.2 Multiple Meshes and Parallel Processing

The term “multiple meshes” means that the computational domain consists of more than one computational mesh, usually connected although this is not required. If more than one mesh is used, there should be a `MESH` line for each. The order in which these lines are entered in the input file matters. In general, the meshes should be entered from finest to coarsest. FDS assumes that a mesh listed first in the input file has precedence over a mesh listed second if the two meshes overlap. Meshes can overlap, abut, or not touch at all. In the last case, essentially two separate calculations are performed with no communication at all between them. Obstructions and vents are entered in terms of the overall coordinate system and need not apply to any one particular mesh. Each mesh checks the coordinates of all the geometric entities and decides whether or not they are to be included.

#### Serial vs. Parallel Processing of Multiple Meshes

To run FDS in parallel, you **must** break up the computational domain into multiple meshes so that the workload can be divided among the available processors. In general, it is better to run multiple mesh cases with the parallel version of FDS if you have the computers available, but be aware that two computers will not necessarily finish the job in half the time as one. For the parallel version to work well, there has to be a comparable number of cells in each mesh, or otherwise most of the computers will sit idle waiting for the one with the largest mesh to finish processing each time step. You can use multiple meshes even when running the serial version of FDS, in which case one CPU will serially process each mesh, one by one. Why do this? For one, if you set

```
SYNCHRONIZE=.FALSE.
```

on the `TIME` line, then in each mesh, the governing equations will be solved with a time step based on the flow speed within that particular mesh. Because each mesh can have different time steps, this technique can

save CPU time by requiring relatively coarse meshes to be updated only when necessary. Coarse meshes are best used in regions where temporal and spatial gradients of key quantities are small or unimportant. Be aware, however, that unsynchronized time steps are more likely to lead to numerical instabilities.

By default, the time steps in each mesh are synchronized. With this setting, all meshes are active each iteration. For a single-processor, multiple mesh calculation, this strategy reduces and may even eliminate any benefit seen by using multiple meshes. However, in a parallel calculation, if a particular mesh is inactive during an iteration because it is not ready to be updated, then the processor assigned to that mesh is also inactive. Forcing the mesh to be updated with a smaller than ideal time step does not cost anything since that processor would have been idle anyway. The benefit is that there is a tighter connection between meshes. It is also possible to synchronize the time step in only a select set of meshes. To do this, add `SYNCHRONIZE=.TRUE.` to the appropriate `MESH` lines and then add `SYNCHRONIZE=.FALSE.` to the `TIME` line.

### 6.3.3 Mesh Alignment


Whether the calculation is to be run on a single processor, or on multiple processors, the rules of prescribing multiple meshes are similar, with some issues to keep in mind. The most important rule of mesh alignment is that abutting cells ought to have the same cross sectional area, or integral ratios, as shown in Fig. 6.2. The requirement of integral mesh alignment is new starting with FDS version 5.1. It is a more restrictive requirement than in previous versions because it was becoming too difficult to maintain complete flexibility in alignment while trying to improve the accuracy of the methodology.

The following rules of thumb should also be followed when setting up a multiple mesh calculation:


- Avoid putting mesh boundaries where critical action is expected, especially fire. Sometimes fire spread from mesh to mesh cannot be avoided, but if at all possible try to keep mesh interfaces relatively free of complicated phenomena since the exchange of information across mesh boundaries is not yet as accurate as cell to cell exchanges within one mesh.
- In general, there is little advantage to overlapping meshes because information is only exchanged at exterior boundaries. This means that a mesh that is completely embedded within another receives information at its exterior boundary, but the larger mesh receives no information from the mesh embedded within. Essentially, the larger, usually coarser, mesh is doing its own simulation of the scenario and is not affected by the smaller, usually finer, mesh embedded within it. Details within the fine mesh, especially related to fire growth and spread, may not be picked up by the coarse mesh. In such cases, it is preferable to isolate the detailed fire behavior within one mesh, and position coarser meshes at the exterior boundary of the fine mesh. Then the fine and coarse meshes mutually exchange information.
- Be careful when using the shortcut convention of declaring an entire face of the domain to be an `OPEN` vent. Every mesh takes on this attribute. See Section 7.3 for more details.
- If a planar obstruction is close to where two meshes abut, make sure that each mesh “sees” the obstruction. If the obstruction is even a millimeter outside of one of the meshes, that mesh does not account for it, in which case information is not transferred properly between meshes.

### Accuracy of the Parallel Calculation


Experiment with different mesh configurations using relatively coarse mesh cells to ensure that information is being transferred properly from mesh to mesh. There are two issues of concern. First, does it appear that the flow is being badly affected by the mesh boundary? If so, try to move the mesh boundaries away from

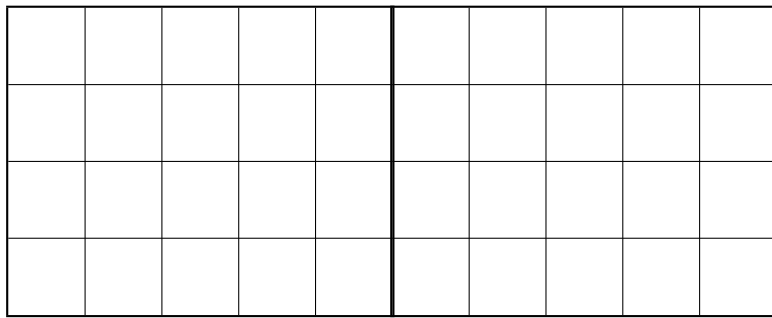


This is the ideal kind of mesh to mesh alignment.

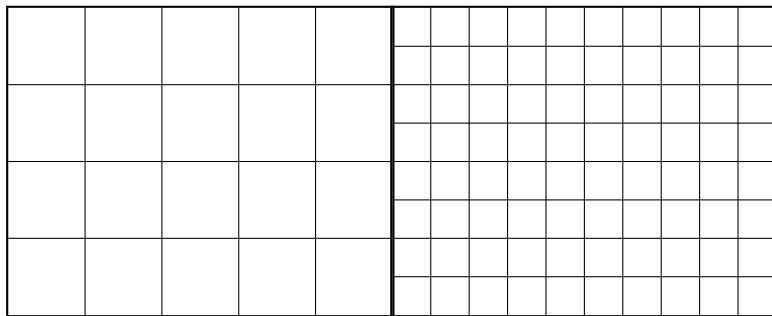

This is allowed so long as there are an integral number of fine cells abutting each coarse cell.

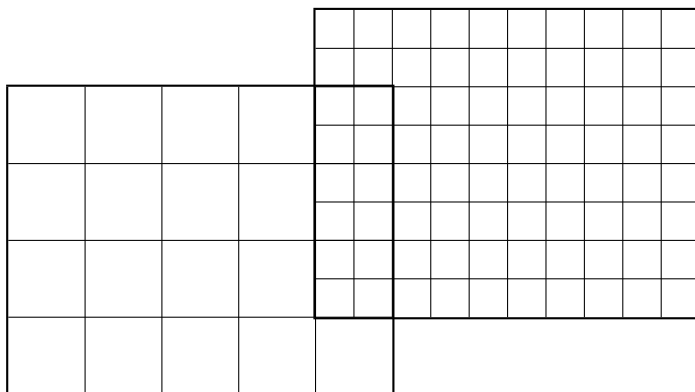

This is allowed, but of questionable value.

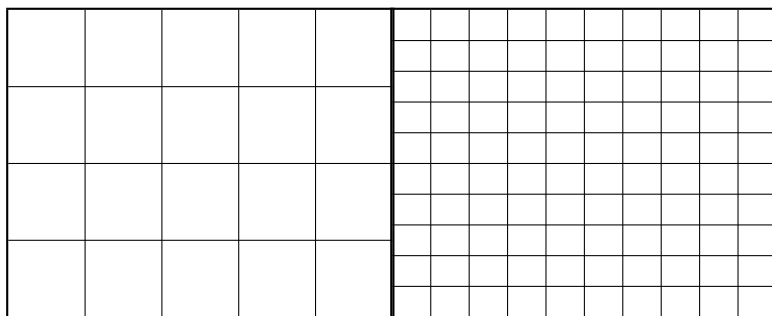

This is no longer allowed in FDS 5.1 and higher.

Figure 6.2: **Rules concerning alignment of meshes.**

areas of activity. Second, is there too much of a jump in cell size from one mesh to another? If so, consider whether the loss of information moving from a fine to a coarse mesh is tolerable.

### Efficiency of the Parallel Calculation

When running a case with multiple meshes in parallel, the efficiency of the calculation can be checked as follows: (1) Set `SYNCHRONIZE=.TRUE.` on the `TIME` line, (2) Let the program run several hundred time steps, (3) Calculate the difference in wall clock time between two 100 iteration print outs in the file **CHID.out** (see Section 24.1). Divide the time difference by 100. This is the average elapsed wall clock time per time step, (4) Look at the `CPU/step` for each mesh. The largest value should be less than, but close to, the average elapsed wall clock time per step. The efficiency of the parallel calculation is the maximum `CPU/step` divided by the average wall clock time per step. If this number is between 90 % and 100 %, the parallel code is working well.

### 6.3.4 Mesh Stretching: The `TRNX`, `TRNY` and/or `TRNZ` Namelist Groups (Table 13.25)

By default the mesh cells that fill the computational domain are uniform in size. However, it is possible to specify that the cells be non-uniform in one or two of the three coordinate directions. For a given co-



Figure 6.3: **Piecewise-Linear Transformation.**



Figure 6.4: **Polynomial Transformation.**

ordinate direction,  $x$ ,  $y$  or  $z$ , a function can be prescribed that transforms the uniformly-spaced mesh to a non-uniformly spaced mesh. **Be careful with mesh transformations!** If you shrink cells in one region you must stretch cells somewhere else. When one or two coordinate directions are transformed, the aspect ratio of the mesh cells in the 3D mesh will vary. To be on the safe side, transformations that alter the aspect ratio of cells beyond 2 or 3 should be avoided. Keep in mind that the large eddy simulation technique is based on the assumption that the numerical mesh should be fine enough to allow the formation of eddies that are responsible for the mixing. In general, eddy formation is limited by the largest dimension of a mesh cell, thus shrinking the mesh resolution in one or two directions may not necessarily lead to a better simulation if the third dimension is large.

Transformations, in general, reduce the efficiency of the computation, with two coordinate transformations impairing efficiency more than a transformation in one coordinate direction. Experiment with different meshing strategies to see how much of a penalty you will pay.

Here is an example of how to do a mesh transformation. Suppose your mesh is defined

```
&MESH IJK=15,10,20, XB=0.0,1.5,1.2,2.2,3.2,5.2 /
```

and you want to alter the uniform spacing in the  $x$  direction. First, refer to the figures above. You need to define a function  $x = f(\xi)$  that maps the uniformly-spaced *Computational Coordinate* (CC)  $0 \leq \xi \leq 1.5$  to the *Physical Coordinate* (PC)  $0 \leq x \leq 1.5$ . The function has three mandatory constraints: it must be monotonic (always increasing), it must map  $\xi = 0$  to  $x = 0$ , and it must map  $\xi = 1.5$  to  $x = 1.5$ . The default transformation function is  $f(\xi) = \xi$  for a uniform mesh, but you need not do anything in this case.

Two types of transformation functions are allowed. The first, and simplest, is a piecewise-linear function. Figure 6.3 gives an example of a piecewise-linear transformation. The graph indicates how 15 uniformly spaced mesh cells along the horizontal axis are transformed into 15 non-uniformly spaced cells along the vertical axis. In this case, the function is made up of straight line segments connecting points (CC,PC), in increasing order, as specified by the following lines in the input file:

```
&TRNX CC=0.30, PC=0.50, MESH_NUMBER=2 /
&TRNX CC=1.20, PC=1.00, MESH_NUMBER=2 /
```

The parameter CC refers to the Computational Coordinate,  $\xi$ , located on the horizontal axis; PC is the Physical Coordinate,  $x$ , located on the vertical axis. The slopes of the line segments in the plot indicate whether the mesh is being stretched (slopes greater than 1) or shrunk (slopes less than 1). The tricky part about this process is that you usually have a desired shrinking/stretching strategy for the Physical Coordinate on the vertical axis, and must work backwards to determine what the corresponding points should be for the Computational Coordinate on the horizontal axis. Note that the above transformation is applied to the second mesh in a multiple mesh job.

The second type of transformation is a polynomial function whose constraints are of the form

$$\frac{d^n f(\text{CC})}{d\xi^n} = \text{PC}$$

Figure 6.4 gives an example of a polynomial transformation, for which the parameters are specified (assuming that this is the third mesh):

```
&TRNX IDERIV=0, CC=0.75, PC=0.75, MESH_NUMBER=3 /
&TRNX IDERIV=1, CC=0.75, PC=0.50, MESH_NUMBER=3 /
```

which correspond to the constraints  $f(0.75) = 0.75$  and  $\frac{df}{d\xi}(0.75) = 0.5$ , or, in words, the function maps 0.75 into 0.75 and the slope of the function at  $\xi = 0.75$  is 0.5. The transform function must also pass through the points (0,0) and (1.5,1.5), meaning that FDS must compute the coefficients for the cubic polynomial  $f(\xi) = c_0 + c_1\xi + c_2\xi^2 + c_3\xi^3$ . More constraints on the function lead to higher order polynomial functions, so be careful about too many constraints which could lead to non-monotonic functions. The monotonicity of the function is checked by the program and an error message is produced if it is not monotonic.

### 6.3.5 Choosing the Right Mesh Dimensions

A common question asked by new FDS users is, “What size mesh should I use?” The answer is not easy because it depends considerably on what you are trying to accomplish. In general, you should build an FDS input file using a relatively coarse mesh, and then gradually refine the mesh until you do not see appreciable differences in your results. Formally, this is referred to as a mesh sensitivity study.

For simulations involving buoyant plumes, a measure of how well the flow field is resolved is given by the non-dimensional expression  $D^*/\delta x$ , where  $D^*$  is a characteristic fire diameter

$$D^* = \left( \frac{\dot{Q}}{\rho_\infty c_p T_\infty \sqrt{g}} \right)^{\frac{2}{5}} \quad (6.1)$$

and  $\delta x$  is the nominal size of a mesh cell<sup>1</sup>. The quantity  $D^*/\delta x$  can be thought of as the number of computational cells spanning the characteristic (not necessarily the physical) diameter of the fire. The more cells spanning the fire, the better the resolution of the calculation. It is better to assess the quality of the mesh in terms of this non-dimensional parameter, rather than an absolute mesh cell size. For example, a cell size of 10 cm may be “adequate,” in some sense, for evaluating the spread of smoke and heat through a building from a sizable fire, but may not be appropriate to study a very small, smoldering source.

As an example, in the mesh sensitivity study for NUREG 1824 [4], the  $D^*/\delta x$  values ranged from 4 to 16. These values were used to adequately resolve plume dynamics, along with other geometrical characteristics of the models as well. This range does not indicate what values to use for all models, only what values worked well for that particular set of models.

---

<sup>1</sup>The characteristic fire diameter is related to the characteristic fire size via the relation  $Q^* = (D^*/D)^{5/2}$ , where  $D$  is the physical diameter of the fire.

## 6.4 Miscellaneous Parameters: The MISC Namelist Group (Table 13.12)

MISC is the namelist group of global miscellaneous input parameters. Only one MISC line should be entered in the data file. For example, the input line

```
&MISC SURF_DEFAULT='CONCRETE',TMPA=25. /
```

establishes that all bounding surfaces are to be made of CONCRETE unless otherwise specified, and that the ambient temperature is 25 °C.

The MISC parameters vary in scope and degree of importance. Here is a partial list of MISCellaneous parameters. Others are described where necessary throughout this guide.

**DNS** A logical parameter that, if .TRUE., directs FDS to perform a Direct Numerical Simulation, as opposed to the default Large Eddy Simulation (LES).

**GVEC** The 3 components of gravity, in  $\text{m/s}^2$ . The default is GVEC=0, 0, -9.81.

**HUMIDITY** Relative humidity, in units of %. This need only be specified if there is a source of water in the simulation other than the fire itself. Otherwise, water vapor is not explicitly tracked. Default 40 %.

**ISOTHERMAL** A logical parameter that indicates that the calculation does not involve any changes in temperature or radiation heat transfer, thus reducing the number of equations that must be solved, and simplifying those that are. Automatically sets RADIATION to .FALSE.

**NOISE** FDS initializes the flow field with a very small amount of “noise” to prevent the development of a perfectly symmetric flow when the boundary and initial conditions are perfectly symmetric. To turn this off, set NOISE=.FALSE.

**P\_INF** Background pressure (at the ground) in Pa. The default is 101325 Pa.

**RADIATION** A logical parameter indicating whether radiation transport ought to be calculated. The default is .TRUE.

**SUPPRESSION** A logical parameter indicating whether FDS should include gas phase flame extinction. The default is .TRUE.

**SURF\_DEFAULT** The SURF line that is to be applied to all boundaries, unless otherwise specified. The default is 'INERT', non-reacting solid boundary fixed at TMPA. You do not need to define 'INERT' via a SURF line.

**TMPA** Ambient temperature, the temperature of everything at the start of the simulation. The default is 20 °C.

**U0, V0, W0** Initial values of the gas velocity in each of the coordinate directions. Normally, these are all 0 m/s, but there are a few applications where it is convenient to start the flow immediately, like in an outdoor simulation involving wind.



### 6.4.1 Stopping and Restarting Calculations

An important `MISC` parameter is called `RESTART`. Normally, a simulation consists of a sequence of events starting from ambient conditions. However, there are occasions when you might want to stop a calculation, make a few limited adjustments, and then restart the calculation from that point in time. To do this, first bring the calculation to a halt gracefully by creating a file called **CHID.stop** in the directory where the output files are located. Remember that FDS is case-sensitive. The file name must be exactly the same as the `CHID` and ‘stop’ should be lower case. FDS checks for the existence of this file at each time step, and if it finds it, gracefully shuts down the calculation after first creating a final `Plot3D` file and a file (or files in the case of a multiple mesh job) called **CHID.restart** (or **CHID\_nn.restart**). To restart a job, the file(s) **CHID.restart** should exist in the working directory, and the phrase `RESTART=.TRUE.` needs to be added to the `MISC` line of the input data file. For example, suppose that the job whose `CHID` is “plume” is halted by creating a dummy file called **plume.stop** in the directory where all the output files are being created. To restart this job from where it left off, add `RESTART=.TRUE.` to the `MISC` line of the input file **plume.fds**, or whatever you have chosen to name the input file. The existence of a restart file with the same `CHID` as the original job tells FDS to continue saving the new data in the same files as the old. If `RESTART_CHID` is also specified on the `MISC` line, then FDS will look for old output files tagged with this string instead of using the specified `CHID` on the `HEAD` line. In this case, the new output files will be tagged with `CHID`, and the old output files will not be altered.

When running the restarted job, the diagnostic output of the restarted job is appended to the file **CHID.out** that was created by the original job. All of the other output files from the original run are appended as well.

There may be times when you want to save restart files periodically during a run as insurance against power outages or system crashes. If this is the case, at the start of the original run set `DT_RESTART=50.` on the `DUMP` line to save restart files every 50 s, for example. The default for `DT_RESTART` is 1000000, meaning no restart files are created unless you gracefully stop a job by creating a dummy file called **CHID.stop**.

It is also possible to use the new control function feature (see Section 11.5) to stop a calculation or dump a restart file when the computation reaches some measurable condition such as a first sprinkler activation.

Between job stops and restarts, major changes cannot be made in the calculation like adding or removing vents and obstructions. The changes are limited to those parameters that do not instantly alter the existing flow field. Since the restart capability has been used infrequently by the developers, it should be considered a fragile construct. Examine the output to ensure that no sudden or unexpected events occur during the stop and restart.

### 6.4.2 Special Topic: Defying Gravity

Most users of FDS assume that the acceleration of gravity points toward the negative end of the  $z$  axis, or more simply, downward. However, to change the direction of gravity to model a sloping roof or tunnel, for example, specify the gravity vector on the `MISC` line with a triplet of numbers of the form `GVEC=0.0, 0.0, -9.81` (units are  $\text{m/s}^2$ ). This is the default, but it can be changed to be any direction.

Note: if sprinklers are specified, the gravity vector must not be changed. Much of the logic governing the trajectories of water droplets over solid objects assumes that gravity points in the negative  $z$  direction.

There are a few special applications where you might want to vary the gravity vector in time, for instance, for spacecraft applications. The gravity vector, `GVEC`, can be made a function of time using “ramps” for the individual components, `RAMP_GX`, `RAMP_GY`, and `RAMP_GZ`, all specified on the `MISC` line. More about `RAMPs` can be found in Section 8.5.

### 6.4.3 Special Topic: Improving the Pressure Solver

FDS uses a low-Mach number formulation of the Navier-Stokes equations. One of the consequences of this is that the speed of sound is assumed infinite, and that the pressure throughout the computational domain is affected, instantaneously, by local changes in the flow field. A simple example of this is when air is pushed through a tunnel. If the tunnel has forced flow at one end and an opening at the other, the volume flow at the opening is the same as that which is forced at the other end. Without any heat addition, the air is assumed incompressible. Information is passed through the tunnel instantaneously in the model via a solution of a linear system of equations for the pressure. For a single mesh, the solution of this Poisson equation for the pressure is very accurate. However, for multiple meshes, there is potentially a delay in information passing throughout the domain because the Poisson equation is solved on each individual mesh, without any influence from the larger computational domain. The details of the numerics can be found in the FDS Technical Reference Guide.

A new feature has been added in FDS 5 to improve the accuracy of the multi-mesh pressure solver. Briefly, a correction is made to the local solutions of the Poisson equation by way of a global solution for an “average” pressure in each mesh. This can be thought of as the pressure that one would obtain from a zone or lumped parameter model where each compartment in a building has its own bulk pressure obtained via mass balance estimates at compartment boundaries. Currently, this pressure correction is still an option because it requires additional testing and it requires additional CPU time. To invoke it, add

```
PRESSURE_CORRECTION=.TRUE.
```

to the `MISC` line. Run your case with and without the option to determine how much additional CPU time is required, and also how much of an improvement in accuracy it yields. This can be done in two ways. First, examine vector slice files of various quantities at the mesh boundaries to see if there are noticeable changes in the flow field due to the boundary. Second, add

```
CHECK_VOLUME_FLOW=.TRUE.
```

to the `DUMP` line, just for debugging purposes. This will prompt FDS to compute the volume flow at each mesh boundary to determine if the pressure correction scheme is working properly. If error messages appear on the screen or in the standard error file, post the case to the Issue Tracker.

### 6.4.4 Special Topic: Restoring the Baroclinic Vorticity

There is an approximation made when solving for the pressure where it is assumed that

$$\nabla \cdot \frac{1}{\rho} \nabla \tilde{p} = \frac{1}{\rho_\infty} \nabla^2 \tilde{p}. \quad (6.2)$$

The consequence of this approximation is that the vorticity generated due to the non-alignment of the density and pressure gradients, or the baroclinic torque, is neglected. For most large scale applications, the assumption is justified by the fact that the vorticity generated by buoyancy is the dominant source of vorticity. By neglecting the baroclinic torque the solution of the elliptic partial differential equation obtained by taking the divergence of the momentum equation is greatly simplified. However, an option exists in the code to restore the baroclinic torque by decomposing the relevant term in the pressure equation as follows,

$$\nabla \cdot \frac{1}{\rho^{n+1}} \nabla \tilde{p}^{n+1} \approx \nabla \cdot \frac{1}{\bar{\rho}^{n+1}} \nabla \tilde{p}^{n+1} + \nabla \cdot \left( \frac{1}{\rho^{n+1}} - \frac{1}{\bar{\rho}^{n+1}} \right) \nabla \tilde{p}^n. \quad (6.3)$$

The first term on the right hand side of (6.3) is absorbed in  $\nabla^2 \mathcal{H}$ . In the second term, which becomes part of  $\nabla \cdot \mathbf{F}$ , we must use the most recent value of the pressure  $\tilde{p}^n$ . The expression  $\bar{\rho}$  is an average density, equal to  $2\rho_{\min}\rho_{\max}/(\rho_{\min} + \rho_{\max})$ . To make this correction, simply include the statement `BAROCLINIC=.TRUE.` on the `MISC` line. In a DNS calculation (`DNS=.TRUE.`), the correction is made by default. However, for

an LES calculation (the default mode in FDS), the correction must be explicitly invoked. The cost of the correction is not prohibitive – try calculations with and without the correction to determine if its inclusion is warranted.

### 6.4.5 Special Topic: Stack Effect

Tall buildings often experience buoyancy-induced air movement due to temperature differences between inside and outside, known as *stack effect*. To simulate this phenomenon in FDS, you must include the entire building, or a substantial fraction of it, both inside and out, in the computational domain. It is important to capture the pressure and density decrease in the atmosphere based on the specified temperature `LAPSE_RATE` (°C/m) that is entered on the `MISC` line. Experiment with different meshing strategies before including any fire or HVAC functionality. Slowly build in complexity. See Section 16.4 for an example.

### 6.4.6 Special Topic: Large Eddy Simulation Parameters

In default mode, FDS uses the Smagorinsky form of Large Eddy Simulation (LES) to model subgrid-scale turbulence. The viscosity  $\mu$  is modeled

$$\mu_{\text{LES}} = \rho (C_s \Delta)^2 \left( 2 \bar{\mathbf{S}}_{ij} \cdot \bar{\mathbf{S}}_{ij} - \frac{2}{3} (\nabla \cdot \bar{\mathbf{u}})^2 \right)^{\frac{1}{2}} \quad (6.4)$$

where  $C_s$  is an empirical constant and  $\Delta$  is a length on the order of the size of a grid cell. The bar above the various quantities denotes that these are the resolved, or *filtered*, values, meaning that they are computed on a numerical grid. The other diffusive parameters, the thermal conductivity and material diffusivity, are related to the turbulent viscosity by

$$k_{\text{LES}} = \frac{\mu_{\text{LES}} C_p}{\text{Pr}_t} \quad ; \quad (\rho D)_{l,\text{LES}} = \frac{\mu_{\text{LES}}}{\text{Sc}_t} \quad (6.5)$$

The turbulent Prandtl number  $\text{Pr}_t$  and the turbulent Schmidt number  $\text{Sc}_t$  are assumed to be constant for a given scenario. Although it is not recommended for most calculations, you can modify  $C_s = 0.2$ ,  $\text{Pr}_t = 0.5$ , and  $\text{Sc}_t = 0.5$  via the parameters `CSMAG`, `PR`, and `SC` on the `MISC` line. A more detailed discussion of these parameters is given in the FDS Technical Reference Guide [1].

### 6.4.7 Special Topic: Numerical Stability Parameters

The time step of an FDS simulation is constrained by the convective and diffusive transport speeds via two conditions. The first is known as the Courant-Friedrichs-Lewy (CFL) condition. The CFL condition asserts that the solution of the equations cannot be updated with a time step larger than that which would allow a parcel of fluid to travel further than a single mesh cell. In each mesh cell of dimension  $\delta x$  by  $\delta y$  by  $\delta z$  with velocity components  $u$ ,  $v$ , and  $w$ , the CFL number is defined:

$$\text{CFL} = \delta t \max \left( \frac{|u|}{\delta x}, \frac{|v|}{\delta y}, \frac{|w|}{\delta z} \right) \quad (6.6)$$

Every time step, the CFL number is computed in each mesh cell, and the time step,  $\delta t$ , is adjusted if the maximum value of the CFL number is not between `CFL_MIN` and `CFL_MAX`, whose default values are 0.8 and 1.0, respectively. These values are included in the `MISC` namelist group.

A similar condition, but one constraining the time step when diffusive transport dominates, is sometimes called the Von Neumann condition. The Von Neumann number is defined:

$$\text{VN} = 2 \max \left( v, D, \frac{k}{\rho c_p} \right) \delta t \left( \frac{1}{\delta x^2} + \frac{1}{\delta y^2} + \frac{1}{\delta z^2} \right) \quad (6.7)$$

Like the CFL number, VN is computed in each mesh cell, and the time step is adjusted if VN is outside the range between VN\_MIN and VN\_MAX, which are 0.8 and 1.0 by default. Note that this constraint is applied to the momentum, mass and energy equations via the relevant diffusion parameter – viscosity, material diffusivity or thermal conductivity. This constraint on the time step is typical of any explicit, second-order numerical scheme for solving a parabolic partial differential equation. To save CPU time, the Von Neumann criterion is only invoked for DNS calculations or for LES calculations with mesh cells smaller than 5 mm.

Resetting the stability parameters is not recommended except in very special circumstances, as they can lead to simulations failing due to numerical instabilities.

If you want to prevent FDS from automatically changing the time step, set LOCK\_TIME\_STEP=.FALSE. on the TIME line, in which case the specified time step, DT, will not be adjusted. This parameter is intended for diagnostic purposes only, for example, timing program execution. It can lead to numerical instabilities if the initial time step is set too high.

## 6.5 Special Topic: Unusual Initial Conditions: The `INIT` Namelist Group (Table 13.8)

Usually, an FDS simulation begins at time  $t = 0$  with ambient conditions. The air temperature is assumed constant with height, and the density and pressure decrease with height (the  $z$  direction). This decrease is not noticed in most building scale calculations, but it is important in large outdoor simulations. There are some scenarios for which it is convenient to change the ambient conditions within some rectangular region of the domain. If so, add lines of the form

```
&INIT XB=0.5,0.8,2.1,3.4,2.5,3.6, TEMPERATURE=30. /
```

Here, within the region whose bounds are given by the sextuplet `XB`, the initial temperature shall be 30 °C instead of the ambient. This construct can also be used for `DENSITY` or `MASS_FRACTION(N)` where `N` indicates the `N`th species listed in the input file.

The `INIT` construct may be useful in examining the influence of stack effect in a building, where the temperature is different inside and out.

Note that a solid obstruction can be given an initial temperature via the parameter `TMP_INNER` on the `SURF` line. An initial velocity can be prescribed via `U0`, `V0`, and `W0` on the `MISC` line.

## 6.6 Special Topic: Setting Limits: The `CLIP` Namelist Group (Table 13.2)

On rare occasions you might need to set upper or lower bounds on the density, temperature, or species mass fractions. The parameters listed in Table 13.2 are for diagnostic purposes only.



## Chapter 7

# Building the Model

A considerable amount of work in setting up a calculation lies in specifying the geometry of the space to be modeled and applying boundary conditions to these objects. The geometry is described in terms of rectangular obstructions that can heat up, burn, conduct heat, *etc.*; and vents from which air or fuel can be either injected into, or drawn from, the flow domain. A boundary condition needs to be assigned to each obstruction and vent describing its thermal properties. A fire is just one type of boundary condition. This chapter describes how to build the model. The next chapter describes how to assign properties to the boundaries.

### 7.1 Creating Obstructions: The OBST Namelist Group (Table 13.13)

The namelist group OBST contains parameters used to define obstructions. Each OBST line contains the coordinates of a rectangular solid within the flow domain. This solid is defined by two points  $(x_1, y_1, z_1)$  and  $(x_2, y_2, z_2)$  that are entered on the OBST line in terms of the sextuplet XB = X1, X2, Y1, Y2, Z1, Z2. In addition to the coordinates, the boundary conditions for the obstruction can be specified with the parameter SURF\_ID, which designates which SURF group (Section 8.2) to apply at the surface of the obstruction. If the obstruction has different properties for its top, sides and bottom, do not specify only one SURF\_ID. Instead, use SURF\_IDS, an array of three character strings specifying the boundary condition IDs for the top, sides and bottom of the obstruction, respectively. If the default boundary condition is desired, then SURF\_ID(S) need not be set. However, if at least one of the surface conditions for an obstruction is the inert default, it can be referred to as 'INERT', but it does not have to be explicitly defined. For example:

```
&SURF ID='FIRE',HRRPUA=1000.0 /
&OBST XB=2.3,4.5,1.3,4.8,0.0,9.2,SURF_IDS='FIRE','INERT','INERT' /
```

puts a fire on top of the obstruction. This is a simple way of prescribing a burner.

Some additional features of obstructions are as follows:

- In addition to SURF\_ID and SURF\_IDS, you can also use the sextuplet SURF\_ID6 as follows:

```
&OBST XB=2.3,4.5,1.3,4.8,0.0,9.2,
      SURF_ID6='FIRE','INERT','HOT','COLD','BLOW','INERT' /
```

where the six surface descriptors refer to the planes  $x = 2.3$ ,  $x = 4.5$ ,  $y = 1.3$ ,  $y = 4.8$ ,  $z = 0.0$ , and  $z = 9.2$ , respectively. Note that SURF\_ID6 should not be used on the same OBST line as SURF\_ID or SURF\_IDS.

- Obstructions can have zero thickness. Often, thin sheets, like a window, form a barrier, but if the numerical mesh is coarse relative to the thickness of the barrier, the obstruction might be unnecessarily large if it is assumed to be one layer of mesh cells thick. All faces of an obstruction are shifted to the closest mesh cell. If the obstruction is very thin, the two faces may be approximated on the same cell face. FDS and Smokeview render this obstruction as a thin sheet, but it is allowed to have thermally thick boundary conditions. This feature is fragile, especially in terms of burning and blowing gas. A thin sheet obstruction can only have one velocity vector on its face, thus a gas cannot be injected reliably from a thin obstruction because whatever is pushed from one side is necessarily pulled from the other. For full functionality, the obstruction should be specified to be at least one mesh cell thick. Thin sheet obstructions work fine as flow barriers, but other features are fragile and should be used with caution. To prevent FDS from allowing thin sheet obstructions, set `THICKEN_OBSTRUCTIONS=.TRUE.` on the `MISC` line, or `THICKEN=.TRUE.` on each `OBST` line for which the thin sheet assumption is not allowed.
- Unlike earlier versions of FDS, obstructions that are too small relative to the underlying numerical mesh are rejected. Be careful when testing cases on coarse meshes.
- Obstructions may be created or removed during a simulation. See Section 11.4.1 for details.
- If two obstructions overlap at one or more faces, the one listed last in the input file takes precedence over the one listed first, in the sense that the latter's surface properties will be applied to the overlapping face. Smokeview renders both obstructions independently of each other, often leading to an unsightly cross-hatching of the two surface colors where there is an overlap. A simple remedy for this is to “shrink” the first obstruction slightly by adjusting its coordinates (`XB`) accordingly. Then, in Smokeview, toggle the “q” key to show the obstructions as you specified them, rather than as FDS rendered them.
- Obstructions can be protected from the `HOLE` punching feature. Sometimes it is convenient to create a door or window using a `HOLE`. For example, suppose a `HOLE` is punched in a wall to represent a door or window. An obstruction can be defined to fill this hole (presumably to be removed or colored differently or whatever) so long as the phrase `PERMIT_HOLE=.FALSE.` is included on the `OBST` line. In general, any `OBSTRUCTION` can be made impenetrable to a `HOLE` using this phrase. By default, `PERMIT_HOLE=.TRUE.`, meaning that an `OBSTRUCTION` is assumed to be penetrable unless otherwise directed.
- If the obstruction is not to be removed or rejected for any reason, set `REMOVABLE=.FALSE.` This is sometimes needed to stop FDS from removing the obstruction if it is embedded within another, like a door within a wall.
- In rare cases, you might not want to allow a `VENT` to be attached to a particular obstruction, in which case set `ALLOW_VENT=.FALSE.`
- Obstructions can be made semi-transparent by assigning a `TRANSPARENCY` on the `OBST` line. This real parameter ranges from 0 to 1, with 0 being fully transparent. The parameter should always be set along with either `COLOR` or an `RGB` triplet. It can also be specified on the appropriate `SURF` line, along with a color indicator.
- Obstructions are drawn solid in Smokeview. To draw an outline representation, set `OUTLINE=.TRUE.`

### 7.1.1 Non-rectangular Geometry and Sloped Ceilings

The efficiency of FDS is due to the simplicity of its numerical mesh. However, there are situations in which certain geometric features do not conform to the rectangular mesh, such as a sloped ceiling or roof. In



these cases, construct the curved geometry using rectangular obstructions, a process sometimes called “stair stepping”. A concern is that the stair stepping changes the flow pattern near the wall. To lessen the impact of stair stepping on the flow field near the wall, prescribe the parameter

```
SAWTOOTH=.FALSE.
```

on each OBST line that makes up the stair stepped obstruction. The effect of this parameter is to prevent vorticity from being generated at sharp corners, in effect smoothing out the jagged steps that make up the obstruction. This is not a complete solution of the problem, but it does provide a simple way of ensuring that the flow field around a non-rectangular obstruction is not inhibited by extra drag created at sharp corners.

Do not apply SAWTOOTH=.FALSE. to obstructions that have any SURF\_IDS with the attribute BURN\_AWAY=.TRUE.

## 7.2 Creating Voids: The HOLE Namelist Group (Table 13.7)

The HOLE namelist group is used to define parameters (Table 13.7) to carve a hole out of an existing obstruction or set of obstructions. To do this, add lines of the form

```
&HOLE XB=2.0,4.5,1.9,4.8,0.0,9.2 /
```

Any solid mesh cells within the volume  $2.0 < x < 4.5$ ,  $1.9 < y < 4.8$ ,  $0.0 < z < 9.2$  are removed. Obstructions intersecting the volume are broken up into smaller blocks.

If the hole represents a door or window, a good rule of thumb is to punch more than enough to create the hole. This ensures that the hole is created through the entire obstruction.

For example, if the OBST line denotes a wall 0.1 m thick:

```
&OBST XB=1.0,1.1,0.0,5.0,0.0,3.0 /
```

and you want to create a door, add this:

```
&HOLE XB=0.99,1.11,2.0,3.0,0.0,2.0 /
```

The extra centimeter added to the  $x$  coordinates of the hole make it clear that the hole is to punch through the entire obstruction.

When a HOLE is created, the affected obstruction(s) are either rejected, or created or removed at pre-determined times. See Section 11.4.1 for details. To allow a hole to be controlled with either the CTRL or DEVC namelist groups, you will need to add the CTRL\_ID or DEVC\_ID parameter respectively, to the HOLE line.

Note that while single DEVC or CTRL can be used to control multiple items, a DEVC or CTRL that is being used for a HOLE should not be used for anything else other than additional HOLES.

If it is desired that the obstruction(s) to be cut out should have a different color than the original obstruction, set the COLOR or integer triplet RGB on the HOLE line (see Section 8.6).

When a HOLE is in a .FALSE. state, an obstruction is placed in the hole. To make this obstruction transparent, the TRANSPARENCY parameter should be specified by a real number from 0-1. Note

that if `TRANSPARENCY` is specified, then either a `COLOR` or `RGB` triplet ought to be specified as well. A `TRANSPARENCY` value near, but not equal to, zero can be used to simulate a window when the `HOLE`'s `INITIAL_STATE=.FALSE.` When the `DEVC` or `CTRL` is activated and changes the state of the hole to `.TRUE.`, the `HOLE` is then open and completely transparent. See Section 20.1 for an example.

If an obstruction is not to be punctured by a `HOLE`, add `PERMIT_HOLE=.FALSE.` to the `OBST` line.

It is a good idea to inspect the geometry by running either a setup job (`T_END=0` on the `TIME` line) or a short-time job to test the operation of devices and control functions.

Note that a `HOLE` has no effect on a `VENT` or a mesh boundary. It only applies to `OBST`structions.

### 7.3 Applying Surface Properties: The `VENT` Namelist Group (Table 13.26)

Whereas the `OBST` group is used to specify obstructions within the computational domain, the `VENT` group (Table 13.26) is used to prescribe planes adjacent to obstructions or external walls. The vents are chosen in a similar manner to the obstructions, with the sextuplet `XB` denoting a plane abutting a solid surface. Two of the six coordinates must be the same, denoting a plane as opposed to a solid.

Note that only one `VENT` may be specified for any given wall cell. If additional `VENT` lines are specified for a given wall cell, FDS will output a warning message and ignore the subsequent lines (i.e. only the first vent will be applied)

The term “`VENT`” is somewhat misleading. Taken literally, a `VENT` can be used to model components of the ventilation system in a building, like a diffuser or a return. In these cases, the `VENT` coordinates form a plane on a solid surface forming the boundary of the duct. No holes need to be created through the solid; it is assumed that air is pushed out of or sucked into duct work within the wall. Less literally, a `VENT` is used simply as a means of applying a particular boundary condition to a rectangular patch on a solid surface. A fire, for example, is usually created by first generating a solid obstruction via an `OBST` line, and then specifying a `VENT` somewhere on one of the faces of the solid with a `SURF_ID` with the characteristics of the thermal and combustion properties of the fuel. For example, the lines

```
&OBST XB=0.0,5.0,2.0,3.0,0.0,4.0, SURF_ID='big block' /
&VENT XB=1.0,2.0,2.0,2.0,1.0,3.0, SURF_ID='hot patch' /
```

specify a large obstruction (with the properties given elsewhere in the file under the name ‘`big block`’) with a “patch” applied to one of its faces with alternative properties under the name ‘`hot patch`’. This latter surface property need not actually be a “vent,” like a supply or return duct, but rather just a patch with different boundary conditions than those assumed for the obstruction. Note that the surface properties of a `VENT` over-ride those of the underlying obstruction.

Unlike previous versions of FDS, you can no longer specify a free-standing fan using the `VENT` construct. A `VENT` must always be attached to a solid obstruction. See Section 8.2.3 for instructions on specifying different types of fans.

An easy way to specify an entire external wall is to replace `XB` with `MB` (Mesh Boundary), a character string whose value is one of the following: ‘`XMAX`’, ‘`XMIN`’, ‘`YMAX`’, ‘`YMIN`’, ‘`ZMAX`’ or ‘`ZMIN`’ denoting the

planes  $x = XMAX$ ,  $x = XMIN$ ,  $y = YMAX$ ,  $y = YMIN$ ,  $z = ZMAX$  or  $z = ZMIN$ , respectively. Like an obstruction, the boundary condition index of a vent is specified with `SURF_ID`, indicating which of the listed `SURF` lines to apply. If the default boundary condition is desired, then `SURF_ID` need not be set.

Be careful when using the `MB` shortcut when doing a multiple mesh simulation, that is, when more than one rectangular mesh is used. The plane designated by the keyword `MB` is applied to all of the meshes, possibly leading to confusion about whether a plane is a solid wall or an open boundary. Check the geometry in Smokeview to assure that the `VENTs` are properly prescribed. Use color as much as possible to double-check the set-up. More detail on color in Section 8.6 and Table 8.1. Also, the parameter `OUTLINE=.TRUE.` causes the `VENT` to be drawn as an outline in Smokeview.

### 7.3.1 Special `VENTs`

There are two reserved `SURF_ID`'s that may be applied to a `VENT` – '`OPEN`' and '`MIRROR`'. The term *reserved* means that these two `SURF_IDS` should not be explicitly defined by you. Their properties are predefined.

#### An `OPEN VENT`

The first special `VENT` is invoked by the parameter `SURF_ID='OPEN'`. This is used only if the `VENT` is applied to the exterior boundary of the computational domain, where it denotes a passive opening to the outside. By default, FDS assumes that the exterior boundary of the computational domain (the `XBs` on the `MESH` line) is a solid wall. To change this, use an `OPEN` vent as if it were an open door or window. To create a totally or partially open domain, use `OPEN` vents on the exterior mesh boundaries (`MBs`).

By default, it is assumed that ambient conditions exist beyond the '`OPEN`' vent. However, in some cases, you may want to alter this assumption, for example, the temperature. If you assume a temperature other than ambient, specify `TMP_EXTERIOR` along with `SURF_ID='OPEN'`. Use this option cautiously – in many situations if you want to describe the exterior of a building, it is better to include the exterior explicitly in your calculation because the flow in and out of the doors and windows will be more naturally captured. See Section 6.4.5 for more details.

As with exterior temperature, to change the exterior mass fraction of a particular gas species, set `MASS_FRACTION(N)` on the `VENT` line, where `N` denotes the species index. See Section 9.2 for more information about gas species.

If you want to specify a non-ambient pressure at the `OPEN` boundary, see Section 8.2.5.

Vents to the outside of the computational domain (`OPEN` vents) may **not** be opened or closed during a simulation. See Section 11.4.2 for details.

#### A `MIRROR VENT`

A `VENT` with `SURF_ID='MIRROR'` denotes a symmetry plane. Usually, a `MIRROR` spans an entire face of the computational domain, essentially doubling the size of the domain with the `MIRROR` acting as a plane of symmetry. The flow on the opposite side of the `MIRROR` is exactly reversed. From a numerical point of view, a `MIRROR` is a no-flux, free-slip boundary. As with `OPEN`, a `MIRROR` can only be prescribed at an exterior boundary of the computational domain. Often, `OPEN` or `MIRROR` `VENTs` are prescribed along an entire side of the computational domain, in which case the “`MB`” notation is handy.

Note that the mirror image of a scene is **not** shown in Smokeview.

A word of warning about `MIRROR` boundaries in FDS. In conventional RANS (Reynolds-Averaged Navier-Stokes) models, symmetry boundaries are often used as a way of saving on computation time. However, because FDS is an LES (Large Eddy Simulation) model, the use of symmetry boundaries should be considered carefully. The reason for this is that an LES model does not compute a time-averaged solution of the N-S equations. In other words, for a RANS model, a fire plume is represented as an axially-symmetric flow field because that is what you would expect if you time-averaged the actual flow field over a sufficient amount of time. Thus, for a RANS model, a symmetry boundary along the plume centerline is appropriate. In an LES model, however, there is no time-averaging built into the equations, and there is no time-averaged, symmetric solution. Putting a `MIRROR` boundary along the centerline of a fire plume will change its dynamics entirely. It will produce something very much like the flow field of a fire that is adjacent to a vertical wall. For this reason, a `MIRROR` boundary condition is not recommended along the centerline of a turbulent fire plume. If the fire or burner is very small, and the flow is laminar, then the `MIRROR` boundary condition makes sense. In fact, in 2-D calculations, `MIRROR` boundary conditions are employed in the third coordinate direction (this is done automatically, you need not specify it explicitly).

### 7.3.2 Controlling VENTS

`VENT` functionality can be controlled in some cases using “devices” and “controls,” specified via a `DEVC_ID` or a `CTRL_ID`. See Section 11.4.2 for details.

### 7.3.3 Trouble-Shooting VENTS

Unlike most of the entries in the input file, the order that you specify `VENTS` can be important. There might be situations where it is convenient to position one `VENT` atop another. For example, suppose you want to designate the ceiling of a compartment to have a particular set of surface properties, and you designate the entire ceiling to have the appropriate `SURF_ID`. Then, you want to designate a smaller patch on the ceiling to have another set of surface properties, like an air supply. In this case, you must designate the supply `VENT` **first** because for that area of the ceiling, FDS will ignore the ceiling properties and apply the supply properties. FDS processes the first `VENT`, not the second as it did in versions prior to FDS 5. Now, the rule for `VENTS` is “first come, first served.” Keep in mind, however, that the second `VENT` is not rejected entirely – only where there is overlap. FDS will also print out a warning to the screen (or to standard error) saying which `VENT` has priority.

Smokeview can help identify where two `VENTS` overlap, assuming each has a unique `COLOR`. Because Smokeview draws `VENTS` on top of each other, areas of overlap will have a grainy, awkward appearance that changes pattern as you move the scene. In situations where you desire the overlap for the sake of convenience, you might want to slightly adjust the coordinates of the preferred `VENT` so that it is slightly offset from the solid surface. Make the offset less than about a tenth of a cell dimension so that FDS snaps it to its desired location. Then, by toggling the “q” key in Smokeview, you can eliminate the grainy color overlap by showing the `VENT` exactly where you specified it, as opposed to where FDS repositioned it. This trick also works where the faces of two obstructions overlap.

If an error message appears requesting that the orientation of a vent be specified, first check to make sure that the vent is a plane. If the vent is a plane, then the orientation can be forced by specifying the parameter `IOR`. If the normal direction of the `VENT` is in the positive  $x$  direction, set `IOR=1`. If the normal direction is in the negative  $x$  direction, set `IOR=-1`. For the  $y$  and  $z$  direction, use the number 2 and 3, respectively. Setting `IOR` may sometimes solve the problem, but it is more likely that if there is an error message about orientation, then the `VENT` is buried within a solid obstruction, in which case the program cannot determine the direction in which the `VENT` is facing.

## Chapter 8

# Boundary Conditions

This chapter describes how to specify the properties of the objects that make up the bounding surfaces of the flow domain. **This is the most challenging part of setting up the simulation.** Why? First, for both real and simulated fires, the growth of the fire is very sensitive to the thermal properties of the surrounding materials. Second, even if all the material properties are known to some degree, the physical phenomena of interest may not be simulated properly due to limitations in the model algorithms or resolution of the numerical mesh. It is your responsibility to supply the thermal properties of the materials, and then assess the performance of the model to ensure that the phenomena of interest are being captured.

### 8.1 Basics

By default, the outer boundary of the computational domain is assumed to be a solid boundary that is maintained at ambient temperature. The same is true for any obstructions that are added to the scene. To specify the properties of solids, use the namelist group `SURF` (Section 8.2). Starting in FDS 5, solids are assumed to consist of layers which can be made of different materials. The properties of each material required are designated via the `MATL` namelist group (Section 8.4). These properties indicate how rapidly the materials heat up, and how they burn. Each `MATL` entry in the input file must have an `ID`, or name, so that they may be associated with a particular `SURF` via the parameter `MATL_ID`. For example, the input file entries:

```
&MATL ID          = 'BRICK'  
  CONDUCTIVITY    = 0.69  
  SPECIFIC_HEAT   = 0.84  
  DENSITY         = 1600. /  
  
&SURF ID          = 'BRICK WALL'  
  MATL_ID         = 'BRICK'  
  COLOR           = 'RED'  
  BACKING         = 'EXPOSED'  
  THICKNESS       = 0.20 /  
  
&OBST XB=0.1, 5.0, 1.0, 1.2, 0.0, 1.0, SURF_ID='BRICK WALL' /
```

define a brick wall that is 4.9 m long, 1 m high, and 20 cm thick.

The thickness of the wall indicated by the `OBST` line need not match that indicated by the `SURF` line. The thickness of the material on the surface of the wall is dictated by the parameter `THICKNESS`. These two parameters are independent for each other, the `OBST` line describes the overall geometric structure, the `SURF` line describes the characteristics of the surfaces of the geometry which includes the thickness of the layers of materials applied to that surface.

## 8.2 Describing the Bounding Surfaces: The `SURF` Namelist Group (Table 13.22)

`SURF` is the namelist group (Table 13.22) that defines the structure of all solid surfaces or openings within or bounding the flow domain. Boundary conditions for obstructions and vents are prescribed by referencing the appropriate `SURF` line(s) whose parameters are described in this section.

The default boundary condition for all solid surfaces is that of a inert wall with the temperature fixed at `TEMPA`, and is referred to as `'INERT'`. If only this boundary condition is needed, there is no need to add any `SURF` lines to the input file. If additional boundary conditions are desired, they are to be listed one boundary condition at a time. Each `SURF` line consists of an identification string `ID='...'` to allow references to it by an obstruction or vent. Thus, on each `OBST` and `VENT` line, the character string `SURF_ID='...'` indicates the `ID` of the `SURF` line containing the desired boundary condition parameters. If a particular `SURF` line is to be applied as the default boundary condition, `CONCRETE` for example, set `SURF_DEFAULT='CONCRETE'` on the `MISC` line.

The default boundary condition `'INERT'` does allow for heat loss and is not the same as an adiabatic surface. If you wish to define a surface as adiabatic, then you should set `ADIABATIC=.TRUE.` on the `SURF` line.

### 8.2.1 Specifying a Fire with a Known Heat Release Rate

Solids and liquid fuels can be modeled by specifying their relevant properties via the `MATL` namelist group. However, if you simply want to specify a fire of a given heat release rate (`HRR`), you need not specify any material properties. A specified fire is basically modeled as the ejection of gaseous fuel from a solid surface or vent. This is essentially a burner, with a specified Heat Release Rate Per Unit Area, `HRRPUA`, in units of  $\text{kW/m}^2$ . For example

```
&SURF ID='FIRE',HRRPUA=500. /
```

applies  $500 \text{ kW/m}^2$  to any surface with the attribute `SURF_ID='FIRE'`. See the discussion of **Time Dependent Conditions** in Section 8.5 to learn how to ramp the heat release rate up and down.

An alternative to `HRRPUA` with the exact same functionality is `MLRPUA`, except this parameter specifies the Mass Loss Rate of fuel gas Per Unit Area in  $\text{kg/m}^2/\text{s}$ . Do not specify both `HRRPUA` and `MLRPUA` on the same `SURF` line. With either, the stoichiometry of the gas phase reaction is set by the parameters on the `REAC` line. All of the species associated with the combustion process are accounted for by way of the mixture fraction variable and should not be explicitly prescribed. The exception to this rule is where a non-reacting gas is introduced into the domain that merely serves as a diluent, like  $\text{CO}_2$  from an extinguisher or  $\text{H}_2\text{O}$  from evaporated sprinkler droplets (see Section 9.2 for details). If a finite rate combustion model is desired instead of the default mixture fraction model, see Section 9.3.

Specifying `HRRPUA` or `MLRPUA` automatically invokes the mixture fraction combustion model.

### 8.2.2 Simple Thermal Boundary Conditions

Usually, the thermal properties of a solid boundary are specified via the `MATL` namelist group, which is in turn invoked by the `SURF` entry via the character string `MATL_ID`. However, sometimes it is convenient to simply specify a fixed temperature boundary condition, in which case set `TMP_FRONT` to be the surface temperature in units of  $^{\circ}\text{C}$ . For a solid surface of fixed convective heat flux, set `CONVECTIVE_HEAT_FLUX` to be the convective heat flux in units of  $\text{kW/m}^2$ . If `CONVECTIVE_HEAT_FLUX` is positive, the wall heats up the surrounding gases. If `CONVECTIVE_HEAT_FLUX` is negative, the wall cools the surrounding gases. The radiative heat flux can be specified only by setting both `TMP_FRONT` and `EMISSIVITY`.

Fixed temperature or fixed heat flux boundary conditions are easy to apply, but only of limited usefulness in real fire scenarios. In most cases, walls, ceilings and floors are made up of several layers of lining materials.

It is assumed that the innermost layer backs up to an air gap at ambient temperature (like a sheet of gypsum board attached to wood studs), or it backs up to an insulated material in which case no heat is lost to the backing material, or it backs up to the room on the other side of the wall. By default, it is assumed that the wall liner backs up to an air gap (`BACKING='VOID'`). If the wall liner is assumed to back up against an insulating material, like a sheet of steel attached to a fiber insulating board, the expression `BACKING='INSULATED'` on the `SURF` line prevents any heat loss from the back side of the material.

Finally, if it is desired that the heat transfer through the wall into the space behind the wall, the attribute `BACKING='EXPOSED'` should be listed. This feature only works if the wall is less than or equal to one mesh cell thick, and if there is a non-zero volume of computational domain on the other side of the wall. Obviously, if the wall is an external boundary of the domain, the heat is lost to the void.

For some special applications, it is often desired that a solid surface be adiabatic, that is, there is no net heat transfer (radiative and convective) from the gas to the solid. For this case, all that must be prescribed on the `SURF` line is `ADIABATIC=.TRUE.`, nothing else. FDS will compute a wall temperature so that the sum of the convective and radiative fluxes is zero.

### 8.2.3 Fans and other Velocity Boundary Conditions

For most applications, the ventilation system of a building is described in FDS using velocity *boundary conditions*. For example, fresh air can be blown into, and smoke can be drawn from, a compartment by specifying a velocity in the *normal* direction to a solid surface. However, there are various other facets of velocity boundary conditions that are described below.

#### Supply and Exhaust Vents

The easiest way to describe a supply or exhaust fan is to create a `VENT` positioned on a solid surface with a `SURF_ID` with some form of specified velocity or volume flow rate. The normal component of velocity is usually specified directly via the parameter `VEL`. If `VEL` is negative, the flow is directed *into* the computational domain, *i.e.*, a supply vent. If `VEL` is positive, the flow is drawn *out of* the domain, *i.e.*, an exhaust vent. For example, the lines

```
&SURF ID='SUPPLY', VEL=-1.2, COLOR='BLUE' /  
&VENT XB=5.0,5.0,1.0,1.4,2.0,2.4, SURF_ID='SUPPLY' /
```

create a `VENT` that *supplies* air at a velocity of 1.2 m/s through an area of nominally  $0.16 \text{ m}^2$ , depending on the realignment of the `VENT` onto the FDS mesh. Regardless of the orientation of the plane  $x = 5$ , the flow will be directed *into* the room because of the sign of `VEL`. In this example the `VENT` may not be exactly  $0.16 \text{ m}^2$  in area because it may not align exactly with the computational mesh. If this is the

case then `VOLUME_FLUX` can be prescribed instead of `VEL`. The units are  $\text{m}^3/\text{s}$ . If the flow is entering the computational domain, `VOLUME_FLUX` should be a negative number, the same convention as for `VEL`. Note that a `SURF` with a `VOLUME_FLUX` prescribed can be invoked by either a `VENT` or an `OBST`, but be aware that in the latter case, the resulting velocity on the face or faces of the obstruction will be given by the specified `VOLUME_FLUX` divided by the area of that particular face. For example:

```
&SURF ID='SUPPLY', VOLUME_FLUX=-5.0, COLOR='GREEN' /
&OBST XB=..., SURF_ID6='BRICK','SUPPLY','BRICK','BRICK','BRICK','BRICK' /
```

dictates that the forward  $x$ -facing surface of the obstruction is to have a velocity equal to  $5 \text{ m}^3/\text{s}$  divided by the area of the face (as approximated within FDS) flowing into the computational domain.

Note that either `VEL` or `VOLUME_FLUX` should be prescribed, not both. The choice depends on whether an exact velocity is desired at a given vent, or whether the given volume flux is desired.

## Heaters

You can create a simple heating vent by changing the temperature of the incoming air

```
&SURF ID='BLOWER', VEL=-1.2, TMP_FRONT=50. /
```

The `VENT` with `SURF_ID='BLOWER'` would blow  $50^\circ\text{C}$  air at  $1.2 \text{ m/s}$  into the flow domain. Making `VEL` positive would suck air out, in which case `TMP_FRONT` would not be necessary.

Note that if `HRRPUA` or solid phase reaction parameters are specified, no velocity should be prescribed. The combustible gases are ejected at a velocity computed by FDS.

## Total Mass Flux

Most often, you specify a simple supply or exhaust vent by setting either a normal velocity or volume flux at a solid surface. However, you may wish to control the mass flow rate ( $\text{kg/s}$ ), as opposed to the volume flow rate ( $\text{m}^3/\text{s}$ ), via the parameter `MASS_FLUX_TOTAL`. `MASS_FLUX_TOTAL` uses the same sign convention as `VEL` above. In fact, the value entered for `MASS_FLUX_TOTAL` is converted internally into a velocity boundary condition whose value for an outflow is adjusted based on the local density.

## Tangential Velocity Boundary Conditions

As a gas flows past a solid obstruction, it “sticks” to the surface and forms a boundary layer. Ideally, the gas velocity at the surface is zero, and it increases rapidly through a boundary layer that is only a few millimeters thick to its “free-stream” value. In most practical simulations, it is not possible to resolve this boundary layer directly; thus, an empirical model is used to represent its effect on the overall flow field. In an LES calculation (default), the velocity at the wall is set to be a fraction of its value in the mesh cell adjacent to the wall. Only in a DNS (Direct Numerical Simulation) calculation is the velocity at the wall actually set to zero. To alter these defaults, you can set a parameter called `SLIP_FACTOR`. This parameter ranges from -1 to 1. If a no-slip wall is desired, `SLIP_FACTOR=-1`. If a free-slip wall is desired, `SLIP_FACTOR=1`. Numbers in between -1 and 1 can represent partial slip conditions, which may be appropriate for simulations involving large mesh cells. The default `SLIP_FACTOR` is 0.5 for LES, -1.0 for DNS.



It is not recommended that you change the default velocity boundary condition unless you are interested in its effect on the overall flow. Sometimes people represent various degrees of *surface roughness* via the `SLIP_FACTOR`. However, this should be done carefully using experimental data or empirical correlation as guidance.

## Louvered Vents

Most real supply vents are covered with some sort of grill or louvers which act to redirect, or *diffuse*, the incoming air stream. It is possible to mimic this effect, to some extent, by prescribing both a normal and the tangential components of the flow. The normal component is specified with `VEL` as described above. The tangential is prescribed via a pair of real numbers `VEL_T` representing the desired tangential velocity components in the other two coordinate directions (*x* or *y* should precede *y* or *z*). For example, the line

```
&SURF ID='LOUVER', VEL=-1.2, VEL_T=0.5,-0.3 /
```

is a boundary condition for a louvered vent that pushes air into the space with a normal velocity of 1.2 m/s and a tangential velocity of 0.5 m/s in either the *x* or *y* direction and -0.3 m/s in either the *y* or *z* direction, depending on what the normal direction is.

In cases of limited mesh resolution, it may not be possible to describe a louvered vent or slot diffuser using `VEL_T` because there may not be enough mesh cells spanning the opening. In these cases, you might consider simply specifying a flat plate obstruction in front of the `VENT` with an offset of one mesh cell. The plate will simply redirect the air flow in all lateral directions.

## Jet Fans

Fans do not have to be mounted on a solid wall, like a supply or an exhaust fan. If you just want to blow gases in a particular direction, create a thin (zero cells thick) `OBST`struction and apply to it, via `SURF_ID` only, a `SURF` line that has the parameter `POROUS=.TRUE.` along with the other velocity parameters described above. This allows hot, smokey gases to pass through the obstruction, much like a free-standing fan. These obstructions are merely flat plates, by necessity. The velocity `VEL` associated with a `POROUS` surface is meant to represent the velocity in the positive or negative coordinate direction, as indicated by its sign. **This is different than the convention used when the `SURF` is attached to a solid wall.**

You may also want to construct a *shroud* around the fan using four flat plates arranged to form a short passageway that draws gases in one side and expels them out the other. The plate representing the fan itself can be positioned about halfway along the passage.

A `SURF` with `POROUS=.TRUE.` can only be applied to an `OBST`struction. It has no meaning when applied to a `VENT`.

## Fan Curves

The above strategies for specifying various parts of a ventilation system have not considered the fact that a real ventilation system is affected by pressure changes between compartments. This topic is taken up in Section 8.3.2.

### 8.2.4 Species and Species Mass Flux Boundary Conditions

There are two species boundary conditions that can be specified (see Section 9.2 for details on inputting and using species). These boundary conditions are `MASS_FLUX(N)` and `MASS_FRACTION(N)` where *N*

refers to a given species is via its place in the input file. For example, the second listed species is  $N=2$ . If a simple no-flux condition is desired at a solid wall, do not set anything. If the mass fraction of the  $N$ th species is to be some value at a forced flow boundary (VEL or MASS\_FLUX\_TOTAL) set MASS\_FRACTION( $N$ ) equal to the desired mass fraction on the appropriate SURF line. If the mass flux of the  $N$ th species is desired, set MASS\_FLUX( $N$ ) instead of MASS\_FRACTION( $N$ ). If MASS\_FLUX( $N$ ) is set, no VEL should be set. It is automatically calculated based on the mass flux. The inputs MASS\_FLUX( $N$ ) (and typically MASS\_FRACTION( $N$ )) should only be used for inflow boundary conditions. MASS\_FLUX( $N$ ) should be positive with units of  $\text{kg/m}^2/\text{s}$ .

Note that specifying MASS\_FRACTION( $N$ ), sets the "ghost" cell values for the species mass fractions. Since the mass conservation equation is an advection-diffusion equation, if the specified velocity is small, then the diffusion term can dominate resulting in an unintended mass flux of species. To obtain a guaranteed mass flux of a species, you should use MASS\_FLUX( $N$ )

### 8.2.5 Special Topic: Pressure Boundary Conditions

In some situations, it is more convenient to specify a pressure, rather than a velocity, at a boundary. Suppose, for example, that you are modeling the interior of a tunnel, and a wind is blowing at one of the portals that affects the overall flow within the tunnel. If (and only if) the portal is defined using an OPEN vent, then the *dynamic pressure* at the boundary can be specified like this:

```
&VENT XB=..., SURF_ID='OPEN', DYNAMIC_PRESSURE=2.4, PRESSURE_RAMP='wind' /
&RAMP ID='wind', T= 0.0, F=1.0 /
&RAMP ID='wind', T=30.0, F=0.5 /
:
:
```

The use of a *dynamic pressure* boundary affects the FDS algorithm as follows. At OPEN boundaries, the hydrodynamic pressure (head)  $\mathcal{H}$  is specified as

$$\begin{aligned}\mathcal{H} &= \text{DYNAMIC\_PRESSURE}/\rho_\infty + |\mathbf{u}|^2/2 && \text{(outgoing)} \\ \mathcal{H} &= \text{DYNAMIC\_PRESSURE}/\rho_\infty && \text{(incoming)}\end{aligned}\tag{8.1}$$

where  $\rho_\infty$  is the ambient density and  $\mathbf{u}$  is the most recent value of the velocity on the boundary. The PRESSURE\_RAMP allows you to alter the pressure as a function of time. Note that you do not need to ramp the pressure up or down starting at zero, like you do for various other ramps. The net effect of a positive dynamic pressure at an otherwise quiescent boundary is to drive a flow into the domain. However, a fire-driven flow of sufficient strength can push back against this incoming flow. A simple example demonstrating this effect is given in Section 15.3.

### 8.2.6 Special Topic: Fires and Flows in the Outdoors

Simulating a fire in the outdoors is not much different than a fire indoors, but there are a few issues that need to be addressed. First, the velocity of the wind profile at any exterior boundary will be a top hat (constant) by default, but the parameter PROFILE on the SURF line can yield other profiles. For example, PROFILE='PARABOLIC' produces a parabolic profile with VEL being the maximum velocity, and 'ATMOSPHERIC' produces a typical atmospheric wind profile of the form  $u = u_0(z/z_0)^p$ . If an atmospheric profile is prescribed, also prescribe  $z_0$  for  $z_0$  and PLE for  $p$ . VEL specifies the reference velocity  $u_0$ . Note that  $z_0$  is not the ground, but rather some height where the wind speed is measured, like an elevated weather station. It is assumed that the ground is located at  $z = 0$ . To change this assumption, set GROUND\_LEVEL on

the MISC line to be the appropriate value of  $z$ . Be careful not to apply an atmospheric velocity profile below GROUND\_LEVEL or FDS will stop with an error.

Another useful parameter for outdoor simulations is the temperature lapse rate of the atmosphere. Typically, in the first few hundred meters of the atmosphere, the temperature decreases several degrees Celsius per kilometer. These few degrees are important when considering the rise of smoke since the temperature of the smoke decreases rapidly as it rises. The LAPSE\_RATE of the atmosphere can be specified on the MISC line in units of  $^{\circ}\text{C}/\text{m}$ . A negative sign indicates that the temperature *decreases* with height. This need only be set for outdoor calculations where the height of the domain is tens or hundreds of meters. The default value of the LAPSE\_RATE is  $0^{\circ}\text{C}/\text{m}$ .

By default, FDS assumes that the density and pressure decrease with height, regardless of the application or domain size. For most simulations, this effect is negligible, but it can be turned off completely by setting STRATIFICATION=.FALSE. on the MISC line.

### 8.2.7 Special Topic: A Radially-Spreading Fire

Sometimes it is desired that a fire spread radially at some specified rate. Rather than trying to design material properties to achieve this, you can alternatively use a VENT in a special way. If the SURF\_ID associated with a VENT defines a specified heat release rate, HRRPUA, and time history, RAMP\_Q or TAU\_Q, you can also specify XYZ and SPREAD\_RATE on the VENT line. Then the fire is directed to start at the point XYZ and spread radially at a rate of SPREAD\_RATE (m/s). The ramp-up begins at the time when the fire arrives at a given point. For example, the lines

```
&SURF ID='FIRE', HRRPUA=500.0, RAMP_Q='fireramp' /
&RAMP ID='fireramp', T= 0.0, F=0.0 /
&RAMP ID='fireramp', T= 1.0, F=1.0 /
&RAMP ID='fireramp', T=30.0, F=1.0 /
&RAMP ID='fireramp', T=31.0, F=0.0 /
&VENT XB=0.0,5.0,1.5,9.5,0.0,0.0, SURF_ID='FIRE', XYZ=1.5,4.0,0.0, SPREAD_RATE=0.03 /
```

create a rectangular patch at  $z = 0$  on which the fire starts at the point (1.5,4.0,0.0) and spreads outwards at a rate of 0.03 m/s. Each surface cell burns for 30 s as the fire spreads outward, creating a widening ring of fire. Note that the RAMP\_Q is used in this construct to turn the burning on and off to simulate the consumption of fuel as the fire spreads radially. It should not be used to mimic the “ $t$ -squared” curve – the whole point of the exercise is to mimic this curve in a more natural way. Eventually, the fire goes out as the ring grows past the boundary of the rectangle. Some trial and error is probably required to find the SPREAD\_RATE that leads to a desired time history of the heat release rate.

### 8.2.8 Special Topic: Non-Planar Walls and Targets

All obstructions in FDS are assumed to conform to the rectilinear mesh, and all bounding surfaces are assumed to be flat planes. However, many objects, like cables, pipes, and ducts, are not flat. Even though these objects have to be represented in FDS as “boxes,” you can still perform the internal heat transfer calculation as if the object were really cylindrical or spherical. For example, the input lines:

```
&OBST XB=0.0,5.0,1.1,1.2,3.4,3.5, SURF_ID='CABLE' /
&SURF ID='CABLE', MATL_ID='PVC', GEOMETRY='CYLINDRICAL', THICKNESS=0.01 /
```

can be used to model a power cable that is 5 m long, cylindrical in cross section, 2 cm in diameter. The heat transfer calculation is still one-dimensional; that is, it is assumed that there is a uniform heat flux all about the object. This can be somewhat confusing because the cable is represented as an obstruction of

square cross section, with a separate heat transfer calculation performed at each face, and no communication among the four faces. Obviously, this is not an ideal way to do solid phase heat transfer, but it does provide a reasonable bounding surface temperature for the gas phase calculation. More detailed assessment of a cable would require a two or three-dimensional heat conduction calculation, which is not included in FDS. Use `GEOMETRY=' SPHERICAL'` to describe a spherical object.

### 8.3 Pressure-Related Effects: The ZONE Namelist Group (Table 13.26)

The basic FDS equation set assumes pressure to be composed of a “background” component,  $\bar{p}(z,t)$ , plus a perturbation,  $\tilde{p}(\mathbf{x},t)$ . Most often,  $\bar{p}$  is just the hydrostatic pressure, and  $\tilde{p}$  is the flow-induced pressure field that FDS calculates at each time step. Originally (FDS v. 1-4), it was possible to create a single, sealed compartment whose walls conformed to the exterior of the computational domain. A fire or fan could increase (or decrease) the background pressure in this single compartment, and a leakage area could be defined between the compartment and the ambient exterior. Flow through the “cracks” was simply a function of the background pressure via the usual empirical rules. This idea has been generalized starting in FDS 5. Now, you can specify any number of sealed portions of the computational domain to have their own “background” pressures, and these zones can be connected via leakage and duct paths.

There are several restrictions to assigning pressure zones. First, the pressure zones must be completely surrounded by obstructions (an external boundary also suffices). Second, the obstructions cannot be removed during the calculation. In other words, the door or window cannot suddenly fly open (equivalently, there must be no OPEN vents if one of the zone boundaries is an external boundary of the computational domain). Third, the pressure zones **can** span multiple meshes, but check the pressure in each mesh to ensure consistency.

#### 8.3.1 Leaks

The volume flow,  $\dot{V}$ , through a leak of area  $A_L$  is given by

$$\dot{V}_{\text{leak}} = A_L \text{sign}(\Delta p) \sqrt{2 \frac{|\Delta p|}{\rho_\infty}} \quad (8.2)$$

where  $\Delta p$  is the pressure difference between the adjacent compartments (in units of Pa) and  $\rho_\infty$  is the ambient density (in units of kg/m<sup>3</sup>). The discharge coefficient normally seen in this type of formula is assumed to be 1. Leakage is inherently a submesh-scale phenomenon because the leakage area is usually very small. In other words, it is not possible to define a leak directly on the numerical mesh. It is sometimes possible to “lump” the leaks into a single mesh-resolvable hole, but this is problematic for two reasons. First, the leakage area rarely corresponds neatly to the area of a single mesh cell-sized hole. Second, the flow speeds through the hole can be large and cause numerical instabilities.

A better way to handle leakage is by exploiting pressure zones. A pressure zone is a user-specified volume within the computational domain that is entirely surrounded by solid obstructions. For example, the interior of a closed room can be, and should be, declared a pressure zone. Leakage from one compartment to another is then designated on the input lines defining the individual pressure ZONES:

```
&ZONE XB=0.3,1.2,0.4,2.9,0.3,4.5, LEAK_AREA(0)=0.0001 /  
&ZONE XB=2.3,5.8,1.4,2.9,6.8,9.7, LEAK_AREA(1)=0.0002, LEAK_AREA(0)=0.0003 /
```

The first line designates a region of the computational domain to be “Pressure Zone” 1. Note that the order of the ZONE lines is important; that is, the order implicitly defines Zone 1, Zone 2, *etc.* Zone 0 is by default the ambient pressure exterior. In this example, a leak exists between Zone 1 and the exterior Zone 0, and the area of the leak is 0.0001 m<sup>2</sup> (1 cm by 1 cm hole, for example). Zone 2 leaks to Zone 1 (and vis versa) with a leak area of 0.0002 m<sup>2</sup>. Zone 2 also leaks to the outside with an area of 0.0003 m<sup>2</sup>. Note that zones need not be connected for a leak to occur. At least one of the obstructions that form the walls of Zone 1 must have the attribute LEAK\_PATH=1, 0, meaning that the leak between Zones 1 and 0 is uniformly distributed over solids defined with:

```
&SURF ID='whatever',..., LEAK_PATH=1,0 /
```

Likewise, the boundaries of Zone 1 and Zone 2 must include solids whose SURF properties include LEAK\_PATH=1, 2, but these solids need not form a boundary between the two zones. The SURFACES with the LEAK\_PATH attribute lump all of the leakage over these areas. The order of the two pressure zones designated by LEAK\_PATH is unimportant.

### 8.3.2 Fan Curves

In Section 8.2.3 there is a discussion of velocity boundary conditions, in which a fan is modeled simply as a solid boundary that blows or sucks air, regardless of the surrounding pressure field. In reality, fans operate based on the pressure drop across the duct or manifold in which they are installed. A very simple “fan curve” is given by:

$$\dot{V}_{\text{fan}} = A_{\text{duct}} U_{\text{max}} \text{sign}(\Delta p_{\text{max}} - \Delta p) \sqrt{\frac{|\Delta p - \Delta p_{\text{max}}|}{\Delta p_{\text{max}}}} \quad (8.3)$$

where  $A_{\text{duct}}$  is the area of the duct ( $\text{m}^2$ ),  $U_{\text{max}}$  is the air velocity ( $\text{m/s}$ ), and  $\Delta p_{\text{max}}$  is the maximum pressure difference the fan can operate upon. Figure (8.1 displays a typical fan curve.

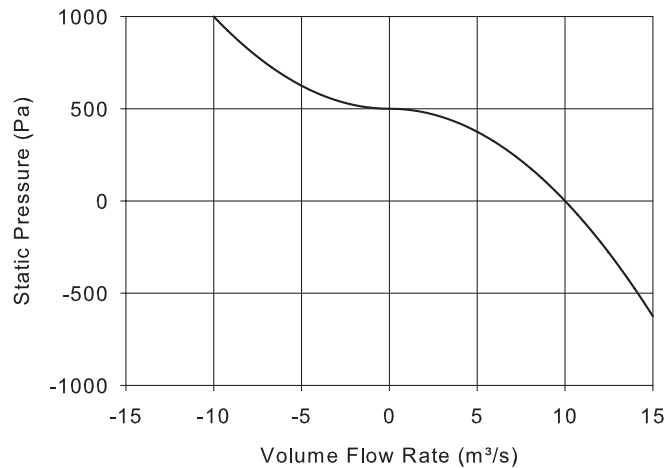


Figure 8.1: Fan curve corresponding to VOLUME\_FLUX=10 and MAX\_PRESSURE=500.

The ideal velocity of the fan,  $U_{\text{max}}$ , is specified via the parameter VEL on the appropriate SURF line. Alternatively, the volume flow rate,  $A_{\text{duct}} U_{\text{max}}$ , can be specified using VOLUME\_FLUX. Do not use both. These parameters were already introduced in Section 8.2. To simulate the behavior of a real fan, a few extra parameters need to be specified. To set  $\Delta p_{\text{max}}$ , the maximum operating over-pressure, add MAX\_PRESSURE to the SURF line. Note that MAX\_PRESSURE should always be positive and in units of Pa. If in the simulation the computed pressure exceeds the specified MAX\_PRESSURE, then there will be a backflow in the duct.

Here is an example how fans can be specified. The actual case (**fan\_test**) is discussed in Section 16.3. In it, two simple compartments share a common wall. Both compartments are considered as separate “pressure zones.” Two fans are mounted in the Partition Wall, blowing in opposite directions.

```
&SURF ID='BLOW LEFT', POROUS=.TRUE., VEL=-0.2, DUCT_PATH=1,2, MAX_PRESSURE=1000. /
&SURF ID='BLOW RIGHT', POROUS=.TRUE., VEL= 0.4, DUCT_PATH=2,1, MAX_PRESSURE=1000. /

&ZONE XB=-3.0, 0.0,-1.0, 1.0, 0.0, 2.0 / Pressure Zone 1
```

```

&ZONE XB= 0.0, 3.0,-1.0, 1.0, 0.0, 2.0 / Pressure Zone 2

&OBST XB= 0.0, 0.0,-1.0, 1.0, 0.0, 2.0 / Partition Wall

&HOLE XB=-0.1, 0.1,-0.1, 0.1, 0.4, 0.6 /
&OBST XB= 0.0, 0.0,-0.1, 0.1, 0.4, 0.6, ..., SURF_ID='BLOW RIGHT', PERMIT_HOLE=.FALSE. /

&HOLE XB=-0.1, 0.1,-0.1, 0.1, 1.4, 1.6 /
&OBST XB= 0.0, 0.0,-0.1, 0.1, 1.4, 1.6, ..., SURF_ID='BLOW LEFT', PERMIT_HOLE=.FALSE. /

```

Consider a few of the extra parameters. The attribute `POROUS=.TRUE.` allows hot, smokey gases to pass through the obstructions that represent the fans. These obstructions are merely flat plates, by necessity. The velocity `VEL` associated with a `POROUS` surface is meant to represent the velocity in the positive or negative coordinate direction, as indicated by its sign. This is different than the convention used when the `SURF` is attached to a solid wall. The `DUCT_PATH` defines the pressure `ZONE` downstream and upstream of the fan, respectively. The fan with `ID='BLOW LEFT'`, for example, blows air into `ZONE 1` from `ZONE 2`. In more complicated scenarios, it is possible to tie the fan behavior to disconnected compartments, where it is assumed that a “virtual” duct connects the two spaces. The `HOLES` in the Partition Wall serve only to carve out space for the obstructions that represent the fans. Note the obstructions have zero thickness, as required by the `POROUS` surface. The attribute `PERMIT_HOLE=.FALSE.` tells FDS not to reject the obstructions because they are embedded within the Partition Wall.

## 8.4 Describing Real Materials: The MATL Namelist Group

A solid boundary can consist of multiple layers of different materials, and each layer can consist of multiple material components. These combinations of layers and material components are specified on the SURF line via the array called MATL\_ID (IL, IC). The argument IL is an integer indicating the layer index, starting at 1, the layer at the exterior boundary. The argument IC is an integer indicating the component index. For example, MATL\_ID (2, 3) = 'BRICK' indicates that the third material component of the second layer is BRICK. In practice, the materials are often listed as in the following example:

```
&MATL ID          = 'INSULATOR'
  CONDUCTIVITY     = 0.041
  SPECIFIC_HEAT    = 2.09
  DENSITY          = 229. /

&SURF ID          = 'BRICK WALL'
  MATL_ID          = 'BRICK', 'INSULATOR'
  COLOR           = 'RED'
  BACKING          = 'EXPOSED'
  THICKNESS        = 0.20, 0.10 /
```

Without arguments, the parameter MATL\_ID is assumed to be a list of the materials in multiple layers, with each layer consisting of only a single material component.

Note also in this example that the BRICK WALL is not symmetric. Be careful when applying this SURF line to an entire obstruction, because the attribute EXPOSED implies that the back surface of the obstruction is different than the front surface.

The maximum number of material layers is 20. The maximum number of material components is 20.

Mixtures of solid materials within the same layer can be defined using the MATL\_MASS\_FRACTION keyword. This parameter has the same two indices as the MATL\_ID keyword. For example, if the brick layer contains some additional water, the input could look like this:

```
&MATL ID          = 'WATER'
  CONDUCTIVITY     = 0.60
  SPECIFIC_HEAT    = 4.19
  DENSITY          = 1000. /

&SURF ID          = 'BRICK WALL'
  MATL_ID (1, 1:2) = 'BRICK', 'WATER'
  MATL_MASS_FRACTION (1, 1:2) = 0.95, 0.05
  MATL_ID (2, 1)   = 'INSULATOR'
  COLOR           = 'RED'
  BACKING          = 'EXPOSED'
  THICKNESS        = 0.20, 0.10 / <--- for layers 1 and 2
```

In this example, the first layer of material, Layer 1, is composed of a mixture of brick and water. This is given by the MATL\_ID array which specifies Component 1 of Layer 1 to be brick, and Component 2 of Layer 1 to be water. The mass fraction of each is specified via MATL\_MASS\_FRACTION. In this case, brick is 95 %, by mass, of Layer 1, and water is 5 %.



It is important to notice that the components of the solid mixtures are treated as pure substances with no voids. The density of the mixture is

$$\rho = \left( \sum_i \frac{Y_i}{\rho_i} \right)^{-1} \quad (8.4)$$

where  $Y_i$  are the material mass fractions and  $\rho_i$  are the material bulk densities defined on the `MATL` lines. In the example above, the resulting density of the wall would be about 1553 kg/m<sup>3</sup>. The fact that the wall density is smaller than the density of pure brick may be confusing, but can be explained easily. If the wall can contain water, the whole volume of the wall can not be pure brick. Instead there are voids (pores) that are filled with water. If the water is taken away, there is only about 1476 kg/m<sup>3</sup> of brick left. To have a density of 1600 kg/m<sup>3</sup> for a partially void wall, a higher density should be used for the pure brick.

### 8.4.1 Thermal Properties

For any solid material, specify its thermal `CONDUCTIVITY` (W/m·K), `DENSITY` (kg/m<sup>3</sup>), `SPECIFIC_HEAT` (kJ/kg/K), and `EMISSIVITY` (0.9 by default). Both `CONDUCTIVITY` and `SPECIFIC_HEAT` can be functions of temperature. `DENSITY` and `EMISSIVITY` cannot. Temperature-dependence is specified using the `RAMP` convention. As an example, consider marinite, a wall material suitable for high temperature applications:

```
&MATL ID              = 'MARINITE'
      EMISSIVITY       = 0.8
      DENSITY          = 737.
      SPECIFIC_HEAT_RAMP = 'c_ramp'
      CONDUCTIVITY_RAMP = 'k_ramp' /
&RAMP ID='k_ramp', T= 24., F=0.13 /
&RAMP ID='k_ramp', T=149., F=0.12 /
&RAMP ID='k_ramp', T=538., F=0.12 /
&RAMP ID='c_ramp', T= 93., F=1.172 /
&RAMP ID='c_ramp', T=205., F=1.255 /
&RAMP ID='c_ramp', T=316., F=1.339 /
&RAMP ID='c_ramp', T=425., F=1.423 /
```

Notice that with temperature-dependent quantities, the `RAMP` parameter `T` means Temperature, and `F` is the value of either the specific heat or conductivity. In this case, neither `CONDUCTIVITY` nor `SPECIFIC_HEAT` is given on the `MATL` line, but rather the `RAMP` names.

Prior to FDS5, the thermal radiation from the gas space was always absorbed at the surface of the solid material and the emission to the gas space took place on the surface. Starting in FDS5, the solid material can be given an `ABSORPTION_COEFFICIENT` (1/m) that allows the radiation penetrate and absorb into the solid. Correspondingly, the emission of the material is based on the internal temperatures, not just the surface.

### 8.4.2 Pyrolysis Models

FDS has several approaches for describing the pyrolysis of solids and liquids. The approach to take depends largely on the availability of material properties and the appropriateness of the underlying pyrolysis model. This section provides a description of the input parameters, starting with a general solid.

#### Solid Fuels

A solid object might contain multiple layers with multiple material components per layer. The solid object is described by a `SURF` line which contains the names of the various `MATL`s it is composed of. Each `MATL` can undergo several reactions that may occur at different temperatures and consume different amounts of heat.

Each individual reaction can produce a (single) solid `RESIDUE`, water vapor, and/or fuel gas. For example, the evaporation of water from a solid material is described by the “reaction” that converts liquid water to water vapor. This reaction occurs close to 100 °C and produces only water vapor. It does not produce a solid `RESIDUE` nor fuel gas. However, a pyrolyzing solid might undergo a reaction that produces a solid `RESIDUE`, water vapor, *and* fuel gas.

For each `MATL` entry in the input file, decide how many reactions it can undergo. It may not undergo any – it may only just heat up. However, if it is to change form via one or more reactions, designate the number of reactions with the integer `N_REACTIONS`. It is very important that you designate `N_REACTIONS` or else FDS will ignore all parameters associated with reactions. Note, that quite often the empirical observation of multiple reactions does not imply `N_REACTIONS` > 1, but is caused by the fact that the examined sample is a mixture of multiple materials reacting at different temperatures. Currently, the maximum number of reactions for each material is 10 and the chain of consecutive reactions may contain up to 20 steps.

Next, decide what each reaction produces: a (single) solid `RESIDUE`, water vapor, and/or fuel gas. This information is conveyed to FDS via the *yields*: `NU_RESIDUE(j)`, `NU_WATER(j)`, and `NU_FUEL(j)`, respectively. Here, *j* indicates which reaction the parameters pertain to. If, like the evaporation of water, only water vapor is produced, set `NU_WATER(j)`=1.0 and the other two to zero. The yields are all zero by default. If `NU_RESIDUE(j)` is non-zero, then you *must* indicate what the solid residue is via `RESIDUE(j)`, the `ID` of another `MATL` that is also listed in the input file. Ideally, the sum of the yields should add to 1, meaning that the mass of the reactant is conserved. However, there are times when it is convenient to have the yields sum to something less than one. For example, the spalling or ablation of concrete can be described as a “reaction” that consumes energy but does not produce any “product” because the concrete is assumed to have either fallen off the surface in chunks or pulverized powder. The concrete’s mass is not conserved *in the model* because it has essentially disappeared from that particular surface. A more general way to specify gaseous yields is to use the parameter `NU_GAS`, as explained in Section 8.4.3.

Now you must specify at what temperature the reaction occurs, and how fast the reaction occurs at that temperature. The reaction rate at the temperature,  $T_s$ , of the *i*th material (*i.e.* the `MATL` that you are currently describing) undergoing its *j*th reaction is given by:

$$r_{ij} = \frac{\partial}{\partial t} \left( \frac{\rho_{s,i}}{\rho_{s0}} \right) = \left( \frac{\rho_{s,i}}{\rho_{s0}} \right)^{n_{s,ij}} A_{ij} \exp \left( -\frac{E_{ij}}{RT_s} \right) \max [0, T_s - T_{thr,ij}]^{n_{r,ij}} \quad (8.5)$$

$\rho_{s,i}$  is the density of the *i*th material within that particular layer, in the sense of the mass of the *i*th material divided by the volume of the layer.  $\rho_{s0}$  is the initial density of the layer. Thus,  $\rho_{s,i}/\rho_{s0}$  is a quantity that increases as the *i*th material is produced as a residue of some other reaction, and decreases as the *i*th material decomposes. If the layer is composed of only one material, and if the reactions produce no solid residues, then  $\rho_{s,i}/\rho_{s0}$  is always 1.  $n_{s,ij}$  is the reaction order and prescribed under the name `N_S(j)`, and is 1 by default. If the value of  $n_s$  is not known, it is a good starting point to assume  $n_s = 1$ .

The pre-exponential factor,  $A_{ij}$ , is prescribed under the name `A(j)`, with units of  $s^{-1}$ .  $E_{ij}$ , the activation energy, is prescribed via `E(j)` in units of kJ/kmol. Remember that 1 kcal is 4.184 kJ, and be careful with factors of 1000. *A* and *E* are not readily accessible for most real materials. However, if they are known, specify both. Avoid specifying just one because they act as a pair. If *A* and *E* are not known, which is usually the case, specify `REFERENCE_RATE` ( $s^{-1}$ ) and `REFERENCE_TEMPERATURE` (°C). This directs FDS to calculate the activation energy, *E*, using the specified reference rate, reference temperature, and an assumed value of  $A = 1 \times 10^{13} s^{-1}$ . Essentially, this guarantees that the `REFERENCE_RATE` is achieved at the `REFERENCE_TEMPERATURE`. The default value of `REFERENCE_RATE` is  $0.1 s^{-1}$ . It is suggested that unless you have information to the contrary, leave `REFERENCE_RATE` at its default value and just specify the `REFERENCE_TEMPERATURE`. Note that the `REFERENCE_TEMPERATURE` is *not* the same as an ignition temperature. Rather, it is simply the temperature at which the mass fraction of the *i*th material decreases at

a rate of  $0.1 \text{ s}^{-1}$ . You should check the sensitivity of these parameters following the procedure explained in Section 21.1.

$T_{thr,ij}$  is an optional “threshold” temperature that allows the definition of non-Arrhenius pyrolysis functions and ignition criteria, and is prescribed by `THRESHOLD_TEMPERATURE(j)`. By default,  $T_{thr,ij}$  is -273.15 degrees Celsius,  $n_{t,j}$  is zero; thus, the last term of Equation 8.5 does not affect the pyrolysis rate. The term can be used to describe a threshold temperature for the pyrolysis reaction by setting  $T_{thr,ij}$  and  $n_{t,j} = 0$ . Then the term is equal to 0 at temperatures below  $T_{thr,ij}$  and 1 at temperatures above.  $n_{t,j}$  is prescribed under the name `N_T(j)`.

Remember that all temperatures are specified in degrees Celsius, but are then converted to degrees Kelvin within the program. Thus, the formulae in this section ought to be interpreted in terms of the absolute temperature.

One last issue before a few examples – the most important one of all. Equation (8.5) describes the rate of the reaction as a function of temperature. Most solid phase reactions require energy; that is, they are *endothermic*. The amount of energy consumed, per unit mass of reactant that is converted into something else, is specified by the `HEAT_OF_REACTION(j)`. Technically, this is the enthalpy difference between the products and the reactant. A positive value indicates that the reaction is *endothermic*; that is, the reaction takes energy out of the system. Usually the `HEAT_OF_REACTION` is accurately known only for simple phase change reactions like the vaporization of water. For other reactions, it must be determined empirically.

Here is an example of a material that burns in the neighborhood of 350 °C, converting all its mass to fuel gases (`NU_FUEL=1.`).

```
&MATL ID              = 'My Fuel'
      FYI              = 'Properties completely fabricated'
      SPECIFIC_HEAT     = 1.0
      CONDUCTIVITY      = 0.1
      DENSITY           = 100.0
      HEAT_OF_COMBUSTION = 15000.
      N_REACTIONS       = 1
      NU_FUEL(1)        = 1.
      REFERENCE_TEMPERATURE(1) = 350.
      HEAT_OF_REACTION(1) = 3000. /
```

Note that the argument (1) has been added to the reaction parameters to emphasize the fact that these parameters are stored in arrays of length equal to `N_REACTIONS`. If there is only one reaction, you need not include the (1), but it is a good habit to get into. Note also that the `HEAT_OF_COMBUSTION` is the energy released per unit mass of fuel gas that mixes with oxygen and combusts. This has nothing to do with the pyrolysis process, so why is it specified here? The answer is that there can be only one *gas phase* reaction of fuel and oxygen in FDS, but there can be dozens of different materials and dozens of *solid phase* reactions. To ensure that the fuel vapors from different materials combust to produce the proper amount of energy, it is very important to specify a `HEAT_OF_COMBUSTION` for each material. That way, the mass loss rate of fuel gases is automatically adjusted so that the effective mass loss rate multiplied by the single, global, gas phase heat of combustion produces the expected heat release rate. If, for example, the `HEAT_OF_COMBUSTION` specified on the `REAC` line is twice that specified on the `MATL` line, the mass of contained within wall cell will be decremented by that determined by the pyrolysis model, but the mass added to gas phase would be reduced by 50 %. A different value of heat of combustion can be specified for each reaction and each gaseous species using the notation `HEAT_OF_COMBUSTION(j,s)`, as explained in Section 8.4.3.

Several other examples of solid phase reactions can be found in various examples. See Sections 21.2.1 and 21.2.2.

## Solid Fuels that Burn at a Specified Rate

Real objects, like furnishings, office equipment, and so on, are often difficult to describe via the `SURF` and `MATL` parameters. Sometimes the only information about a given object is its bulk thermal properties, its “ignition” temperature, and what its subsequent burning rate is, as a function of time from ignition. For this situation, add lines similar to the following:

```
&MATL ID                      = 'stuff'
    CONDUCTIVITY                = 0.1
    SPECIFIC_HEAT                = 1.0
    DENSITY                     = 900.0 /

&SURF ID                      = 'my surface'
    COLOR                       = 'GREEN'
    MATL_ID                     = 'stuff'
    HRRPUA                      = 1000.
    IGNITION_TEMPERATURE        = 500.
    RAMP_Q                      = 'fire_ramp'
    THICKNESS                   = 0.01 /

&RAMP ID='fire_ramp', T= 0.0, F=0.0 /
&RAMP ID='fire_ramp', T= 10.0, F=1.0 /
&RAMP ID='fire_ramp', T=310.0, F=1.0 /
&RAMP ID='fire_ramp', T=320.0, F=0.0 /
```

An object with surface properties defined by ‘my surface’ shall burn at a rate of 1000 kW/m<sup>2</sup> after a linear ramp-up of 10 s following its “ignition” when its surface temperature reaches 500 °C. Burning shall continue for 5 min, and then ramp-down in 10 s. Note that the time `T` in the `RAMP` means time from ignition. Note also that now the “ignition temperature” is a surface property, not material property.

After the surface has ignited, the heat transfer into the solid is still being solved but there is no coupling between the burning rate and the surface temperature. As a result, the surface temperature may increase too much. To account for the energy loss due to the vaporization of the solid fuel, `HEAT_OF_VAPORIZATION` can be specified for the surface. For example, when using the lines below, the net heat flux at the material surface is reduced by a factor 1000 kJ/kg times the instantaneous burning rate.

```
&SURF ID                      = 'my surface'
    COLOR                       = 'GREEN'
    MATL_ID                     = 'stuff'
    HRRPUA                      = 1000.
    IGNITION_TEMPERATURE        = 500.
    HEAT_OF_VAPORIZATION        = 1000.
    RAMP_Q                      = 'fire_ramp'
    THICKNESS                   = 0.01 /
```

The parameters `HRRPUA`, `IGNITION_TEMPERATURE`, and `HEAT_OF_VAPORIZATION` are all telling FDS that you want to control the burning rate yourself, but you still want to simulate the heating up and “ignition” of the fuel. When these parameters appear on the `SURF` line, they are acting in concert. If `HRRPUA` appears alone, the surface will begin burning at the start of the simulation, like a piloted burner. The addition of an `IGNITION_TEMPERATURE` delays burning until your specified temperature is reached. The addition of `HEAT_OF_VAPORIZATION` tells FDS to account for the energy used to vaporize the fuel. For any of these options, if a `MATL` line is invoked by a `SURF` line containing a specified `HRRPUA`, then that `MATL` ought to have only thermal properties. It should have no reaction parameters, product yields, and so on, like those described in the previous sections. By specifying `HRRPUA`, you are controlling the burning rate rather than letting the material pyrolyze based on the conditions of the surrounding environment.

## Liquid Fuels

For a liquid fuel, the thermal properties are similar to those of a solid material, with a few exceptions. The evaporation rate of the fuel is governed by the Clausius-Clapeyron equation (see FDS Technical Reference Guide for details). The only drawback of this approach is that the fuel gases burn regardless of any ignition source. Thus, if a liquid fuel is specified, the fuel begins burning at once. Here is an example of a steel pan filled with a thin layer of ethanol. Note that the material properties are not all traceable to a measurement.

```
&MATL ID                      = 'ETHANOL LIQUID'
    EMISSIVITY                 = 1.0
    NU_FUEL                    = 0.97
    HEAT_OF_REACTION           = 880.
    CONDUCTIVITY               = 0.17
    SPECIFIC_HEAT              = 2.45
    DENSITY                   = 787.
    ABSORPTION_COEFFICIENT     = 40.
    BOILING_TEMPERATURE        = 76. /

&MATL ID                      = 'STEEL'
    EMISSIVITY                 = 1.0
    DENSITY                   = 7850.
    CONDUCTIVITY              = 45.8
    SPECIFIC_HEAT             = 0.46 /

&MATL ID                      = 'CONCRETE'
    DENSITY                   = 2200.
    CONDUCTIVITY              = 1.2
    SPECIFIC_HEAT             = 0.88 /

&SURF ID                      = 'ETHANOL POOL'
    FYI                       = '4 kg of ethanol in a 0.7 m x 0.8 m pan'
    COLOR                     = 'YELLOW'
    MATL_ID                   = 'ETHANOL LIQUID','STEEL','CONCRETE'
    THICKNESS                 = 0.0091,0.001,0.05
    TMP_INNER                 = 18. /
```

The inclusion of `BOILING_TEMPERATURE` on the `MATL` line tells FDS to use its liquid pyrolysis model. It also automatically sets `N_REACTIONS=1`, that is, the only “reaction” is the phase change from liquid to gaseous fuel. Thus, `HEAT_OF_REACTION` in this case is the latent heat of vaporization. The gaseous fuel yield, `NU_FUEL`, is 0.97 instead of 1 to account for impurities in the liquid that do not take part in the combustion process.

The thermal conductivity, density and specific heat are used to compute the loss of heat into the liquid via conduction using the same one-dimensional heat transfer equation that is used for solids. Obviously, the convection of the liquid is important, but is not considered in the model.

Note also the `ABSORPTION_COEFFICIENT` for the liquid. This denotes the absorption in depth of thermal radiation. Liquids do not just absorb radiation at the surface, but rather over a thin layer near the surface. Its effect on the burning rate is significant.

### 8.4.3 Special topic: Yields of Gaseous Species (`NU_GAS`)

The yields of fuel and water gases are usually specified with the parameters `NU_FUEL` and `NU_WATER` on the `MATL` line. However, the yield of any explicitly-defined (via the `SPEC` line) gas species can be specified using the parameter `NU_GAS(j,k)`, where `j` refers to the `j`’th reaction of the material and `k` refers to the `k`’th explicitly-defined gas species. `NU_GAS` can also be used to specify the yields of the mixture fraction

and water vapor, assuming each is implicitly-defined and its order in the list of species is obtained from the output file **CHID.out**.

For consistency, the `HEAT_OF_COMBUSTION(j,k)` can also be specified separately for each reaction and species. These values are used only if the corresponding heat of combustion for the gaseous species is greater than zero.

In the example below, the pyrolysis of wood is included within a simulation that uses a finite-rate reaction instead of the default mixture fraction model. Notice in this case that all of the gas species (except for the background nitrogen) are explicitly defined, and as a result, FDS needs to be told explicitly what gaseous species are produced by the solid phase reactions. In this case, 82 % of the mass of wood is converted to gaseous 'PYROLYZATE' and 18 % is converted to solid 'CHAR'.

```
&SPEC ID = 'PYROLYZATE', MW=53.6 /
&SPEC ID = 'OXYGEN', MASS_FRACTION_0 = 0.23 /
&SPEC ID = 'WATER VAPOR' /
&SPEC ID = 'CARBON DIOXIDE' /

&MATL ID = 'WOOD'
    EMISSIVITY              = 0.9
    CONDUCTIVITY             = 0.2
    SPECIFIC_HEAT            = 1.3
    DENSITY                  = 570.
    N_REACTIONS              = 1
    A                        = 1.89E10
    E                        = 1.51E5
    N_S                      = 1.0
    NU_RESIDUE               = 0.18
    NU_GAS(1,1:4)            = 0.82,0,0,0
    HEAT_OF_REACTION         = 430.
    HEAT_OF_COMBUSTION(1,1) = 14500.
    RESIDUE                  = 'CHAR' /
```

#### 8.4.4 Special topic: Making Fuels Disappear (BURN\_AWAY)

If a burning object is to disappear from the calculation once it is exhausted of fuel, set `BURN_AWAY=.TRUE.`. Use this parameter cautiously. If an object has the potential of burning away, a significant amount of extra memory has to be set aside to store additional surface information as the rectangular block is eaten away. If `BURN_AWAY` is prescribed as a `SURF` parameter, then a solid object with this `SURF_ID` disappears from a calculation as the mass of each of its mesh cells are consumed. The mass of each mesh cell is the volume of the mesh cell multiplied by the `DENSITY` of the materials making up the obstruction.

Note also that if `BURN_AWAY` is prescribed, the `SURF` should be applied to the entire object, not just a face of the object because it is unclear how to handle edges of solid obstructions that have different `SURF_IDS` on different faces.

Also note that the amount of combustible fuel equals the `DENSITY` of the designated materials multiplied by the volume of the mesh cell. If the volume of the obstruction changes because it has to conform to the uniform mesh, FDS does **not** adjust the burning rate to account for this as it does with various quantities associated with areas, like `HRRPUA`.

Examples of how to use the `BURN_AWAY` feature are given in Section 17.2 and Section 22.1.

If all the material components of the surface are reacting, and the pyrolysis reactions have no solid residue, the thickness of the surface is going to shrink when the surface reacts. The shrinking behavior can be prevented in the numerical model by setting `SHRINK=.FALSE.` on the `SURF` line. However, setting

SHRINK=.FALSE. may introduce numerical problems in the wall solver. When all the material of a shrinking surface is consumed but BURN\_AWAY is not prescribed, the surface temperature is set to TMP\_BACK, convective heat flux to zero and burning rate to zero.

### 8.4.5 Special Topic: Initial and Backside Boundary Conditions

By default, the initial temperature of the solid material is set to ambient temperature. Use TMP\_INNER on the SURF line to specify a different initial temperature. Also, the backside temperature boundary condition of a solid can be set using the parameter TMP\_BACK on the SURF line. TMP\_BACK is not the actual backside surface temperature, but the gas temperature that the surface transfer heat with. This parameter has no meaning for surfaces with BACKING='EXPOSED' or BACKING='INSULATED'.

Note that the parameters TMP\_INNER and TMP\_BACK are only meaningful for solids with specified THICKNESS and material properties (via the MATL\_ID keyword).

### 8.4.6 Special Topic: Numerical Accuracy and Stability

To compute the temperature and reactions inside the solids, FDS solves the one-dimensional heat transfer equation numerically. The size of the mesh cells on the surface of the solid is automatically chosen using a rule that makes the cell size smaller than the square root of the material diffusivity ( $k/\rho c$ ). By default, the solid mesh cells increase towards the middle of the material layer and are smallest on the layer boundaries.

The default parameters are usually appropriate for simple heat transfer calculations but sometimes the use of pyrolysis reactions makes the temperatures and burning rate fluctuate. The numerical stability of the solid phase solution may then be improved by making the mesh density more uniform inside the material and by making the mesh cells smaller. Adjustments may also be needed in case of extremely transient heat transfer situations. Use STRETCH\_FACTOR=1. on the SURF line to have a perfectly uniform mesh. Values between 1 and 2 give different levels of stretching. The size of all the mesh cells can be scaled by setting CELL\_SIZE\_FACTOR less than 1.0. For example, CELL\_SIZE\_FACTOR=0.5 makes the mesh cells half the size. Setting WALL\_INCREMENT=1 on the TIME line forces the solid phase temperatures to be solved on every time step.

See Section 21.1 for ways to check and improve the accuracy of the solid phase calculation.

## 8.5 User-Specified Functions: The RAMP and TABL Namelist Groups

Many of the parameters specified in the input file are fixed constants. However, there are several parameters that may vary in time, temperature, or space. These functions can be complex, thus you have to have some way to convey them. The namelist group `RAMP` and `TABL`, as it names imply, allow you to control the behavior of selected parameters. `RAMP` allows you to specify a function with one independent variable (such as time) is mapped to one dependent variable (such as velocity). `TABL` allows for the specification of a mapping from multiple independent variables (such as a solid angle) to multiple dependent variables (such as a sprinkler flow rate and droplet speed).

### 8.5.1 Time-Dependent Functions

At the start of any calculation, the temperature is ambient everywhere, the flow velocity is zero everywhere, nothing is burning, and the mass fractions of all species are uniform. When the calculation starts temperatures, velocities, burning rates, *etc.*, are ramped-up from their starting values because nothing can happen instantaneously. By default, everything is ramped-up to their prescribed values in roughly 1 s. However, control the rate at which things turn on, or turn off, by specifying time histories for the boundary conditions that are listed on a given `SURF` line. The above boundary conditions can be made time-dependent using either prescribed functions or user-defined functions. The parameters `TAU_Q`, `TAU_T`, and `TAU_V` indicate that the heat release rate (`HRRPUA`); surface temperature (`TMP_FRONT`); and/or normal velocity (`VEL`, `VOLUME_FLUX`), or `MASS_FLUX_TOTAL` are to ramp up to their prescribed values in `TAU` seconds and remain there. If `TAU_Q` is positive, then the heat release rate ramps up like  $\tanh(t/\tau)$ . If negative, then the `HRR` ramps up like  $(t/\tau)^2$ . If the fire ramps up following a  $t^2$  curve, it remains constant after `TAU_Q` seconds. These rules apply to `TAU_T` and `TAU_V` as well. The default value for all `TAUS` is 1 s. If something other than a  $\tanh$  or  $t^2$  ramp up is desired, then a user-defined burning history must be input. To do this, set `RAMP_Q`, `RAMP_T` or `RAMP_V` equal to a character string designating the ramp function to use for that particular surface type, then somewhere in the input file generate lines of the form:

```
&RAMP ID='rampname1', T= 0.0, F=0.0 /
&RAMP ID='rampname1', T= 5.0, F=0.5 /
&RAMP ID='rampname1', T=10.0, F=0.7 /
.
.
.
&RAMP ID='rampname2', T= 0.0, F=0.0 /
&RAMP ID='rampname2', T=10.0, F=0.3 /
&RAMP ID='rampname2', T=20.0, F=0.8 /
.
.
.
```

Here, `T` is the time, and `F` indicates the fraction of the heat release rate, wall temperature, velocity, mass fraction, *etc.*, to apply. Linear interpolation is used to fill in intermediate time points. Be sure that the prescribed function starts at `T=0.0`.

Note that each set of `RAMP` lines must have a unique `ID` and that the lines must be listed with monotonically increasing `T`.

Note that the `TAUS` and the `RAMPs` are mutually exclusive. For a given surface quantity, both cannot be prescribed.



As an example, the simple blowing vent from above can be controlled via the lines:

```
&SURF ID='BLOWER',VEL=-1.2,TMP_FRONT=50., RAMP_V='BLOWER RAMP', RAMP_T='HEATER RAMP' /
&RAMP ID='BLOWER RAMP',T= 0.0,F=0.0 /
&RAMP ID='BLOWER RAMP',T=10.0,F=1.0 /
&RAMP ID='BLOWER RAMP',T=80.0,F=1.0 /
&RAMP ID='BLOWER RAMP',T=90.0,F=0.0 /
&RAMP ID='HEATER RAMP',T= 0.0,F=0.0 /
&RAMP ID='HEATER RAMP',T=20.0,F=1.0 /
&RAMP ID='HEATER RAMP',T=30.0,F=1.0 /
&RAMP ID='HEATER RAMP',T=40.0,F=0.0 /
```

Now the temperature and velocity of the incoming air stream would follow the same ramp functions.

Note that the temperature and velocity can be independently controlled by assigning different RAMPs to RAMP\_T and RAMP\_V, respectively.

Use TAU\_MF(N) or RAMP\_MF(N) to control the ramp-ups for either the mass fraction or mass flux of species N. The mass fraction of species N at the surface is given by

$$Y_N(t) = Y_N(0) + f(t) (Y_N - Y_N(0))$$

where  $Y_N(0)$  is the ambient mass fraction of species N (MASS\_FRACTION\_0 in the Nth SPEC namelist line is used to prescribe  $Y_N(0)$ ),  $Y_N$  is the desired mass fraction to which the function  $f(t)$  is ramping (MASS\_FRACTION(N) specified in the SURF line is used to prescribe  $Y_N$ ). The function  $f(t)$  is either a tanh,  $t^2$ , or user-defined function. For a user-defined function, indicate the name of the ramp function with RAMP\_MF(N), a character string.

## 8.5.2 Temperature-Dependent Functions

Thermal properties like conductivity and specific heat can vary significantly with temperature. In such cases, use the RAMP function like this:

```
&MATL ID          = 'STEEL'
FYI              = 'A242 Steel'
SPECIFIC_HEAT_RAMP = 'c_steel'
CONDUCTIVITY_RAMP  = 'k_steel'
DENSITY          = 7850. /

&RAMP ID='c_steel', T= 20., F=0.45 /
&RAMP ID='c_steel', T=377., F=0.60 /
&RAMP ID='c_steel', T=677., F=0.85 /

&RAMP ID='k_steel', T= 20., F=48. /
&RAMP ID='k_steel', T=677., F=30. /
```

Note that here (as opposed to time ramps) the parameter F is the actual physical quantity, not just a fraction of some other quantity. Thus, if CONDUCTIVITY\_RAMP is used, there should be no value of CONDUCTIVITY given. Note also that for values of temperature, T, below and above the given range, FDS will assume a constant value equal to the first or last F specified.

Note that each set of RAMP lines must have a unique ID and that the lines must be listed with monotonically increasing T.

### 8.5.3 Tabular Functions

Some input quantities, such as a sprinkler spray pattern, vary multi-dimensionally. In such cases, use the `TABL` namelist group. The format of the `TABL` lines is application-specific, but in general look like this:

```
&TABL ID='TABLE1', TABLE_DATA=40,50, 85, 95,10,0.5 /  
&TABL ID='TABLE1', TABLE_DATA=40,50,185,195,10,0.5 /
```

A detailed description of the various table entries is given in the sections that describe quantities that use such tables. Currently, only sprinklers and nozzles use this group of parameters to define a complex spray pattern.

Note that each set of `TABL` lines must have a unique `ID`. Specific requirements on ordering the lines will depend upon the type of `TABL` and those requirements are provided in the appropriate section in this guide.

## 8.6 Coloring Obstructions, Vents, Surfaces and Meshes

Colors for many items within FDS can be prescribed in two ways; a triplet of integers after keyword RGB or one of many COLOR name character strings.

The three RGB integer numbers range from 0 to 255, indicating the amount of Red, Green and Blue that make up the color. If you define the COLOR by name, it is important that you type the name EXACTLY as it is listed in the color tables here in this document and on the FDS website.

Table 8.1 provides a small sampling of RGB values and COLOR names for a variety of colors. A complete listing of all 500+ colors that can be specified by name after the COLOR keyword is available on the FDS website. If the COLOR name is not listed in the table on the website, then that name does not exist to FDS.

It is highly recommended that colors be assigned to surfaces via the SURF line because as the geometries of FDS simulations become more complex, it is very useful to use color as a spot check to determine if the desired surface properties have been assigned throughout the room or building under study.

For example, if you desire that all surfaces associated with a given SURF line be colored the same way, prescribe a triplet of integers called RGB on the SURF line. The following SURF line;

```
&SURF ID='UPHOLSTERY', ..., RGB=0,255,0 /
```

will cause the furnishings with a “SURF” of “UPHOLSTERY” to be colored green in Smokeview. It is best to avoid using the primary colors because these same colors are used by Smokeview to draw color contours.

Obstructions and vents may be colored individually (over-riding the SURF line’s RGB) by specifying COLOR value to any of the listed names in Table 8.1 or ‘INVISIBLE’ on the respective OBST or VENT line. Using ‘INVISIBLE’ causes the vent or obstruction to not be drawn.

Colors may also be specified using the integer triplet RGB on an OBST or VENT line to gain a wider color palette. The use of RGB is preferable, especially to create colors that do not clash with the pastel colors used to show temperatures, concentrations, *etc.* See Table 8.1 for a list of color names and RGB values.

### 8.6.1 Texture Mapping

There are various ways of prescribing the color of various objects within the computational domain, but there is also a way of pasting images onto the obstructions for the purpose of making the Smokeview images more realistic. This technique is known as “texture mapping.” For example, to apply a wood paneling image to a wall, add to the SURF line defining the physical properties of the paneling the text




































































```
&SURF ID='wood paneling', ..., TEXTURE_MAP='paneling.jpg', TEXTURE_WIDTH=1.,  
TEXTURE_HEIGHT=2. /
```

Assuming that a JPEG file called **paneling.jpg** exists in the working directory, Smokeview should read it and display the image wherever the paneling is used (SGI Users: use rgb files instead of jpg). Note that the image does not appear when Smokeview is first invoked. It is an option controlled by the Show/Hide menu. The parameters TEXTURE\_WIDTH and TEXTURE\_HEIGHT are the physical dimensions of the image. In this case, the JPEG image is of a 1 m wide by 2 m high piece of paneling. Smokeview replicates the image as often as necessary to make it appear that the paneling is applied where desired. Consider carefully how the image repeats itself when applied in a scene. If the image has no obvious pattern, there is no problem with the image being repeated. If the image has an obvious direction, the real triplet TEXTURE\_ORIGIN should be added to the VENT or OBST line to which a texture map should be applied. For example,

```
&OBST XB=1.0,2.0,3.0,4.0,5.0,7.0,SURF_ID='wood paneling',  
TEXTURE_ORIGIN=1.0,3.0,5.0 /
```

applies paneling to an obstruction whose dimensions are 1 m by 1 m by 2 m, such that the image of the paneling is positioned at the point (1.0,3.0,5.0). The default value of TEXTURE\_ORIGIN is (0,0,0), and the global default can be changed by added a TEXTURE\_ORIGIN statement to the MISC line.

Table 8.1: Sample of Color Definitions (A complete list is included on the website)

| Name          |   | R   | G   | B   | Name          |   | R   | G   | B   |
|---------------|---|-----|-----|-----|---------------|---|-----|-----|-----|
| AQUAMARINE    |    | 127 | 255 | 212 | MAROON        |    | 128 | 0   | 0   |
| ANTIQUE WHITE |    | 250 | 235 | 215 | MELON         |    | 227 | 168 | 105 |
| BEIGE         |    | 245 | 245 | 220 | MIDNIGHT BLUE |    | 25  | 25  | 112 |
| BLACK         |    | 0   | 0   | 0   | MINT          |    | 189 | 252 | 201 |
| BLUE          |    | 0   | 0   | 255 | NAVY          |    | 0   | 0   | 128 |
| BLUE VIOLET   |    | 138 | 43  | 226 | OLIVE         |    | 128 | 128 | 0   |
| BRICK         |    | 156 | 102 | 31  | OLIVE DRAB    |    | 107 | 142 | 35  |
| BROWN         |    | 165 | 42  | 42  | ORANGE        |    | 255 | 128 | 0   |
| BURNT SIENNA  |    | 138 | 54  | 15  | ORANGE RED    |    | 255 | 69  | 0   |
| BURNT UMBER   |    | 138 | 51  | 36  | ORCHID        |    | 218 | 112 | 214 |
| CADET BLUE    |    | 95  | 158 | 160 | PINK          |    | 255 | 192 | 203 |
| CHOCOLATE     |    | 210 | 105 | 30  | POWDER BLUE   |    | 176 | 224 | 230 |
| COBALT        |    | 61  | 89  | 171 | PURPLE        |    | 128 | 0   | 128 |
| CORAL         |    | 255 | 127 | 80  | RASPBERRY     |    | 135 | 38  | 87  |
| CYAN          |    | 0   | 255 | 255 | RED           |    | 255 | 0   | 0   |
| DIMGRAY       |   | 105 | 105 | 105 | ROYAL BLUE    |   | 65  | 105 | 225 |
| EMERALD GREEN |  | 0   | 201 | 87  | SALMON        |  | 250 | 128 | 114 |
| FIREBRICK     |  | 178 | 34  | 34  | SANDY BROWN   |  | 244 | 164 | 96  |
| FLESH         |  | 255 | 125 | 64  | SEA GREEN     |  | 84  | 255 | 159 |
| FOREST GREEN  |  | 34  | 139 | 34  | SEPIA         |  | 94  | 38  | 18  |
| GOLD          |  | 255 | 215 | 0   | SIENNA        |  | 160 | 82  | 45  |
| GOLDENROD     |  | 218 | 165 | 32  | SILVER        |  | 192 | 192 | 192 |
| GRAY          |  | 128 | 128 | 128 | SKY BLUE      |  | 135 | 206 | 235 |
| GREEN         |  | 0   | 255 | 0   | SLATEBLUE     |  | 106 | 90  | 205 |
| GREEN YELLOW  |  | 173 | 255 | 47  | SLATE GRAY    |  | 112 | 128 | 144 |
| HONEYDEW      |  | 240 | 255 | 240 | SPRING GREEN  |  | 0   | 255 | 127 |
| HOT PINK      |  | 255 | 105 | 180 | STEEL BLUE    |  | 70  | 130 | 180 |
| INDIAN RED    |  | 205 | 92  | 92  | TAN           |  | 210 | 180 | 140 |
| INDIGO        |  | 75  | 0   | 130 | TEAL          |  | 0   | 128 | 128 |
| IVORY         |  | 255 | 255 | 240 | THISTLE       |  | 216 | 191 | 216 |
| IVORY BLACK   |  | 41  | 36  | 33  | TOMATO        |  | 255 | 99  | 71  |
| KELLY GREEN   |  | 0   | 128 | 0   | TURQUOISE     |  | 64  | 224 | 208 |
| KHAKI         |  | 240 | 230 | 140 | VIOLET        |  | 238 | 130 | 238 |
| LAVENDER      |  | 230 | 230 | 250 | VIOLET RED    |  | 208 | 32  | 144 |
| LIME GREEN    |  | 50  | 205 | 50  | WHITE         |  | 255 | 255 | 255 |
| MAGENTA       |  | 255 | 0   | 255 | YELLOW        |  | 255 | 255 | 0   |

## Chapter 9

# Combustion and Radiation

A common source of confusion in FDS is the distinction between gas phase *combustion* and solid phase *pyrolysis*. The former refers to the reaction of fuel vapor and oxygen; the latter the generation of fuel vapor at a solid or liquid surface. Whereas there can be many types of combustibles in an FDS fire simulation, there can only be one gaseous fuel. The reason is cost. It is expensive to solve transport equations for multiple gaseous fuels. Consequently, the burning rates of solids and liquids are automatically adjusted by FDS to account for the difference in the heats of combustion of the various combustibles. In effect, you specify a single gas phase reaction as a surrogate for all the potential fuel sources.

The gas phase reaction can be described in two ways. By default, a so-called *mixture fraction* model is used to account for the evolution of the fuel gas from its surface of origin through the combustion process. The alternative is what is referred to as the *finite-rate* approach, where all of the individual gas species involved in the combustion process are defined and tracked individually. This is a costlier and more complicated approach than the *mixture fraction* model. This chapter describes both methods, with an emphasis on the more commonly used mixture fraction model.


### 9.1 Mixture Fraction Combustion: The REAC Namelist Group

There are two ways of designating a fire: the first is to specify a Heat Release Rate Per Unit Area `HRRPUA` on a `SURF` line. The other is to specify a `HEAT_OF_REACTION`, along with other thermal parameters on a `MATL` line, in which case the burning rate of the fuel depends on the net heat feedback to the surface. In both cases, the mixture fraction combustion model is used. In fact, the mere presence of these parameters automatically invokes the mixture fraction model. Do not specify explicitly gas species like oxygen if you have also specified heat release rates or solid phase reaction rates.

#### 9.1.1 The Basics

A single `REAC` line is used with the mixture fraction model. If the `REAC` line is not found in the input file, propane will be used as the surrogate fuel, and all burning rates will be adjusted accordingly. If you only specify the fire's heat release rate with `HRRPUA`, then the reaction parameters may not require adjusting, and no `REAC` line need be added to the input file. However, if you know something about the predominant fuel gas, you might want to consider specifying, at the very least, the basic stoichiometry via the `REAC` line.

Using the mixture fraction model, each reaction is assumed to be of the form:



You need only specify the chemical formula of the fuel along with the yields of CO, soot, and H<sub>2</sub>, and the amount of hydrogen in the soot,  $H_{frac}$ . For completeness you can specify the N<sub>2</sub> content of the fuel and the presence of other species. FDS will use that information internally to determine the amount of combustion products that are formed:

$$\begin{aligned}
 v_{O_2} &= v_{CO_2} + \frac{v_{CO}}{2} + \frac{v_{H_2O}}{2} - \frac{z}{2} \\
 v_{CO_2} &= x - v_{CO} - (1 - H_{frac})v_{soot} \\
 v_{H_2O} &= \frac{y}{2} - \frac{H_{frac}}{2}v_{soot} - v_{H_2} \\
 v_{CO} &= \frac{W_f}{W_{CO}}y_{CO} \\
 v_{H_2} &= \frac{W_f}{W_{H_2}}y_{H_2} \\
 v_{soot} &= \frac{W_f}{W_s}y_s \\
 v_{N_2} &= \frac{v}{2} \\
 v_{other} &= w \\
 W_s &= H_{frac}W_H + (1 - H_{frac})W_C
 \end{aligned}$$

The following parameters may be prescribed on the REAC line. Note that the various YIELDS are for well-ventilated, post-flame conditions. There are options to predict various species yields in under-ventilated fire scenarios, but these special models still require the post-flame yields for CO, soot and any other species listed below.

ID A character string naming the reaction.

C, H, O, N, OTHER The fuel chemical formula. All numbers are positive. (Mixture Fraction only, default values are those of propane)

MW\_OTHER Average molecular weight for OTHER (g/mol). (Mixture Fraction only, default is the molecular weight of N<sub>2</sub>, 28 g/mol)

Y\_O2\_INFINITY Ambient mass fraction of oxygen (Mixture Fraction only, default 0.23)

Y\_F\_INLET Mass fraction of fuel in fuel stream (Mixture Fraction only, default 1.0)

SOOT\_YIELD The fraction of fuel mass converted into smoke particulate,  $y_s$ . Note that this parameter does not apply to the processes of soot growth and oxidation, but rather to the net production of the smoke particulate from the fire. (Mixture Fraction only, default 0.01)

SOOT\_H\_FRACTION The fraction of the atoms in the soot that are hydrogen. (Mixture Fraction only, default 0.1)

CO\_YIELD The fraction of fuel mass converted into carbon monoxide,  $y_{CO}$ . (Mixture Fraction only, default 0.0)

H2\_YIELD The fraction of fuel mass converted into hydrogen,  $y_{H_2}$ . (Mixture Fraction only, default 0.0)

HEAT\_OF\_COMBUSTION  $\Delta H$  (kJ/kg). The amount of energy released per unit mass of fuel consumed. Note that if the heat of combustion is not specified, it is assumed to be

$$\Delta H \approx \frac{v_{O_2} W_{O_2}}{v_f W_f} \text{ EPUMO2} \quad \text{kJ/kg}$$

EPUMO2 The amount of energy released per unit mass of oxygen consumed. (kJ/kg) Default is 13,100 kJ/kg. Note that if both EPUMO2 and HEAT\_OF\_COMBUSTION are specified that FDS will ignore the value for EPUMO2.

IDEAL Logical value indicating whether or not the EPUMO2 or HEAT\_OF\_COMBUSTION values represent values for complete combustion (.TRUE.) or for incomplete combustion (.FALSE.), i.e. the values account for the specified  $y_{CO}$ ,  $y_{H_2}$ , and  $y_s$ . If IDEAL, then FDS will internally adjust  $\Delta H$  to account for products of incomplete combustion.

A few sample REAC lines are given here. The values are for demonstration only.

```
&REAC ID          = 'METHANE'
      C           = 1.
      H           = 4. /

&REAC ID          = 'PROPANE'
      SOOT_YIELD   = 0.01
      C           = 3.
      H           = 8.
      HEAT_OF_COMBUSTION = 46460.
      IDEAL        = .TRUE. /

&REAC ID          = 'PROPANE'
      SOOT_YIELD   = 0.01
      C           = 3.
      H           = 8.
      HEAT_OF_COMBUSTION = 46124.
      IDEAL        = .FALSE. /

&REAC ID          = 'ACRYLONITRILE'
      C           = 3.
      H           = 3.
      N           = 1.
      HEAT_OF_COMBUSTION = 24500.
      IDEAL        = .TRUE. /

&REAC ID          = 'CARBON DISULFIDE'
      C           = 1.
      Other        = 2.
      MW_OTHER     = 32.
      HEAT_OF_COMBUSTION = 13600.
      IDEAL        = .TRUE. /
```

### 9.1.2 Special Topic: Heat of Combustion

By default the EPUMO2 value is combined with the stoichiometric parameters listed on the REAC line to compute the heat of combustion. Specifying the HEAT\_OF\_COMBUSTION will override that computation. However, if heats of reaction have been specified on the MATL line and the heat of combustion of the material differs from that specified by the governing reaction, then add a HEAT\_OF\_COMBUSTION (kJ/kg) to the MATL

line. With the mixture fraction combustion model, it is assumed that there is only one fuel. However, in a realistic fire scenario, there may be many fuels originating from the various burning objects in the building. Specify the stoichiometry of the predominant reaction via the `REAC` namelist group. If the stoichiometry of the burning material differs from the global reaction, the `HEAT_OF_COMBUSTION` is used to ensure that an equivalent amount of fuel is injected into the flow domain from the burning object.

### 9.1.3 Special Topic: Flame Extinction

Modeling suppression of a fire due to the introduction of a suppression agent like  $\text{CO}_2$  or water mist, or due to the exhaustion of oxygen within a compartment is challenging because the relevant physical mechanisms occur at length scales smaller than a single mesh cell. Flames are extinguished due to lowered temperatures and dilution of the oxygen supply. A simple suppression algorithm has been implemented in FDS that attempts to gauge whether or not a flame is viable at the fuel-oxygen interface. The Technical Reference Guide [1] contains more details about how the mechanism works. The only parameters you can control are the Limiting Oxygen Index `X_O2_LL`, and the `CRITICAL_FLAME_TEMPERATURE`. Both are set on the `REAC` line. The default values are 0.15 (volume fraction) and 1427 °C, respectively. To eliminate any gas phase suppression, set `X_O2_LL` to 0. To turn off suppression completely, set `SUPPRESSION=.FALSE.` on the `MISC` line.

### 9.1.4 Special Topic: CO Production

An algorithm has been implemented that computes the combustion as a two step reaction that predicts the formation and destruction of CO. The Technical Reference Guide [1] contains more details about how the mechanism works. This algorithm is used when `CO_PRODUCTION` is set to `.TRUE.` on the `MISC` line. Even though the algorithm predicts CO formation and its eventual oxidation at elevated temperature, it cannot predict the post-flame yield of CO. For example, within a flashed over compartment, the algorithm predicts the elevated CO levels, but it cannot predict the CO concentration of the exhaust gases that exit the flaming region. Thus, even if using this model, you must specify the `CO_YIELD` that is expected of a well-ventilated fire.

Note that when active, this algorithm requires the use of three parameters for the mixture fraction vs. the two parameters used when it is disabled and will therefore increase run times and memory usage accordingly. If the simulation you are performing will not result in an under-ventilated fire, then there will be of little if any benefit to enabling the CO production algorithm.

### 9.1.5 Special Topic: Turbulent Combustion

Unless you are performing a Direct Numerical Simulation (DNS), the reaction rate of fuel and oxygen is not based on the diffusion of fuel and oxygen at a well-resolved flame sheet. Instead, semi-empirical rules are invoked by FDS to determine the rate of mixing of fuel and oxygen within a given mesh cell at a given time step. This section provides a brief explanation of these rules and the parameters that control them.

In an LES simulation, the heat release rate is computed as

$$\dot{q}''' = \frac{\max(\rho Y_F, s \rho Y_{O_2})}{\tau} \Delta H \quad ; \quad s = \frac{W_F}{v_{O_2} W_{O_2}} \quad (9.2)$$

Here,  $\tau$  is a mixing time scale [5] given by

$$\tau = \frac{C (\delta x \delta y \delta z)^{\frac{2}{3}}}{D_{LES}} \quad (9.3)$$



The coefficient,  $C$ , is taken as 0.1 in FDS by default, based on comparisons to various flame height correlations. It is given by `C_EDC` on the `REAC` line. If you do not want to use this model, set `EDDY_DISSIPATION=.FALSE.` on the `REAC` line, in which case  $\tau$  becomes the time step,  $\delta t$ .

There are two additional bounds on the local heat release rate per unit volume. One is based on an empirically determined maximum heat release rate per unit area of flame sheet:

$$\dot{q}_{\max,1}''' = \frac{\dot{q}_{\max}''}{(\delta x \delta y \delta z)^{\frac{1}{3}}} \quad (9.4)$$

The parameter  $\dot{q}_{\max}''$  is called `HRRPUA_SHEET` on the `REAC` line and its default value is 200 kW/m<sup>2</sup>. The second bound is based on an empirical estimate of the average volumetric heat release rate of a fire.

$$\dot{q}_{\max,2}''' = \frac{\overline{\dot{q}_{\max}'''} - (1 - \delta t / \tau') \overline{\dot{q}'''}}{\delta t / \tau'} \quad (9.5)$$

Orloff and De Ris [6] suggest a value of 1200 kW/m<sup>3</sup>, and FDS uses by default a value of 3000 kW/m<sup>3</sup> as an upper bound (`HRRPUV_AVERAGE` on the `REAC` line). Here,  $\tau'$  is an averaging time that should be larger than the pulsation period of the fire. It is given by `HRRPUV_AVERAGE_TIME` on the `REAC` line. It is 1 s by default.

## 9.2 Extra Gas Species: The SPEC Namelist Group

Normally when you specify a fire via either HRRPUA on the SURF line or reaction parameters on the MATL line, the mixture fraction combustion model is applied. A set of two or three scalar variables,  $Z_i$ , represent the state of the combustion process from pure fuel ( $\sum Z_i = 1$ ) to pure air ( $\sum Z_i = 0$ ). The major reactants and products of combustion – fuel,  $O_2$ ,  $CO_2$ ,  $H_2O$ ,  $N_2$ ,  $CO$  and soot – are all pre-tabulated functions of the mixture fraction,  $Z$ . In other words, the values of  $Z_i$  in any given mesh cell determines the mass fraction of all the gases listed. The fuel chemistry listed under the REAC namelist group is used to generate the table associating the mass fractions with  $Z_i$ . You need not, *and should not*, explicitly list the reactants and products of combustion.

Suppose however that gases are introduced into the domain that are neither reactants nor products of combustion. This gas can be tracked separately from the mixture fraction via an additional scalar transport equation<sup>1</sup>. In fact, there does not need to be any fire at all – FDS can be used to transport a mixture of non-reacting ideal gases.

The namelist group SPEC is used to specify each additional species. Each SPEC line should include at the very least the name of the species via a character string called (ID). Next, if the ambient (initial) mass fraction of the gas is something other than 0, then the parameter MASS\_FRACTION\_0 is used to specify it. Several gases that can be included in a calculation are listed in Table 9.1. The physical properties of these gases are known and do not need to be specified. However, if a desired gas is not included in Table 9.1, its molecular weight MW must be specified in units of g/mol. In addition, if a DNS calculation is being performed, either the Lennard-Jones potential parameters  $\sigma$  (SIGMALJ) and  $\epsilon/k$  (EPSILONKLJ) should be specified; or the VISCOSITY (kg/m/s), CONDUCTIVITY (W/m/K), and DIFFUSIVITY ( $m^2/s$ ) between the given species and the background species should be specified.

```
&SPEC ID='ARGON',MASS_FRACTION_0=0.1,MW=40. /
```

As an example, the lines:

```
&SPEC ID='ARGON', MASS_FRACTION_0=0.1, MW=40. /
&SPEC ID='HELIUM' /
.
.
&SURF ID='INLET', MASS_FRACTION(2)=0.2, VEL=-0.3, TAU_MF(2)=0.5, TAU_V=0.5 /
```

specify that ARGON and HELIUM are to be included in the calculation in addition to the (unlisted) default BACKGROUND\_SPECIES='AIR'. At the INLET, a mixture of helium (0.2 by mass), argon (0.1 by mass because nothing different is specified), and air (0.7 by mass making up the rest) flows out at a velocity of 0.3 m/s *into* the flow domain. The mass fraction of helium and the velocity are both ramped up according to the function  $\tanh(t/0.5)$ .

If the simulation does not involve the mixture fraction model – either because no combustion is desired or if a finite rate reaction(s) is being specified (see Section 9.3) – you can specify that the background gas species be something other than air. For a gas mixture comprised of  $n$  species, FDS only solves transport equations for  $n - 1$  because it also solves an equation for total mass conservation. To set the properties of the implicitly defined BACKGROUND\_SPECIES, use the MISC line. If this species is not listed in Table 9.1, specify its molecular weight, MW, and (optionally) its VISCOSITY and CONDUCTIVITY. In the absence of any of these parameters, the appropriate values of 'AIR' are assumed.

<sup>1</sup> Often an extra gas introduced into a calculation is the same as a product of combustion, like water vapor from a sprinkler or carbon dioxide from an extinguisher. These gases are tracked separately, thus water vapor generated by the combustion is tracked via the mixture fraction variable and water vapor generated by evaporating sprinkler droplets is tracked via its own transport equation. In the case of sprinklers, do not specify WATER VAPOR as an extra species – it is done automatically.

Table 9.1: **Optional Gas Species** [7]

| Species         | Mol. Wgt.<br>(g/mol) | $\sigma$<br>(Å) | $k/\epsilon$<br>(K) |
|-----------------|----------------------|-----------------|---------------------|
| AIR             | 29                   | 3.711           | 78.6                |
| CARBON DIOXIDE  | 44                   | 3.941           | 195.2               |
| CARBON MONOXIDE | 28                   | 3.690           | 91.7                |
| HELIUM          | 4                    | 2.551           | 10.22               |
| HYDROGEN        | 2                    | 2.827           | 59.7                |
| METHANE         | 16                   | 3.758           | 148.6               |
| NITROGEN        | 28                   | 3.798           | 71.4                |
| OXYGEN          | 32                   | 3.467           | 106.7               |
| PROPANE         | 44                   | 5.118           | 237.1               |
| WATER VAPOR     | 18                   | 2.641           | 809.1               |

Recognized species that are emissive will be defined as `ABSORBING` and radiative absorption for those species will be computed. The keyword `ABSORBING` can be specified on the `SPEC` line as well. If `.TRUE.` and the species is not in the recognized list, then it will be assumed to be a fuel when invoking `RADCAL` to compute its absorptivity.

## 9.3 Finite-Rate Combustion

Usually, FDS uses mixture fraction concepts to describe combustion. However, FDS can also explicitly track gas species and reactions that can occur between them. This section describes how to do this.

1. It is strongly recommended that finite-rate reactions be invoked only when FDS is running in DNS mode. Set `DNS=.TRUE.` on the `MISC` line. Note: you may use the finite-rate reaction scheme in an LES calculation, but because the temperature in a large scale calculation is smeared out over a mesh cell, some of the reaction parameters may need to be modified to account for the lower temperatures.
2. The `BACKGROUND_SPECIES` on the `MISC` line is normally set to be `'NITROGEN'`.
3. The namelist group `SPEC` is used to specify each additional species. Do not enter a `SPEC` line for the background species.
4. Read Section 9.2 for a description of the boundary conditions for the gas species.
5. The `REAC` namelist group is used to designate the fuel and the reaction rate parameters. For a finite-rate reaction you can specify multiple `REAC` lines. Note that FDS will evaluate the reactions in the order they are listed in the input file.

`FUEL` Character string indicating which of the listed optional gas species is the fuel.

`OXIDIZER` Character string indicating which of the listed optional gas species is the oxidizer.

`BOF` Pre-exponential factor in one-step chemical reaction in units of  $\text{cm}^3/\text{mole/s}$ .

`E` Activation energy for one-step chemical reaction in units of  $\text{kJ/kmol}$ .

`NU` Array containing the stoichiometry of the chemical reaction for each `SPEC` where negative values indicate reactants and positive values indicate products. Note that the background species cannot participate in the reaction.

`N_S` Array containing the exponents for the finite rate equation for each `SPEC`. Note that a `SPEC` can be given an `N_S` but not a `NU`, i.e the rate equation can be dependent on a species that does not participate directly in the reaction. Note that the background species cannot participate in the reaction.

`HEAT_OF_COMBUSTION` The effective heat of combustion the chemical reaction in units of  $\text{kJ/kg}$ . (Default 40,000  $\text{kJ/kg}$ )

## 9.4 Radiation Transport: The `RADI` Namelist Group

For most FDS simulations, thermal radiation transport is computed by default and you need not set any parameters to make this happen. However, there are situations where it is important to be aware of issues related to the radiative transport solver. The most important issue involves the fraction of energy released from the fire as thermal radiation, commonly referred to as the *radiative fraction*. It is a function of both the flame temperature and chemical composition, neither of which are reliably calculated in a large scale fire calculation because the flame sheet is not well-resolved on the mesh. In calculations in which the mesh cells are on the order of a centimeter and larger, the temperature near the flame surface cannot be relied upon when computing the source term in the radiation transport equation, especially because of the  $T^4$  dependence. To compensate, if you prescribe a non-zero value of `RADIATIVE_FRACTION` on the `RADI` line, a mesh cell cut by the flame radiates that fraction of the chemical energy being released into it. Some of that energy may be reabsorbed elsewhere, yielding a net radiative loss that is less than `RADIATIVE_FRACTION`, depending mainly on the size of the fire and the soot loading. If it is desired to use the radiation transport equation as is, then `RADIATIVE_FRACTION` ought to be set to zero, and the source term in the radiative transport equation is then based solely on the gas temperature and the chemical composition. By default, the `RADIATIVE_FRACTION` is 0.35 for an LES calculation, and zero for DNS.

There are several ways to improve the performance of the Finite Volume Method in solving the radiation transport equation (RTE), most of which increase the computation time. The solver has two modes of operation – a gray gas model (default) and a wide band model [1]. Modifications to these models can be made via a namelist group called `RADI`. If running in gray gas mode (default), increase the number of angles from the default 100 with the integer parameter `NUMBER_RADIATION_ANGLES`. The frequency of calls to the radiation solver can be reduced from every 3 time steps with integer `TIME_STEP_INCREMENT`. The increment over which the angles are updated can be reduced from 5 with the integer `ANGLE_INCREMENT`. Briefly, if `TIME_STEP_INCREMENT` and `ANGLE_INCREMENT` are both set to 1, the radiation field is completely updated in a single time step, but the cost of the calculation increases significantly.

A few parameters affecting the absorption of radiation by water droplets are as follows: `RADTMP` is the assumed radiative source temperature. It is used in the computation of the mean scattering and absorption cross sections of water droplets. The default is 900 °C. `NMIEANG` is the number of angles in the numerical integration of the Mie-phase function. Increasing `NMIEANG` improves the accuracy of the radiative properties of water droplets. The cost of the better accuracy is seen in the initialization phase, not during the actual simulation. The default value for `NMIEANG` is 15.

If the optional six band model is desired, set `WIDE_BAND_MODEL=.TRUE.`. It is recommended that this option only be used when the fuel is relatively non-sooting because it adds significantly to the cost of the calculation. To add three additional fuel bands, set `CH4_BANDS=.TRUE.`. See FDS Technical Reference Guide for more details. Note also that when `WIDE_BAND_MODEL=.TRUE.`, the `ABSORPTION_COEFFICIENT` output quantity becomes practically useless, because it then corresponds to one individual band of the spectrum.

It is possible to turn off the radiation transport solver (saving roughly 20 % in CPU time) by adding the statement `RADIATION=.FALSE.` to the `MISC` line. For isothermal calculations, the radiation is turned off automatically. If burning is taking place and radiation is turned off, then the total heat release rate is reduced by the `RADIATIVE_FRACTION`, which is input on the `RADI` line. This radiated energy completely disappears from the calculation. More on this feature can be found in Section 9.1.2.

In simulations with no combustion nor radiating species, it is possible to use a constant absorption coefficient by specifying `KAPPA0` on the `RADI` line.



## Chapter 10

# Particles and Droplets: The `PART` Namelist Group

Lagrangian particles<sup>1</sup> are used in FDS as water or liquid fuel droplets, flow tracers, and various other objects that are not defined or confined by the numerical mesh. Sometimes the particles have mass, sometimes they do not. Some evaporate, absorb radiation, *etc.* `PART` is the namelist group that is used to prescribe parameters associated with Lagrangian particles.

All Lagrangian particles must be explicitly defined via the `PART` namelist group. In versions of FDS prior to 5, water droplets and smoke particles were implicitly defined. Shortcuts for defining water droplets and smoke particles are possible, via parameters like `WATER=.TRUE.` and `MASSLESS=.TRUE.`

### 10.1 Basics

Properties of different types of Lagrangian particles are designated via the `PART` namelist group. Much like `SURF` lines contain the properties of a solid surface or vent, `PART` lines contain information about particles and droplets. Once a particular type of particle or droplet has been described using a `PART` line, then the name of that particle or droplet type is invoked elsewhere in the input file via the parameter `PART_ID`. There are no reserved `PART_ID`s – all must be defined. For example, an input file may have several `PART` lines that include the properties of different types of Lagrangian particles:

```
&PART ID='my smoke',... /  
&PART ID='my water',... /
```

These Lagrangian particles can be introduced at a solid surface via the `SURF` line that defines the properties of the material, for example

```
&SURF ...,PART_ID='my smoke' /
```

or the `PART` type can be invoked from a `PROP` line to change the properties of the droplets ejected by a sprinkler or nozzle, for example

```
&PROP ID='Acme Spk-123', QUANTITY='SPRINKLER LINK TEMPERATURE', PART_ID='my water', ... /
```

---

<sup>1</sup>Throughout this section, the terms “droplets” and “particles” are used interchangeably. From the point of view of FDS, they are all Lagrangian particles; that is, point elements that are not bound by the structure of the underlying grid.

Note that a surface on which particles are specified must have a non-zero normal velocity directed into the computational domain. This happens automatically if the surface is burning, but must be specified if it is not.

## 10.2 Controlling Particles and Droplets

Depending on how the particles or droplets are introduced into the computational domain, the following are important parameters for controlling them:

**DT\_INSERT** Time increment in seconds between the introduction of a “batch” of particles or droplets. The number per “batch” depends on how they are introduced. If more particles are desired, lower the input value of this parameter. The default value is 0.05 s.

**SAMPLING\_FACTOR** Sampling factor for the output file **CHID.prt5**. This parameter can be used to reduce the size of the particle output file used to animate the simulation. The default value is 1 for **MASSLESS** particles, meaning that every particle or droplet will be shown in Smokeview. The default is 10 for all other types of particles. **MASSLESS** particles are discussed in Section 10.4.

**AGE** Number of seconds the particle or droplet exists, after which time it is removed from the calculation. This is a useful parameter to use when trying to reduce the number of droplets or particles in a simulation.

### Particles Introduced at a Solid Surface

If the particles have mass and are introduced from a solid surface, specify **PARTICLE\_MASS\_FLUX** on the **SURF** line. The number of particles inserted at each solid cell every **DT\_INSERT** seconds is specified by **NPPC** on the **SURF** line defining the solid surface. The default value of **NPPC** is 1. As an example, the following set of input lines:

```
&PART ID='drops', QUANTITIES(1:3)='DROPLET_DIAMETER', 'DROPLET_TEMPERATURE', 'DROPLET_AGE',  
    DIAMETER=750., SAMPLING_FACTOR=1, COLOR='RED', EVAPORATE=.FALSE. /  
&SURF ID='HOLE', PART_ID='drops', VEL=-5., PARTICLE_MASS_FLUX=0.1, COLOR='RED' /  
&OBST XB=-0.2,0.2,-0.2,0.2,4.0,4.4, SURF_IDS='INERT','HOLE','INERT' /
```

creates an obstruction that ejects non-evaporating, red particles with a mean volumetric diameter of 750  $\mu\text{m}$  out of its sides at a rate of 0.1  $\text{kg}/\text{m}^2/\text{s}$ . FDS will adjust the mass flux if the obstruction or vent dimensions are changed to conform to the numerical grid. Note that the **IDS** have no meaning other than as identifiers. The particles are colored red in Smokeview, but can also be colored according to their diameter, temperature, or age.

### Droplets Introduced at a Sprinkler or Nozzle

**DROPLETS\_PER\_SECOND** is the number of droplets inserted every second per active sprinkler or nozzle. Its default value is 1000. Note that this parameter only affects sprinklers and nozzles. Changing this parameter does *not* change the flow rate, but rather the number of droplets used to represent the flow. Also note that the number of droplets introduced per “batch” is **DROPLETS\_PER\_SECOND** times **DT\_INSERT**.



Note that `DROPLETS_PER_SECOND` can be a very important parameter. In some simulations, it is a good idea to increase this number so that the liquid mass is distributed more uniformly over the droplets. If this parameter is too small, it can lead to a grainy, or uneven evaporation pattern, sometimes even to the point of causing a numerical instability. If you encounter a numerical instability shortly after the activation of a sprinkler or nozzle, consider increasing `DROPLETS_PER_SECOND` to produce a smoother evaporation pattern that is more realistic. Keep in mind that for a real sprinkler or nozzle, there are many more droplets created per second than the number that can be simulated.

### Particles or Droplets Introduced Initially

Sometimes it is convenient to introduce droplets or particles at the start of the simulation. For this purpose, `NUMBER_INITIAL_DROPLETS` is the number of particles/droplets within the computational domain at the start of the simulation. Its default value is 0, meaning that initially there are no particles or droplets present. If non-zero, also specify `MASS_PER_VOLUME` (kg/m<sup>3</sup>) which specifies the particle/droplet mass per unit volume (Default 1 kg/m<sup>3</sup>). Do not confuse this parameter with `DENSITY`, explained in the next section. For example, water has a `DENSITY` of 1000 kg/m<sup>3</sup>, whereas a liter of water broken up into droplets and spread over a cubic meter has a `MASS_PER_VOLUME` of 1 kg/m<sup>3</sup>. Also, to limit the particles/droplets to a certain region of the domain, add the real sextuplet `XB` to designate the coordinates of a rectangular volume. The format for `XB` is the same as that used on the `OBST` line.

### Droplets that Strike Solid Surfaces

When a droplet strikes a solid surface, it sticks and is reassigned a new speed and direction. If the surface is horizontal, the direction is randomly chosen. If vertical, the direction is downwards. The rate at which the droplets move over the horizontal and vertical surfaces is difficult to quantify. The parameters `HORIZONTAL_VELOCITY` and `VERTICAL_VELOCITY` on the `PART` line allow you to control the rate at which droplets move horizontally or vertically (downward). The defaults are 0.2 m/s and 0.5 m/s, respectively.

Be aware that when droplets hit obstructions, the vertical direction is assumed to coincide with the  $z$  axis, regardless of any change to the gravity vector, `GVEC`.

## 10.3 Particle and Droplet Properties

For Lagrangian particles that are not `MASSLESS`, the following parameters should be included on the `PART` line.

`DENSITY` The density of the liquid or solid droplet/particle. (Default 1000 kg/m<sup>3</sup>)

`SPECIFIC_HEAT` Specific heat of liquid or solid droplet/particle. (Default 4.184 kJ/kg/K)

`DIAMETER` Median volumetric diameter of droplets/particles, with the distribution assumed to be a combination of Rosin-Rammler and log-normal (Default 500  $\mu$ m). The width of the distribution is controlled by the parameter `GAMMA_D` (default 2.4) The Rosin-Rammler/log-normal distribution is given by

$$F(d) = \begin{cases} \frac{1}{\sqrt{2\pi}} \int_0^d \frac{1}{\sigma d'} e^{-\frac{[\ln(d'/d_m)]^2}{2\sigma^2}} dd' & (d \leq d_m) \\ 1 - e^{-0.693(\frac{d}{d_m})^\gamma} & (d_m < d) \end{cases} \quad (10.1)$$

Note that the parameter  $\sigma$  is given the value  $\sigma = 2/(\sqrt{2\pi}(\ln 2) \gamma) = 1.15/\gamma$  which ensures that the two functions are smoothly joined at  $d = d_m$ . You can also add a value for `SIGMA_D` to the `PART` line if you want to over-ride this feature. The larger the value of  $\gamma$ , the narrower the droplet size is distributed about the median value. Note that you can prevent droplets or particles from exceeding `MAXIMUM_DIAMETER`, which is infinitely large by default. Also note that droplets less than `MINIMUM_DIAMETER` are assumed to evaporate in a single time step, eliminating numerical instabilities that can occur when droplets get very, very small. The default `MINIMUM_DIAMETER` is 20  $\mu\text{m}$ . To prevent FDS from generating a distribution of droplets/particles altogether, set `MONODISPERSE=.TRUE.` on the `PART` line, in which case every droplet or particle will be assigned the same `DIAMETER`.

The following parameters pertain to the evaporation of liquid droplets. It is assumed by default that non-massless particles are liquid droplets, but you can specify `EVAPORATE=.FALSE.` to change this. Details are in the next section.

`VAPORIZATION_TEMPERATURE` Boiling temperature of liquid droplet. (Default 100 °C)

`MELTING_TEMPERATURE` Melting (solidification) temperature of liquid droplet. (Default 0 °C)

`INITIAL_TEMPERATURE` Initial temperature of liquid droplet. (Default `TMPA`)

`HEAT_OF_VAPORIZATION` Latent heat of vaporization of liquid droplet. (Default 2259 kJ/kg)

## 10.4 Special Types of Particles and Droplets

There are several useful attributes that you can assign to particles or droplets, usually via a simple logical parameter. Be aware with each of these parameters that specifying it as `.TRUE.` may cause other parameters to be functionally useless, or may cause conflicts that FDS may or may not detect. A good rule of thumb is always to ask yourself what is the basic information that *must* be conveyed to the program, and stick to that. For example, if the particles are to be `MASSLESS`, there is no point in declaring anything else except maybe a `COLOR` for `Smokeyview`.

### Massless Particles

The simplest use of Lagrangian particles is for visualization, in which case the particles are considered massless tracers. In this case, the particles are defined via the line

```
&PART ID='tracers', MASSLESS=.TRUE., ... /
```

Note that if the particles are `MASSLESS`, it is not appropriate to color them according to any particular property. Unlike early versions of FDS, particles are no longer colored by gas phase quantities, but rather by properties of the particle itself. For example, `'DROPLET_TEMPERATURE'` for a non-massless particle refers to the temperature of the particle itself rather than the local gas temperature.

Also note that if `MASSLESS=.TRUE.`, the `SAMPLING_FACTOR` is set to 1 unless you say otherwise, which would be silly since `MASSLESS` particles are for visualization only.

### Static Particles or Droplets

`STATIC` is a logical parameter indicating whether particles move or just serve as obstructions or clutter. Setting `STATIC=.TRUE.` only makes sense in conjunction with a non-zero value of `NUMBER_INITIAL_DROPLETS`. The default value of `STATIC` is `.FALSE.`

## Water Droplets

`WATER=.TRUE.` declares that the liquid droplets evaporate into `WATER VAPOR`, a separate gas phase species that is *automatically* added to the calculation by this command. By default, `WATER=.FALSE.`, even though the default properties of droplets are that of water. Setting `WATER=.TRUE.` instructs FDS to add `WATER VAPOR` as an explicitly defined species, and it also invokes appropriate constants related to the absorption of thermal radiation by the water droplets. It also causes the droplets to be colored blue in Smokeview.

If the liquid droplets are to evaporate into some other gaseous species, you must explicitly define the species via the `SPEC` namelist group (see Section 9.2), and then designate the appropriate `SPEC_ID` on the `PART` line.

## Fuel Droplets

`FUEL=.TRUE.` indicates that the liquid droplets evaporate into fuel gas and burn. In this case, add the `HEAT_OF_COMBUSTION` (kJ/kg) of the fuel. Fuel droplets are colored yellow by default in Smokeview. This feature only works for a mixture fraction-based combustion calculation, in which case the droplets evaporate into an equivalent amount of fuel vapor such that the resulting heat release rate (assuming complete combustion) is equal to the evaporation rate multiplied by the `HEAT_OF_COMBUSTION`.

## Particles that do not Evaporate

Unless you declare `MASSLESS=.TRUE.` on the `PART` line, it is assumed that the particle or droplet has mass and thermal properties that dictate its heat up and evaporation. To prevent evaporation, set `EVAPORATE=.FALSE.`. The particles will still heat up due to convection, but they will not shrink and no additional gaseous species need to be declared.

Note that the absorption of thermal radiation by water (`WATER=.TRUE.`) or fuel droplets (`FUEL=.TRUE.`) is handled in FDS with fairly well-established physical sub-models, the details of which are contained in the FDS Technical Reference Guide [1]. However, for arbitrary particles or droplets, there is no assumed radiative absorption.

## 10.5 Coloring Particles and Droplets

The parameter `QUANTITIES` is an array of character strings indicating which scalar quantities should be used to color the particles or droplets when viewed as an animation. The choices are `'DROPLET_TEMPERATURE'` (°C), `'DROPLET_DIAMETER'` (μm), `'DROPLET_VELOCITY'` (m/s), `'DROPLET_MASS'` (kg), `'DROPLET_AGE'` (s). As a default, if no `QUANTITIES` are specified and none are selected in Smokeview, then Smokeview will display particles with a single color. To select this color specify either `RGB` or `COLOR`. By default, water droplets are colored blue and fuel droplets yellow. All others are colored black.

## 10.6 Special Topic: Droplet Fuel Sprays

The evaporation of water droplets from sprinklers has been generalized so that a liquid fuel spray nozzle can be modeled. Fuel evaporation is triggered by the inclusion of the phrase `FUEL=.TRUE.` on the appropriate `PART` line. The spray nozzle characteristics are specified in the same way as those for a sprinkler. Here is an example of a liquid fuel spray nozzle (also see Section 22.3):

```

&DEVC ID='nozzle_1', XYZ=4.0,-.3,0.5, PROP_ID='nozzle', QUANTITY='TIME', SETPOINT=0. /

&PART ID='heptane droplets', FUEL=.TRUE., VAPORIZATION_TEMPERATURE=98.,
      HEAT_OF_VAPORIZATION=316., SPECIFIC_HEAT=2.25, DENSITY=688.,
      QUANTITIES(1:2)='DROPLET_DIAMETER','DROPLET_TEMPERATURE',
      DROPLETS_PER_SECOND=2000, DIAMETER=1000., HEAT_OF_COMBUSTION=44500.,
      DT_INSERT=0.02, SAMPLING_FACTOR=1 /

&PROP ID='nozzle', PART_ID='heptane droplets', FLOW_RATE=1.96,
      FLOW_RAMP='fuel', DROPLET_VELOCITY=10., SPRAY_ANGLE=0.,30. /
&RAMP ID='fuel', T= 0.0, F=0.0 /
&RAMP ID='fuel', T=20.0, F=1.0 /
&RAMP ID='fuel', T=40.0, F=1.0 /
&RAMP ID='fuel', T=60.0, F=0.0 /

```

The vaporization (boiling) temperature of the liquid fuel is in degrees Celsius, the heat of vaporization is in units of kJ/kg, the specific heat is in units of kJ/kg/K, and the density is in units of kg/m<sup>3</sup>. `FUEL=.TRUE.` automatically invokes a mixture fraction calculation in which fuel from the evaporating fuel droplets is burned according to the overall reaction scheme. Because the default mixture fraction combustion model assumes that fuel and oxygen burn when mixed (assuming that the oxygen concentration is above an empirically determined threshold), there is no need to specify an ignition source. For most liquid fuels, the small amount of evaporation at ambient temperature is enough to start the combustion process. In some sense, there is an implicit pilot flame.

Note that this construct is fragile and subject to mesh dependence. If the mesh cells are too coarse, the evaporating fuel is diluted to such a degree that it never burns. Proper resolution depends on the type of fuel and the amount of fuel being ejected from the nozzle.

Simulations with both fuel and water droplets are possible, unlike versions of FDS prior to 5.

## 10.7 Special Topic: Suppression by Water (Mixture Fraction Model Only)

Modeling suppression of a fire by a water spray is challenging because the relevant physical mechanisms occur at length scales smaller than a single mesh cell. In the gas phase, flames are extinguished due to lowered temperatures and dilution of the oxygen supply. See Section 9.1.2 for more information about gas phase suppression.

For the solid phase, water reduces the fuel pyrolysis rate by cooling the fuel surface and also changing the chemical reactions that liberate fuel gases from the solid. If the solid or liquid fuel has been given reaction parameters via the `MATL` line, there is no need to set any additional suppression parameters. It is assumed that water impinging on the fuel surface takes energy away from the pyrolysis process and thereby reduces the burning rate of the fuel. If the surface has been assigned a `HRRPUA` (Heat Release Rate Per Unit Area), a parameter needs to be specified that governs the suppression of the fire by water. An empirical way to account for fire suppression by water is to characterize the reduction of the pyrolysis rate in terms of an exponential function. The local mass loss rate of the fuel is expressed in the form

$$\dot{m}''_f(t) = \dot{m}''_{f,0}(t) e^{-\int k(t) dt} \quad (10.2)$$

Here  $\dot{m}''_{f,0}(t)$  is the user-specified burning rate per unit area when no water is applied and  $k$  is a function of the local water mass per unit area,  $m''_w$ , expressed in units of kg/m<sup>2</sup>.

$$k(t) = E\_COEFFICIENT m''_w(t) \quad s^{-1} \quad (10.3)$$

The parameter `E_COEFFICIENT` must be obtained experimentally, and it is expressed in units of  $\text{m}^2/\text{kg}/\text{s}$ . Usually, this type of suppression algorithm is invoked when the fuel is complicated, like a cartoned commodity.



# Chapter 11

## Devices and Control Logic

Sprinklers, smoke detectors, heat flux gauges, and thermocouples may seem to be completely unrelated, but from the point of view of FDS, they are simply devices that operate in specific ways depending on the properties assigned to them. They can be used to record some quantity of the simulated environment, like a thermocouple, or they can represent a mathematical model of a complex sensor, like a smoke detector, and in some cases they can trigger events to happen, like a timer.

Past versions of FDS used device specific namelist groups, like `SPRK`, `HEAT`, `SMOD`, and `THCP`, but the number and variety of fire-specific sensing and measurement devices continues to expand, and the data structures in FDS could not easily accommodate all possibilities. In addition, the logic associated with sensor activation and subsequent actions, like a vent opening, had become too complicated and prone to bugs. Devices are now specified with a new format that streamlines and expands the possibilities of sensor profiles.

Starting in FDS 5, all devices, in the broadest sense of the word, are designated via the namelist group `DEVC`. In addition, advanced functionality and properties are accommodated via additional namelists groups called `CTRL` (Control) and `PROP` (Properties).

### 11.1 Device Location and Orientation: The `DEVC` Namelist Group (Table 13.4)

Regardless of the specific properties, each device needs to be sited either at a point within the computational domain, or over a span of the domain, like a beam smoke detector. For example, a sprinkler is sited within the domain with a line like:

```
&DEVC XYZ=3.0,5.6,2.3, PROP_ID='Acme Sprinkler 123', ID='Spk_39' /
```

The physical coordinates of the device are given by a triplet of real numbers `XYZ`. The properties of the device are contained on the `PROP` line `PROP_ID`, which will be explained below for each of the special devices included in FDS. The character string `ID` is merely a descriptor to identify the device in the output files, and if any action is tied to its activation.

Not all devices need to be associated with a particular set of properties via the `PROP_ID`. For example, pointwise output quantities are specified with a single `DEVC` line, like

```
&DEVC ID='TC-23', XYZ=3.0,5.6,2.3, QUANTITY='TEMPERATURE' /
```

which tells FDS to record the temperature at the given point as a function of time. The `ID` is a label in the output file.

Some devices have a particular orientation which can be specified with various parameters; `IOR`, `ORIENTATION`, `ROTATION`. `IOR` or the Index of Orientation, is necessary for any device that is placed on the surface of a solid. The values  $\pm 1$  or  $\pm 2$  or  $\pm 3$  indicate the direction that the device “points”, where 1 is parallel to the X axis, 2 is parallel to the Y axis and 3 is parallel to the Z axis.

`ORIENTATION` is used for devices that are not on a surface and require a directional specification, like a sprinkler. `ORIENTATION` is specified with a triplet of real number values that indicate the components of the direction vector. The default value of `ORIENTATION` is (0,0,-1).

For example, a default downward-directed sprinkler spray can be redirected in other direction. If you were to prescribe,

```
&DEVC XYZ=3.0,5.6,2.3, PROP_ID='...', ID='...', ORIENTATION=1,0,0 /
```

the sprinkler would point in the positive  $x$  direction. For other devices, the `ORIENTATION` would only change the way the device is drawn by Smokeview.

## 11.2 Device Output

Each device has a `QUANTITY` associated with it. The output file for all `DEVC` quantities is a comma-delimited ASCII file called **CHID\_devc.csv** (See Section 24.3 for output file format.) This file can be imported into most spread sheet software packages. If the number of `DEVC` lines exceeds 256, the limit of some spreadsheet applications, the output file will be split into appropriately sized smaller files. To prevent the file splitting, specify `COLUMN_DUMP_LIMIT=.FALSE.` on the `DUMP` line.

All devices must have a specified `QUANTITY`. Some special devices (Section 11.3) have their `QUANTITY` specified on a `PROP` line. A `QUANTITY` specified on a `PROP` line associated with a `DEVC` line will override an `QUANTITY` specified on the `DEVC` line.

## 11.3 Special Devices and their Properties: The `PROP` Namelist Group (Table 13.16)

Many devices are fairly easy to describe, like a point measurement, with only a few parameters which can be included on the `DEVC` line. However, for more complicated devices, it is inconvenient to list all of the properties on each and every `DEVC` line. For example, a simulation might include hundreds of sprinklers, but it is tedious to list the properties of the sprinkler each time the sprinkler is sited. For these devices, use a separate namelist group called `PROP` to store the relevant parameters. Each `PROP` line is identified by a unique `ID`, and invoked by a `DEVC` line by the string `PROP_ID`. The `ID` might be the manufacturer’s name, like ‘ACME Sprinkler 123’, for example.

The best way to describe the `PROP` group is to list the various special devices and their properties.

### 11.3.1 Sprinklers

Here is a very simple example of sprinkler:

```
&PROP ID='K-11', QUANTITY='SPRINKLER LINK TEMPERATURE', RTI=148., C_FACTOR=0.7,
      ACTIVATION_TEMPERATURE=74., OFFSET=0.10,PART_ID='water drops', FLOW_RATE=189.3,
      DROPLET_VELOCITY=10., SPRAY_ANGLE=30.,80. /

&DEVC ID='Spr_60', XYZ=22.88,19.76,7.46, PROP_ID='K-11' /
&DEVC ID='Spr_61', XYZ=22.88,21.76,7.46, PROP_ID='K-11' /
```



A sprinkler, known as 'SPR\_60', is located at a point in space given by XYZ. It is a 'K-11' type sprinkler, whose properties are given on the PROP line. Note that the various names (IDs) mean nothing to FDS, except as a means of associating one thing with another, so try to use IDs that are as meaningful to you as possible. The parameter QUANTITY='SPRINKLER LINK TEMPERATURE' *does* have a specific meaning to FDS, directing it to compute the activation of the device using the standard RTI algorithm. The various sprinkler properties will be discussed below.<sup>1</sup>

Properties associated with sprinklers included in the PROP group are:

RTI Response Time Index in units of  $\sqrt{\text{m} \cdot \text{s}}$ . (Default 165.)

C\_FACTOR in units of  $\sqrt{\text{m/s}}$ . (Default 0.)

ACTIVATION\_TEMPERATURE in units of °C. (Default 74 °C)

INITIAL\_TEMPERATURE of the link in units of °C. (Default TMPA)

FLOW\_RATE in units of L/min. An alternative is to provide the K\_FACTOR in units of  $\text{L/min/bar}^{\frac{1}{2}}$  and the OPERATING\_PRESSURE in units of atm. The flow rate is then given by  $\dot{m}_w = K\sqrt{p}$ . Note that 1 bar is equivalent to 14.5 psi, 1 gpm is equivalent to 3.785 L/min,  $1 \text{ gpm/psi}^{\frac{1}{2}}$  is equivalent to  $14.41 \text{ L/min/bar}^{\frac{1}{2}}$ .

OFFSET Radius of a sphere (m) surrounding the sprinkler where the water droplets are initially placed in the simulation. It is assumed that at and beyond the OFFSET the droplets have completely broken up and are transported independently of each other. (Default 0.05 m)

DROPLET\_VELOCITY Initial droplet velocity. (Default 5 m/s)

SPRAY\_ANGLE A pair of angles (in degrees) through which the droplets are sprayed. The angles outline a conical spray pattern relative to the south pole of the sphere centered at the sprinkler with radius OFFSET. For example, SPRAY\_ANGLE=30., 80. directs the water droplets to leave the sprinkler through a band between 60° and 10° south latitude, assuming the orientation of the sprinkler is (0,0,-1), the default. The droplets are uniformly distributed within this belt.

SPRAY\_PATTERN\_TABLE Name of a set of TABL lines containing the description of the spray pattern.

PART\_ID The name of the PART line containing properties of the droplets. See Section 10 for additional details.

Be aware that sprinklers produce many droplets that need to be tracked in the calculation. To limit the burden, sprinkler droplets disappear when they hit the lower boundary of the computational domain, regardless of whether it is solid or not. To stop FDS from removing sprinkler droplets from the lower boundary of the computational domain, add the phrase POROUS\_FLOOR=.FALSE. to the MISC (Section 6.4) line. Be aware, however, that droplets that land on the floor continue to move horizontally in randomly selected directions; bouncing off obstructions, and consuming CPU time.

For more information about sprinklers, their activation and spray dynamics, is included in the FDS Technical Reference Guide [1].

---

<sup>1</sup>Past versions of FDS used a separate file to store properties of a given sprinkler. This file is no longer used.

## Special Topic: Specifying Complex Spray Patterns

If a more complex spray pattern is desired than can be achieved by using `SPRAY_ANGLE`, `VELOCITY`, and `FLOW_RATE`, then a `SPRAY_PATTERN_TABLE` can be specified using the `TABL` (Section 8.5) namelist group. For a spray pattern, specify the total flow using `FLOW_RATE` of the `PROP` line, the name of the spray pattern using `SPRAY_PATTERN_TABLE` and then one or more `TABL` lines of the format:

```
&TABL ID='table_id', TABLE_DATA=LAT1,LAT2,LON1,LON2,VELO,FRAC /
```

where each `TABL` line for a given 'table\_id' provides information about the spherical distribution of the spray pattern for a specified solid angle. `LAT1` and `LAT2` are the bounds of the solid angle measured in degrees from the south pole (0 is the south pole and 90 is the equator, 180 is the north pole). Note that this is not the conventional way of specifying a latitude, but rather a convenient system based on the fact that a typical sprinkler sprays water downwards, which is why 0 degrees is assigned to the “south pole,” or the  $-z$  direction. The parameters `LON1` and `LON2` are the bounds of the solid angle (also in degrees), where 0 (or 360) is aligned with the  $-x$  axis and 90 is aligned with the  $-y$  axis. `VELO` is the velocity (m/s) of the droplets at their point of insertion. `FRAC` the fraction of the total flow rate of liquid that should emerge from that particular solid angle.

In the example below, the spray pattern is defined as two jets, each with a velocity of 10 m/s and a flow rate of 20 L/min (the total `FLOW_RATE` is 40 L/min and the fraction for each jet is 0.5). The jets are centered at points 45° below the “equator,” and are separated by 180°.

```
&PROP ID='y-pipe',  
  QUANTITY='SPRINKLER LINK TEMPERATURE',  
  FLOW_RATE=40.,  
  PART_ID='water_drops',  
  SPRAY_PATTERN_TABLE='TABLE1' /  
  
&TABL ID='TABLE1', TABLE_DATA=40,50, 85, 95,10,0.5 /  
&TABL ID='TABLE1', TABLE_DATA=40,50,185,195,10,0.5 /
```

Note that each set of `TABL` lines must have a unique `ID`. Specific requirements on ordering the lines will depend upon the type of `TABL` and those requirements are provided in the appropriate section in this guide. Also note that the `TABL` lines can be specified in any order.

### 11.3.2 Nozzles

Nozzles are very much like sprinklers, only they do not activate based on the standard RTI model. To simulate a nozzle that activates at a given time, for example, specify a `QUANTITY` and `SETPOINT` directly on the `DEVC` line. Examples of nozzles can be found in Chapter 19.

The following lines:

```
&DEVC XYZ=23.91,21.28,0.50, PROP_ID='nozzle', ORIENTATION=0,0,1, QUANTITY='TIME',  
  SETPOINT=0., ID='noz_1' /  
&DEVC XYZ=26.91,21.28,0.50, PROP_ID='nozzle', ORIENTATION=0,0,1, QUANTITY='TIME',  
  SETPOINT=5., ID='noz_2' /  
&PROP ID='nozzle', PART_ID='heptane drops', FLOW_RATE=2.132,  
  FLOW_TAU=-50., DROPLET_VELOCITY=5., SPRAY_ANGLE=0.,45. /
```

designate two nozzles of the same type, one which activates at zero seconds, the other at 5 s. Note that nozzles must have an associated `PROP` line. The parameter `PART_ID` tells FDS to spray liquid droplets.

### 11.3.3 Heat Detectors

QUANTITY='LINK TEMPERATURE', as in this example, defines a heat detector, which uses essentially the same activation algorithm as a sprinkler, without the water spray.

```
&DEVC ID='HD_66', PROP_ID='Acme Heat', XYZ=2.3,4.6,3.4 /
&PROP ID='Acme Heat', QUANTITY='LINK TEMPERATURE', RTI=132., ACTIVATION_TEMPERATURE=74. /
```

Like a sprinkler, RTI is the Response Time Index in units of  $\sqrt{\text{m} \cdot \text{s}}$ . ACTIVATION\_TEMPERATURE is the link activation temperature in degrees C (Default 74 °C). INITIAL\_TEMPERATURE is the initial temperature of the link in units of °C (Default TMPA).

### 11.3.4 Smoke Detectors

A smoke detector is defined in the input file with an entry similar to:

```
&DEVC ID='SD_29', PROP_ID='Acme Smoke Detector', XYZ=2.3,4.6,3.4 /
&PROP ID='Acme Smoke Detector', QUANTITY='CHAMBER OBSCURATION', LENGTH=1.8,
    ACTIVATION_OBSCURATION=3.28 /
```

for the single parameter Heskestad model. Note that a PROP line is mandatory for a smoke detector, in which case the DEVC QUANTITY can be specified on the PROP line. For the four parameter Cleary model, use a PROP line like:

```
&PROP ID='Acme Smoke Detector', QUANTITY='spot obscuration', ALPHA_C=1.8, BETA_C=-1.1,
    ALPHA_E=0.98, BETA_E=-0.77, ACTIVATION_OBSCURATION=3.28 /
```

where the two characteristic filling or “lag” times are of the form:

$$\delta t_e = \alpha_e u^{\beta_e} \quad ; \quad \delta t_c = \alpha_c u^{\beta_c} \quad (11.1)$$

The default detector parameters are for the Heskestad model with a characteristic LENGTH of 1.8 m. For the Cleary model, the ALPHAS and BETAS must all be listed explicitly. Suggested constants for unidentified ionization and photoelectric detectors presented in Table 11.1. ACTIVATION\_OBSCURATION is the threshold value in units of %/m. The threshold can be set according to the setting commonly provided by the manufacturer. The default setting is 3.28 %/m (1 %/ft).

Table 11.1: Suggested Values for Smoke Detector Model. See Ref. [8] for others.

| Detector                | $\alpha_e$ | $\beta_e$ | $\alpha_c, L$ | $\beta_c$ |
|-------------------------|------------|-----------|---------------|-----------|
| Cleary Ionization I1    | 2.5        | -0.7      | 0.8           | -0.9      |
| Cleary Ionization I2    | 1.8        | -1.1      | 1.0           | -0.8      |
| Cleary Photoelectric P1 | 1.8        | -1.0      | 1.0           | -0.8      |
| Cleary Photoelectric P2 | 1.8        | -0.8      | 0.8           | -0.8      |
| Heskestad Ionization    | —          | —         | 1.8           | —         |

## Defining Smoke

By default, FDS assumes that the smoke from a fire is generated in direct proportion to the heat release rate. A value of `SOOT_YIELD=0.01` on the `REAC` line means that the smoke generation rate is 0.01 of the fuel burning rate. The “smoke” in this case is not explicitly tracked by FDS, but rather is assumed to be a function of the mixture fraction variables that are explicitly tracked.

Suppose, however, that you want to define your own “smoke” and that you want to specify its production rate independently of the `HRR` (or even in lieu of an actual fire, like a smouldering source). You also want to define a mass extinction coefficient for the smoke and an assumed molecular weight (as it will be tracked like a gas species). Finally, you also want to visualize the smoke using the “`SMOKE3D`” feature in Smokeview. Use the following lines:

```
&SPEC ID='MY SMOKE', MW=29., MASS_EXTINCTION_COEFFICIENT=8700. /
&SURF ID='SMOULDER', TMP_FRONT=1000., MASS_FLUX(1)=0.0001, COLOR='RED' /
&VENT XB=0.6,1.0,0.3,0.7,0.0,0.0, SURF_ID='SMOULDER' /

&PROP ID='Acme Smoke', QUANTITY='CHAMBER OBSCURATION', SPEC_ID='MY SMOKE' /
&DEVC XYZ=1.00,0.50,0.95, PROP_ID='Acme Smoke', ID='smoke_1' /

&DUMP SMOKE3D_QUANTITY='MY SMOKE', DT_PL3D=30. /
```

The same smoke detector model is used that was described above. Only now, the mass fraction of your species ‘`MY SMOKE`’ is used in the algorithm, rather than that associated with the mixture fraction. Note that your species will not participate in the radiation calculation. It will merely serve as a surrogate for smoke.

### 11.3.5 Beam Detection Systems

A beam detector can be defined by specifying the endpoints  $(x_1, y_1, z_1)$ ,  $(x_2, y_2, z_2)$ , of the beam, using `XB`, and the total total % obscuration at which the detector activates. The two endpoints must lie in the same mesh. FDS determines which mesh cells lie along the path specified by the two endpoints. The beam detector response is evaluated as

$$\text{Obscuration} = \left( 1 - \exp \left( -K_m \sum_{i=1}^N \rho_{\text{soot},i} \Delta x_i \right) \right) \times 100 \% \quad (11.2)$$

where  $i$  is a mesh cell along the path of the beam,  $\rho_{\text{soot},i}$  is the soot density of the mesh cell, and  $\Delta x_i$  is the distance within the mesh cell that is traversed by the beam.

```
&DEVC XB=x1,x2,y1,y2,z1,z2, QUANTITY='PATH OBSCURATION', ID='beam1', SETPOINT=0.33 /
```

### 11.3.6 Aspiration Detection Systems

An aspiration detection system groups together a series of soot measurement devices. An aspiration system consists of a sampling pipe network that draws air from a series of locations to a central point where an obscuration measurement is made. To define such a system in FDS, you must provide the sampling locations, sampling flow rates, the transport time from each sampling location, and if an alarm output is desired, the overall obscuration “setpoint.” One or more `DEVC` inputs are used to specify details of the sampling locations, and one additional input is used to specify the central detector:

```

&DEVC XYZ=..., QUANTITY='DENSITY', SPEC_ID='soot', ID='soot1', DEVC_ID='asp1',
FLOWRATE=0.1, DELAY=20 /
&DEVC XYZ=..., QUANTITY='DENSITY', SPEC_ID='soot', ID='soot2', DEVC_ID='asp1',
FLOWRATE=0.2, DELAY=10 /
...
&DEVC XYZ=..., QUANTITY='DENSITY', SPEC_ID='soot', ID='sootN', DEVC_ID='asp1',
FLOWRATE=0.3, DELAY=30 /

&DEVC XYZ=..., QUANTITY='ASPIRATION', ID='asp1', BYPASS_FLOWRATE=0.4, SETPOINT=0.02 /

```

where the `DEVC_ID` is used at each sampling point to reference the central detector, `FLOWRATE` is the gas flow rate in kg/s, `DELAY` is the transport time (in seconds) from the sampling location to the central detector, `BYPASS_FLOWRATE` is the flow rate in kg/s of any air drawn into the system from outside the computational domain (accounts for portions of the sampling network lying outside the domain defined by the `MESH` inputs), and `SETPOINT` is the alarm threshold obscuration in units of %/m. The output of the aspiration system is computed as

$$\text{Obscuration} = \left( 1 - \exp \left( -K_m \frac{\sum_{i=1}^N \rho_{\text{soot},i}(t - t_{d,i}) \dot{m}_i}{\sum_{i=1}^N \dot{m}_i} \right) \right) \times 100 \text{ \%}/\text{m} \quad (11.3)$$

where  $\dot{m}_i$  is the mass `FLOWRATE` of the  $i$ th sampling location,  $\rho_{\text{soot},i}(t - t_{d,i})$  is the soot density at the  $i$ th sampling location  $t_{d,i}$  s prior (`DELAY`) to the current time  $t$ , and  $K_m$  is the `MASS_EXTINCTION_COEFFICIENT` associated with visible light.

## 11.4 Basic Control Logic

Devices can be used to control various actions, like creating and removing obstructions, or activating and deactivating fans and vents. Every device has an associated `QUANTITY`, whether it is included directly on the `DEVC` line or indirectly on the optional `PROP` line. Using the `DEVC` parameter `SETPOINT`, you can trigger an action to occur when the `QUANTITY` value passes above, or below, the given `SETPOINT`. The choice is dictated by the given `TRIP_DIRECTION`, which is just a positive or negative integer. The following parameters dictate how a device will control something:

**SETPOINT** The value of the device at which its state changes. For a detection type of device (e.g. heat or smoke) this value is taken from the device's `PROP` inputs and need not be specified on the `DEVC` line.

**TRIP\_DIRECTION** A positive integer means the device will change state when its value increases past the setpoint and a negative integer means the device will change state when its value decreases past the setpoint. The default value is +1.

**LATCH** If this logical value is set to `.TRUE.` the device will only change state once. The default value is `.TRUE.`

**INITIAL\_STATE** This logical value is the initial state of the device. The default value is `.FALSE.` For example, if an obstruction associated with the device is to disappear, set `INITIAL_STATE=.TRUE.`

If you desire to control FDS using more complex logic than can be provided by the use of a single device and its setpoint, control functions can be specified using the `CTRL` input. See Section 11.5 for more on `CTRL` functions.

The simplest example of a device is just a timer:

```
&DEVC XYZ=1.2,3.4,5.6, ID='my clock', QUANTITY='TIME', SETPOINT=30. /
```

Anything associated with the device via the parameter, `DEVC_ID='my clock'`, will change its state at 30 seconds. For example, if the text were added to an `OBST` line, that obstruction would change from its `INITIAL_STATE` of `.FALSE.` to `.TRUE.` after 30 s. In other words, it would be created at 30 s instead of at the start of the simulation. This is a simple way to open a door or window.

### 11.4.1 Creating and Removing Obstructions

In many fire scenarios, the opening or closing of a door or window can lead to dramatic changes in the course of the fire. Sometimes these actions are taken intentionally, sometimes as a result of the fire. Within the framework of an FDS calculation, these actions are represented by the creation or removal of solid obstacles, or the opening or closing of exterior vents.

Remove or create a solid obstruction by assigning the character string `DEVC_ID` the name of a `DEVC ID` on the `OBST` line that is to be created or removed. This will direct FDS to remove or create the obstruction when the device changes state to `.FALSE.` or `.TRUE.`, respectively. For example, the lines

```
&OBST XB=..., SURF_ID='...', DEVC_ID='det2' /  
.  
.  
&DEVC XYZ=..., PROP_ID='...', ID='det1' /  
&DEVC XYZ=..., PROP_ID='...', ID='det2', INITIAL_STATE=.TRUE. /
```

will cause the given obstruction to be removed when the specified DEVC changes state.

Creation or removal at a predetermined time can be performed using a DEVC that has TIME as its measured quantity. For example, the following instructions will cause the specified HOLES and OBSTRUCTIONS to appear/disappear at the various designated times:

```
&HOLE XB=0.25,0.45,0.20,0.30,0.20,0.30, COLOR='RED', DEVC_ID='timer 1' /
&HOLE XB=0.25,0.45,0.70,0.80,0.70,0.80, COLOR='GREEN', DEVC_ID='timer 2' /
&OBST XB=0.70,0.80,0.20,0.30,0.20,0.30, COLOR='BLUE', DEVC_ID='timer 3' /
&OBST XB=0.70,0.80,0.60,0.70,0.60,0.70, COLOR='PINK', DEVC_ID='timer 4' /

&DEVC XYZ=..., ID='timer 1', SETPOINT= 1., QUANTITY='TIME', INITIAL_STATE=.FALSE./
&DEVC XYZ=..., ID='timer 2', SETPOINT= 2., QUANTITY='TIME', INITIAL_STATE=.TRUE. /
&DEVC XYZ=..., ID='timer 3', SETPOINT= 3., QUANTITY='TIME', INITIAL_STATE=.FALSE./
&DEVC XYZ=..., ID='timer 4', SETPOINT= 4., QUANTITY='TIME', INITIAL_STATE=.TRUE. /
```

The blue obstruction appears at 3 s because its initial state is false, meaning that it does not exist initially. The pink obstruction disappears at 4 s because it does exist initially. The red hole is created at 1 s because it does not exist initially (it is filled in with a red obstruction). The green hole is filled in at 2 s because it does exist (as a hole) initially. **You should always try a simple example first before embarking on a complicated creation/removal scheme for obstructions and holes.**

To remove an obstruction, then re-create a different one in its place, use 2 lines

```
&OBST XB=..., SURF_ID='whatever', DEVC_ID='device 1' /
&OBST XB=..., SURF_ID='whatever', DEVC_ID='device 2' /
```

since the code simply sees this as two different obstructions.

Until further notice, an obstruction that makes up the boundary of a “pressure zone” (see Section 8.3) should not be created or removed. The reason for this restriction is that abrupt changes in pressure can cause numerical instabilities.

## 11.4.2 Activating and Deactivating Vents

When a device or control function is applied to a VENT, the purpose is to either activate or deactivate any time ramp associated with the VENT via its SURF\_ID. For example, to control a fan with the device 'det2', do the following:

```
&SURF ID='FAN', VOLUME_FLUX=5. /
&VENT XB=..., SURF_ID='FAN', DEVC_ID='det2' /
&DEVC ID='det2', XYZ=..., QUANTITY='TIME', SETPOINT=30., INITIAL_STATE=.FALSE. /
```

Note that at 30 seconds, the “state” of the 'FAN' changes from .FALSE. to .TRUE., or more simply, the 'FAN' turns on. Since there is no explicit time function associated with the 'FAN', the default 1 second ramp-up will begin at 30 seconds instead of at 0 seconds.

If in this example INITIAL\_STATE=.TRUE., then the fan should “deactivate,” or turn off at 30 seconds. Essentially, “activation” of a VENT causes all associated time functions to be delayed until the device SETPOINT is reached. “Deactivation” of a VENT turns off all time functions. Usually this means that the parameters on the SURF line are all nullified, so it is a good idea to check the functionality with a simple example.

Until further notice, a 'MIRROR' or 'OPEN' VENT should not be activated or deactivated. The reason for this restriction is that abrupt changes in pressure can cause numerical instabilities.

## 11.5 Advanced Control Functions: The CTRL Namelist Group

There are many systems whose functionality cannot be described by a simple device with a single “setpoint.” Consider for example, a typical HVAC system. It is controlled by a thermostat that is given a temperature setpoint. The system turns on when the temperature goes below the setpoint by some amount and then turns off when the temperature rises above that same setpoint by some amount. This behavior can not be defined by merely specifying a single setpoint. You must also define the range or “deadband” around the setpoint, and whether an increasing or decreasing temperature activates the system. For the HVAC example, crossing the lower edge of the deadband activates heating; crossing the upper edge activates cooling.

While HVAC is not the primary purpose of FDS, there are numerous situations where a system responds to the fire in non-trivial way. The CTRL input is used to define these more complicated behaviors. A control function will take as input the outputs of one or more devices and/or control functions. In this manner, complicated behaviors can be simulated by making functions of other functions. For most of the control function types, the logical value output of the devices and control functions and the time they last changed state are used as the inputs.

For any input that a DEVC\_ID can be specified for (such as OBST or VENT), a CTRL\_ID can be specified instead.

Table 11.2: Control function types for CTRL

| Function Type | Description  |
|---------------|--|
| ANY           | Changes state if <u>any</u> INPUTS are .TRUE .                   |
| ALL           | Changes state if <u>all</u> INPUTS are .TRUE .                   |
| ONLY          | Changes state if and <u>only</u> if N INPUTS are .TRUE .         |
| AT_LEAST      | Changes state if <u>at least</u> N INPUTS are .TRUE .            |
| TIME_DELAY    | Changes state DELAY s after INPUT becomes .TRUE .                |
| CUSTOM        | Changes state based on evaluating a RAMP of the function’s input |
| DEADBAND      | Behaves like a thermostat  |
| KILL          | Terminates code execution if its sole INPUT is .TRUE .           |
| RESTART       | Dumps restart files if its sole INPUT is .TRUE .                 |

A control is identified by the ID parameter. The inputs to the control are identified by the INPUT\_ID parameter. INPUT\_ID would be passed one or more ID strings from either devices or other controls.

If you want to design a system of controls and devices that involves multiple changes of state, include the attribute LATCH=.FALSE. on the relevant DEVC or CTRL input lines. By default, devices and controls may only change state once, like a sprinkler activating or smoke detector alarming. LATCH=.TRUE. by default for both devices and controls.

### 11.5.1 Control Functions: ANY, ALL, ONLY, and AT\_LEAST

Suppose you want an obstruction to be removed (a door is opened, for example) after any of four smoke detectors in a room has activated. Use input lines of the form:

```
&OBST XB=..., SURF_ID='...', CTRL_ID='SD' /  
  
&DEVC XYZ=1,1,3, PROP_ID='Acme Smoker', ID='SD_1' /  
&DEVC XYZ=1,4,3, PROP_ID='Acme Smoker', ID='SD_2' /
```



```
&DEVC XYZ=4,1,3, PROP_ID='Acme Smoker', ID='SD_3' /
&DEVC XYZ=4,4,3, PROP_ID='Acme Smoker', ID='SD_4' /
&CTRL ID='SD', FUNCTION_TYPE='ANY', INPUT_ID='SD_1','SD_2','SD_3','SD_4',
INITIAL_STATE=.TRUE. /
```

The INITIAL\_STATE of the control function SD is .TRUE., meaning that the obstruction exists initially. The “change of state” means that the obstruction is removed when any smoke detector alarms. By default, the INITIAL\_STATE of the control function SD is .FALSE., meaning that the obstruction does not exist initially.

Suppose that now you want the obstruction to be created (a door is closed, for example) after all four smoke detectors in a room have activated. Use a control line of the form:

```
&CTRL ID='SD', FUNCTION_TYPE='ALL', INPUT_ID='SD_1','SD_2','SD_3','SD_4' /
```

The control functions AT\_LEAST and ONLY are generalizations of ANY and ALL.

For example,

```
&CTRL ID='SD', FUNCTION_TYPE='AT_LEAST', N=3, INPUT_ID='SD_1','SD_2','SD_3','SD_4' /
```

changes the state from .FALSE. to .TRUE. when at least 3 detectors activate.

Note that in this example, and the example below, the parameter N is used to specify the number of activated or “TRUE” inputs required for the conditions of the Control Function to be satisfied.

The control function,

```
&CTRL ID='SD', FUNCTION_TYPE='ONLY', N=3, INPUT_ID='SD_1','SD_2','SD_3','SD_4' /
```

changes the state from .FALSE. to .TRUE. when 3, and only 3, detectors activate.

### 11.5.2 Control Function: TIME\_DELAY

There is often a time delay between when a device activates, and when some other action occurs, like in a dry pipe sprinkler system.

```
&DEVC XYZ=2,2,3, PROP_ID='Acme Sprinkler_link', QUANTITY='LINK TEMPERATURE',
ID='Spk_29_link', CTRL_ID='dry pipe' /
&DEVC XYZ=2,2,3, PROP_ID='Acme Sprinkler', QUANTITY='CONTROL', ID='Spk_29',
CTRL_ID='dry pipe' /
&CTRL ID='dry pipe', FUNCTION_TYPE='TIME_DELAY', INPUT_ID='Spk_29_link', DELAY=30. /
```

This relationship between a sprinkler and its pipes means that the sprinkler spray is controlled (in this case delayed) by the dry pipe, which adds 30 s to the activation time of Spk\_29, measured by Spk\_29\_link, before water can flow out of the head.

### 11.5.3 Control Function: DEADBAND

For an HVAC example, the following lines of input would set up a simple thermostat:

```
&SURF ID='FAN', TMP_FRONT=40., VOLUME_FLUX=-1. /
&VENT XB=-0.3,0.3,-0.3,0.3,0.0,0.0, SURF_ID='FAN', CTRL_ID='thermostat' /
&DEVC ID='TC', XYZ=2.4,5.7,3.6, QUANTITY='TEMPERATURE' /
&CTRL ID='thermostat', FUNCTION_TYPE='DEADBAND', INPUT_ID='TC',
ON_BOUND='LOWER', SETPOINT=23.,27.,LATCH=.FALSE./
```

Here, we want to control the VENT that simulates the FAN, which blows hot air into the room. A DEVC called TC is positioned in the room to measure the TEMPERATURE. The thermostat uses a SETPOINT to turn on the FAN when the temperature falls below 23 °C (ON\_BOUND='LOWER') and it turns off when the temperature rises above 27 °C.

Note that a deadband controller needs to have LATCH set to .FALSE. .

#### 11.5.4 Control Function: RESTART and KILL

There are times when one only wishes to run a simulation until some goal is reached. Previously this could generally only be done by constantly monitoring the simulation's output and manually stopping the calculation when one observed the goal being met. By using the KILL control function this can be done automatically.

Additionally there are analyses where one wishes to create some baseline condition and then run multiple permutations of that baseline. For example one may wish to run a series of simulations where different mitigation strategies are tried once a detector alarms. By using the RESTART control function, one can cause a restart file to be created once a desired condition is met. The simulation can continue and the restart files can be copied to have the CHID of the various permutations (providing of course that the usual restrictions on the use of restart files are followed). For example, the lines

```
&DEVC ID='temp', QUANTITY='TEMPERATURE', SETPOINT=1000., XYZ=4.5,6.7,3.6 /
&DEVC ID='velo', QUANTITY='VELOCITY', SETPOINT=10., XYZ=4.5,6.7,3.6 /

&CTRL ID='kill', FUNCTION_TYPE='KILL', INPUT_ID='temp' /
&CTRL ID='restart', FUNCTION_TYPE='RESTART', INPUT_ID='velo' /
```

will lead to the job being stopped gracefully, with restart files output, when the temperature at a given point rises above 1000 °C; or to just restart files being output when the velocity at a given point exceeds 10 m/s.

#### 11.5.5 Control Function: CUSTOM

For most of the control function types, the logical (true/false) output of the devices and control functions and the time they last changed state are taken as inputs. A CUSTOM function uses the numerical output of a DEVC along with a RAMP to determine the output of the function. When the RAMP output for the DEVC value is negative, the CTRL will have the value of its INITIAL\_STATE. When the RAMP output for the DEVC value is positive, the CTRL will have the opposite value of its INITIAL\_STATE. In the case below, the CUSTOM control function uses the numerical output of a timer device as its input. The function returns true (the default value for INITIAL\_STATE is .FALSE.) when the F parameter in the ramp specified with RAMP\_ID is a positive value and false when the RAMP F value is negative. In this case, the control would start false and would switch to true when the timer reaches 60 seconds. It would then stay in a true state until the timer reaches 120 seconds and would then change back to false.

Note that when using control functions the IDs assigned to both the CTRL and the DEVC inputs must be unique across both sets of inputs, i.e. you cannot use the same ID for both a control function and a device.

In the HVAC example above, we could set the system to function on a fixed cycle by using a CUSTOM control function based on time:

```

&SURF ID='FAN', TMP_FRONT=40., VOLUME_FLUX=-1. /
&VENT XB=-0.3,0.3,-0.3,0.3,0.0,0.0, SURF_ID='FAN', CTRL_ID='cycling timer' /
&DEVC ID='TIMER', XYZ=2.4,5.7,3.6, QUANTITY='TIME' /
&CTRL ID='cycling timer', FUNCTION_TYPE='CUSTOM, INPUT_ID='TIMER', RAMP_ID='cycle' /
&RAMP ID='cycle', T= 59, F=-1 /
&RAMP ID='cycle', T= 61, F= 1 /
&RAMP ID='cycle', T=119, F= 1 /
&RAMP ID='cycle', T=121, F=-1 /

```

In the above example the fan will be off initially, turn on at 60 s and then turn off at 120 s.

You can make an obstruction appear and disappear multiple times by using lines like

```

&OBST XB=..., SURF_ID='whatever', CTRL_ID='cycling timer' /
&DEVC ID='TIMER', XYZ=..., QUANTITY='TIME' /
&CTRL ID='cycling timer', FUNCTION_TYPE='CUSTOM, INPUT_ID='TIMER', RAMP_ID='cycle' /
&RAMP ID='cycle', T= 0, F=-1 /
&RAMP ID='cycle', T= 59, F=-1 /
&RAMP ID='cycle', T= 61, F= 1 /
&RAMP ID='cycle', T=119, F= 1 /
&RAMP ID='cycle', T=121, F=-1 /

```

The above will have the obstacle initially removed, then added at 60 s, and removed again at 120 s.

Experiment with these combinations using a simple case before trying a case to make sure that FDS indeed is doing what is intended.

### 11.5.6 Combining Control Functions: A Pre-Action Sprinkler System

For a pre-action sprinkler system, the normally dry sprinkler pipes are flooded when a detection event occurs. For this example, the detection event is when two of four smoke detectors alarm. It takes 30 s to flood the piping network. The nozzle is a DEVC named 'NOZZLE 1' controlled by the CTRL named 'nozzle trigger'. The nozzle activates when both detection and the time delay have occurred. Note that the DEVC is specified with QUANTITY='CONTROL'.

```

&DEVC XYZ=1,1,3, PROP_ID='Acme Smoker', ID='SD_1' /
&DEVC XYZ=1,4,3, PROP_ID='Acme Smoker', ID='SD_2' /
&DEVC XYZ=4,1,3, PROP_ID='Acme Smoker', ID='SD_3' /
&DEVC XYZ=4,4,3, PROP_ID='Acme Smoker', ID='SD_4' /
&DEVC XYZ=2,2,3, PROP_ID='Acme Nozzle', QUANTITY='CONTROL',
    ID='NOZZLE 1', CTRL_ID='nozzle trigger' /

&CTRL ID='nozzle trigger', FUNCTION_TYPE='ALL', INPUT_ID='smokey','delay' /
&CTRL ID='delay', FUNCTION_TYPE='TIME_DELAY', INPUT_ID='smokey', DELAY=30. /
&CTRL ID='smokey', FUNCTION_TYPE='AT_LEAST', N=2, INPUT_ID='SD_1','SD_2','SD_3','SD_4' /

```

### 11.5.7 Combining Control Functions: A Dry Pipe Sprinkler System

For a dry-pipe sprinkler system, the normally dry sprinkler pipes are pressurized with gas. When a link activates in a sprinkler head, the pressure drop allows water to flow into the pipe network. For this example it takes 30 s to flood the piping network once a sprinkler link has activated. The sequence of events required for operation is first ANY of the links must activate which starts the 30 s TIME\_DELAY. Once the 30 s delay has occurred, each nozzle with an active link, the ALL control functions, will then flow water.

```

&DEVC XYZ=2,2,3, PROP_ID='Acme Sprinkler Link', ID='LINK 1' /
&DEVC XYZ=2,3,3, PROP_ID='Acme Sprinkler Link', ID='LINK 2' /

```

```

&PROP ID='Acme Sprinkler Link', QUANTITY='LINK TEMPERATURE',
      ACTIVATION_TEMPERATURE=74., RTI=30./

&DEVC XYZ=2,2,3, PROP_ID='Acme Nozzle', QUANTITY='CONTROL',
      ID='NOZZLE 1', CTRL_ID='nozzle 1 trigger' /
&DEVC XYZ=2,3,3, PROP_ID='Acme Nozzle', QUANTITY='CONTROL',
      ID='NOZZLE 2', CTRL_ID='nozzle 2 trigger' /

&CTRL ID='check links', FUNCTION_TYPE='ANY', INPUT_ID='LINK 1','LINK 2'/
&CTRL ID='delay', FUNCTION_TYPE='TIME_DELAY', INPUT_ID='check links', DELAY=30. /
&CTRL ID='nozzle 1 trigger', FUNCTION_TYPE='ALL', INPUT_ID='delay','LINK 1'/
&CTRL ID='nozzle 2 trigger', FUNCTION_TYPE='ALL', INPUT_ID='delay','LINK 2'/

```

## Chapter 12

# Output Data

Before a calculation is started, carefully consider what information should be saved. All output quantities must be specified at the start of the calculation. In most cases, there is no way to retrieve information after the calculation ends if it was not specified from the start. There are several different ways of visualizing the results of a calculation. Most familiar to experimentalists is to save a given quantity at a single point in space so that this quantity can be plotted as a function of time, like a thermocouple temperature measurement. The namelist group `DEVC`, described previously, is used to specify point measurements.

To visualize the flow patterns better, save planar slices of data, either in the gas or solid phases, by using the `SLCF` (SLiCe File) or `BNDF` (BouNDary File) namelist group. Both of these output formats permit you to animate these quantities in time.

For static pictures of the flow field, use the `PLot3D` files that are automatically generated 5 times a run. `Plot3D` format is used by many CFD programs as a simple way to store specified quantities over the entire mesh at one instant in time.

Finally, tracer particles can be injected into the flow field from vents or obstacles, and then viewed in `Smokeview`. Use the `PART` namelist group to control the injection rate, sampling rate and other parameters associated with particles.

Note: unlike in FDS version 1, particles are no longer used to introduce heat into the flow, thus particles no longer are ejected automatically from burning surfaces.

### 12.1 Output Control Parameters: The `DUMP` Namelist Group

The namelist group `DUMP` contains parameters (Table 13.5) that control the rate at which output files are written, and various other global parameters associated with output files. This namelist group is new starting in FDS 5, although its parameters have been specified via other namelist groups in past versions.

`NFRAMES` Number of output dumps per calculation. The default is 1000. Device data, slice data, particle data, isosurface data, 3D smoke data, boundary data, solid phase profile data, and control function data are saved every  $(T\_END - T\_BEGIN) / NFRAMES$  seconds unless otherwise specified using `DT_DEVC`, `DT_SLCF`, `DT_PART`, `DT_ISO`, `DT_BNDF`, `DT_PROF`, or `DT_CTRL`. Note that `DT_SLCF` controls `Smoke3D` output. `DT_HRR` controls the output of heat release rate and associated quantities.

`MASS_FILE` If `.TRUE.`, produce an output file listing the total masses of all gas species as a function of time. It is `.FALSE.` by default because the calculation of all gas species in all mesh cells is time-consuming. The parameter `DT_MASS` controls the frequency of output.

`STATE_FILE` If `.TRUE.`, produce an output file listing the species mass fractions associated with the mixture fraction, assuming complete combustion. It is `.FALSE.` by default, and only makes sense for calculations involving the mixture fraction model.

`MAXIMUM_DROPLETS` Maximum number of Lagrangian particles that can be included on any mesh at any given time. (Default 500000)

`SMOKE3D` If `.FALSE.`, do not produce an animation of the smoke and fire. It is `.TRUE.` by default.

`FLUSH_FILE_BUFFERS` By default, every 10 time steps FDS purges the output file buffers and forces the data to be written out into the respective output files. It has been noticed on Windows machines that occasionally a runtime error occurs because of file access problems related to the buffer flushing. If this happens, set this parameter to `.FALSE.`, but be aware that it may not be possible to look at output in Smokeview until after the calculation is finished.

`STATUS_FILES` If `.TRUE.`, produces an output file **CHID.notready** which is deleted, if the simulation is completed successfully. This file can be used as an error indicator. It is `.FALSE.` by default.

## 12.2 Output File Types

FDS has various types of output files that store computed data. Some of the files are in binary format and intended to be read and rendered by Smokeview. Some of the files are just comma-delimited text files. It is important to remember that you must explicitly declare in the input file most of the FDS output data. A considerable amount of the input file is usually devoted to this.

### 12.2.1 Device Output: The `DEVC` Namelist Group

For many commonly used measurement devices there is no need to associate a specific `PROP` line to the `DEVC` entry. In such cases, use the character string `QUANTITY` to indicate that a particular gas or solid phase quantity at the point should be recorded in the output file with the suffix `_devc.csv`. The quantities are listed in Table 12.1. Many of the gas phase quantities are self-explanatory. For example, if you just want to record the time history of the temperature at a given point, add

```
&DEVC XYZ=6.7,2.9,2.1, QUANTITY='TEMPERATURE', ID='T-1' /
```

and a column will be added to the output file `CHID_devc.csv` under the label 'T-1'. In this case, the `ID` has no other role than as a column label in the output file. Note that versions of FDS prior to version 5 used an 8 cell linear interpolation for a given *gas phase* point measurement. In other words, if you specified a point via the triplet of real numbers, `XYZ`, FDS would calculate the value of the quantity by linearly interpolating the values defined at the centers of the 8 nearest cells. Starting in FDS 5, this is no longer done. Instead, FDS reports the value of the `QUANTITY` in the cell where the point `XYZ` is located.

When prescribing a solid phase quantity, be sure to position the probe at a solid surface. It is not always obvious where the solid surface is since the mesh does not always align with the input obstruction locations. To help locate the appropriate surface, the parameter `IOR` *must* be included when designating a solid phase quantity. If the orientation of the solid surface is in the positive  $x$  direction `IOR=1`, negative  $x$  direction `IOR=-1`, positive  $y$  `IOR=2`, negative `IOR=-2`, positive  $z$  `IOR=3`, and negative  $z$  `IOR=-3`. There are still instances where FDS cannot determine which solid surface is being designated, in which case an error message appears in the diagnostic output file. Re-position the probe and try again. For example, the line

```
&DEVC XYZ=0.7,0.9,2.1, QUANTITY='WALL TEMPERATURE', IOR=-2, ID='...' /
```

designates the surface temperature of a wall facing the negative  $y$  direction.

In addition to point measurements, the `DEVC` group can be used to report integrated quantities (See Table 12.1). For example, you may want to know the mass flow out of a door or window. To report this, add the line

```
&DEVC XB=0.3,0.5,2.1,2.5,3.0,3.0, QUANTITY='MASS FLOW', ID='whatever' /
```

Note that in this case, a plane is specified rather than a point. The sextuplet `XB` is used for this purpose. Notice when a flow is desired, two of the six coordinates need to be the same. Another `QUANTITY`, `HRR`, can be used to compute the total heat release rate within a subset of the domain. In this case, the sextuplet `XB` ought to define a volume rather than a plane. Specification of the plane or volume over which the integration is to take place can only be done using `XB` – avoid planes or volumes that cross multiple mesh boundaries. FDS has to decide which mesh to use in the integration, and it chooses the finest mesh overlapping the centroid of the designated plane or volume.

### 12.2.2 Quantities within Solids: The PROF Namelist Group

FDS uses a fine, non-uniform, one-dimensional mesh at each boundary cell to compute heat transfer within a solid. The parameters (Table 13.15) to specify a given PROFILE are similar to those used to specify a surface quantity in the DEVC group. XYZ designates the triplet of coordinates, QUANTITY is the physical quantity to monitor, IOR the orientation, and ID an identifying character string. Here is an example of how you would use this feature to get a time history of temperature profiles within a given solid obstruction:

```
&PROF XYZ=..., QUANTITY='TEMPERATURE', ID='TUI1SA_FDS', IOR=3 /
```

Other possible quantities are the total density of the wall (QUANTITY = 'DENSITY') or densities of solid material components (QUANTITY = 'MATL\_ID'), where MATL\_ID is the name of the material.

Each PROF line creates a separate file. This may be more than is needed. Sometimes, all you want to know is the temperature at a certain depth. To get an inner wall temperature, you can also just use a device as follows:

```
&DEVC XYZ=..., QUANTITY='INSIDE WALL TEMPERATURE', DEPTH=0.005, ID='Temp_1', IOR=3 /
```

The parameter DEPTH (m) indicates the distance inside the solid surface. Note that this QUANTITY is allowed only as a DEVC, not a BNDF, output. Also note that if the wall thickness is decreasing over time due to the solid phase reactions, the distance is measured from the current surface, and the measurement point is 'moving' towards the back side of the solid. Eventually, the measurement point may get out of the solid, in which case it starts to show ambient temperature. If you just want to know the temperature of the back surface of the "wall," then use

```
&DEVC XYZ=..., QUANTITY='BACK WALL TEMPERATURE', ID='Temp_b', IOR=3 /
```

Note that this quantity is only meaningful if the front or exposed surface of the "wall" has the attribute BACKING='EXPOSED' on the SURF line that defines it. The coordinates, XYZ, and orientation, IOR, refer to the front surface. To check that the heat conduction calculation is being done properly, you can add the additional line

```
&DEVC XYZ=..., QUANTITY='WALL TEMPERATURE', ID='Temp_f', IOR=-3 /
```

where now XYZ and IOR refer to the coordinates and orientation of the back side of the wall. These two wall temperatures ought to be the same. Remember that the "wall" in this case can only be at most one mesh cell thick, and its THICKNESS need not be the same as the mesh cell width. Rather, the THICKNESS ought to be the actual thickness of the "wall" through which FDS performs a 1-D heat conduction calculation.

### 12.2.3 Animated Planar Slices: The SLCF Namelist Group

The SLCF ("slice file") namelist group parameters (Table 13.20) allows you to record various gas phase quantities at more than a single point. A "slice" refers to a subset of the whole domain. It can be a line, plane, or volume, depending on the values of XB. The sextuplet XB indicates the boundaries of the "slice" plane. XB is prescribed as in the OBST or VENT groups, with the possibility that 0, 2, or 4 out of the 6 values be the same to indicate a volume, plane or line, respectively. A handy trick is to specify, for example, PBX=5.3 instead of XB if it is desired that the entire plane  $y = 5.3$  slicing through the domain be saved. PBX and PBZ control planes perpendicular to the  $x$  and  $z$  axes, respectively.

Animated vectors can be created in Smokeview if a given SLCF line has the attribute VECTOR=.TRUE. If two SLCF entries are in the same plane, then only one of the lines needs to have VECTOR=.TRUE. Otherwise, a redundant set of velocity component slices will be created.

Slice file information is recorded in files (See Section 24.7) labeled CHID\_n.sf, where  $n$  is the index of the slice file. A short fortran program **fds2ascii.f** produces a text file from a line, plane or volume of data. See Section 12.4 for more details.



### 12.2.4 Animated Boundary Quantities: The `BNDF` Namelist Group

The `BNDF` (“boundary file”) namelist group parameters allows you to record surface quantities at all solid obstructions. As with the `SLCF` group, each quantity is prescribed with a separate `BNDF` line, and the output files are of the form `CHID_n.bf`. No physical coordinates need be specified, however, just `QUANTITY`. See Table 12.1. For certain output quantities, additional parameters need to be specified via the `PROP` namelist group. In such cases, add the character string, `PROP_ID`, to the `BNDF` line to tell FDS where to find the necessary extra information.

Note that `BNDF` files (Section 24.9) can become very large, so be careful in prescribing the time interval. One way to reduce the size of the output file is to turn off the drawing of boundary information on desired obstructions. On any given `OBST` line, if the string `BNDF_OBST=.FALSE.` is included, the obstruction is not colored. To turn off all boundary drawing, set `BNDF_DEFAULT=.FALSE.` on the `MISC` line. Then individual obstructions can be turned back on with `BNDF_OBST=.TRUE.` on the appropriate `OBST` line. Individual faces of a given obstruction can be controlled via `BNDF_FACE (IOR)`, where `IOR` is the index of orientation (+1 for the positive  $x$  direction, -1 for negative, and so on).

### 12.2.5 Animated Isosurfaces: The `ISO` Namelist Group

The `ISO` (“ISOsurface File”) namelist group is used to specify the output of gas phase scalar quantities, as three dimensional animated contours. For example, a 300 °C temperature isosurface shows where the gas temperature is 300 °C. Three different values of the temperature can be saved via the line:

```
&ISO QUANTITY='TEMPERATURE', VALUE(1)=50., VALUE(2)=200., VALUE(3)=500. /
```

where the values are in degrees C. Note that the isosurface output files `CHID_n.iso` can become very large, so experiment with different sampling rates (`DT_ISO` on the `DUMP` line).

Any gas phase quantity can animated via iso-surfaces, but use caution. To render an iso-surface, the desired quantity must be computed in every mesh cell at every output time step. For quantities like `TEMPERATURE`, this is not a problem, as FDS computes it and saves it anyway. However, soot density or oxygen demand substantial amounts of time to compute at each mesh cell.

### 12.2.6 Plot3D Static Data Dumps

By default, flow field data in Plot3D format is output 5 times a run. Five quantities are written out to a file at one instant in time. The default specification is:

```
&DUMP ..., PLOT3D_QUANTITY(1:5)='TEMPERATURE',  
        'U-VELOCITY','V-VELOCITY','W-VELOCITY','HRRPUV' /
```

It’s best to leave the velocity components as is, because Smokeview uses them to draw velocity vectors. The first and fifth quantities can be changed with the parameters `PLOT3D_QUANTITY(1)` and `PLOT3D_QUANTITY(5)` on the `DUMP` line. If any of the specified quantities require the additional specification of a particular species, use `PLOT3D_SPEC_ID(n)` to provide the `SPEC_ID` for `PLOT3D_QUANTITY(n)`.

Note that there can only be one `DUMP` line.

Data stored in Plot3D [9] files (See Section 24.8) use a format developed by NASA and used by many CFD programs for representing simulation results. Plot3D data is visualized in three ways: as 2D contours, vector plots and iso-surfaces. Vector plots may be viewed if one or more of the  $u$ ,  $v$  and  $w$  velocity components are stored in the Plot3D file. The vector length and direction show the direction and relative speed of

the fluid flow. The vector colors show a scalar fluid quantity such as temperature. Plot3D data are stored in files with extension `.q`. There is an optional file that can be output with coordinate information if another visualization package is being used to render the files. If you write `WRITE_XYZ=.TRUE.` on the `DUMP` line, a file with suffix `.xyz` is written out. Smokeview does not require this file because the coordinate information can be obtained elsewhere.

### 12.2.7 SMOKE3D: Realistic Smoke and Fire

When you do a fire simulation using the default mixture fraction combustion model, FDS automatically creates two output files that are rendered by Smokeview as realistic looking smoke and fire. By default, the output quantities are the 'MASS FRACTION' of 'soot' and 'HRRPUV' (Heat Release Rate Per Unit Volume) are used in the visualization. You have the option of rendering any other species mass fraction instead of 'soot', so long as the `MASS_EXTINCTION_COEFFICIENT` (either from the `REAC` line, or overridden by the value on the `SPEC` line) is appropriate in describing the attenuation of visible light by the specified gas species. The alternative gas species is given by `SMOKE3D_QUANTITY` on the `DUMP` line. If the specified quantity requires the additional specification of a particular species, use `SMOKE3D_SPEC_ID` to provide the `SPEC_ID`. See the Smokeview User's Guide for more details on how these quantities are rendered.

Here is an example of how to control the smoke species. Normally, you do not need to do this as the "smoke" is an assumed part of the default mixture fraction model.

```
&SPEC ID='MY SMOKE', MW=29., MASS_EXTINCTION_COEFFICIENT=8700. /
&SURF ID='NO FIRE', TMP_FRONT=1000., MASS_FLUX(1)=0.0001, COLOR='RED' /
&VENT XB=0.6,1.0,0.3,0.7,0.0,0.0, SURF_ID='NO FIRE' /
&DUMP SMOKE3D_QUANTITY='MASS FRACTION', SMOKE3D_SPEC_ID='MY SMOKE' /
```

The production rate of 'MY SMOKE' is 0.0001 kg/m<sup>2</sup>/s, applied to an area of 0.16 m<sup>2</sup>. The `MASS_EXTINCTION_COEFFICIENT` is passed to Smokeview to be used for visualization.

## 12.3 Special Output Quantities

This section lists a variety of output quantities that are useful for studying thermally-driven flows, combustion, pyrolysis, and so forth. Note that some of the output quantities can be produced in a variety of ways.

### 12.3.1 Heat Release Rate

Quantities associated with the overall energy budget are reported in the comma delimited file **CHID\_hrr.csv**. This file is automatically generated; the only input parameter associated with it is `DT_HRR` on the `DUMP` line. The file consists of six columns. The first column contains the time in seconds. The second through fifth columns contain integrated energy gains and losses, all in units of kW. The second column contains the total heat release rate, the third contains the radiative heat loss to all the boundaries (solid and open), the fourth contains the convective and radiative heat loss to the boundaries (*i.e.* the energy flowing out of or into the domain), and the fifth contains the energy conducted into the solid surfaces. The sixth column contains the total burning rate of fuel, in units of kg/s. It is included merely as a check of the total heat release rate.

Let  $\Omega$  denote the unblocked computational domain, *i.e.* the volume within the bounding rectangle occupied by gas. Let  $\partial\Omega$  be the boundary of  $\Omega$ . The boundary can be divided into two parts  $\partial\Omega = \partial\Omega_1 + \partial\Omega_2$ . The first part  $\partial\Omega_1$  consists of all the solid walls. The second part  $\partial\Omega_2$  consists of openings from outside the domain through which gases may flow. This could be an open window to the exterior, or a forced vent.

The total heat release rate is given by

$$\dot{Q} = \int_{\Omega} \dot{q}''' dV \quad (12.1)$$

The radiative loss to the boundaries can be computed with either a volume or boundary integral

$$\dot{Q}_r = \int_{\Omega} \nabla \cdot \mathbf{q}_r dV = \int_{\partial\Omega} \mathbf{q}_r \cdot d\mathbf{S} = \int_{\partial\Omega} \dot{q}_r'' dA \quad (12.2)$$

It represents the energy radiating away from the fire and hot gases into the solid boundaries or out of the computational domain. The convective/radiative loss to open boundaries is

$$\dot{Q}_{conv} = \int_{\partial\Omega} c_p \rho (T - T_{\infty}) \mathbf{u} \cdot d\mathbf{S} + \int_{\partial\Omega_2} \dot{q}_r'' dA \quad (12.3)$$

where the integral is positive if the flow and radiative flux are going out of the domain. The conductive loss to solid surfaces is given by

$$\dot{Q}_{cond} = \int_{\partial\Omega_1} \dot{q}_r'' + \dot{q}_c'' dA \quad (12.4)$$

where the integral is positive if heat is being lost into a wall colder than the gas.

For scenarios in which the fire is the primary source of energy, after the gas temperatures within the computational domain reach a nearly steady state

$$\dot{Q} \approx \dot{Q}_{conv} + \dot{Q}_{cond} \quad (12.5)$$

This is merely a check of the global energy balance, that is, the energy generated within the space heats up the gases and solid surfaces, and then a balance between heat input and output is achieved.

### 12.3.2 Visibility and Obscuration

If you are performing a fire calculation using the mixture fraction approach, the smoke is tracked along with all other major products of combustion. The most useful quantity for assessing visibility in a space is the *light extinction coefficient*,  $K$  [10]. The intensity of monochromatic light passing a distance  $L$  through smoke is attenuated according to

$$I/I_0 = e^{-KL} \quad (12.6)$$

The light extinction coefficient,  $K$ , is a product of the density of smoke particulate,  $\rho Y_s$ , and a mass specific extinction coefficient that is fuel dependent

$$K = K_m \rho Y_s \quad (12.7)$$

Devices that output a % obscuration such as a DEVC with a QUANTITY of ASPIRATION, CHAMBER OBSCURATION (smoke detector), or PATH OBSCURATION (beam detector) are discussed respectively in Section 11.3.6, Section 11.3.4, and Section 11.3.5

Estimates of visibility through smoke can be made by using the equation

$$S = C/K \quad (12.8)$$

where  $C$  is a non-dimensional constant characteristic of the type of object being viewed through the smoke, *i.e.*  $C = 8$  for a light-emitting sign and  $C = 3$  for a light-reflecting sign [10]. Since  $K$  varies from point to point in the domain, the visibility  $S$  does as well. Keep in mind that FDS can only track smoke whose production rate and composition are specified. Predicting either is beyond the capability of the present version of the model.

Three parameter control smoke production and visibility; each parameter is input on the REAC line. The first parameter is SOOT\_YIELD, which is the fraction of fuel mass that is converted to soot if the mixture fraction model is being used. The second parameter is called the MASS\_EXTINCTION\_COEFFICIENT, and it is the  $K_m$  in Eq. (12.7). The default value is 8700 m<sup>2</sup>/kg, a value suggested for flaming combustion of wood and plastics<sup>1</sup>. The third parameter is called the VISIBILITY\_FACTOR, the constant  $C$  in Eq. (12.8). It is 3 by default.

The gas phase output quantity 'EXTINCTION COEFFICIENT' is  $K$ . A similar quantity is the 'OPTICAL DENSITY',  $K/2.3$ , the result of using  $\log_{10}$  in the definition

$$D \equiv -\frac{1}{L} \log_{10} \left( \frac{I}{I_0} \right) = K \log_{10} e \quad (12.9)$$

The visibility  $S$  is output via the keyword VISIBILITY. Note that, by default, the visibility is associated with the smoke that is implicitly defined by the mixture fraction model. However, this quantity can also be associated with an explicitly defined species via the inclusion of a SPEC\_ID. In other words, you can specify the output quantity 'VISIBILITY' along with a SPEC\_ID. This does not require that you do a mixture fraction calculation; only that you have specified the given species via a separate SPEC line. You can specify a unique MASS\_EXTINCTION\_COEFFICIENT on the SPEC line as well.

### 12.3.3 Layer Height and the Average Upper and Lower Layer Temperatures

Fire protection engineers often need to estimate the location of the interface between the hot, smoke-laden upper layer and the cooler lower layer in a burning compartment. Relatively simple fire models, often referred to as *two-zone models*, compute this quantity directly, along with the average temperature of the upper

<sup>1</sup>For most flaming fuels, a suggested value for  $\kappa$  is 8700 m<sup>2</sup>/kg  $\pm$  1100 m<sup>2</sup>/kg at a wavelength of 633 nm [11]

and lower layers. In a computational fluid dynamics (CFD) model like FDS, there are not two distinct zones, but rather a continuous profile of temperature. Nevertheless, there are methods that have been developed to estimate layer height and average temperatures from a continuous vertical profile of temperature. One such method [12] is as follows: Consider a continuous function  $T(z)$  defining temperature  $T$  as a function of height above the floor  $z$ , where  $z = 0$  is the floor and  $z = H$  is the ceiling. Define  $T_u$  as the upper layer temperature,  $T_l$  as the lower layer temperature, and  $z_{int}$  as the interface height. Compute the quantities:

$$\begin{aligned} (H - z_{int}) T_u + z_{int} T_l &= \int_0^H T(z) dz = I_1 \\ (H - z_{int}) \frac{1}{T_u} + z_{int} \frac{1}{T_l} &= \int_0^H \frac{1}{T(z)} dz = I_2 \end{aligned}$$

Solve for  $z_{int}$ :

$$z_{int} = \frac{T_l(I_1 I_2 - H^2)}{I_1 + I_2 T_l^2 - 2 T_l H} \quad (12.10)$$

Let  $T_l$  be the temperature in the lowest mesh cell and, using Simpson's Rule, perform the numerical integration of  $I_1$  and  $I_2$ .  $T_u$  is defined as the average upper layer temperature via

$$(H - z_{int}) T_u = \int_{z_{int}}^H T(z) dz \quad (12.11)$$

Further discussion of similar procedures can be found in Ref. [13].

The quantities `LAYER HEIGHT`, `UPPER TEMPERATURE` and `LOWER TEMPERATURE` can be designated via “device” (`DEVC`) lines in the input file<sup>2</sup>. For example, the entry

```
&DEVC XB=2.0,2.0,3.0,3.0,0.0,3.0, QUANTITY='LAYER HEIGHT', ID='whatever' /
```

produces a time history of the smoke layer height at  $x = 2$  and  $y = 3$  between  $z = 0$  and  $z = 3$ . If multiple meshes are being used, the vertical path *cannot* cross mesh boundaries.

### 12.3.4 The True Gas Temperature vs. the Measured Gas Temperature

The output quantity `THERMOCOUPLE` is the temperature of the thermocouple itself, usually close to the gas temperature, but not always. It is determined by solving the following equation for  $T_{TC}$  iteratively [14]

$$\epsilon_{TC}(\sigma T_{TC}^4 - U/4) + h(T_{TC} - T_g) = 0 \quad (12.12)$$

where  $\epsilon_{TC}$  is the emissivity of the thermocouple,  $U$  is the integrated radiative intensity,  $T_g$  is the true gas temperature, and  $h$  is the heat transfer coefficient to a small sphere,  $h = k_a \text{Nu} / \text{Pr} / d_{TC}$ . The bead `BEAD_DIAMETER` and `BEAD_EMISSIVITY` are given on the associated `PROP` line. See the discussion on heat transfer to a water droplet in the Technical Reference Guide for details of the convective heat transfer to a small sphere.

### 12.3.5 Heat Fluxes and Thermal Radiation

There are various ways of recording the heat flux at a solid boundary. If you want to record the *net* heat flux to the surface,  $\dot{q}_c'' + \dot{q}_r''$ , use the `QUANTITY` called 'NET HEAT FLUX'. The individual components, the *net* convective and radiative fluxes, are 'CONVECTIVE HEAT FLUX' and 'RADIATIVE HEAT FLUX', respectively. If you want to compare predicted heat flux with a measurement, you often need to use 'GAUGE

<sup>2</sup>Note that in FDS 5 and beyond, these quantities are no longer available as slice files.

HEAT FLUX'. The difference between 'NET HEAT FLUX' and 'GAUGE HEAT FLUX' is that the former is the rate at which energy is absorbed by the solid surface; the latter is the amount of energy that would be absorbed if the surface were cold (or some specified temperature):

$$\dot{q}_r''/\epsilon + \dot{q}_c'' + h(T_w - T_\infty) + \sigma(T_w^4 - T_\infty^4)$$

If the heat flux gauge used in an experiment has a temperature other than ambient, set GAUGE\_TEMPERATURE on the PROP line associated with the device. When comparing against a radiometer measurement, use RADIOMETER:

$$\dot{q}_r''/\epsilon + \sigma(T_w^4 - T_\infty^4)$$

For diagnostic purposes it is sometimes convenient to output the 'INCIDENT HEAT FLUX':

$$\dot{q}_r''/\epsilon + \sigma T_w^4 + \dot{q}_c''$$

All of the above heat flux output quantities are defined at a solid surface. However, 'RADIATIVE HEAT FLUX GAS' acts like a radiometer that is not attached to a solid surface. This quantity integrates the incoming radiative flux over  $2\pi$  solid angles around the vector defined by ORIENTATION, a triplet of real numbers that defines the orientation of the device. For example,

ORIENTATION=-1.0, 0.0, 0.0

means that the device points in the negative  $x$  direction. Unlike IOR, the ORIENTATION can be in any direction, not just those associated with the three coordinate directions.

### 12.3.6 Droplet Output Quantities

It is possible to record various properties of evaporating droplets. Some of the output quantities are associated with solid boundaries. For example, 'MPUA' is the Mass Per Unit Area of the droplets named PART\_ID. Likewise, 'AMPUA' is the Accumulated Mass Per Unit Area. Both of these are given in units of  $\text{kg/m}^2$ . Think of these outputs as measures of the instantaneous mass density per unit area, and the accumulated total, respectively. The accumulated total is analogous to a "bucket test," where the droplets are collected in buckets and the total mass determined at the end of a given time period. The cooling of a solid surface by droplets of a given type is given by 'CPUA', the Cooling Per Unit Area in units of  $\text{kW/m}^2$ .

Be aware of the fact that the default behavior for droplets hitting the "floor," that is, the plane  $z = Z_{\text{MIN}}$ , is to disappear (POROUS\_FLOOR=.TRUE. on the MISC line). In this case, 'MPUA' will be zero, but 'AMPUA' will not. FDS stores the droplet mass just before removing the droplet from the simulation for the purpose of saving CPU time.

Away from solid surfaces, 'MPUV' is the Mass Per Unit Volume of the droplets as they fly through the air, in units of  $\text{kg/m}^3$ . 'DROPLET FLUX X', 'DROPLET FLUX Y', and 'DROPLET FLUX Z' produce *only* slice and Plot3D files of the mass flux of droplets in the  $x$ ,  $y$ , and  $z$  directions, respectively, in units of  $\text{kg/m}^2/\text{s}$ .

### 12.3.7 Interfacing with Structural Models

FDS solves a one-dimensional heat conduction equation for each boundary cell marking the interface between gas and solid, assuming that material properties for the material layer(s) are provided. The results can be transferred (via either DEVC or BNDF output) to other models that predict the mechanical response of the walls or structure. For many applications, the 1-D solution of the heat conduction equation is adequate, but in situations where it is not, another approach can be followed. FDS includes a calculation of the Adiabatic Surface Temperature (AST), a quantity that is representative of the heat flux to a solid surface. Following the

idea proposed by Ulf Wickstrom [15], the following equation can be solved via a simple iterative technique to determine an effective gas temperature,  $T_{AST}$ :

$$\dot{q}_r'' + \dot{q}_c'' = \epsilon \sigma (T_{AST}^4 - T_w^4) + h(T_{AST} - T_w) \quad (12.13)$$

The sum  $\dot{q}_r'' + \dot{q}_c''$  is the *net* heat flux onto the solid surface, whose temperature is  $T_w$ . The heat fluxes and surface temperature are computed in FDS, and they are inter-dependent. The computed wall temperature affects the net heat flux and vice versa. However, because FDS only computes the solution to the 1-D heat conduction equation in the solid, it may be prone to error if lateral heat conduction within the solid is significant. Thus, in some scenarios neither the FDS-predicted heat fluxes or the surface temperature can be used as an accurate indicator of the thermal insult from the hot, smokey gases onto solid objects.

Of course, both the heat fluxes,  $\dot{q}_r''$  and  $\dot{q}_c''$ , and the surface temperature,  $T_w$  can be passed from FDS to the other model, and suitable corrections can be made based on a presumably more accurate prediction of the solid temperature. Alternatively, the single quantity,  $T_{AST}$ , can be transferred, as this is the temperature that the solid surface effectively “sees.” It represents the gas phase thermal environment, however complicated, but it does not carry along the uncertainty associated with the simple solid phase heat conduction model within FDS. Obviously, the objective in passing information to a more detailed model is to get a better prediction of the solid temperature (and ultimately its mechanical response) than FDS can provide.

### 12.3.8 Useful Solid Phase Outputs

In addition to the `PROFILE` output, there are various additional quantities that are useful for monitoring reacting surfaces. For example, `'WALL THICKNESS'` gives the overall thickness of the solid surface element. `'SURFACE DENSITY'` gives the overall mass per unit area for the solid surface element, computed as an integral of material density over wall thickness. Both quantities are available both as `DEVC` and `BNDF`.

To record the change in a material component’s density with time, use the output quantity `'SOLID DENSITY'` in the following way:

```
&DEVC ID='...', XYZ=..., IOR=3, QUANTITY='SOLID DENSITY', MATL_ID='wood', DEPTH=0.001 /
```

This produces a time history of the density of the material referred to as `'wood'` on a `MATL` line. The density is recorded 1 mm beneath the surface which is oriented in the positive  $z$  direction. Note that if `'wood'` is part of a mixture, the density represents the mass of `'wood'` per unit volume of the mixture. Note also that `'SOLID DENSITY'` is only available as a `DEVC` (device) quantity.

### 12.3.9 Spatially-Integrated Outputs

A useful feature of a device (`DEVC`) is to specify an output quantity along with a desired statistic. For example,

```
&DEVC XYZ=2.3,4.5,6.7, QUANTITY='TEMPERATURE', ID='whatever', STATISTICS='MAX' /
```

causes FDS to write out the maximum gas phase temperature over the entire mesh containing the point `XYZ`. Note that it does not compute the maximum over the entire computational domain, just that particular mesh. Other `STATISTICS` include `'MIN'` and `'MEAN'`. They can be used for both gas and solid phase output quantities. In the case of solids, the specification of a `SURF_ID` limits the search to only those surfaces. Use the `STATISTICS` feature with caution because it demands that FDS evaluate the given `QUANTITY` in all gas or solid phase cells.

### Volume-Weighted Mean

For a given gas phase output quantity,  $\phi(x,y,z)$ , STATISTICS='VOLUME MEAN' produces the discrete analog of

$$\frac{1}{V} \int \phi(x,y,z) dx dy dz \quad (12.14)$$

which is very similar to 'MEAN', but it weights the values according to the relative size of the mesh cell. Note that this statistic is only appropriate for gas phase quantities. Note also that you must specify a volume to sum over via the coordinate parameters, XB, all of which must be contained within the same mesh.

### Mass-Weighted Mean

For a given gas phase output quantity,  $\phi(x,y,z)$ , STATISTICS='MASS MEAN' produces the discrete analog of

$$\frac{\int \rho \phi(x,y,z) dx dy dz}{\int \rho dx dy dz} \quad (12.15)$$

which is similar to 'VOLUME MEAN', but it weights the values according to the relative mass of the mesh cell. Note that this statistic is only appropriate for gas phase quantities. Note also that you must specify a volume to sum over via the coordinate parameters, XB, all of which must be contained within the same mesh.

### Volume Integral

For a given gas phase output quantity,  $\phi(x,y,z)$ , STATISTICS='VOLUME INTEGRAL' produces the discrete analog of

$$\int \phi(x,y,z) dx dy dz \quad (12.16)$$

Note that this statistic is only appropriate for gas phase quantities, in particular those whose units involve  $m^{-3}$ . For example, heat release rate per unit volume is an appropriate output quantity. Note also that you must specify a volume to sum over via the coordinate parameters, XB, all of which must be contained within the same mesh.

### Area Integral

For a given gas phase output quantity,  $\phi(x,y,z)$ , STATISTICS='AREA INTEGRAL' produces the discrete analog of

$$\int \phi(x,y,z) dA \quad (12.17)$$

where  $dA$  depends on the coordinates you specify for XB. Note that this statistic is only appropriate for gas phase quantities, in particular those whose units involve  $m^{-2}$ . For example, the quantity 'MASS FLUX X' along with SPEC\_ID='my gas' is an appropriate output quantity if you want to know the mass flux of the gas species that you have named 'my gas' through an area normal to the  $x$  direction. Note also that you must specify an area to sum over via the coordinate parameters, XB, all of which must be contained within the same mesh.



## Surface Integral

For a given solid phase output quantity,  $\phi$ , STATISTICS='SURFACE INTEGRAL' produces the discrete analog of

$$\int \phi dA \quad (12.18)$$

Note that this statistic is only appropriate for solid phase quantities, in particular those whose units involve  $m^{-2}$ . For example, the various heat and mass fluxes are appropriate output quantities.

## Mass and Energy Flows

The net flow of mass and energy into or out of compartments can be useful for many applications. There are several outputs that address these. All are prescribed via the device (DEVC) namelist group only. For example:

```
&DEVC XB=0.3,0.5,2.1,2.5,3.0,3.0, QUANTITY='MASS FLOW', ID='whatever' /
```

outputs the net integrated mass flux through the given planar area, oriented in the positive  $z$  direction, in this case. The three flows – 'VOLUME FLOW', 'MASS FLOW', and 'HEAT FLOW' are defined:

$$\begin{aligned} \dot{V} &= \int \mathbf{u} \cdot d\mathbf{S} \\ \dot{m} &= \int \rho \mathbf{u} \cdot d\mathbf{S} \\ \dot{q} &= \int c_p \rho (T - T_\infty) \mathbf{u} \cdot d\mathbf{S} \end{aligned}$$

The addition of a + or – to the QUANTITY names yields the integral of the flow in the positive or negative direction only. In other words, if you want to know the mass flow out of a compartment, use 'MASS FLOW +' or 'MASS FLOW -', depending on the orientation of the door.

### 12.3.10 Wind and the Pressure Coefficient

In the field of wind engineering, a commonly used quantity is known as the PRESSURE\_COEFFICIENT:

$$C_p = \frac{p - p_\infty}{\frac{1}{2} \rho_\infty U^2} \quad (12.19)$$

$p_\infty$  is the ambient, or “free stream” pressure, and  $\rho_\infty$  is the ambient density. The parameter  $U$  is the free-stream wind speed, given as CHARACTERISTIC\_VELOCITY on the PROP line

```
&BNDF QUANTITY='PRESSURE COEFFICIENT', PROP_ID='whatever' /  
&DEVC ID='pressure tap', XYZ=..., IOR=2, QUANTITY='PRESSURE COEFFICIENT', PROP_ID='whatever' /  
&PROP ID='whatever', CHARACTERISTIC_VELOCITY=3.4 /
```

Thus, you can either paint values of  $C_p$  at all surface points, or create a single time history of  $C_p$  using a single device at a single point.

## 12.4 Extracting Numbers from the Output Data Files

Often it is desired to present results of calculations in some form other than those offered by Smokeview. In this case, there is a short Fortran 90 program called **fds2ascii.f90**, with a PC compiled version called **fds2ascii.exe**. To run the program, just type

```
fds2ascii
```

at the command prompt. You will be asked a series of questions about which type of output file to process, what time interval to time average the data, and so forth. A single file is produced with the name **CHID\_fds2ascii.csv**. A typical command line session looks like this:

```
>> fds2ascii
  Enter Job ID string (CHID):
bucket_test
  What type of file to parse?
  PL3D file? Enter 1
  SLCF file? Enter 2
  BNDF file? Enter 3
3
  Enter Sampling Factor for Data?
  (1 for all data, 2 for every other point, etc.)
1
  Limit the domain size? (y or n)
y
  Enter min/max x, y and z
-5 5 -5 5 0 1
  1 MESH 1, WALL TEMPERATURE
  Enter starting and ending time for averaging (s)
35 36
  Enter orientation: (plus or minus 1, 2 or 3)
3
  Enter number of variables
1
  Enter boundary file index for variable 1
1
  Enter output file name:
bucket_test_fds2ascii.csv
  Writing to file...      bucket_test_fds2ascii.csv
```

These commands tell **fds2ascii** that you want to convert (binary) boundary file data into a text file. You want to sample every data point within the specified volume, you want only those surfaces that point upwards (+3 orientation), you only want 1 variable (only one is listed anyway and its index is 1 – that is just the number used to list the available files). The data will be time-averaged, and it will be output to a file listed at the end of the session.

## 12.5 Summary of Output Quantities

Table 12.1, spread over the following pages, summarizes the various Output Quantities. The column “File Type” lists the allowed output files for the quantities. “B” is for Boundary (BNDF), “D” is for Device (DEVC), “I” is for Iso-surface (ISOI), “P” is for Plot3D, “PA” for PArticle (PART), “S” is for Slice (SLCF). Be careful when specifying complicated quantities for Iso-surface or Plot3D files, as it requires computation in every gas phase cell.

For those output quantities that require a species name via SPEC\_ID, the species implicitly defined when doing a mixture fraction calculation are as follows:

```
fuel
oxygen
nitrogen
water vapor
carbon dioxide
carbon monoxide
hydrogen
soot
other
```

As an example of how to use the species names, suppose you want to calculate the integrated mass flux of carbon monoxide through a horizontal plane, like the total amount entrained in a fire plume. Use a “device” as follows

```
&DEVC ID='CO_flow', XB=-5,5,-5,5,2,2, QUANTITY='MASS FLUX Z', SPEC_ID='carbon monoxide',
      STATISTICS='AREA INTEGRAL' /
```

Here, the ID is just a label in the output file. The use of lower case letters for the SPEC\_ID indicates that you want to record the mass flow of the CO that is implicitly defined by the mixture fraction variables. This is the default combustion model in FDS. If you have defined a species explicitly via a SPEC line, you can specify that instead.

The format of certain output quantities changed, starting with FDS version 5.2, but the older names originating with version 5.0 will still be accepted. The new convention is that when an output quantity is related to a particular gas species or particle type, then you must specify the appropriate SPEC\_ID or PART\_ID on the same input line. Also note that the use of underscores in output quantity names has been eliminated – just remember that all output quantity names ought to be in single quotes.

Table 12.1: Summary of all Output Quantities

| Output QUANTITY               | Symbol                                    | Units                    | File Type |
|-------------------------------|---|--------------------------|-----------|
| ABSORPTION COEFFICIENT        | $\kappa$ (Section 9.4)                    | 1/m                      | D,I,P,S   |
| ADIABATIC SURFACE TEMPERATURE | See Section 12.3.7                        | $^{\circ}\text{C}$       | B,D       |
| AMPUA**                       | See Section 12.3.6                        | $\text{kg/m}^2$          | B,D       |
| ASPIRATION                    | See Section 11.3.6                        | %                        | D         |
| BACK WALL TEMPERATURE         | See Section 12.2.2                        | $^{\circ}\text{C}$       | B,D       |
| BURNING RATE                  | $\dot{m}''_f$                             | $\text{kg/m}^2/\text{s}$ | B,D       |
| CHAMBER OBSCURATION           | See Section 11.3.4                        | %/m                      | D         |
| CONTROL                       | See Section 11.5                          |                          | D         |
| CONVECTIVE HEAT FLUX          | $\dot{q}''_c$ (Section 12.3.5)            | $\text{kW/m}^2$          | B,D       |
| CPUA**                        | See Section 12.3.6                        | $\text{kW/m}^2$          | B,D       |
| CPU TIME                      | Elapsed CPU time                          | s                        | D         |
| DENSITY                       | $\rho$ or $\rho Y_{\alpha}$ with SPEC_ID  | $\text{kg/m}^3$          | D,I,P,S   |
| DIVERGENCE                    | $\nabla \cdot \mathbf{u}$                 | $\text{s}^{-1}$          | D,I,P,S   |
| DROPLET FLUX X**              | See Section 12.3.6                        | $\text{kg/m}^2/\text{s}$ | P,S       |
| DROPLET FLUX Y**              | See Section 12.3.6                        | $\text{kg/m}^2/\text{s}$ | P,S       |
| DROPLET FLUX Z**              | See Section 12.3.6                        | $\text{kg/m}^2/\text{s}$ | P,S       |
| DROPLET DIAMETER              | $2r_d$                                    | $\mu\text{m}$            | PA        |
| DROPLET VELOCITY              | $ \mathbf{u}_d $                          | m/s                      | PA        |
| DROPLET TEMPERATURE           | $T_d$                                     | $^{\circ}\text{C}$       | PA        |
| DROPLET MASS                  | $m_d$                                     | kg                       | PA        |
| DROPLET AGE                   | $t_d$                                     | s                        | PA        |
| GAUGE HEAT FLUX               | See Section 12.3.5                        | $\text{kW/m}^2$          | B,D       |
| H                             | $H =  \mathbf{u} ^2/2 + \tilde{p}/\rho_0$ | $(\text{m/s})^2$         | D,I,P,S   |
| HEAT FLOW                     | See Section 12.3.9                        | kW                       | D         |
| NET HEAT FLUX                 | See Section 12.3.5                        | $\text{kW/m}^2$          | B,D       |
| HRR                           | $\int \dot{q}''' dV$                      | kW                       | D         |
| HRRPUV                        | $\dot{q}'''$                              | $\text{kW/m}^3$          | D,I,P,S   |
| INCIDENT HEAT FLUX            | See Section 12.3.5                        | $\text{kW/m}^2$          | B,D       |
| INSIDE WALL TEMPERATURE       | See Section 12.2.2                        | $^{\circ}\text{C}$       | D         |
| ITERATION                     | Number of time steps                      |                          | D         |
| LAYER HEIGHT                  | See Section 12.3.3                        | m                        | D         |
| LINK TEMPERATURE              | See Section 11.3.3                        | $^{\circ}\text{C}$       | D         |
| LOWER TEMPERATURE             | See Section 12.3.3                        | $^{\circ}\text{C}$       | D         |
| MASS FLOW                     | See Section 12.3.9                        | kg/s                     | D         |
| MASS FLUX*                    | Mass flux at solid surface                | $\text{kg/m}^2/\text{s}$ | B,D       |
| MASS FLUX X*                  | $\rho u Y_{\alpha}$                       | $\text{kg/m}^2/\text{s}$ | D,I,P,S   |
| MASS FLUX Y*                  | $\rho v Y_{\alpha}$                       | $\text{kg/m}^2/\text{s}$ | D,I,P,S   |
| MASS FLUX Z*                  | $\rho w Y_{\alpha}$                       | $\text{kg/m}^2/\text{s}$ | D,I,P,S   |

\* Quantity requires the specification of a gas species using SPEC\_ID.

\*\* Quantity requires the specification of a particle name using PART\_ID.

| Output QUANTITY            | Symbol                             | Units             | File Type |
|----------------------------|------------------------------------|-------------------|-----------|
| MASS FRACTION*             | $Y_\alpha$                         | kg/kg             | D,I,P,S   |
| MIXTURE FRACTION           | $Z$                                | kg/kg             | D,I,P,S   |
| MPUA**                     | See Section 12.3.6                 | kg/m <sup>2</sup> | B,D       |
| MPUV**                     | See Section 12.3.6                 | kg/m <sup>3</sup> | D,P,S     |
| OPTICAL DENSITY            | $K/2.3$ (Section 12.3.2)           | 1/m               | D,I,P,S   |
| EXTINCTION COEFFICIENT     | $K$ (Section 12.3.2)               | 1/m               | D,I,P,S   |
| PATH OBSCURATION           | See Section 11.3.5                 | %                 | D         |
| PRESSURE                   | Perturbation pressure, $\tilde{p}$ | Pa                | D,I,P,S   |
| PRESSURE COEFFICIENT       | $C_p$ (Section 12.3.10)            |                   | B,D       |
| RADIATIVE HEAT FLUX        | See Section 12.3.5                 | kW/m <sup>2</sup> | B,D       |
| RADIATIVE HEAT FLUX GAS    | See Section 12.3.5                 | kW/m <sup>2</sup> | D         |
| RADIOMETER                 | See Section 12.3.5                 | kW/m <sup>2</sup> | B,D       |
| RELATIVE HUMIDITY          | Relative humidity                  | %                 | D,I,P,S   |
| SOOT VOLUME FRACTION       | $\rho Y_s(Z)/\rho_s$               | mol/mol           | D,I,P,S   |
| SPRINKLER LINK TEMPERATURE | See Section 11.3.1                 | °C                | D         |
| SOLID DENSITY              | See Section 12.3.8                 | kg/m <sup>3</sup> | D         |
| SURFACE DENSITY            | See Section 12.3.8                 | kg/m <sup>2</sup> | B,D       |
| TEMPERATURE                | $T$ (Section 12.3.4)               | °C                | D,I,P,S   |
| THERMOCOUPLE               | $T_{TC}$ (Section 12.3.4)          | °C                | D         |
| TIME                       | $t$ (Section 11.1)                 | s                 | D         |
| TIME STEP                  | $\delta t$ , Numerical time step   | s                 | D         |
| U-VELOCITY                 | $u$                                | m/s               | D,I,P,S   |
| V-VELOCITY                 | $v$                                | m/s               | D,I,P,S   |
| W-VELOCITY                 | $w$                                | m/s               | D,I,P,S   |
| UPPER TEMPERATURE          | See Section 12.3.3                 | °C                | D         |
| VELOCITY                   | $\sqrt{u^2 + v^2 + w^2}$           | m/s               | D,I,P,S   |
| VISCOSITY                  | $\mu$                              | kg/m/s            | D,I,P,S   |
| VISIBILITY                 | $S = C/K$ (Section 12.3.2)         | m                 | D,I,P,S   |
| VOLUME FLOW                | See Section 12.3.9                 | m <sup>3</sup> /s | D         |
| VOLUME FRACTION*           | $X_\alpha$                         | mol/mol           | D,I,P,S   |
| WALL CLOCK TIME            | Elapsed wall clock time            | s                 | D         |
| WALL TEMPERATURE           | $T_w$                              | °C                | B,D       |
| WALL THICKNESS             | See Section 12.3.8                 | m                 | B,D       |

\* Quantity requires the specification of a gas species using SPEC\_ID.

\*\* Quantity requires the specification of a particle name using PART\_ID.



## Chapter 13

# Alphabetical List of Input Parameters

This Appendix lists all of the input parameters for FDS in separate tables grouped by Namelist, these tables are in alphabetical order along with the parameters within them. This is intended to be used as a quick reference and does not replace reading the detailed description of the parameters in the main body of this guide. See Table 5.1 for a cross-reference of relevant sections and the tables in this Appendix. The reason for this statement is that many of the listed parameters are mutually exclusive – specifying more than one can cause the program to either fail or run in an unpredictable manner. Also, some of the parameters trigger the code to work in a certain mode when specified. For example, specifying the thermal conductivity of a solid surface triggers the code to assume the material to be thermally-thick, mandating that other properties be specified as well. Simply prescribing as many properties as possible from a handbook is bad practice. Only prescribe those parameters which are necessary to describe the desired scenario.

## 13.1 BNDF (Boundary File Parameters)

Table 13.1: For more information see Section 12.2.4.

| BNDF (Boundary File Parameters) |           |                                 |  |  |
|---------------------------------|-----------|---------------------------------|--|--|
| FYI                             | Character | Comment String (has no effect)  |  |  |
| PART_ID                         | Character | Particle identifier (if needed) |  |  |
| PROP_ID                         | Character | Property identifier (if needed) |  |  |
| QUANTITY                        | Character | Quantity to visualize           |  |  |
| SPEC_ID                         | Character | Species identifier (if needed)  |  |  |

## 13.2 CLIP (MIN/MAX Clipping Parameters)

Table 13.2: For more information see Section 6.6.

| CLIP (Specified Upper and Lower Limits) |            |                                |                   |  |
|---|------------|--------------------------------|-------------------|--|
| FYI                                     | Character  | Comment String (has no effect) |                   |  |
| MAXIMUM_DENSITY                         | Real       | Maximum Gas Density            | kg/m <sup>3</sup> |  |
| MAXIMUM_MASS_FRACTION                   | Real Array | Maximum Gas Mass Fraction      | kg/kg             |  |
| MAXIMUM_TEMPERATURE                     | Real       | Maximum Gas Temperature        | °C                |  |
| MINIMUM_DENSITY                         | Real       | Minimum Gas Density            | kg/m <sup>3</sup> |  |
| MINIMUM_MASS_FRACTION                   | Real Array | Minimum Gas Mass Fraction      | kg/kg             |  |
| MINIMUM_TEMPERATURE                     | Real       | Maximum Gas Temperature        | °C                |  |

## 13.3 CTRL (Control Function Parameters)

Table 13.3: For more information see Section 11.5.

| CTRL (Control Function Parameters) |             |  |   |         |
|------------------------------------|-------------|--|---|---------|
| DELAY                              | Real        | Time delay                               | s | 0.      |
| FUNCTION_TYPE                      | Character   | Type of control function                 |   |         |
| ID                                 | Character   | IDentifier                               |   |         |
| INITIAL_STATE                      | Logical     | Initial state of control function        |   | .FALSE. |
| INPUT_ID                           | Char. Array | DEVC and/or CTRL input IDs               |   |         |
| LATCH                              | Logical     | Control function changes state only once |   | .TRUE.  |
| N                                  | Integer     | Number of .TRUE. INPUTS                  |   | 1       |
| ON_BOUND                           | Character   | Active edge of a DEADBAND                |   | LOWER   |
| RAMP_ID                            | Character   | ID for a CUSTOM ramp controller          |   |         |
| SETPOINT (2)                       | Real        | Lower and upper bound of a DEADBAND      |   |         |



## 13.4 DEVC (Device Parameters)

Table 13.4: For more information see Section 11.1.

| DEVC (Device Parameters) |                |  |      |         |
|--------------------------|----------------|--|------|---------|
| BYPASS_FLOWRATE          | Real           | Aspiration smoke detector parameter            | kg/s | 0       |
| CTRL_ID                  | Character      | Associated CTRL line                           |      |         |
| DELAY                    | Real           | Transport time for an aspiration detector      | s    | 0       |
| DEVC_ID                  | Character      | Associated DEVC line for aspiration detector   |      |         |
| DEPTH                    | Real           | Depth into surface for internal wall temp      | m    | 0       |
| FLOWRATE                 | Real           | Suction flowrate for an aspiration detector    | kg/s | 0       |
| FYI                      | Character      | Comment String (has no effect)                 |      |         |
| IOR                      | Integer        | Index of Orientation ( $\pm 1, \pm 2, \pm 3$ ) |      |         |
| ID                       | Character      | Identifying label for output                   |      |         |
| INITIAL_STATE            | Logical        | Initial state of device                        |      | .FALSE. |
| LATCH                    | Logical        | Device cannot change state multiple times      |      | .TRUE.  |
| MATL_ID                  | Character      | Material identifier (if needed)                |      |         |
| ORIENTATION              | Real Triplet   | Direction vector                               |      | 0,0,-1  |
| PART_ID                  | Character      | Particle identifier (if needed)                |      |         |
| PROP_ID                  | Character      | Associated PROPERTY line                       |      |         |
| QUANTITY                 | Character      | Name of Quantity to output                     |      |         |
| ROTATION                 | Real Triplet   | Rotation Angle                                 | deg  | 0       |
| SETPOINT                 | Real           | Value at which device changes state            |      |         |
| SPEC_ID                  | Character      | Species identifier (if needed)                 |      |         |
| STATISTICS               | Character      | See Section 12.3.9                             |      |         |
| SURF_ID                  | Character      | See Section 12.3.9                             |      |         |
| TRIP_DIRECTION           | Integer        | Sign of derivative at first state change       |      | 1       |
| XB (6)                   | Real Sextuplet | Coordinates of non-point measurement           | m    |         |
| XYZ                      | Real Triplet   | Physical coordinates                           | m    |         |

## 13.5 DUMP (Output Parameters)

Table 13.5: For more information see Section 12.1.

| DUMP (Output Parameters) |         |                                  |   |                               |
|--------------------------|---------|----------------------------------|---|-------------------------------|
| CHECK_VOLUME_FLOW        | Logical | See Section 6.4.3                |   | .FALSE.                       |
| COLUMN_DUMP_LIMIT        | Logical | Limit text output to 255 columns |   | .TRUE.                        |
| CTRL_COLUMN_LIMIT        | Integer | Number of columns in CTRL file   |   | 254                           |
| DEVC_COLUMN_LIMIT        | Integer | Number of columns in DEVC file   |   | 254                           |
| DT_BNDF                  | Real    | Boundary dump interval           | s | $2 \Delta t / \text{NFRAMES}$ |
| DT_CTRL                  | Real    | Control status dump interval     | s | $\Delta t / \text{NFRAMES}$   |
| DT_DEVC                  | Real    | Device output dump interval      | s | $\Delta t / \text{NFRAMES}$   |
| DT_HRR                   | Real    | Heat release dump interval       | s | $\Delta t / \text{NFRAMES}$   |
| DT_ISOF                  | Real    | Iso-surface dump interval        | s | $\Delta t / \text{NFRAMES}$   |

Table 13.5: Continued

| DUMP (Output Parameters) |             |                                   |   |                             |
|--------------------------|-------------|-----------------------------------|---|-----------------------------|
| DT_MASS                  | Real        | Mass diagnostic dump interval     | s | $\Delta t / \text{NFRAMES}$ |
| DT_PART                  | Real        | Particle dump interval            | s | $\Delta t / \text{NFRAMES}$ |
| DT_PL3D                  | Real        | PLOT3D dump interval              | s | $\Delta t / 5$              |
| DT_PROF                  | Real        | Profile dump interval             | s | $\Delta t / \text{NFRAMES}$ |
| DT_RESTART               | Real        | Restart core dump interval        | s | 1000000.                    |
| DT_SLCF                  | Real        | Slice dump interval               | s | $\Delta t / \text{NFRAMES}$ |
| FLUSH_FILE_BUFFERS       | Logical     | Periodically empty file buffers   |   | .TRUE.                      |
| MASS_FILE                | Logical     | Flag for species MASS file        |   | .FALSE.                     |
| MAXIMUM_DROPLETS         | Integer     | Max particles per mesh            |   | 500000                      |
| NFRAMES                  | Integer     | Number of Frames of output data   |   | 1000                        |
| PLOT3D_QUANTITY (5)      | Char. Quint | See Section 12.2.6                |   |                             |
| PLOT3D_SPEC_ID (5)       | Char. Quint | See Section 12.2.6                |   |                             |
| SMOKE3D                  | Logical     | Flag for 3D Smoke Visualization   |   | .TRUE.                      |
| SMOKE3D_QUANTITY         | Character   | See Section 12.2.7                |   |                             |
| SMOKE3D_SPEC_ID          | Character   | See Section 12.2.7                |   |                             |
| STATE_FILE               | Logical     | Flag for state relation file      |   | .FALSE.                     |
| STATUS_FILES             | Logical     | Flag for status (notready) file   |   | .FALSE.                     |
| WRITE_XYZ                | Logical     | Flag for writing PLOT3D .xyz file |   | .FALSE.                     |

$$\Delta t = T_{\text{END}} - T_{\text{BEGIN}}$$

## 13.6 HEAD (Header Parameters)

Table 13.6: For more information see Section 6.1.

| HEAD (Header Parameters) |           |                                |  |          |
|--------------------------|-----------|--------------------------------|--|----------|
| CHID                     | Character | Job Identification String      |  | 'output' |
| FYI                      | Character | Comment String (has no effect) |  |          |
| TITLE                    | Character | Title for job                  |  |          |

## 13.7 HOLE (Obstruction Cutout Parameters)

Table 13.7: For more information see Section 7.2.

| HOLE (Obstruction Cutout Parameters) |                 |  |  |  |
|--------------------------------------|-----------------|--|--|--|
| COLOR                                | Character       | Color name of obstruction color                      |  |  |
| CTRL_ID                              | Character       | ID of ConTRoL to control hole's existence            |  |  |
| DEVC_ID                              | Character       | ID of DEViCe to control hole's existence             |  |  |
| FYI                                  | Character       | Comment String (has no effect)                       |  |  |
| RGB (3)                              | Integer Triplet | Color indices (0 - 255) for resulting obstruction(s) |  |  |

Table 13.7: Continued

| HOLE (Obstruction Cutout Parameters) |                |                             |   |  |
|--------------------------------------|----------------|-----------------------------|---|--|
| TRANSPARENCY                         | Real           | Transparency of obstruction |   |  |
| XB (6)                               | Real Sextuplet | Physical coordinates        | m |  |

### 13.8 INIT (Initial Conditions)

Table 13.8: For more information see Section 6.5.

| INIT (Initial Conditions) |                |                              |                   |         |
|---------------------------|----------------|------------------------------|-------------------|---------|
| DENSITY                   | Real           | Initial value of density     | kg/m <sup>3</sup> | Ambient |
| MASS_FRACTION (II)        | Real Array     | Initial value of species II  | kg/kg             | Ambient |
| TEMPERATURE               | Real           | Initial value of temperature | °C                | TMPA    |
| XB (6)                    | Real Sextuplet | Coordinates                  | m                 |         |

### 13.9 ISOF (Isosurface Parameters)

Table 13.9: For more information see Section 12.2.5.

| ISOF (Isosurface Parameters) |            |                                |  |  |
|------------------------------|------------|--------------------------------|--|--|
| FYI                          | Character  | Comment String (has no effect) |  |  |
| QUANTITY                     | Character  | Quantity to visualize          |  |  |
| SPEC_ID                      | Character  | Species indicator (if needed)  |  |  |
| VALUE (I)                    | Real Array | Contour value(s)               |  |  |

### 13.10 MATL (Material Properties)

Table 13.10: For more information see Section 8.4.

| MATL (Material Properties) |           |                                |                   |        |
|----------------------------|-----------|--------------------------------|-------------------|--------|
| A                          | Real      | Pre-exponential factor         | 1/s               | 1E13   |
| ABSORPTION_COEFFICIENT     | Real      | Absorption Coefficient         | 1/m               | 50000. |
| BOILING_TEMPERATURE        | Real      | Boiling temperature            | °C                | 5000.  |
| CONDUCTIVITY               | Real      | Thermal conductivity           | W/m/K             | 0.     |
| CONDUCTIVITY_RAMP          | Character | Ramp ID for conductivity       |                   |        |
| DENSITY                    | Real      | Solid mass per unit volume     | kg/m <sup>3</sup> | 0.     |
| E                          | Real      | Activation energy              | kJ/kmol           |        |
| EMISSIVITY                 | Real      | Emissivity                     |                   | 0.9    |
| FYI                        | Character | Comment String (has no effect) |                   |        |
| HEAT_OF_COMBUSTION         | Real      | Heat of combustion             | kJ/kg             |        |

Table 13.10: Continued

| MATL (Material Properties) |           |                             |                 |         |
|----------------------------|-----------|-----------------------------|-----------------|---------|
| HEAT_OF_REACTION           | Real      | Heat of reaction            | kJ/kg           | 0.      |
| ID                         | Character | IDentifier                  |                 |         |
| THRESHOLD_TEMPERATURE      | Real      | Threshold temperature       | °C              | -273.15 |
| N_REACTIONS                | Character | Number of Reactions         |                 | 0       |
| N_S                        | Real      | Exponent of mass fraction   |                 | 1.      |
| N_T                        | Real      | Exponent of temperature     |                 | 0.      |
| NU_FUEL                    | Real      | Fuel Yield                  | kg/kg           | 0.      |
| NU_RESIDUE                 | Real      | Residue Yield               | kg/kg           | 0.      |
| NU_WATER                   | Real      | Steam Yield                 | kg/kg           | 0.      |
| REFERENCE_RATE             | Real      | Reaction rate at ref. temp. | s <sup>-1</sup> | 0.1     |
| REFERENCE_TEMPERATURE      | Real      | Reference temperature       | °C              |         |
| RESIDUE                    | Character | ID of residue MATL          |                 |         |
| SPECIFIC_HEAT              | Real      | Specific heat               | kJ/kg/K         | 0.      |
| SPECIFIC_HEAT_RAMP         | Character | Ramp ID for specific heat   |                 |         |

### 13.11 MESH (Mesh Parameters)

Table 13.11: For more information see Section 6.3.

| MESH (Mesh Parameters) |                 |   |   |             |
|------------------------|-----------------|---|---|-------------|
| COLOR                  | Character       | Mesh Line Color                             |   | 'BLACK'     |
| CYLINDRICAL            | Logical         | 2-D Axi-symmetric calculation               |   | .FALSE.     |
| ID                     | Character       | MESH IDentifier                             |   |             |
| IJK                    | Integer Triplet | No. cells in $x$ , $y$ , and $z$ directions |   | 10          |
| FYI                    | Character       | Comment String (has no effect)              |   |             |
| RGB                    | Integer Triplet | Color indices (0-255)                       |   | 0,0,0       |
| SYNCHRONIZE            | Logical         | Sync. time steps of multiple meshes         |   | .TRUE.      |
| XB (6)                 | Real Sextuplet  | Min/Max Coordinates of the MESH             | m | 0,1,0,1,0,1 |

### 13.12 MISC (Miscellaneous Parameters)

Table 13.12: For more information see Section 6.4.

| MISC (Miscellaneous Parameters) |           |                              |  |         |
|---------------------------------|-----------|------------------------------|--|---------|
| ASSUMED_GAS_TEMPERATURE         | Real      | See Section 21.1             |  |         |
| BACKGROUND_SPECIES              | Character | See Section 9.2              |  | 'AIR'   |
| BAROCLINIC                      | Logical   | Baroclinic torque correction |  | .FALSE. |
| BNDF_DEFAULT                    | Logical   | See Section 12.2.4           |  | .TRUE.  |
| CFL_MAX                         | Real      | See Section 6.4.7            |  | 1.0     |
| CFL_MIN                         | Real      | See Section 6.4.7            |  | 0.8     |

Table 13.12: Continued

| MISC (Miscellaneous Parameters) |               |  |                     |            |
|---------------------------------|---------------|--|---------------------|------------|
| CSMAG                           | Real          | Smagorinsky constant                     |                     | 0.20       |
| CONDUCTIVITY                    | Real          | See Section 9.2                          | W/m/K               |            |
| CO_PRODUCTION                   | Logical       | See Section 9.1.2                        |                     | .FALSE.    |
| DNS                             | Logical       | Direct Numerical Simulation              |                     | .FALSE.    |
| FYI                             | Character     | Comment String (has no effect)           |                     |            |
| GROUND_LEVEL                    | Real          | See Section 8.2.6                        | m                   | 0.         |
| GVEC                            | Real triplet  | Gravity vector                           | m/s <sup>2</sup>    | 0,0,-9.81  |
| H_FIXED                         | Real          | See Section 21.1                         | W/m <sup>2</sup> /K |            |
| HUMIDITY                        | Real          | Relative Humidity                        | %                   | 40.        |
| ISOTHERMAL                      | Logical       | Isothermal calculation                   |                     | .FALSE.    |
| LAPSE_RATE                      | Real          | See Section 8.2.6                        | °C/m                | 0          |
| LES                             | Logical       | Large Eddy Simulation                    |                     | .TRUE.     |
| MW                              | Real          | Molecular Weight (Section 9.2)           | g/mol               |            |
| NOISE                           | Logical       | Toggle initial noise on and off          |                     | .TRUE.     |
| PR                              | Real          | Prandtl number (LES only)                |                     | 0.5        |
| P_INF                           | Real          | Ambient pressure                         | Pa                  | 101325     |
| POROUS_FLOOR                    | Logical       | See Section 11.3.1                       |                     | .TRUE.     |
| PRESSURE_CORRECTION             | Logical       | See Section 6.4.3                        |                     | .FALSE.    |
| RADIATION                       | Logical       | Radiation calculation flag               |                     | .TRUE.     |
| RAMP_GX                         | Character     | Time function, <i>x</i> comp. of gravity |                     |            |
| RAMP_GY                         | Character     | Time function, <i>y</i> comp. of gravity |                     |            |
| RAMP_GZ                         | Character     | Time function, <i>z</i> comp. of gravity |                     |            |
| RESTART                         | Logical       | Restart previous calculation             |                     | .FALSE.    |
| RESTART_CHID                    | Character     | Restart file CHID                        |                     | CHID       |
| SC                              | Real          | Schmidt number (LES only)                |                     | 0.5        |
| SOLID_PHASE_ONLY                | Logical       | See Section 21.1                         |                     | .FALSE.    |
| STRATIFICATION                  | Logical       | See Section 8.2.6                        |                     | .TRUE.     |
| SUPPRESSION                     | Logical       | See Section 9.1.2                        |                     | .TRUE.     |
| SURF_DEFAULT                    | Character     | Default SURFace type                     |                     | 'INERT'    |
| TEXTURE_ORIGIN(3)               | Char. Triplet | See Section 8.6.1                        | m                   | (0.,0.,0.) |
| THICKEN_OBSTRUCTIONS            | Logical       | See Section 7.1                          |                     | .FALSE.    |
| TMPA                            | Real          | Ambient Temperature                      | °C                  | 20.        |
| U0,V0,W0                        | Reals         | Prevailing velocity field                | m/s                 | 0.         |
| VISCOSITY                       | Real          | See Section 9.2                          | kg/m/s              |            |
| VN_MAX                          | Real          | See Section 6.4.7                        |                     | 1.0        |
| VN_MIN                          | Real          | See Section 6.4.7                        |                     | 0.8        |

### 13.13 OBST (Obstruction Parameters)

Table 13.13: For more information see Section 7.1.

| OBST (Obstruction Parameters) |                     |                                     |   |            |
|-------------------------------|---------------------|-------------------------------------|---|------------|
| ALLOW_VENT                    | Logical             | Allow vents on obstruction          |   | .TRUE.     |
| BNDF_FACE (-3:3)              | Logical Array       | See Section 12.2.4                  |   | .TRUE.     |
| BNDF_OBST                     | Logical             | See Section 12.2.4                  |   | .TRUE.     |
| COLOR                         | Character           | Color name of obstruction color     |   |            |
| CTRL_ID                       | Character           | ID of Controlling ConTRoL           |   |            |
| DEVC_ID                       | Character           | ID of Controlling DEViCe            |   |            |
| FYI                           | Character           | Comment String (has no effect)      |   |            |
| OUTLINE                       | Logical             | Draw as Outline                     |   | .FALSE.    |
| PERMIT_HOLE                   | Logical             | Allow a Hole                        |   | .TRUE.     |
| REMOVABLE                     | Logical             | Allow obstruction to be removed     |   | .TRUE.     |
| RGB (3)                       | Integer Triplet     | Color indices (0 - 255)             |   |            |
| SAWTOOTH                      | Logical             | See Section 7.1.1                   |   | .TRUE.     |
| SURF_ID                       | Character           | Associated Surface                  |   |            |
| SURF_IDS (3)                  | Character Triplet   | Associated Surfaces (top,side,bot.) |   |            |
| SURF_ID6 (6)                  | Character Sextuplet | Associated Surfaces (like XB)       |   |            |
| THICKEN                       | Logical             | Force at least one cell thick       |   | .FALSE.    |
| TEXTURE_ORIGIN (3)            | Real Triplet        | See Section 8.6.1                   | m | (0.,0.,0.) |
| TRANSPARENCY                  | Real                | Transparency indicator              |   | 1          |
| XB (6)                        | Real Sextuplet      | Min/Max Physical coordinates        | m |            |

### 13.14 PART (Lagrangian Particles/Droplets)

Table 13.14: For more information see Section 10.

| PART (Lagrangian Particles/Droplets) |           |                             |                   |         |
|--------------------------------------|-----------|-----------------------------|-------------------|---------|
| AGE                                  | Real      | Droplet lifetime            | s                 | 100000. |
| COLOR                                | Character | Default color of droplets   |                   | 'BLACK' |
| DENSITY                              | Real      | Droplet density             | kg/m <sup>3</sup> | 1000.   |
| DIAMETER                             | Real      | Median Volumetric Diameter  | μm                | 500.    |
| DROPLETS_PER_SECOND                  | Integer   | Drops per second per head   |                   | 1000    |
| DT_INSERT                            | Real      | Time between insertions     | s                 | 0.05    |
| EVAPORATE                            | Logical   | Assume liquid evaporation   |                   | .TRUE.  |
| FYI                                  | Character | Comment String              |                   |         |
| FUEL                                 | Logical   | Liquid Fuel                 |                   | .FALSE. |
| GAMMA_D                              | Real      | Size distribution parameter |                   | 2.4     |
| HEAT_OF_COMBUSTION                   | Real      | Heat of Combustion          | kJ/kg             |         |
| HEAT_OF_VAPORIZATION                 | Real      | Latent Heat of Vaporization | kJ/kg             | 2259.   |
| HORIZONTAL_VELOCITY                  | Real      | Droplet speed, horizontal   | m/s               | 0.2     |
| ID                                   | Character | Identifier                  |                   |         |

Table 13.14: Continued

| PART (Lagrangian Particles/Droplets) |            |                             |                   |         |
|--------------------------------------|------------|-----------------------------|-------------------|---------|
| INITIAL_TEMPERATURE                  | Real       | Initial Temperature         | °C                | TMPA    |
| MASSLESS                             | Logical    | Massless tracers            |                   | .FALSE. |
| MASS_PER_VOLUME                      | Real       | Mass per unit volume        | kg/m <sup>3</sup> | 1.      |
| MAXIMUM_DIAMETER                     | Real       | Break-up bound              | μm                | ∞       |
| MINIMUM_DIAMETER                     | Real       | Evaporation bound           | μm                | 20.     |
| MELTING_TEMPERATURE                  | Real       | Melting Temperature         | °C                | 0.      |
| MONODISPERSE                         | Logical    | Uniform droplet size        |                   | .FALSE. |
| NUMBER_INITIAL_DROPLETS              | Integer    | Number of droplets at start |                   | 0       |
| QUANTITIES (10)                      | Character  | Quantities for coloring     |                   |         |
| RGB (3)                              | Integers   | Color indices (0-255)       |                   |         |
| SAMPLING_FACTOR                      | Integer    | Filter for output file      |                   | 1       |
| SIGMA_D                              | Real       | Size distribution parameter |                   |         |
| SPEC_ID                              | Character  | Name of gas species         |                   |         |
| SPECIFIC_HEAT                        | Real       | Droplet specific heat       | kJ/kg/K           | 4.184   |
| STATIC                               | Logical    | Stationary Particles        |                   | .FALSE. |
| VAPORIZATION_TEMPERATURE             | Real       | Liquid Droplet Boiling Temp | °C                | 100.    |
| VERTICAL_VELOCITY                    | Real       | Droplet speed, vertical     | m/s               | 0.5     |
| XB (6)                               | Real array | Initial particle location   | m                 |         |
| WATER                                | Logical    | Water Droplet               |                   | .FALSE. |

### 13.15 PROF (Wall Profile Parameters)

Table 13.15: For more information see Section 12.2.2.

| PROF (Wall Profile Parameters) |              |                                |   |  |
|--------------------------------|--------------|--------------------------------|---|--|
| IOR                            | Real         | Orientation of wall surface    |   |  |
| ID                             | Character    | Identifier                     |   |  |
| FYI                            | Character    | Comment String (has no effect) |   |  |
| QUANTITY                       | Character    | Name of output quantity        |   |  |
| XYZ                            | Real Triplet | Coordinates of wall surface    | m |  |

### 13.16 PROP (Device Properties)

Table 13.16: For more information see Section 11.3.

| PROP (Device Properties) |      |                                |     |      |
|--------------------------|------|--------------------------------|-----|------|
| ACTIVATION_TEMPERATURE   | Real | Threshold link temperature     | °C  | 74   |
| ACTIVATION_OBSCURATION   | Real | Threshold value of obscuration | %/m | 3.28 |
| ALPHA_C                  | Real | Smoke detector parameter       |     | 1.8  |
| ALPHA_E                  | Real | Smoke detector parameter       |     | 0.0  |

Table 13.16: Continued

| PROP (Device Properties) |           |                                |                          |         |
|--------------------------|-----------|--------------------------------|--------------------------|---------|
| BETA_C                   | Real      | Smoke detector parameter       |                          | 1.0     |
| BETA_E                   | Real      | Smoke detector parameter       |                          | 1.0     |
| BEAD_DIAMETER            | Real      | Diameter of TC bead            | m                        | 0.001   |
| BEAD_EMISSIVITY          | Real      | Emissivity of TC bead          |                          | 0.85    |
| C_FACTOR                 | Real      | Sprinkler activation parameter |                          | 0.      |
| CHARACTERISTIC_VELOCITY  | Real      | See Section 12.3.10            | m/s                      | 1.0     |
| DROPLET_VELOCITY         | Real      | Initial droplet velocity       | m/s                      | 5.0     |
| FLOW_RATE                | Real      | Sprinkler or nozzle flow rate  | L/min                    |         |
| FLOW_RAMP                | Character | Time RAMP for flow             |                          |         |
| FLOW_TAU                 | Real      | Time constant for flow         |                          | 0.0     |
| GAUGE_TEMPERATURE        | Real      | See Section 12.3.5             | °C                       | TMPA    |
| ID                       | Character | IDentifier                     |                          |         |
| INITIAL_TEMPERATURE      | Real      | Initial link temperature       | °C                       | TMPA    |
| K_FACTOR                 | Real      | Flow parameter                 | L/min/atm <sup>1/2</sup> | 1.      |
| LENGTH                   | Real      | Smoke detector parameter       |                          | 1.8     |
| OFFSET                   | Real      | Droplet offset distance        | m                        | 0.05    |
| OPERATING_PRESSURE       | Real      | Sprinkler pipe pressure        | atm                      | 1.      |
| PART_ID                  | Character | Name of associated PART line   |                          |         |
| QUANTITY                 | Character | Name of associated output      |                          |         |
| RTI                      | Real      | Response Time Index            | $\sqrt{\text{m s}}$      | 100.    |
| SMOKEVIEW_ID             | Character | Name of drawn object           |                          |         |
| SPEC_ID                  | Character | See Section 11.3.4             |                          |         |
| SPRAY_ANGLE (2)          | Real      | Cone angles for water spray    | deg                      | 60.,75. |
| SPRAY_PATTERN_TABLE      | Character | TABL for spray pattern         |                          |         |

## 13.17 RADI (Radiation Parameters)

Table 13.17: For more information see Section 9.4.

| RADI (Radiation Parameters) |         |                                     |     |         |
|-----------------------------|---------|-------------------------------------|-----|---------|
| ANGLE_INCREMENT             | Integer | Number of angles skipped per update |     | 5       |
| CH4_BANDS                   | Logical | Include extra fuel bands            |     | .FALSE. |
| KAPPA0                      | Real    | Constant absorption coefficient     | 1/m | 0       |
| NMIEANG                     | Integer | Number of polar angles              |     | 15      |
| NUMBER_RADIATION_ANGLES     | Integer | Number of solid angles              |     | 104     |
| PATH_LENGTH                 | Real    | Path length for radiation calc.     | m   |         |
| RADIATIVE_FRACTION          | Real    | Radiative Loss Fraction             |     | 0.35    |
| RADTMP                      | Real    | Assumed radiative source temp.      | °C  | 900     |
| TIME_STEP_INCREMENT         | Integer | Number time steps skipped           |     | 3       |
| WIDE_BAND_MODEL             | Logical | Non-gray gas assumption             |     | .FALSE. |



## 13.18 RAMP (Ramp Function Parameters)

Table 13.18: For more information see Section 8.5.

| RAMP (Ramp Function Parameters) |           |                                |           |  |
|---------------------------------|-----------|--------------------------------|-----------|--|
| FYI                             | Character | Comment String (has no effect) |           |  |
| F                               | Real      | Function value                 |           |  |
| FYI                             | Character | Comment String (has no effect) |           |  |
| ID                              | Character | Identifier                     |           |  |
| T                               | Real      | Time (or Temperature)          | s (or °C) |  |

## 13.19 REAC (Reaction Parameters)

Table 13.19: For more information see Section 9.1.

| REAC (Reaction Parameters)  |           |  |                        |           |
|-----------------------------|-----------|--|------------------------|-----------|
| BOF                         | Real      | Pre-exponential Factor (Finite Rate)     | cm <sup>3</sup> /mol/s |           |
| C                           | Real      | Carbon atoms in fuel                     |                        | 3         |
| C_EDC                       | Real      | See Section 9.1.5                        |                        | 0.1       |
| CO_YIELD                    | Real      | Fraction of CO from the fuel             | kg/kg                  | 0         |
| CRITICAL_FLAME_TEMPERATURE  | Real      | Suppression criterion                    | °C                     | 1427      |
| E                           | Real      | Activation Energy (Finite Rate)          | kJ/kmol                |           |
| EDDY DISSIPATION            | Logical   | See Section 9.1.5                        |                        | . TRUE .  |
| EPUMO2                      | Real      | Energy per Unit Mass Oxygen              | kJ/kg                  | 13100     |
| FUEL                        | Character | Name of Fuel (Finite Rate)               |                        |           |
| FYI                         | Character | Comment String (has no effect)           |                        |           |
| H                           | Real      | Hydrogen atoms in fuel                   |                        | 8         |
| H2_YIELD                    | Real      | Fraction of H <sub>2</sub> from the fuel | kg/kg                  | 0         |
| HEAT_OF_COMBUSTION          | Real      | Energy per Unit Mass Fuel                | kJ/kg                  |           |
| HRRPUA_SHEET                | Real      | See Section 9.1.5                        | kW/m <sup>2</sup>      | 200.      |
| HRRPUV_AVERAGE              | Real      | See Section 9.1.5                        | kW/m <sup>3</sup>      | 3000.     |
| HRRPUV_AVERAGE_TIME         | Real      | See Section 9.1.5                        | s                      | 1.        |
| ID                          | Character | Identifier                               |                        |           |
| IDEAL                       | Logical   | Adjust for minor product yields          |                        | . FALSE . |
| MASS_EXTINCTION_COEFFICIENT | Real      | Visibility parameter                     | m <sup>2</sup> /kg     | 8700.     |
| MAXIMUM_VISIBILITY          | Real      | Visibility parameter                     | m                      | 30        |
| MW_OTHER                    | Real      | Molecular Weight of OTHER                | g/mol                  | 28        |
| N                           | Real      | Nitrogen atoms in the fuel               |                        | 0         |
| N_S (N)                     | Real      | Arrhenius Exponents (Finite Rate)        |                        |           |
| NU (N)                      | Real      | Reaction stoichiometry (Finite Rate)     |                        |           |
| O                           | Real      | Oxygen atoms in the fuel                 |                        | 0         |
| OTHER                       | Real      | Other atoms in the fuel                  |                        | 0         |
| OXIDIZER                    | Character | Name of Oxidizer (Finite Rate)           |                        |           |
| SOOT_YIELD                  | Real      | Fraction of soot from the fuel           | kg/kg                  | 0.01      |

Table 13.19: Continued

| REAC (Reaction Parameters) |      |                                   |         |      |
|----------------------------|------|-----------------------------------|---------|------|
| SOOT_H_FRACTION            | Real | Atom fraction of hydrogen in soot |         | 0.1  |
| VISIBILITY_FACTOR          | Real | Visibility parameter              |         | 3    |
| X_O2_LL                    | Real | Lower Oxygen Limit                | mol/mol | 0.15 |
| Y_F_INLET                  | Real | Mass Frac. of Fuel in Burner      | kg/kg   | 1.0  |
| Y_F_LFL                    | Real | Lower Fuel limit (mass fraction)  | kg/kg   | 0.0  |
| Y_O2_INFTY                 | Real | Ambient oxygen mass fraction      | kg/kg   | 0.23 |

## 13.20 SLCF (Slice File Parameters)

Table 13.20: For more information see Section 12.2.3.

| SLCF (Slice File Parameters) |                |                                       |   |         |
|------------------------------|----------------|---------------------------------------|---|---------|
| FYI                          | Character      | Comment String (has no effect)        |   |         |
| MESH_NUMBER                  | Integer        | Save only slices in this mesh         |   |         |
| PART_ID                      | Character      | Particle identifier (if needed)       |   |         |
| PBX                          | Real           | $x$ -plane to save slice file         |   |         |
| PBY                          | Real           | $y$ -plane to save slice file         |   |         |
| PBZ                          | Real           | $z$ -plane to save slice file         |   |         |
| QUANTITY                     | Character      | Name of Quantity to display           |   |         |
| SPEC_ID                      | Character      | Species identifier (if needed)        |   |         |
| VECTOR                       | Logical        | Include flow vectors                  |   | .FALSE. |
| XB (6)                       | Real Sextuplet | Min/Max coordinates of region to save | m |         |

## 13.21 SPEC (Species Parameters)

Table 13.21: For more information see Section 9.2.

| SPEC (Species Parameters)   |           |                                      |                   |         |
|-----------------------------|-----------|--------------------------------------|-------------------|---------|
| ABSORBING                   | Logical   | Absorbs radiation                    |                   | .FALSE. |
| CONDUCTIVITY                | Real      | Conductivity $k$                     | W/m/K             |         |
| DIFFUSIVITY                 | Real      | Diffusivity $D$                      | m <sup>2</sup> /s |         |
| EPSILONKLJ                  | Real      | Leonard-Jones Parameter              |                   | 0       |
| FORMULA                     | Character | Chemical formula for Smokeview label |                   |         |
| FYI                         | Character | Comment String                       |                   |         |
| ID                          | Character | Name of species                      |                   |         |
| MASS_EXTINCTION_COEFFICIENT | Real      | See Section 11.3.4                   |                   | 0       |
| MASS_FRACTION_0             | Real      | Initial mass fraction                |                   | 0       |
| MW                          | Real      | Molecular Weight                     | g/mol             | 29.     |
| SIGMALJ                     | Real      | Leonard-Jones Parameter              |                   | 0       |

Table 13.21: Continued

| SPEC (Species Parameters) |      |                         |        |  |
|---------------------------|------|-------------------------|--------|--|
| VISCOSITY                 | Real | Dynamic Viscosity $\mu$ | kg/m/s |  |

## 13.22 SURF (Surface Properties)

Table 13.22: For more information see Section 8.2.

| SURF (Surface Properties) |              |                              |                      |             |
|---------------------------|--------------|------------------------------|----------------------|-------------|
| ADIABATIC                 | Logical      | Adiabatic thermal BC         |                      | .FALSE.     |
| BACKING                   | Character    | Back boundary condition      |                      | 'VOID'      |
| BURN_AWAY                 | Logical      | Object can vanish            |                      | .FALSE.     |
| CELL_SIZE_FACTOR          | Real         | See Section 8.4.6            |                      | 1.0         |
| COLOR                     | Character    | Surface Color                |                      |             |
| CONVECTIVE_HEAT_FLUX      | Real         | Heat flux at surface         | kW/m <sup>2</sup>    | 0.          |
| DUCT_PATH                 | Int. Pair    | Pressure Zones for fans      |                      | 0,0         |
| E_COEFFICIENT             | Real         | Extinguishing coefficient    | m <sup>2</sup> /kg/s | 0.          |
| EMISSIVITY                | Real         | Emissivity                   |                      | 0.9         |
| EXTERNAL_FLUX             | Real         | Heat flux to surface         | kW/m <sup>2</sup>    | 0.          |
| FYI                       | Character    | Comment String               |                      |             |
| GEOMETRY                  | Character    | Geometry type                |                      | 'CARTESIAN' |
| HEAT_OF_VAPORIZATION      | Real         | For specified HRR only       | kJ/kg                | 0.          |
| HRRPUA                    | Real         | HRR Per Unit Area            | kW/m <sup>2</sup>    | 0.          |
| ID                        | Character    | IDentifier                   |                      |             |
| IGNITION_TEMPERATURE      | Real         | Ignition temperature         | °C                   | 5000.       |
| LEAK_PATH                 | Int. Pair    | Pressure Zones for leakage   |                      |             |
| MASS_FLUX (I)             | Real Array   | For species I                | kg/m <sup>2</sup> s  | 0.          |
| MASS_FLUX_TOTAL           | Real         | Total Mass Flux              | kg/m <sup>2</sup> s  |             |
| MASS_FRACTION (I)         | Real Array   | For species I                | kg/m <sup>2</sup> s  |             |
| MATL_ID                   | Char. Array  | (Layer,Component)            |                      |             |
| MATL_MASS_FRACTION        | Real Array   | (Layer,Component)            |                      |             |
| MAX_PRESSURE              | Real         | Max over-pressure for fan    | Pa                   | 1E12        |
| MLRPUA                    | Real         | Mass loss rate per unit area | kg/m <sup>2</sup> s  | 0.          |
| NPPC                      | Integer      | Number of particles per cell |                      | 1           |
| PARTICLE_MASS_FLUX        | Real         | See Section 10.2             | kg/m <sup>2</sup> s  | 0.          |
| PART_ID                   | Character    | Lagrangian Particle ID       |                      |             |
| POROUS                    | Logical      | See Section 8.2.3            |                      | .FALSE.     |
| PLE                       | Real         | Atmospheric profile exp.     |                      | 0.3         |
| PROFILE                   | Character    | Name of velocity profile     |                      |             |
| RAMP_MF (I)               | Character    | Ramp ID for species I        |                      |             |
| RAMP_Q                    | Character    | Ramp ID for HRR              |                      |             |
| RAMP_T                    | Character    | Ramp ID for temp.            |                      |             |
| RAMP_V                    | Character    | Ramp ID for velocity         |                      |             |
| RGB (3)                   | Int. Triplet | Color indices (0-255)        |                      | 255,204,102 |

Table 13.22: Continued

| SURF (Surface Properties) |            |                             |                   |        |
|---------------------------|------------|-----------------------------|-------------------|--------|
| SHRINK                    | Logical    | Shrinking material          |                   | .TRUE. |
| SLIP_FACTOR               | Real       | Velocity Slip Condition     |                   | 0.5    |
| STRETCH_FACTOR            | Real       | See Section 8.4.6           |                   | 2.0    |
| TAU_MF (I)                | Real Array | Ramp time for species I     | s                 | 1.     |
| TAU_Q                     | Real       | Ramp time for HRR           | s                 | 1.     |
| TAU_T                     | Real       | Ramp time for temp.         | s                 | 1.     |
| TAU_V                     | Real       | Ramp time for velocity      | s                 | 1.     |
| TEXTURE_HEIGHT            | Real       | Height of texture image     | m                 | 1.     |
| TEXTURE_MAP               | Character  | Name of texture map file    |                   |        |
| TEXTURE_WIDTH             | Real       | Width of texture image      | m                 | 1.     |
| THICKNESS (IL)            | Real Array | Thickness of Layer IL       | m                 | 0.     |
| TMP_BACK                  | Real       | Back surface temperature BC | °C                | 20.    |
| TMP_FRONT                 | Real       | Front surface temperature   | °C                | 20.    |
| TMP_INNER                 | Real       | Initial solid temperature   | °C                | 20.    |
| TRANSPARENCY              | Real       | Transparency of obstruction | 1                 |        |
| VEL                       | Real       | Normal velocity             | m/s               | 0.     |
| VEL_T                     | Real Pair  | Tangential velocity comps.  | m/s               | 0.     |
| VOLUME_FLUX               | Real       | Normal velocity x vent area | m <sup>3</sup> /s | 0.     |
| Z0                        | Real       | Atmospheric profile origin  | m                 | 10.    |

### 13.23 TABL (Table Parameters)

Table 13.23: For more information see Section 8.5.

| TABL (Table Parameters) |            |                                |  |  |
|-------------------------|------------|--------------------------------|--|--|
| ID                      | Character  | IDentifier                     |  |  |
| FYI                     | Character  | Comment String (has no effect) |  |  |
| TABLE_DATA              | Real Array | Data for one row of the table  |  |  |

### 13.24 TIME (Time Parameters)

Table 13.24: For more information see Section 6.2.

| TIME (Time Parameters) |           |                                   |   |         |
|------------------------|-----------|-----------------------------------|---|---------|
| DT                     | Real      | Initial time step                 | s |         |
| FYI                    | Character | Comment String (has no effect)    |   |         |
| LOCK_TIME_STEP         | Logical   | Do not allow time step changes    |   | .FALSE. |
| SYNCHRONIZE            | Logical   | Sync time step of multiple meshes |   | .TRUE.  |
| T_BEGIN                | Real      | Starting time for calculation     | s | 0.      |
| T_ENDorTWFIN           | Real      | Ending time for calculation       | s | 1       |

Table 13.24: Continued

| TIME (Time Parameters) |         |   |  |   |
|------------------------|---------|---|--|---|
| WALL_INCREMENT         | Integer | Time steps between 1D wall solution updates |  | 2 |

### 13.25 TRNX, TRNY, TRNZ (MESH Transformations)

Table 13.25: For more information see Section 6.3.4.

| TRNX, TRNY, TRNZ (MESH Transformations) |           |                                    |   |  |
|---|-----------|------------------------------------|---|--|
| CC                                      | Real      | Computational coordinate           | m |  |
| FYI                                     | Character | Comment String (has no effect)     |   |  |
| IDERIV                                  | Integer   | Order of polynomial transformation |   |  |
| MESH_NUMBER                             | Integer   | Number of mesh to transform        |   |  |
| PC                                      | Real      | Physical coordinate or derivative  |   |  |

### 13.26 VENT (Vent Parameters)

Table 13.26: For more information see Section 7.3.

| VENT (Vent Parameters) |                 |   |       |            |
|------------------------|-----------------|---|-------|------------|
| COLOR                  | Character       | See Section 8.6                         |       |            |
| CTRL_ID                | Character       | ID of Control Function                  |       |            |
| DEVC_ID                | Character       | ID of Controlling Device                |       |            |
| DYNAMIC_PRESSURE       | Real            | See Section 8.2.5                       | Pa    | 0.0        |
| FYI                    | Character       | Comment String (has no effect)          |       |            |
| IOR                    | Integer         | Orientation Index                       |       |            |
| MASS_FRACTION(N)       | Real Array      | Mass Fraction of species N at OPEN vent | kg/kg |            |
| MB                     | Character       | Mesh Boundary                           |       |            |
| OUTLINE                | Logical         | Draw vent as outline                    |       | .FALSE.    |
| PBX, PBZ, PBZ          | Real            | Coordinate Plane                        |       |            |
| PRESSURE_RAMP          | Character       | See Section 8.2.5                       |       |            |
| RGB(3)                 | Integer Triplet | See Section 8.6                         |       |            |
| SPREAD_RATE            | Real            | See Section 8.2.7                       | m/s   | 0.0        |
| SURF_ID                | Character       | Associated Surface                      |       | 'INERT'    |
| TEXTURE_ORIGIN(3)      | Real Triplet    | See Section 8.6.1                       | m     | (0.,0.,0.) |
| TMP_EXTERIOR           | Real            | Temperature at OPEN vent                | °C    |            |
| TRANSPARENCY           | Real            | Transparency indicator                  |       | 1.0        |
| XB(6)                  | Real Sextuplet  | Min/Max physical coordinates            | m     |            |
| XYZ(3)                 | Real Triplet    | See Section 8.2.7                       | m     |            |

### 13.27 ZONE (Pressure Zone Parameters)

Table 13.27: For more information see Section 8.3.

| ZONE (Pressure Zone Parameters) |                |                                 |                |   |
|---------------------------------|----------------|---------------------------------|----------------|---|
| ID                              | Character      | Identifier                      |                |   |
| LEAK_AREA (N)                   | Real           | Leakage area to pressure zone N | m <sup>2</sup> | 0 |
| XB (6)                          | Real Sextuplet | Coordinates of Zone             | m              |   |

## Chapter 14

# Conversion of Old Input Files to FDS 5

Many changes and improvements have been made in the latest release FDS 5. To make an FDS 4 input data file compatible with the new FDS 5 application, a few changes must be made to the file. This appendix will point out all the changes that need to be made to convert an FDS 4.x input file to the new FDS 5.x format.

### 14.1 Numerical Domain Parameters: GRID and PDIM

In previous versions, the computational domain and numerical mesh were specified via lines of the form:

```
&GRID IBAR=30, JBAR=20, KBAR=10 /  
&PDIM XBAR0=0.0, XBAR=3.0, YBAR0=0.0, YBAR=2.0, ZBAR0=0.0, ZBAR=1.0 /
```

In FDS 5, these two lines are now written via the single line:

```
&MESH IJK=30,20,10, XB=0.0,3.0,0.0,2.0,0.0,1.0 /
```

Rules for multiple meshes and mesh transformations still apply.

### 14.2 Obstructions, Vents, and Holes: OBST, VENT, and HOLE

The syntax for these lines is fairly similar to past versions, with the following exceptions:

- For a VENT that spans an entire mesh boundary, CB='XBAR0' is now MB='XMIN'. The character string 'XBAR' is now 'XMAX'. The same applies for the y and z coordinate parameters.
- Control parameters like T\_ACTIVATE, HEAT\_REMOVE, *etc.*, are now consolidated into DEVC\_ID and CTRL\_ID. In brief, any change to an obstruction, vent, or hole is tied to a specific device or control function. See Sections 11.1 and 11.5 for details.

### 14.3 Surface Parameters: SURF

The most significant change to the input file format has been splitting of the SURF line. In past versions, the SURF namelist group contained all the information about a particular boundary type – its material properties, color, thickness, and so on. However, in FDS 5, solid boundaries can now consist of multiple layers of materials, making the old SURF line too cumbersome to specify. Instead, there is a new namelist group called MATL that just contains the properties of a given material. What used to be

```

&SURF ID      = 'BRICK WALL'
  RGB         = 0.6,0.2,0.2
  KS          = 0.69
  C_P         = 0.84
  DENSITY     = 1600.
  BACKING     = 'EXPOSED'
  THICKNESS   = 0.20 /

```

is now given by two input lines:

```

&MATL ID      = 'BRICK'
  CONDUCTIVITY = 0.69
  SPECIFIC_HEAT = 0.84
  DENSITY      = 1600. /

&SURF ID      = 'BRICK WALL'
  MATL_ID     = 'BRICK'
  RGB         = 166,41,41
  BACKING     = 'EXPOSED'
  THICKNESS   = 0.20 /

```

The surface is still specified the same way as before, for example:

```

&OBST XB=0.1, 5.0, 1.0, 1.2, 0.0, 1.0, SURF_ID='BRICK WALL' /

```

Notice the change in the names of the thermal properties `KS` and `C_P` to `CONDUCTIVITY` and `SPECIFIC_HEAT`, respectively. Notice that the color `RGB` is now specified via integers between 0 and 255, instead of real numbers between 0.0 and 1.0. Better yet, just use the `COLOR` Table [8.1](#).

## 14.4 Reaction Parameters: REAC

For most applications, the specification of the combustion reaction has become easier. In past versions, you needed to specify the fuel, its molecular weight, soot and/or CO yields, and the ideal stoichiometry of the reaction:

```

&REAC ID      = 'PROPANE'
  FYI         = 'C_3 H_8'
  MW          = 44.
  SOOT_YIELD   = 0.01
  NU_O2        = 5.
  NU_CO2       = 3.
  NU_H2O       = 4. /

```

Now, you just need to describe the composition of the fuel molecule and any non-ideal product yield. FDS 5 computes what it needs based on this information.

```

&REAC ID      = 'PROPANE'
  SOOT_YIELD   = 0.01
  C            = 3.
  H            = 8. /

```



## 14.5 Device Parameters: SPRK, SMOD, HEAT, THCP

Past versions of FDS had a variety of ways to specify devices. For example, a sprinkler was specified via a line of the form:

```
&SPRK XYZ=4.5,6.7,3.6, MAKE='Acme_K-17', LABEL='spk_34' /
```

which located the sprinkler at XYZ and indicated that the sprinkler's properties were listed in a file called **Acme\_K-17.spk**. Smoke and heat detectors were specified via lines of the form:

```
&SMOD XYZ=4.5,6.7,3.6, LENGTH=2.6, ACTIVATION_OBSCURATION=1.4, LABEL='sd_34' /  
&HEAT XYZ=4.5,6.7,3.6, RTI=45., ACTIVATION_TEMPERATURE=74., LABEL='hd_39' /
```

In FDS 5, these devices are all specified in the same way:

```
&PROP ID='Acme_K-17', QUANTITY='SPRINKLER LINK TEMPERATURE', RTI=148., C_FACTOR=0.7,  
      ACTIVATION_TEMPERATURE=74., PART_ID='water drops', FLOW_RATE=189.3,  
      DROPLET_VELOCITY=10., SPRAY_ANGLE=30.,80. /  
  
&DEVC ID='spk_34', XYZ=4.5,6.7,3.6, PROP_ID='Acme_K-17' /
```

Point output via “thermocouples” (THCPs) are now given by “devices” (DEVCS):

```
&DEVC XYZ=0.7,0.9,2.1, QUANTITY='WALL TEMPERATURE', IOR=-2, ID='probe_2' /
```

The syntax of the old THCP namelist group is almost the same. Just swap DEVC for THCP, and change LABEL to ID. In FDS 5, any input record is identified via its ID.



# **Part III**

## **Sample Calculations**




## Chapter 15

# Basic Hydrodynamics

There are no analytical solutions of the fully-turbulent Navier-Stokes equations, but it is possible to simulate well known fluid flows to determine if the basic fluid flow solver in FDS is working properly.

### 15.1 Axially-Symmetric Helium Plume (helium\_2d)

The governing equations solved in FDS are written in terms of a three dimensional Cartesian coordinate system. However, a two dimensional Cartesian or two dimensional cylindrical (axially-symmetric) calculation can be performed by setting the number of cells in the y direction to 1. An example of an axially-symmetric helium plume is shown here, along with the input file:

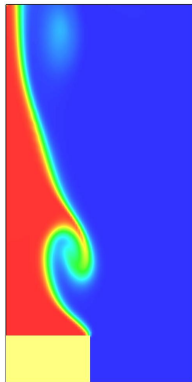


```
&HEAD CHID='helium_2d',TITLE='Axisymmetric Helium Plume' /
&MESH IJK=72,1,144 XB=0.00,0.08,-0.001,0.001,0.00,0.16, CYLINDRICAL=.TRUE. /
&TIME TWFN=5.0 /
&MISC DNS=.TRUE., ISOTHERMAL=.TRUE. /
&SPEC ID='HELIUM' /
&SURF ID='HELIUM', VEL=-0.673, MASS_FRACTION(1)=1.0, TAU_MF(1)=0.3 /
&VENT MB='XMAX', SURF_ID='OPEN' /
&VENT MB='ZMAX', SURF_ID='OPEN' /
&OBST XB= 0.0,0.036,-0.001,0.001,0.00,0.02, SURF_IDS='HELIUM','INERT','INERT' /
&DUMP PLOT3D_QUANTITY(1)='PRESSURE',PLOT3D_QUANTITY(5)='HELIUM' /
&SLCF PBX=0.000,QUANTITY='DENSITY', VECTOR=.TRUE. /
&SLCF PBX=0.000,QUANTITY='HELIUM' /
&TAIL /
```

## 15.2 Sawtooth (sawtooth)

Sometimes it is desired to have stair-stepped obstructions representing curved or sloped geometry. A concern is that this may change the flow pattern near the wall. To lessen the impact of stair-stepped boundaries near the edges of the obstructions, one may specify the option `SAWTOOTH=.FALSE.`. If `SAWTOOTH` is set to `FALSE`, then the velocity boundary conditions will be applied in such a way as to minimize the impact of the boundaries due to vortices at sharp corners, as shown in the following example:

```
&OBST XB= 0.00, 0.05,-0.01, 0.01, 0.00, 0.05, SAWTOOTH=.FALSE., COLOR='EMERALD GREEN' /  
&OBST XB= 0.05, 0.10,-0.01, 0.01, 0.00, 0.10, SAWTOOTH=.FALSE., COLOR='EMERALD GREEN' /  
&OBST XB= 0.10, 0.15,-0.01, 0.01, 0.05, 0.15, SAWTOOTH=.FALSE., COLOR='EMERALD GREEN' /  
&OBST XB= 0.15, 0.20,-0.01, 0.01, 0.10, 0.20, SAWTOOTH=.FALSE., COLOR='EMERALD GREEN' /
```

In the figure below, the top set of obstructions are using the default `SAWTOOTH=.TRUE.` and the bottom set of obstructions are using `SAWTOOTH=.FALSE.`. The adjacent obstructions that have `SAWTOOTH=.FALSE.` are displayed in Smokeview as one smooth obstruction, shown in green. Notice that as the air moves across the different sets of obstructions, the air velocity on the bottom set of obstructions is not affected as much by the vortices.

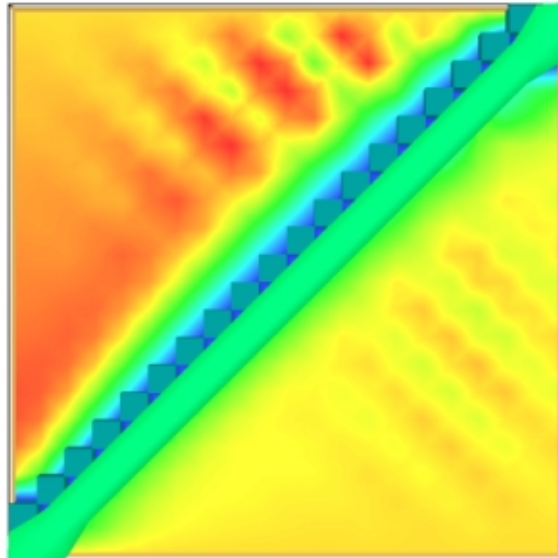

## 15.3 Pressure Boundaries (pressure\_boundary)

This case just demonstrates how to do a time-dependent pressure boundary. It is a 10 m long, 1 m wide, 1 m tall tunnel with a fire in the middle and a pressure boundary imposed on the right side ( $x = 10$ ).

```
&HEAD CHID='pressure_boundary', TITLE='Simple tunnel with pressure boundary, SVN $Revision: 2395 $' /

&MESH IJK=100,10,10, XB=0.0,10.0,0.0,1.0,0.0,1.0 /

&TIME TWFIN=60. /

&SURF ID='FIRE', HRRPUA=2000., COLOR='RED' /
&VENT XB=4.7,5.3,0.2,0.8,0.0,0.0, SURF_ID='FIRE' /

&VENT MB = 'XMIN' SURF_ID = 'OPEN' /
&VENT MB = 'XMAX' SURF_ID = 'OPEN', DYNAMIC_PRESSURE=2.4, PRESSURE_RAMP='wind_ramp' /

&RAMP ID='wind_ramp', T= 0., F= 1. /
&RAMP ID='wind_ramp', T=30., F= 1. /
&RAMP ID='wind_ramp', T=31., F=-1. /

&SLCF PBX=0.5, QUANTITY='VELOCITY', VECTOR=.TRUE. /
&SLCF PBX=0.5, QUANTITY='H' /
&SLCF PBX=0.5, QUANTITY='PRESSURE' /
&SLCF PBX=0.5, QUANTITY='TEMPERATURE' /

&TAIL /
```

This snapshot from Smokeview was taken during the time period when there was a positive pressure imposed at the right portal of the tunnel. The fire leans to the left because of the preferential flow in that direction.








## **Chapter 16**

# **Thermodynamics**

This chapter contains examples of simple calculations that demonstrate various features of FDS related to the conservation of mass and energy via the equation of state.

## 16.1 Pressure Rise in a Sealed Enclosure (pressure\_rise)

This example tests several basic features of FDS. A narrow channel, 3 m long, 0.002 m wide, and 1 m tall, has air injected at a rate of  $0.1 \text{ kg/m}^2/\text{s}$  over an area of 0.2 m by 0.002 m for 60 s, with a linear ramp-up and ramp-down over 1 s. The total mass of air in the channel at the start is 0.00718 kg. The total mass of air injected is 0.00244 kg. The domain is assumed two-dimensional, the walls are adiabatic, and STRATIFICATION is set to .FALSE. simply to remove the slight change in pressure and density with height. The domain is divided into three meshes, each 1 m long and each with identical gridding. We expect the pressure, temperature and density to rise during the 60 s injection period. Afterwards, the temperature, density, and pressure should remain constant, according to the equation of state. The figures below show the results of this calculation. The density matches exactly showing that FDS is injecting the appropriate amount of mass. The steady state values of the pressure, density and temperature are consistent with the ideal values.

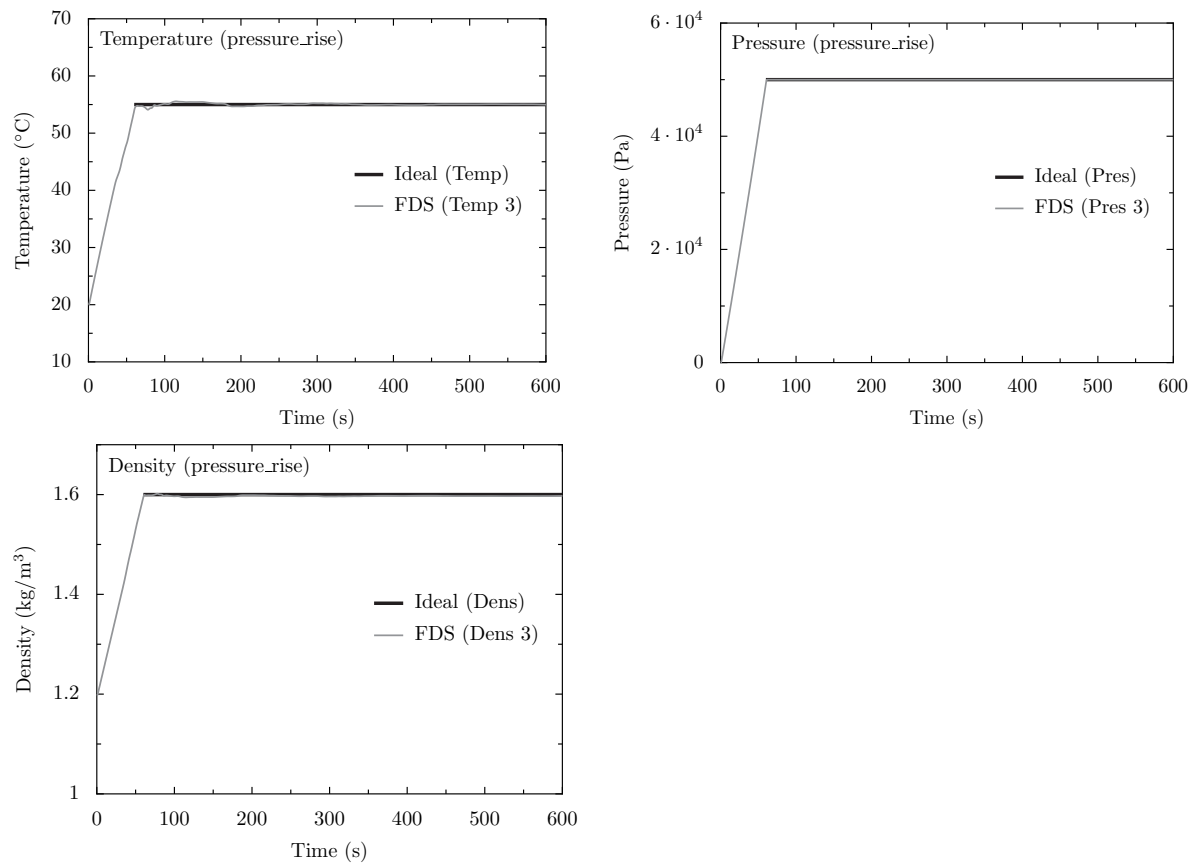

## 16.2 Leaks and Fans in a Sealed Enclosure (leak\_test and leak\_test\_2)

A new feature of FDS 5 is the idea of a “pressure zone.” Unlike traditional compartment or “zone” fire models, FDS was not designed under the assumption that there exist rooms connected by doors or ducts. Rather, the geometry in FDS is completely specified by the user. However, there are features of simpler models that we want to retain. For example, a leak through a small crack, or the transport of air through a ventilation duct. In the following example, a simple compartment (3.6 m by 2.4 m by 2.4 m) has a small fan at one end and one leak under the door at the other end. It is assumed for this example that the compartment is contained within a larger compartment that is perfectly sealed. The fan draws air into the compartment from the plenum space, increasing the pressure inside and decreasing it outside. A steady state is achieved when the volume flow into and out of the compartment falls into balance.

The volume flow rate of the fan is given by the “fan curve”


$$\dot{V}_{\text{fan}} = A_{\text{duct}} U_{\text{max}} \text{sign}(\Delta p_{\text{max}} - \Delta p) \sqrt{\frac{|\Delta p - \Delta p_{\text{max}}|}{\Delta p_{\text{max}}}} \quad (16.1)$$

where  $\Delta p$  is the difference in pressure and  $A_{\text{duct}} = 0.16 \text{ m}^2$ ,  $U_{\text{max}} = 0.1 \text{ m/s}$ , and  $\Delta p_{\text{max}} = 1000 \text{ Pa}$ . The volume flow due to the leak is given by:

$$\dot{V}_{\text{leak}} = A_{\text{leak}} \sqrt{\frac{2\Delta p}{\rho_{\infty}}} \quad (16.2)$$

where  $A_{\text{leak}} = 0.0001 \text{ m}^2$  and  $\rho_{\infty} = 1.2 \text{ kg/m}^3$ . After 5 min the pressure difference is 938.2 Pa. The theoretical value, obtained by equating the fan and leak volume flow rates and solving for  $\Delta p$ , is 938.9 Pa. The slight difference is due to the fact that the solid boundaries within the interior of the computational domain admit a slight volume flux related to details of the numerical solver.

Just for fun, we add another leak to the compartment, only this time the leak is to the exterior of the entire computational domain, an infinite void at ambient pressure. Now the fan flow rate ought to balance the sum of the flow rates from the two leaks. After 5 min, the pressure difference is 935.2 Pa. The two cases are summarized in the following plots:

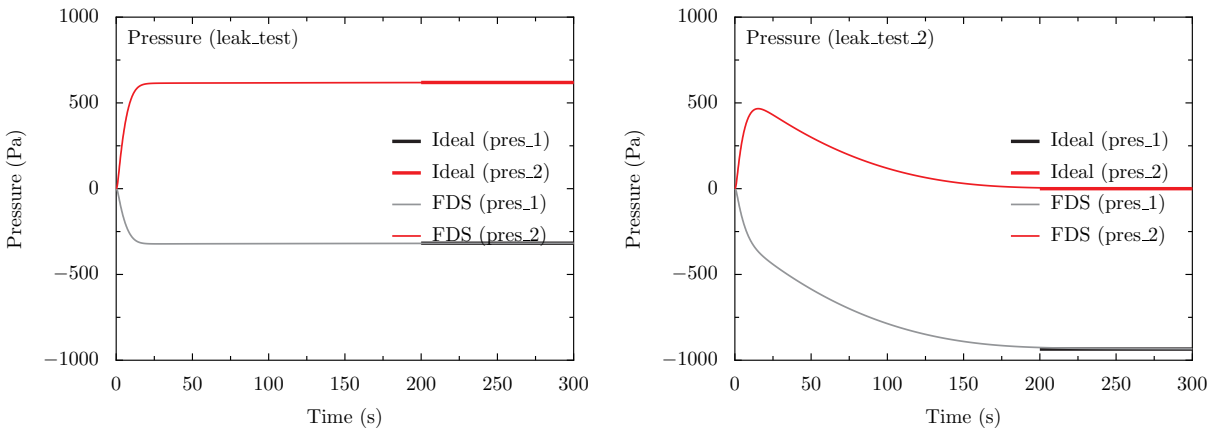

## 16.3 Fan Curves (fan\_test)

In this example, two sealed compartments share a common wall. Both compartments are considered as separate “pressure zones.” Two fans are mounted in the Partition Wall, blowing in opposite directions. The relevant input lines are:

```
&SURF ID='BLOW LEFT', POROUS=.TRUE., VEL=-0.2, DUCT_PATH=1,2, MAX_PRESSURE=1000. /
&SURF ID='BLOW RIGHT', POROUS=.TRUE., VEL= 0.4, DUCT_PATH=2,1, MAX_PRESSURE=1000. /

&ZONE XB=-3.0, 0.0,-1.0, 1.0, 0.0, 2.0 / Pressure Zone 1
&ZONE XB= 0.0, 3.0,-1.0, 1.0, 0.0, 2.0 / Pressure Zone 2

&OBST XB= 0.0, 0.0,-1.0, 1.0, 0.0, 2.0 / Partition Wall

&HOLE XB=-0.1, 0.1,-0.1, 0.1, 0.4, 0.6 /
&OBST XB= 0.0, 0.0,-0.1, 0.1, 0.4, 0.6, ..., SURF_ID='BLOW RIGHT', PERMIT_HOLE=.FALSE. /

&HOLE XB=-0.1, 0.1,-0.1, 0.1, 1.4, 1.6 /
&OBST XB= 0.0, 0.0,-0.1, 0.1, 1.4, 1.6, ..., SURF_ID='BLOW LEFT', PERMIT_HOLE=.FALSE. /
```

The volume flow through the fans is given by the expression:


$$\dot{V}_{\text{fan}} = A_{\text{duct}} U_{\text{max}} \text{sign}(\Delta p_{\text{max}} - \Delta p) \sqrt{\frac{|\Delta p - \Delta p_{\text{max}}|}{\Delta p_{\text{max}}}} \quad (16.3)$$

where  $A_{\text{duct}}$  is the area of the duct (both are  $0.04 \text{ m}^2$ ),  $U_{\text{max}}$  is the air velocity (0.4 m/s from Zone 1 to Zone 2 and 0.2 m/s from Zone 2 to Zone 1), and  $\Delta p_{\text{max}}$  is the maximum pressure difference the fan can operate upon (in this case both fans use 1000 Pa).

In steady state, the volume flow from compartment to compartment (or Zone to Zone) should be equal and opposite in sign.

$$(0.04 \text{ m}^2)(0.4 \text{ m/s}) \sqrt{\frac{|p_2 - p_1 - 1000 \text{ Pa}|}{1000 \text{ Pa}}} = (0.04 \text{ m}^2)(0.2 \text{ m/s}) \sqrt{\frac{|p_1 - p_2 - 1000 \text{ Pa}|}{1000 \text{ Pa}}} \quad (16.4)$$

The solution is  $p_2 = 300 \text{ Pa}$  and  $p_1 = -300 \text{ Pa}$ . Note that the sign of the Volume Flow in FDS has to do with whether the flow is moving in the plus or minus coordinate direction. This convention can make these types of calculations a bit tricky.

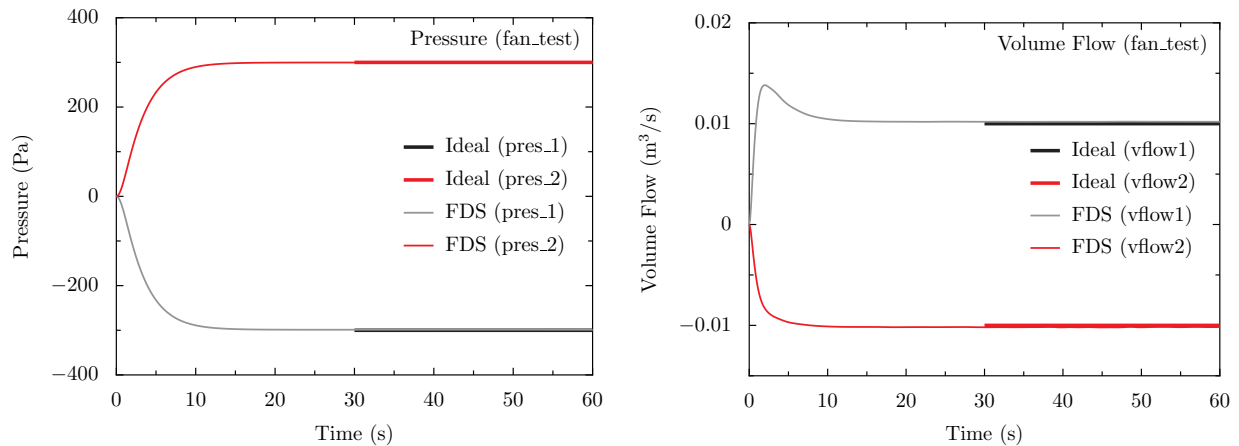

## 16.4 Stack Effect (stack\_effect)

If the interior temperature of a building is at a different temperature than the surrounding atmosphere, upward or downward air flows within shafts or stairwells connected to the ambient via leakage paths will occur. This phenomena is known as the stack effect. The **stack\_effect** test case is a 2D simulation of a 304 m tall building initialized to a temperature of 20 ° with the surround ambient temperature initialized to 10 °. Two small openings in the building are defined 2.5 m above the ground floor of the building and 2.5 m below the roof of the building.

The initial density stratification is defined by assuming a lapse rate of 0 °C/m.

$$\rho_0(z) = \rho_\infty e^{\frac{gW}{R_0 T_0} z} \quad (16.5)$$

Applying this to the external and internal locations at the lower and upper vents results in densities of 1.2392, 1.1969, 1.1954, and 1.1546 kg/m<sup>3</sup>, respectively. FDS computes the same values to within machine precision. Since the openings in the building are equally spaced over its height, the neutral plane of the building will be close to its midpoint. The pressure gradient across the building's wall can be computed as

$$\delta P = \frac{WP_0 g}{R_0} \left( \frac{1}{T_{ambient}} - \frac{1}{T_{building}} \right) h \quad (16.6)$$

where h is the distance from the neutral plane. Using this pressure gradient in Bernoulli's equation (and assuming it remains constant) results in a velocity of 10.09 m/s through the vent. FDS computes a peak velocity of 10.13 m/s or an error of 0.5 %.



# Chapter 17


## Combustion

### 17.1 A Simple Under-Ventilated Compartment Fire (door\_crack)

This example uses the same simple compartment that was used to test leakage and fan curves (Sections 16.2 and 16.3). Now, we add a small (160 kW) fire, with the same fan and leak under the door. The compartment now opens to the atmosphere, not a sealed plenum. We expect a rapid pressure rise in the compartment due to the effect of the fire and the fan. Initially, the pressure rises due to the heat from the fire and the fan blowing air into the compartment:

$$\frac{d\bar{p}_1}{dt} \approx (\gamma - 1) \frac{\dot{Q}}{V} + \gamma \bar{p} \frac{\dot{V}}{V} \approx 3200 \text{ Pa/s} \approx 0.03 \text{ atm/s} \quad (17.1)$$

where  $\gamma \approx 1.4$ ,  $\dot{Q} = 160,000 \text{ W}$ ,  $V = 20.7 \text{ m}^3$ , and  $\dot{V} = 0.016 \text{ m}^3/\text{s}$ . However, as heat is lost to the walls, and as the leak begins to relieve the pressure increase, the pressure rise slows, and then reverses at about 0.25 atm. In roughly 150 s, the fire is self-extinguished due to lack of oxygen. As the pressure rise decreases back to zero, and actually goes below zero, the fan, and the leak under the door, increase the oxygen supply, at least near these openings, and the fuel-rich gases in the compartment continue to burn.

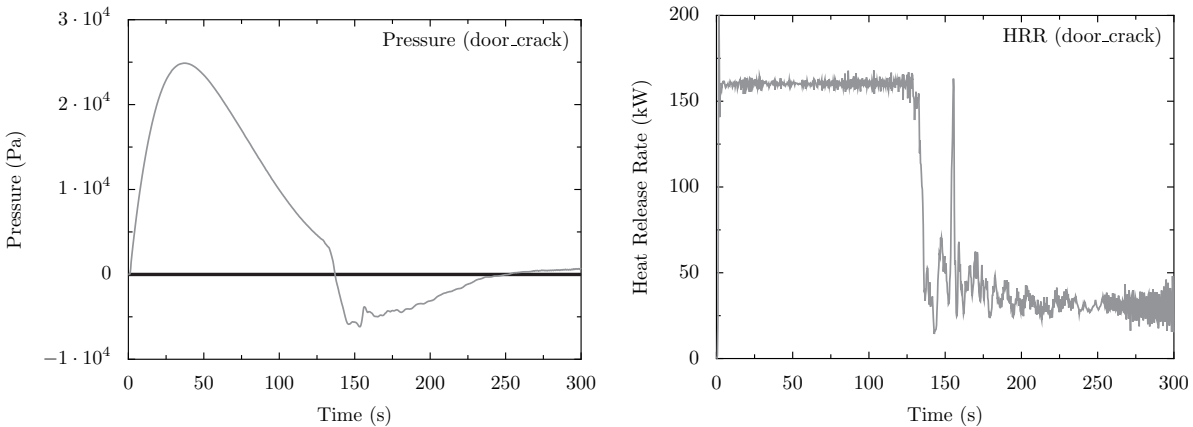

While this case has a number of interesting physical effects, and it *verifies* several features of FDS, it is very important to note the following:

- Although there is smoke seen flowing backwards out the fan duct, in reality there would have been much more. Most conventionally built structures will not withstand over-pressures of 0.25 atm without some sort of relief. The fan and the crack under the door obey simple formulae based on pressure differences, but these assumptions have limits.

- It is likely that the fire in this scenario would indeed extinguish itself as the oxygen volume fraction decreased below about 15 %. **But**, its re-ignition at the door crack and fan grill would depend on the presence of a spark or hot spot of some sort. FDS continues to flow fuel into the compartment past the point of local extinction, but the compartment cools. The default combustion algorithm in FDS assumes that in every grid cell there is a “virtual spark plug” that initiates combustion if the local ratio of fuel and oxygen are appropriate.

## 17.2 Testing the “Burn-Away” Feature (box\_burn\_away)

This is a silly example of a solid block of “foam” that is pyrolyzed until it is completely consumed. The heat flux is generated by placing hot surfaces around the box. There is no combustion. The properties of the block of foam were chosen simply to assure a quick calculation. The objective of the test is to check that the integrated burning rate is consistent with the material properties of the block. The block is 0.4 m on a side, with a density of 20 kg/m<sup>3</sup>. The integrated burning rate (written to box\_burn\_away\_hrr.csv) for a 60 s calculation ought to be:

$$(0.4)^3 \text{ m}^3 \times 20 \text{ kg/m}^3 = 1.28 \text{ kg} \quad (17.2)$$





# Chapter 18

## Detectors


### 18.1 Aspiration Detector (beam\_detector)

A 10 m x 10 m x 4 m compartment is filled with 0.006 kg/kg of MIXTURE\_FRACTION\_2 with the default soot yield 0.01 kg/kg. This results in an initial soot density of  $71.9 \text{ mg/m}^3$  which using the default mass extinction coefficient of  $8700 \text{ m}^2/\text{kg}$  results in an optical depth of  $0.626 \text{ m}^{-1}$ . The compartment has a series of obstructions placed at varying depths that are multiples of 1 m. Using the correlation for the output quantity `visibility`, one obtains a visibility distance of 4.8 m. When viewing the smoke levels with Smokeview, one can just barely see the fifth obstacle which is at a distance of 5 m. Smokeview, therefore, is properly displaying the obscuration of the initial soot density. Three beam detectors are also placed in the compartment. These all have a path length of 10 m, but are at different orientations within the compartment. Using the optical depth of  $0.626 \text{ m}^{-1}$  and the path length of 10 m, the expected total obscuration is 99.81 %, which is the result computed by FDS for each of the three detectors.

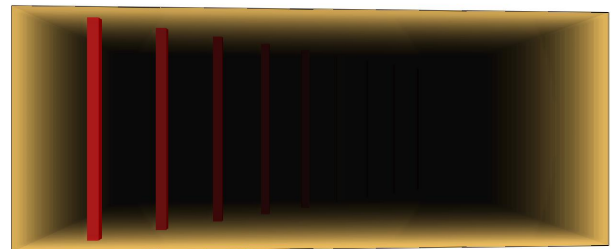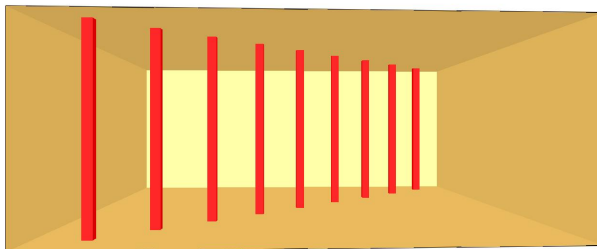

## 18.2 Aspiration Detector (aspiration\_detector)

A cubical compartment, 2 m on a side has a three sampling location aspiration system. The three locations have equal flow rates of 0.3 kg/s, and transport times of 50, 100, and 150 s, respectively. No bypass flow rate is specified for the aspiration detector. 1 kg/s of combustion products with `SOOT_YIELD=0.001` is input into the bottom of the compartment and 1 kg/s of total mass is removed from the top of the compartment. The aspiration detector shows an increasing obscuration over time. There is a delay of slightly over 50 s in the initial increase which results from the 50 s transport time for the first sampling location plus a short period of time to transport the combustion products to the sampling location. The detector response has three plateaus that result from the delay times of the sampling locations. The sampling points are co-located, so each plateau represents an additional one third of the soot being transported to the detector. The soot density at the sampling point is  $3.493 \times 10^{-4} \text{ kg/m}^3$ . Using this value the plateaus are computed as 63.7 %, 86.8 %, and 95.2 %, as seen in the figure.

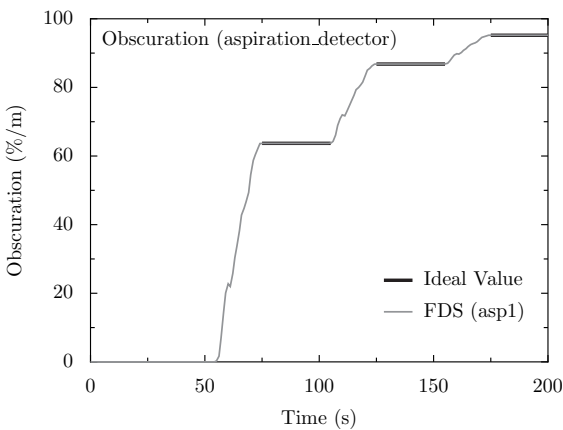


## Chapter 19

# Droplets and Sprays

This chapter considers cases involving evaporating droplets, both water and fuel.

### 19.1 Water Droplet Evaporation (water\_evaporation)

The case called **water\_evaporation** is nothing more than stationary water droplets in an adiabatic box with dimensions of 1 m on a side. The air within the box is stirred to maintain uniform conditions, and there are no leaks or heat losses. The initial air temperature is 40 °C. Initially, the droplets have a median volumetric diameter of 100  $\mu\text{m}$ , a temperature of 90 °C, and a total mass of 0.02 kg. It is expected that a steady-state will be achieved after several minutes. The initial energy content, sum of the air and water enthalpies, of the box is 360,000 kJ. After a short period of time, 0.0141 kg of water evaporate and the box reaches an equilibrium temperature of 16.2 °C, see the figure below. At this point the energy content of the box is 372,000 kJ or a 3 % error. At 16.2 °C, the expected evaporation is 0.0142 kg.

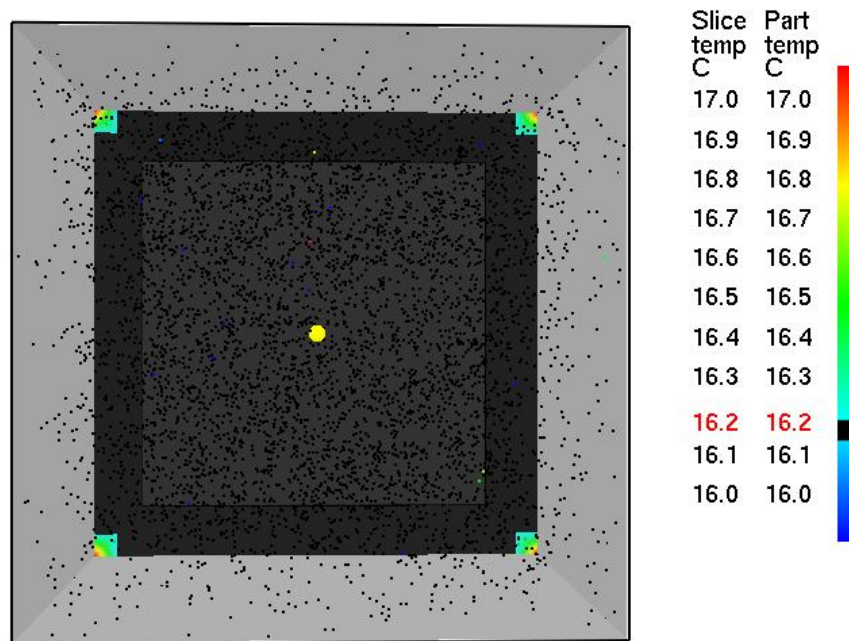

## 19.2 Measuring Water Flux (bucket\_test)

A common way of measuring the spray distribution for any fire sprinkler is called a “bucket test.” Usually, one or several sprinklers is mounted a specified distance above an array of catch bins, the water flows for a given period of time, and the water flux distribution is calculated from the accumulated water mass in each bin. In the test case **bucket\_test**, a single sprinkler is mounted 10 cm below a 5 m ceiling. Water flows for 30 s at a constant rate of 180 L/min (ramped up and down in 1 s). The simulation continues for another 10 s to allow water drops time to reach the floor. The total mass of water discharged is

$$180 \frac{\text{L}}{\text{min}} \times 1 \frac{\text{kg}}{\text{L}} \times \frac{1}{60} \frac{\text{min}}{\text{s}} \times 30 \text{ s} = 90 \text{ kg} \quad (19.1)$$

In the simulation, the boundary quantity `water_drops_AMPUA` (Accumulated Mass Per Unit Area) records the total water mass per unit area ( $\text{kg/m}^2$ ), analogous to actual buckets the size of a grid cell. Summing the values of `water_drops_AMPUA` over the entire floor yields 88.3 kg. Where is the missing water? Some droplets evaporate, and some droplets fly beyond the computational domain. Note that there are no actual “buckets” in the simulation.

The accumulated water mass at the floor is extracted from the boundary (`BNDF`) file via the command line program **fds2ascii**. Here is a transcript of the session used to convert the binary FDS output file into ASCII format:

```
>> fds2ascii
  Enter Job ID string (CHID):
bucket_test
  What type of file to parse?
  PL3D file? Enter 1
  SLCF file? Enter 2
  BNDF file? Enter 3
3
  Enter Sampling Factor for Data?
  (1 for all data, 2 for every other point, etc.)
1
  Limit the domain size? (y or n)
y
  Enter min/max x, y and z
-5 5 -5 5 0 1
  1 MESH 1, water_drops_AMPUA
  Enter starting and ending time for averaging (s)
35 36
  Enter orientation: (plus or minus 1, 2 or 3)
3
  Enter number of variables
1
  Enter boundary file index for variable 1
1
  Enter output file name:
bucket_test_fds2ascii.csv
  Writing to file...      bucket_test_fds2ascii.csv
```

Note that there really is no need to time-average the results. The quantity is inherently accumulating. Also, the “orientation” refers to direction of the surface. In this case, we’re interested in the positive  $z$  direction, or 3.

## 19.3 Complex Spray Patterns (bucket\_test\_2)

The test case from the prior section is modified to create two jets of water.

```
&PROP ID='K-11', QUANTITY='SPRINKLER LINK TEMPERATURE', OFFSET=0.10, PART_ID='water_drops',  
      FLOW_RATE=60., SPRAY_PATTERN_TABLE='TABLE1', SMOKEVIEW_ID='sprinkler_upright' /  
  
&TABL ID='TABLE1', TABLE_DATA=30,31,0,1,5,0.2/  
&TABL ID='TABLE1', TABLE_DATA=30,31,179,180,5,0.8/
```

The jets are separated by 180 degrees. The jet in the  $-x$  direction is given one quarter the flow rate of the jet in the  $+x$  direction.

Viewing the particles in Smokeview shows two distinct jets of droplets in opposite directions. Following the post processing instructions above, you can observe that the  $+x$  jet does have four times the flow of the  $-x$  jet.




## Chapter 20

# General Functionality

This chapter contains a variety of simple tests to check the functionality of the code. These examples are good demonstrations of how to make things happen in FDS.

### 20.1 Creating and Removing HOLES and OBSTRUCTIONS (create\_remove)

It is often convenient to create or remove solid obstructions, or conversely, remove or create empty holes. They are essentially the same thing as far as the logic in FDS is concerned, but the input can be tricky. To avoid confusion, here is an example of holes and obstructions being created and removed.



```
&HOLE XB=0.25,0.45,0.20,0.30,0.20,0.30, COLOR='RED',   DEVC_ID='timer 1' /  
&HOLE XB=0.25,0.45,0.70,0.80,0.70,0.80, COLOR='GREEN', DEVC_ID='timer 2' /  
  
&OBST XB=0.70,0.80,0.20,0.30,0.20,0.30, COLOR='BLUE',  DEVC_ID='timer 3' /  
&OBST XB=0.70,0.80,0.60,0.70,0.60,0.70, COLOR='PINK',  DEVC_ID='timer 4' /  
  
&DEVC XYZ=0.1,0.1,0.1, ID='timer 1', SETPOINT= 1.0, QUANTITY='TIME', INITIAL_STATE=.FALSE./  
&DEVC XYZ=0.2,0.1,0.1, ID='timer 2', SETPOINT= 2.0, QUANTITY='TIME', INITIAL_STATE=.TRUE. /  
&DEVC XYZ=0.1,0.1,0.1, ID='timer 3', SETPOINT= 3.0, QUANTITY='TIME', INITIAL_STATE=.FALSE./  
&DEVC XYZ=0.2,0.1,0.1, ID='timer 4', SETPOINT= 4.0, QUANTITY='TIME', INITIAL_STATE=.TRUE./
```





# Chapter 21

## Materials

### 21.1 Testing Solid Phase Properties

Real materials that can burn can be very complicated. Undoubtedly, the `SURF` and `MATL` lines in the input file will consist of a combination of empirical and fundamental properties, often originating from different sources. How do you know that the various property values and the associated thermo-physical model in FDS constitute an appropriate description of the solid? For a full-scale simulation, it is hard to untangle the uncertainties associated with the gas and solid phase routines. However, it is easy to perform a simple check of any set of surface properties by essentially turning off the gas phase – no combustion and no convective heat transfer. There are several parameters that allow you to do this, spread out over the various namelist groups.

1. Create a trivially small mesh, just to let FDS run. Since the gas phase calculation is essentially being shut off, you just need 4 cells in each direction (`IJK=4, 4, 4`) for the pressure solver to function properly.
2. On the `TIME` line, set `WALL_INCREMENT=1` to force FDS to update the solid phase every time step (normally it does this every other time step), and set `DT` to whatever value appropriate for the solid phase calculation. Since there is no gas phase calculation that will limit the time step, it is best to control this yourself.
3. Put `H_FIXED=0.` on the `MISC` line. This turns off the convective heat flux from gas to surface and vice versa. The heat flux to the solid is specified via `EXTERNAL_FLUX` ( $\text{kW/m}^2$ ) on the `SURF` line that is assigned to the solid surface. If you want to specify a particular convective heat flux to the solid surface, you can set `ASSUMED_GAS_TEMPERATURE` on the `MISC` line, along with a non-zero value of `H_FIXED` in units of  $\text{W/m}^2/\text{K}$ .
4. Turn off all the gas phase computations by setting `SOLID_PHASE_ONLY=.TRUE.` on the `MISC` line. This will also speed up the computations significantly. If the gas phase computations are needed, you may turn off combustion by creating a `REAC` line with only `Y_O2_INFTY=0.01`. This sets the background oxygen mass fraction to 0.01, too low to support any burning.
5. Generate `MATL` lines, plus a single `SURF` line, as you normally would, except add `EXTERNAL_FLUX` to the `SURF` line. This is simply a “virtual” source that heats the solid. Think of this as a perfect radiant panel or cone calorimeter.
6. Assign the `SURF_ID` to a `VENT` that spans the bottom of the computational domain. Create `OPEN` vents on all other faces.

7. Finally, add solid phase output devices to the solid surface, like 'WALL TEMPERATURE', 'NET HEAT FLUX', 'BURNING RATE', 'GAUGE HEAT FLUX', and 'WALL THICKNESS' (assuming the solid is to burn away). Use these to track the condition of the solid as a function of time. In particular, make sure that the 'BURNING RATE' is appropriate for the particular external heat flux applied. Make sure that the 'WALL TEMPERATURE' is appropriate. Compare your results to measurements made in a bench-scale device, like the cone calorimeter. Keep in mind, however, that the calculation and the experiment are not necessarily perfectly matched. The calculation is designed to eliminate uncertainties related to convection, combustion, and apparatus-specific phenomena.

## 21.2 Pyrolysis Samples

### 21.2.1 A Simple Thermoplastic (thermoplastic)

The term “thermoplastic” is often applied to materials that essentially heat up and gasify without leaving any solid residue. The term is used here merely to indicate the class of materials for which the pyrolysis can be modeled with a single reaction that converts solid to gaseous fuel.

The purpose of this example is to demonstrate how the solid phase pyrolysis model works in FDS. Essentially, the gas phase calculation is shut off except for the imposition of a 50 kW/m<sup>2</sup> “virtual” heat flux. The solid in this example is a slab of plastic, similar in composition to PMMA. The solid is described by the following SURF line:


```
&SURF ID='PMMA SLAB'  
      COLOR='BLACK'  
      MATL_ID='PMMA'  
      THICKNESS=0.025  
      EXTERNAL_FLUX=50. / External Flux is ONLY for this simple demo exercise
```

The COLOR is meaningless except to distinguish it in Smokeview. The EXTERNAL\_FLUX is a virtual heat source that is only used for these types of diagnostic exercises. The properties of the material are conveyed via the MATL line:



```
&MATL ID='PMMA'  
      CONDUCTIVITY=0.25  
      SPECIFIC_HEAT=1.0  
      DENSITY=500.  
      N_REACTIONS=1  
      NU_FUEL=1.  
      HEAT_OF_REACTION=1578.  
      HEAT_OF_COMBUSTION=25200.  
      REFERENCE_TEMPERATURE=330. /
```

Notice that in addition to  $k$ ,  $\rho$  and  $c$ , there is one reaction specified, the *yield* of which is 100 % fuel gas (NU\_FUEL=1.). The phase change from solid to gas *consumes* energy at a rate of 1,578 kJ/kg. Although not relevant in this example, the burning of these fuel gases would *produce* energy at a rate of 25,200 kJ/kg. The reaction nominally takes place at 330 °C, a necessary parameter for the pyrolysis model described in Section 8.4.2.

The plots below show the surface temperature and heat flux as functions of time. Note that the default emissivity of the material surface is 0.9, meaning that only 45 kW/m<sup>2</sup> out of the initial 50 kW/m<sup>2</sup> is actually heating the solid. Some of this energy heats up the solid to about 350 °C at the surface, some is radiated away (about 8 kW/m<sup>2</sup>), some is used to convert the solid material into a gas, and is plotted here as the product of the burning rate and the heat of reaction.

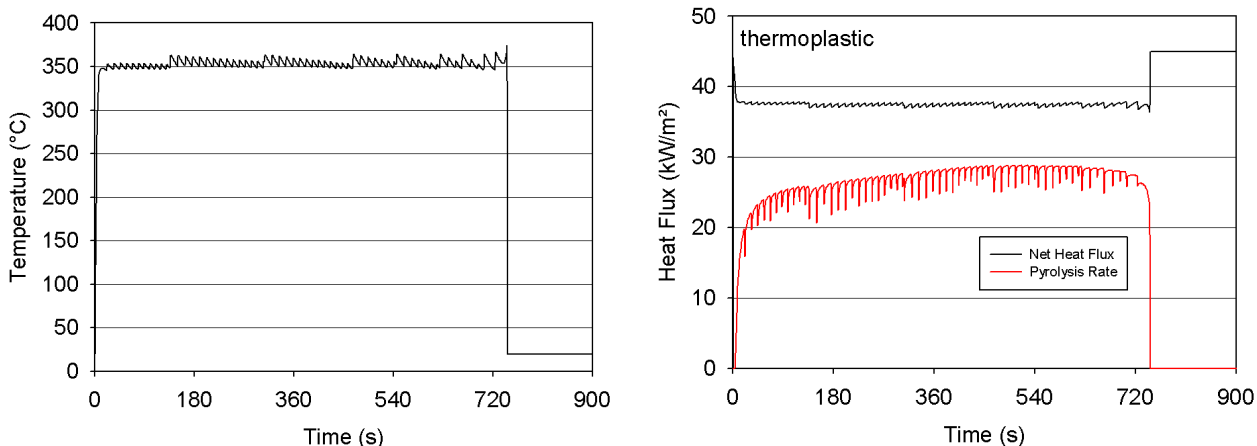

The slab is 0.025 m thick, with a density of 500 kg/m<sup>3</sup>. This means there is 12.5 kg/m<sup>2</sup> of fuel present, which if divided by the burning rate (about 0.018 kg/m<sup>2</sup>/s) yields a burning time of about 700 s. After this, the material is “burned away.”

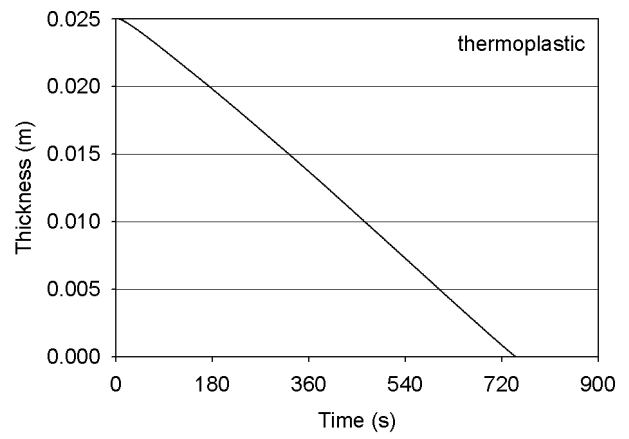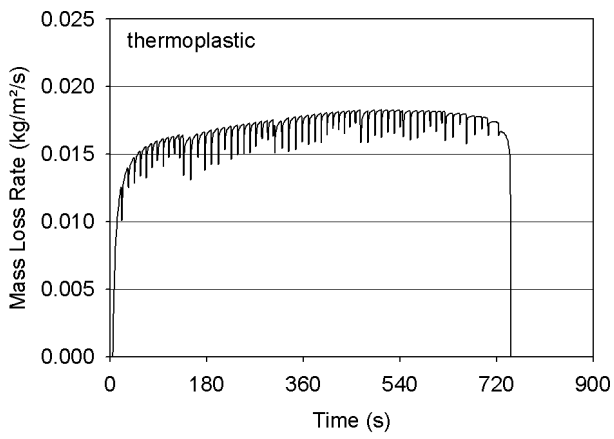

### 21.2.2 A Charring Solid (charring\_solid)

This example just exercises the solid phase algorithm in FDS. Essentially, the gas phase is shut off except for the imposition of a 50 kW/m<sup>2</sup> “virtual” heat flux. The reaction mechanism is fairly complicated, as it includes various solids like cellulose, char, and ash. Each are input via MATL lines as follows:

```
&SURF ID='SPRUCE'
  STRETCH_FACTOR = 1.
  CELL_SIZE_FACTOR = 0.5
  MATL_ID(1,1:3) = 'CELLULOSE','WATER','LIGNIN'
  MATL_MASS_FRACTION(1,1:3) = 0.70,0.1,0.20
  MATL_ID(2,1) = 'CASI'
  THICKNESS(1:2) = 0.01,0.01
  EXTERNAL_FLUX = 50. /
```

```
&MATL ID          = 'CELLULOSE'
  CONDUCTIVITY_RAMP = 'k_cell'
  SPECIFIC_HEAT     = 2.3
  DENSITY           = 400.
  N_REACTIONS       = 1
  A                 = 2.8E19
  E                 = 2.424E5
  HEAT_OF_REACTION  = 0.
  NU_RESIDUE        = 1.0
  RESIDUE           = 'ACTIVE' /
```

```
&MATL ID          = 'ACTIVE'
  EMISSIVITY        = 1.0
  CONDUCTIVITY_RAMP = 'k_cell'
  SPECIFIC_HEAT     = 2.3
  DENSITY           = 400.
  N_REACTIONS       = 2
  A(1:2)            = 1.3E10, 3.23E14
  E(1:2)            = 1.505E5, 1.965E5
  HEAT_OF_REACTION(1:2) = 418., 418.
  NU_RESIDUE(1:2)   = 0.35, 0.0
  NU_FUEL(1:2)      = 0.65, 1.0
  RESIDUE(1)        = 'CHAR' /
```

```
&MATL ID          = 'WATER'
  EMISSIVITY        = 1.0
  DENSITY           = 1000.
  CONDUCTIVITY      = 0.6
  SPECIFIC_HEAT     = 4.19
  N_REACTIONS       = 1
  A                 = 1E20
  E                 = 1.62E+05
  NU_WATER          = 1.0
  HEAT_OF_REACTION  = 2260. /
```

```
&MATL ID          = 'CASI'
  CONDUCTIVITY_RAMP = 'k_CASI'
  DENSITY           = 200.
  SPECIFIC_HEAT     = 1.0 /
```

```
&MATL ID          = 'LIGNIN'
  EMISSIVITY        = 1.0
  DENSITY           = 550.
  CONDUCTIVITY      = 0.1
  SPECIFIC_HEAT     = 1.1 /
```

```
&MATL ID          = 'CHAR'
  EMISSIVITY        = 1.0
  DENSITY           = 140.
  CONDUCTIVITY_RAMP = 'k_char'
  SPECIFIC_HEAT     = 1.1 /
```

```

&RAMP ID='k_cell', T= 20., F=0.15 /
&RAMP ID='k_cell', T=500., F=0.29 /



&RAMP ID='k_char', T= 20., F=0.08 /
&RAMP ID='k_char', T=900., F=0.25 /

&RAMP ID='k_CASI', T= 20., F=0.06 /
&RAMP ID='k_CASI', T=400., F=0.25 /

```

Note the edition of the parameter `EXTERNAL_FLUX` on the `SURF` line. This produces a  $50 \text{ kW/m}^2$  flux on the sample, without any additional input lines in the file. It is just to test the solid phase model and should not be copied into an actual fire simulation.

The figures below show the surface temperature and burning rate under the  $50 \text{ kW/m}^2$  external heat flux. The burning rate peaks at the start of the simulation, decreases throughout the burning phase, and then peaks again at the end due to presence of an external backing material. The initial peak is typical of char-forming solids.

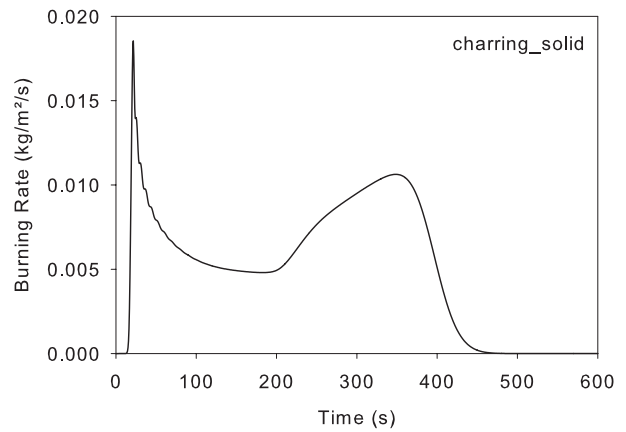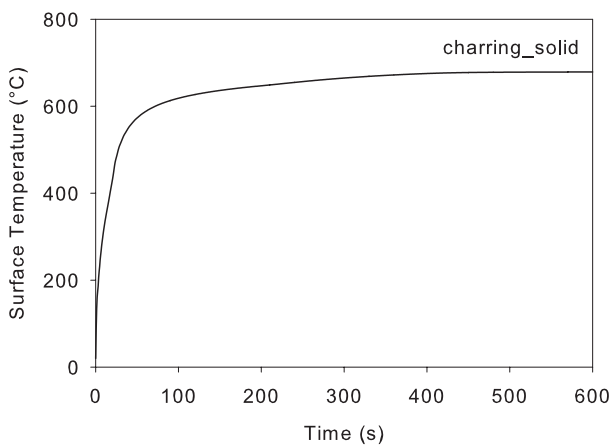

## **Chapter 22**

# **Sample Fires**

All fire simulations must include a “model” of the fire itself. Almost always, these models are simplifications of the actual burning item. The examples in this chapter are merely starting points for more elaborate fire simulations. The point of these examples is to demonstrate that any simulation of a fire ought to first start with a model of just the fire itself and its immediate surroundings. It is a tremendous waste of time to begin a project by setting up a calculation of the fire, smoke and heat transport, target/detector response, and so on, without first doing quick simulations of the fire itself to ensure that it conforms to either a test burn or your own conceptual model.

## 22.1 A Couch Fire (couch)

In residential fires, upholstered furniture makes up a significant fraction of the combustible load. A single couch can generate several megawatts of energy and sometimes lead to compartment flashover. Modeling a couch fire requires a simplification of its structure and materials. At the very least, we want the upholstery to be described as fabric covering foam:

```
&MATL ID          = 'FABRIC'
FYI               = 'Properties completely fabricated'
SPECIFIC_HEAT     = 1.0
CONDUCTIVITY      = 0.1
DENSITY           = 100.0
N_REACTIONS       = 1
NU_FUEL           = 1.
REFERENCE_TEMPERATURE = 350.
HEAT_OF_REACTION  = 3000.
HEAT_OF_COMBUSTION = 15000. /

&MATL ID          = 'FOAM'
FYI               = 'Properties completely fabricated'
SPECIFIC_HEAT     = 1.0
CONDUCTIVITY      = 0.05
DENSITY           = 40.0
N_REACTIONS       = 1
NU_FUEL           = 1.
REFERENCE_TEMPERATURE = 350.
HEAT_OF_REACTION  = 1500.
HEAT_OF_COMBUSTION = 30000. /

&SURF ID          = 'UPHOLSTERY'
FYI               = 'Properties completely fabricated'
COLOR             = 'PURPLE'
BURN_AWAY         = .TRUE.
MATL_ID(1:2,1)    = 'FABRIC','FOAM'
THICKNESS(1:2)    = 0.002,0.1
PART_ID           = 'smoke' /
```

Both the fabric and the foam decompose into fuel gases via single-step reactions. The fuel gases from each have different composition and heats of combustion. FDS automatically adjusts the mass loss rate of each so that the “effective” fuel gas is that specified by the user on the REAC line. The attribute BURN\_AWAY forces FDS to break up the couch into individual cell-sized blocks that will disappear from the calculation as soon as the fuel is exhausted. The surface is specified as consisting of two layers, with a thickness of 2 mm for the FABRIC and 10 cm for the FOAM. The 10 cm is chosen to be the same as the mesh cell size.



## 22.2 Flame Spread along a Cable Tray (cable\_tray)

A common combustible in industrial settings are power, control, and instrument cables. The cables may be bundled in a variety of conduits; the most common of which is a ladder-like “tray.” From the point of view of FDS, the pile of cables in a tray is a composite of a variety of plastics, insulators, and metal, usually copper. Here is one way to describe a tray of cables:

```
&MATL ID                      = 'PLASTIC'
    CONDUCTIVITY                = 0.2
    SPECIFIC_HEAT                = 1.5
    DENSITY                     = 1500.
    N_REACTIONS                  = 1
    HEAT_OF_REACTION             = 3000.
    HEAT_OF_COMBUSTION           = 25000.
    REFERENCE_TEMPERATURE        = 400.
    NU_FUEL                      = 1.0 /

&MATL ID                      = 'COPPER'
    SPECIFIC_HEAT                = 0.38
    CONDUCTIVITY                = 387.
    DENSITY                     = 8940. /

&SURF ID                      = 'Loose Cable'
    COLOR                       = 'IVORY BLACK'
    MATL_ID(1,1:2)              = 'PLASTIC', 'COPPER'
    MATL_MASS_FRACTION(1,1:2)   = 0.4, 0.6
    BACKING                     = 'EXPOSED'
    THICKNESS                   = 0.02 /

&OBST XB=-2.00, 2.00,-0.14, 0.14, 0.51, 0.55, SURF_ID='Loose Cable' /

&OBST XB=-2.00, 2.00,-0.15,-0.15, 0.50, 0.60, SURF_ID='SHEET METAL' / Tray Side
&OBST XB=-2.00, 2.00, 0.15, 0.15, 0.50, 0.60, SURF_ID='SHEET METAL' / Tray Side
&OBST XB=-1.95,-1.90,-0.15, 0.15, 0.50, 0.50, SURF_ID='SHEET METAL' / Rung
&OBST XB=-1.60,-1.55,-0.15, 0.15, 0.50, 0.50, SURF_ID='SHEET METAL' / Rung
...
&OBST XB= 1.90, 1.95,-0.15, 0.15, 0.50, 0.50, SURF_ID='SHEET METAL' / Rung
```

The pile of cables is assumed to be a solid slab, 28 cm wide and 2 cm deep. The tray is slightly wider and deeper, and because it is listed second in the input file, its surface properties take precedence wherever the cable slab and tray coincide. The mesh cells in this example are 5 cm on a side, but the heat transfer within the cable slab are governed by the 2 cm THICKNESS. The slab is 60 % copper, by mass. Note that we are not assuming multiple layers in this example – the slab is a single layer composite of plastic and copper. The plastic burns at about 400 °, but the copper remains. Thus, the cable does not “burn away.”

The point of this test case is merely to propose a simple model of flame spread along a tray of assorted cable. Detailed thermo-physical property data for industrial-grade cable is usually not available, and even if it were, it would probably not improve upon the given model. The properties given in this example are almost completely fabricated. What is important here are the HEAT\_OF\_REACTION and REFERENCE\_TEMPERATURE, obtained in most cases by a bench-scale measurement device like the cone calorimeter.

## 22.3 A Liquid Fuel Spray Burner (spray\_burner)

Controlled fire experiments are often conducted using a spray burner, where a liquid fuel is sprayed out of a nozzle and ignited. In this example (**spray\_burner.fds**), heptane from two nozzles is sprayed downwards into a steel pan. The flow rate is increased linearly so that the fire grows to 2 MW in 20 s, burns steadily for another 20 s, and then ramps down linearly in 20 s. The key input parameters are given here:

```
&DEVC ID='nozzle_1', XYZ=4.0,-.3,0.5, PROP_ID='nozzle', QUANTITY='TIME', SETPOINT=0. /
&DEVC ID='nozzle_2', XYZ=4.0,0.3,0.5, PROP_ID='nozzle', QUANTITY='TIME', SETPOINT=0. /


&PART ID='heptane droplets', FUEL=.TRUE., VAPORIZATION_TEMPERATURE=98.,
      HEAT_OF_VAPORIZATION=316., SPECIFIC_HEAT=2.25, DENSITY=688.,
      QUANTITIES(1:2)='DIAMETER','DROPLET_TEMPERATURE',
      DROPLETS_PER_SECOND=2000, DIAMETER=1000., HEAT_OF_COMBUSTION=44500.,
      DT_INSERT=0.02, SAMPLING_FACTOR=1 /

&PROP ID='nozzle', CLASS='NOZZLE', PART_ID='heptane droplets',
      FLOW_RATE=1.96, FLOW_RAMP='fuel', DROPLET_VELOCITY=10.,
      SPRAY_ANGLE=0.,30. /
&RAMP ID='fuel', T= 0.0, F=0.0 /
&RAMP ID='fuel', T=20.0, F=1.0 /
&RAMP ID='fuel', T=40.0, F=1.0 /
&RAMP ID='fuel', T=60.0, F=0.0 /
```

Many of these parameters are self-explanatory and the units are given in the User's Guide [16]. Note that a 2 MW fire is achieved via 2 nozzles flowing heptane at 1.96 L/min each:

$$2 \times 1.96 \frac{\text{L}}{\text{min}} \times \frac{1}{60} \frac{\text{min}}{\text{s}} \times 688 \frac{\text{kg}}{\text{m}^3} \times \frac{1}{1000} \frac{\text{m}^3}{\text{L}} \times 44500 \frac{\text{kJ}}{\text{kg}} = 2000 \text{ kW} \quad (22.1)$$

The parameter `HEAT_OF_COMBUSTION` over-rides that for the overall reaction scheme. Thus, if other droplets or solid objects have different heats of combustion, the effective burning rates are adjusted so that the total heat release rate is that which the user expects. However, exercises like this ought to be conducted just to ensure that this is the case. The HRR curve for this example is given here:

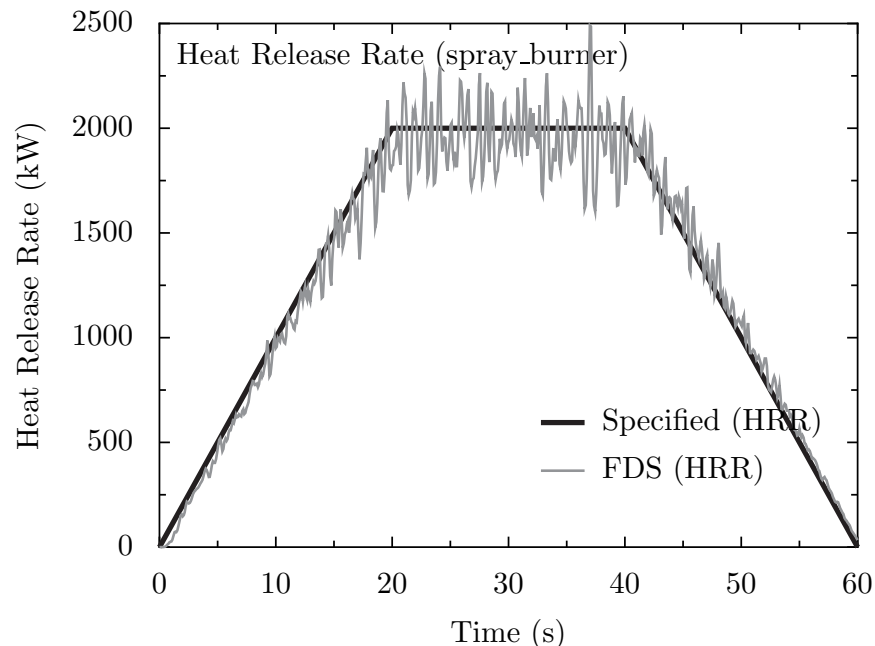

Note that in this example there is no need for a separate ignition source. The combustion model assumes fuel and oxygen burn on contact, and so the small amount of evaporation at ambient temperature is enough to start the reaction.



## **Part IV**

# **Working with the FDS Source Code**



## Chapter 23

# Compiling FDS

This section describes what you need to know if you want to compile the FDS source code yourself. It is not a step by step guide, more detailed instructions can be found on Developer section of the web site at <http://fire.nist.gov/fds>.

If a compiled version of FDS exists for the machine on which the calculation is to be run and no changes have been made to the original source code, there is no need to re-compile the code. For example, the file **fds5.exe** is the compiled single processor program for a Windows-based PC; thus PC users do not need a Fortran compiler and do not need to compile the source code. For machines for which an executable has not been compiled, you must compile the code. Fortran 90/95 and C compilers are needed for compilation.

### 23.1 FDS Source Code

Table 23.1 lists the files that make up the source code. The files with suffix “.f90” contain free form Fortran 90 instructions conforming to the ANSI and ISO standards, with a few exceptions that are discussed below. The source files should be compiled in the order in which they are listed in Table 23.1 because some routines are dependent on others. For Unix/Linux users, **Makefiles** for various platforms are available that assist in the compilation. Compiler options differ from platform to platform. Note the following:

- The source code consists mainly of Fortran 90 statements organized into about 25 files, plus an extra file containing some additional C routines needed for output to Smokeview. All of the C code is contained within the file called **isob.c**.
- Be aware that different compilers handle the names of C subroutines differently. Some compilers append an underscore to the names of the C routines called by the Fortran code. If the compiler produces an error involving the names of routines that are not recognized, invoke the C compiler pre-processing directive `pp_noappend` to stop the compiler from appending the underscore to the names of the C routines.
- There is only one non-standard call in the Fortran code. The non-standard call is `GETARG`, in **func.f90**. This routine reads the name of the input file off of the command line. This call cannot be simply commented out; a suitable alternative must be found. The only compiler option necessary, in addition to any needed to address the above issues, is for full optimization (usually `-O` or some variant). Some compilers have a standard optimization level, plus various degrees of “aggressive” optimization. Be cautious in using the highest levels of optimization.
- For the single processor version of FDS, compile with **main.f90**

- The parallel version of FDS uses **main\_mpi.f90** instead of **main.f90**, plus additional MPI libraries need to be installed. More details on MPI can be found at the web site, along with links to the necessary organizations who have developed free MPI libraries.

Table 23.1: **Source Code Files**

| File Name                       | Description   |
|---------------------------------|---|
| isob.c                          | C Routine for computing isosurfaces and 3D smoke        |
| prec.f90                        | Specification of numerical precision                    |
| smvv.f90                        | Interfaces for C routines used for Smokeview output     |
| devc.f90                        | Derived type definitions and constants for devices'     |
| type.f90                        | Derived type definitions                                |
| mesh.f90                        | Arrays and constants associated with each mesh          |
| cons.f90                        | Global arrays and constants                             |
| func.f90                        | Global functions and subroutines                        |
| irad.f90                        | Functions needed for radiation solver, including RadCal |
| ieva.f90                        | Support routines for evac.f90                           |
| evac.f90                        | Egress computations (future capability)                 |
| pois.f90                        | Poisson (pressure) solver                               |
| radi.f90                        | Radiation solver  |
| part.f90                        | Lagrangian particle transport and sprinkler activation  |
| ctrl.f90                        | Definitions and routines for control functions          |
| dump.f90                        | Output data dumps into files                            |
| read.f90                        | Read input parameters                                   |
| mass.f90                        | Mass equation(s) and thermal boundary conditions        |
| wall.f90                        | Wall boundary conditions                                |
| fire.f90                        | Combustion routines                                     |
| pres.f90                        | Spatial discretization of pressure (Poisson) equation   |
| divg.f90                        | Compute the flow divergence                             |
| init.f90                        | Initialize variables and Poisson solver                 |
| velo.f90                        | Momentum equations                                      |
| vege.f90                        | Experimental vegetation model                           |
| main.f90 <b>or</b> main_mpi.f90 | Main programs, serial and parallel versions             |



## Chapter 24

# Output File Formats

The output from the code consists of the file **CHID.out**, plus various data files that are described below. Most of these output files are written out by the routine **dump.f**, and can easily be modified to accommodate various plotting packages.

### 24.1 Diagnostic Output

The file **CHID.out** consists of a list of the input parameters, and an accounting of various important quantities, including CPU usage. Typically, diagnostic information is printed out every 100 time steps

```

      :
      :
Iteration   8300   May 16, 2003   08:37:53
-----
Mesh  1, Cycle   3427
CPU/step:    2.272 s, Total CPU:    2.15 hr
Time step:  0.03373 s, Total time:  128.86 s
Max CFL number: 0.86E+00 at ( 21,  9, 80)
Max divergence: 0.24E+01 at ( 25, 30, 22)
Min divergence: -.39E+01 at ( 26, 18, 31)
Number of Sprinkler Droplets:    615
Total Heat Release Rate:    7560.777 kW
Radiation Loss to Boundaries:  6776.244 kW
Mesh  2, Cycle   2914
CPU/step:    1.887 s, Total CPU:    1.53 hr
Time step:  0.03045 s, Total time:  128.87 s
Max CFL number: 0.96E+00 at ( 21, 29, 42)
Max divergence: 0.20E+01 at ( 22, 20, 22)
Min divergence: -.60E+01 at (  7, 26, 48)
Number of Sprinkler Droplets:    301
      :
      :
```

The Iteration number indicates how many time steps the code has run, whereas the Cycle number for a given mesh indicates how many time steps have been taken on that mesh. The date and time (wall clock time) are on the line starting with the word Iteration. The quantity CPU/step is the amount of CPU time required to complete a time step for that mesh; Total CPU is the amount of CPU time elapsed since the start of the run; Time step is the time step size for the given mesh; Total time is the time of the simulation;

Max/Min divergence is the max/min value of the function  $\nabla \cdot \mathbf{u}$  and is used as a diagnostic when the flow is incompressible (*i.e.* no heating); and Max CFL number is the maximum value of the CFL number. The Radiation Loss to Boundaries is the amount of energy that is being radiated to the boundaries. As compartments heat up, the energy lost to the boundaries can grow to be an appreciable fraction of the Total Heat Release Rate. Finally, Number of Tracer Particles indicates how many passive particles are being tracked at that time.

Following the completion of a successful run, a summary of the CPU usage per subroutine is listed. This is useful in determining where most of the computational effort is being placed.

## 24.2 Heat Release Rate and Related Quantities

The heat release rate of the fire, plus other global energy-related quantities, are automatically written into a text file called **CHID\_hrr.csv**. The format of the file is as follows

```
s, kW, kW, kW, kW, kg/s, atm, atm
FDS_HRR_Time, HRR, RAD_LOSS, CONV_LOSS, COND_LOSS, BURN_RATE, ZONE_01, ZONE_02, ...
0.0000000E+000, 0.0000000E+000, ...
3.5355338E-001, 0.0000000E+000, ...
.
.
.
```

HRR is the total heat release rate, RAD\_LOSS is the amount of thermal radiation lost to the boundaries, CONV\_LOSS is the rate of energy that is flowing out of (positive) or into (negative) the computational domain, COND\_LOSS is the rate of energy that is being conducted into (positive) or out of (negative) the solid surfaces, BURN\_RATE is the total mass loss rate of fuel, and ZONE\_01, *etc.*, are the background pressures of the various pressure ZONES.

Details of the integrated energy quantities can be found in Section 12.3.1. The background pressure is discussed in Section 8.3.

## 24.3 Device Output Data

Data associated with particular devices (link temperatures, smoke obscuration, thermocouples, *etc.*) specified in the input file under the namelist group DEVC is output in comma delimited format in a file called **CHID\_dev.csv**. The format of the file is as follows

```
s, UNITS(1), UNITS(2), ..., UNITS(N_DEVC)
FDS Time, ID(1), ID(2), ..., ID(N_DEVC)
T(1), VAL(1,1), VAL(2,1), ..., VAL(N_DEVC,1)
T(2), VAL(1,2), VAL(2,2), ..., VAL(N_DEVC,2)
.
.
.
```

where N\_DEVC is the number of devices, ID(I) is the user-defined ID of the Ith device, UNITS(I) the units, T(J) the time of the Jth dump, and VAL(I, J) the value at the Ith device at the Jth time. The files can be imported into Microsoft Excel or almost any other spread sheet program. If the number of columns exceeds 256, the file will automatically be split into smaller files.

## 24.4 Control Output Data

Data associated with particular control functions specified in the input file under the namelist group `CTRL` is output in comma delimited format in a file called **CHID\_ctrl.csv**. The format of the file is as follows

```
s, status, status, status, status
FDS Time, ID (1), ID (2), ..., ID (N_CTRL)
0.00000E+000, -001, 001, ...
1.11803E-001, -001, -001, ...
.
.
.
```

where `N_CTRL` is the number of controllers, `ID (I)` is the user-defined ID of the `I`th control function, and plus or minus 1's represent the state `-1 = .FALSE.` and `+1 = .TRUE.` of the `I`th control function at the particular time. The files can be imported into Microsoft Excel or almost any other spread sheet program. If the number of columns exceeds 256, the file will automatically be split into smaller files.

## 24.5 Gas Mass Data

The total mass of the various gas species at any instant in time is reported in the comma delimited file **CHID\_mass.csv**. The file consists of several columns, the first column containing the time in seconds, the second contains the total mass of all the gas species in the computational domain in units of kg, the next lines contain the total mass of the individual species.

You must specifically ask that this file be generated, as it can potentially cost a fair amount of CPU time to generate. Set `MASS_FILE = .TRUE.` on the `DUMP` line to create this output file.

## 24.6 Mixture Fraction State Relations

The functional dependence of the mass fraction of the reactants and products of combustion on the mixture fraction is reported in the comma delimited file **CHID\_state.csv**. The file consists of nominally 10 columns, the first column containing the mixture fraction, the last column the average molecular weight, and the rest the mass fractions of the various gas species in the case where complete combustion has occurred.

You must specifically ask that this file be generated. Set `STATE_FILE = .TRUE.` on the `DUMP` line to create this output file. If you forget to do this, you can easily re-run the case (remember to rename it something else!) for a few time steps. This file is created before the time iterations even begin.

## 24.7 Slice Files

The slice files defined under the namelist group `SLCF` are named **CHID\_n.sf** ( $n=01,02,\dots$ ), and are written out unformatted, unless otherwise directed. These files are written out from **dump.f** with the following lines:

```
WRITE (LUSF) QUANTITY
WRITE (LUSF) SHORT_NAME
WRITE (LUSF) UNITS
WRITE (LUSF) I1, I2, J1, J2, K1, K2
WRITE (LUSF) TIME
WRITE (LUSF) (( (QQ (I, J, K), I=I1, I2), J=J1, J2), K=K1, K2)
```

```

      .
      .
      .
WRITE(LUSF) TIME
WRITE(LUSF) ( ( (QQ(I, J, K), I=I1, I2), J=J1, J2), K=K1, K2)

```

QUANTITY, SHORT\_NAME and UNITS are character strings of length 30. The sextuplet (I1, I2, J1, J2, K1, K2) denotes the bounding mesh cell nodes. The sextuplet indices correspond to mesh cell nodes, or corners, thus the entire mesh would be represented by the sextuplet (0, IBAR, 0, JBAR, 0, KBAR).

There is a short Fortran 90 program provided, called **fds2ascii.f**, that can convert slice files into text files that can be read into a variety of graphics packages. The program combines multiple slice files corresponding to the same “slice” of the computational domain, time-averages the data, and writes the values into one file, consisting of a line of numbers for each node. Each line contains the physical coordinates of the node, and the time-averaged quantities corresponding to that node. In particular, the graphics package Tecplot reads this file and produces contour, streamline and/or vector plots. See Section 12.4 for more details about the program **fds2ascii**.

## 24.8 Plot3D Data

Quantities over the entire mesh can be output in a format used by the graphics package **Plot3D**. The Plot3D data sets are single precision (32 bit reals), whole and unformatted. Note that there is blanking, that is, blocked out data points are not plotted. If the statement `WRITE_XYZ=.TRUE.` is included on the `DUMP` line, then the mesh data is written out to a file called **CHID.xyz**

```

WRITE(LU13) IBAR+1, JBAR+1, KBAR+1
WRITE(LU13) ( ( (X(I), I=0, IBAR), J=0, JBAR), K=0, KBAR),
.           ( ( (Y(J), I=0, IBAR), J=0, JBAR), K=0, KBAR),
.           ( ( (Z(K), I=0, IBAR), J=0, JBAR), K=0, KBAR),
.           ( ( (IBLK(I, J, K), I=0, IBAR), J=0, JBAR), K=0, KBAR)

```

where `X`, `Y` and `Z` are the coordinates of the cell corners, and `IBLK` is an indicator of whether or not the cell is blocked. If the point (`X`, `Y`, `Z`) is completely embedded within a solid region, then `IBLK` is 0. Otherwise, `IBLK` is 1. Normally, the mesh file is not dumped.

The flow variables are written to a file called **CHID\_\*\*\*\*\_\*\*.q**, where the stars indicate a time at which the data is output. The file is written with the lines

```

WRITE(LU14) IBAR+1, JBAR+1, KBAR+1
WRITE(LU14) ZERO, ZERO, ZERO, ZERO
WRITE(LU14) ( ( (QQ(I, J, K, N), I=0, IBAR), J=0, JBAR), K=0, KBAR), N=1, 5)

```

The five channels `N=1, 5` are by default the temperature ( $^{\circ}\text{C}$ ), the  $u$ ,  $v$  and  $w$  components of the velocity (m/s), and the heat release rate per unit volume ( $\text{kW/m}^3$ ). Alternate variables can be specified with the input parameter `PLOT3D_QUANTITY(1:5)` on the `DUMP` line. Note that the data is interpolated at cell corners, thus the dimensions of the Plot3D data sets are one larger than the dimensions of the computational mesh.

Smokeview can display the Plot3D data. In addition, the Plot3D data sets can be read into some other graphics programs that accept the data format. This particular format is very convenient, and recognized by a number of graphics packages, including AVS, IRIS Explorer and Tecplot<sup>1</sup>.

<sup>1</sup>With the exception of Smokeview, the graphics packages referred to in this document are not included with the source code, but are commercially available.

## 24.9 Boundary Files

The boundary files defined under the namelist group `BNDF` are named **CHID\_n.bf** ( $n=0001,0002,\dots$ ), and are written out unformatted. These files are written out from **dump.f** with the following lines:

```
WRITE(LUBF) QUANTITY
WRITE(LUBF) SHORT_NAME
WRITE(LUBF) UNITS
WRITE(LUBF) NPATCH
WRITE(LUBF) I1,I2,J1,J2,K1,K2,IOR,NB,NM
WRITE(LUBF) I1,I2,J1,J2,K1,K2,IOR,NB,NM
.
.
.
WRITE(LUBF) TIME
WRITE(LUBF) ((QQ(I,J,K),I=11,I2),J=J1,J2),K=K1,K2)
WRITE(LUBF) ((QQ(I,J,K),I=11,I2),J=J1,J2),K=K1,K2)
.
.
.
WRITE(LUBF) TIME
WRITE(LUBF) ((QQ(I,J,K),I=11,I2),J=J1,J2),K=K1,K2)
WRITE(LUBF) ((QQ(I,J,K),I=11,I2),J=J1,J2),K=K1,K2)
.
.
.
```

`QUANTITY`, `SHORT_NAME` and `UNITS` are character strings of lengths 60, 30 and 30, respectively. `NPATCH` is the number of planes (or “patches”) that make up the solid boundaries plus the external walls. The sextuplet `(I1,I2,J1,J2,K1,K2)` defines the cell nodes of each patch. `IOR` is an integer indicating the orientation of the patch ( $\pm 1, \pm 2, \pm 3$ ). You do not prescribe these. `NB` is the number of the boundary (zero for external walls) and `NM` is the number of the mesh. Note that the data is planar, thus one pair of cell nodes is the same. Presently, Smokeview is the only program available to view the boundary files.

## 24.10 Particle Data

Coordinates and specified quantities related to tracer particles, sprinkler droplets, and other Lagrangian particles are written to a FORTRAN unformatted (binary) file called **CHID.prt5**. Note that the format of this file has changed from previous versions (4 and below). The file consists of some header material, followed by particle data output every `DT_PART` seconds. The time increment `DT_PART` is specified on the `DUMP` line. It is `T_END/NFRAMES` by default. The header materials is written by the following FORTRAN code in the file called **dump.f90**.

```
WRITE(LUPF) ONE_INTEGER          ! Integer 1 to check Endian-ness
WRITE(LUPF) NINT(VERSION*100.)    ! FDS version number
WRITE(LUPF) N_PART                ! Number of PARTICle classes
DO N=1,N_PART
  PC => PARTICLE_CLASS(N)
  WRITE(LUPF) PC%N_QUANTITIES,ZERO_INTEGER ! ZERO_INTEGER is a place holder
  DO NN=1,PC%N_QUANTITIES
    WRITE(LUPF) CDATA(PC%QUANTITIES_INDEX(NN)) ! 30 character output quantity
    WRITE(LUPF) UDATA(PC%QUANTITIES_INDEX(NN)) ! 30 character output units
  ENDDO
ENDDO
```

Note that the initial printout of the number 1 is used by Smokeview to determine the Endian-ness of the file. The Endian-ness has to do with the particular way real numbers are written into a binary file. The version number is used to distinguish new versus old file formats. The parameter `N_PART` is not the number of particles, but rather the number of particle classes corresponding to the `PART` namelist groups in the input file. Every `DT_PART` seconds the coordinates of the particles and droplets are output as 4 byte reals:

```
WRITE(LUPF) REAL(T,FB) ! Write out the time T as a 4 byte real
DO N=1,N_PART
  WRITE(LUPF) NPLIM ! Number of particles in the PART class
  WRITE(LUPF) (XP(I),I=1,NPLIM),(YP(I),I=1,NPLIM),(ZP(I),I=1,NPLIM)
  WRITE(LUPF) (TA(I),I=1,NPLIM) ! Integer "tag" for each particle
  IF (PC%N_QUANTITIES > 0) WRITE(LUPF) ((QP(I,NN),I=1,NPLIM),NN=1,PC%N_QUANTITIES)
ENDDO
```

The particle “tag” is used by Smokeview to keep track of individual particles and droplets for the purpose of drawing streamlines. It is also useful when parsing the file. The quantity data, `QP(I,NN)`, is used by Smokeview to color the particles and droplets. Note that it is now possible with the new format to color the particles and droplets with several different quantities.

## 24.11 Profile Files

The profile files defined under the namelist group `PROF` are named **CHID\_prof\_nn.csv** (*nn*=01,02...), and are written out formatted. These files are written out from **dump.f** with the following line:

```
WRITE(LU_PROF) T,NWP+1,(X_S(I),I=0,NWP),(Q(I),I=0,NWP)
```

After the time `T`, the number of node points is given and then the node coordinates. These are written out at every time step because the wall thickness and the local solid phase mesh may change over time due to the solid phase reactions. Array `Q` contains the values of the output quantity, which may be wall temperature, density or component density.

## 24.12 3-D Smoke File Format

3-D smoke files contain alpha values used by Smokeview to draw semi-transparent planes representing smoke and fire. FDS outputs 3-D smoke data at fixed time intervals, but unlike other output data, the file format is C, not Fortran. Note that char’s are one byte, and “int’s” and float’s are four bytes. A *pseudo-code* representation of the 3-D smoke file is given by:

```
endian flag (int)
is1, is2, js1, js2, ks1, ks2 (6*int)
version (int)
for each time:
  time (float)
  chars_uncompressed, chars_compressed (2*int)
  compressed_data (chars_compressed*char)
end time
```

The endian flag is an integer one. Smokeview uses this number to determine whether the computer creating the 3-D smoke file and the computer viewing the 3-D smoke file use the same or different byte swap (endian) conventions for storing floating point numbers. The opacity data is compressed using run-length encoding (RLE).

## 24.13 Isosurface File Format

Iso-surface files are used to store one or more surfaces where the specified `QUANTITY` is a specified value. FDS outputs iso-surface data at fixed time intervals. As with 3-D smoke, the file format is C, not Fortran. Note that char's are one byte, short's are two bytes and "int's" and float's are four bytes. A *pseudo-code* representation of the iso-surface file is given by:

```
version                                (int)
len1,len2,len3                        (3*int)
label1,label2,label3                 ((len1+len2+len3+4)*char)
nlevels                              (int)
level_1, level_2, ..., level_nlevels (nlevels*float)
for each time:
  time                                (float)
  for each level
    nvertices                         (int)
    ntriangles                       (int)
    vertices_1, ..., vertex_nvertices (3*short*nvertices)
    triangles_1, ..., triangle_ntriangles (3*(byte/short/float)*ntriangles)
  end level
end time
```

The length of each `triangles_i` node is one byte if the number of triangles, `ntriangles`, is between zero and 255 (inclusive), two bytes if `ntriangles` is between 256 and 65536 (inclusive) and four bytes if `ntriangles` is greater than or equal to 65536.





# Bibliography

- [1] K.B. McGrattan, S. Hostikka, J.E. Floyd, H.R. Baum, and R.G. Rehm. Fire Dynamics Simulator (Version 5), Technical Reference Guide. NIST Special Publication 1018-5, National Institute of Standards and Technology, Gaithersburg, Maryland, October 2007. [i](#), [3](#), [35](#), [72](#), [77](#), [83](#), [89](#)
- [2] G.P. Forney. User's Guide for Smokeview Version 5 - A Tool for Visualizing Fire Dynamics Simulation Data. NIST Special Publication 1017-1, National Institute of Standards and Technology, Gaithersburg, Maryland, August 2007. [i](#), [3](#), [7](#)
- [3] W. Gropp, E. Lusk, and A. Skjellum. *Using MPI – Portable Parallel Programming with the Message-Passing Interface*. MIT Press, Cambridge, Massachusetts, 2 edition, 1999. [10](#)
- [4] Verification and Validation of Selected Fire Models for Nuclear Power Plant Applications. NUREG 1824, United States Nuclear Regulatory Commission, Washington, DC, 2007. [31](#)
- [5] V. Raman, H. Pitsch, and R.O. Fox. Hybrid large-eddy simulation/Lagrangian filtered-density-function approach for simulating turbulent combustion. *Combustion and Flame*, 143:56–78, 2005. [72](#)
- [6] L. Orloff and J. De Ris. Froude Modeling of Pool Fires. In *Proceedings of the Nineteenth Symposium (International) on Combustion*, pages 885–895. Combustion Institute, Pittsburgh, Pennsylvania, 1982. [73](#)
- [7] R.C. Reid, J.M. Prausnitz, and B.E. Poling. *Properties of Gases and Liquids*. McGraw-Hill, New York, 4th edition, 1987. [75](#)
- [8] P.J. DiNenno, editor. *SFPE Handbook of Fire Protection Engineering*. National Fire Protection Association, Quincy, Massachusetts, 3rd edition, 2002. [91](#)
- [9] Pamela P. Walatka and Pieter G. Buning. PLOT3D User's Manual, version 3.5. NASA Technical Memorandum 101067, NASA, 1989. [105](#)
- [10] G.W. Mulholland. *SFPE Handbook of Fire Protection Engineering*, chapter Smoke Production and Properties. National Fire Protection Association, Quincy, Massachusetts, 3rd edition, 2002. [108](#)
- [11] G.W. Mulholland and C. Croarkin. Specific Extinction Coefficient of Flame Generated Smoke. *Fire and Materials*, 24:227–230, 2000. [108](#)
- [12] M.L. Janssens and H.C. Tran. Data Reduction of Room Tests for Zone Model Validation. *Journal of Fire Science*, 10:528–555, 1992. [109](#)
- [13] Y.P. He, A. Fernando, and M.C. Luo. Determination of interface height from measured parameter profile in enclosure fire experiment. *Fire Safety Journal*, 31:19–38, 1998. [109](#)

- [14] S. Welsh and P. Rubini. Three-dimensional Simulation of a Fire-Resistance Furnace. In *Fire Safety Science – Proceedings of the Fifth International Symposium*. International Association for Fire Safety Science, 1997. 109
- [15] U. Wickstrom, D. Duthinh, and K.B. McGrattan. Adiabatic Surface Temperature for Calculating Heat Transfer to Fire Exposed Structures. In *Proceedings of the Eleventh International Interflam Conference*. Interscience Communications, London, 2007. 111
- [16] K.B. McGrattan, B.W. Klein, S. Hostikka, and J.E. Floyd. Fire Dynamics Simulator (Version 5), User's Guide. NIST Special Publication 1019-5, National Institute of Standards and Technology, Gaithersburg, Maryland, October 2007. 170

# Index

2D Calculations, [25](#)

ABSORPTION\_COEFFICIENT, [77](#)

atmospheric stratification, [50](#)

Axially-Symmetric Calculations, [25](#)

baroclinic torque, [34](#)

BNDF, [105](#)

    QUANTITY, [105](#)

boundary conditions, [45](#), [46](#)

boundary layer, [48](#)

CLIP, [37](#)

CO Production, [72](#)

Colors, [67](#)

Controls, [96](#)

    Create and Remove Obstructions, [94](#)

    Function List, [96](#)

    Using DEVC, [94](#)

CTRL, [96](#)

    DELAY, [97](#)

    FUNCTION\_TYPE, [96](#)

        ALL, [97](#)

        ANY, [97](#)

        AT\_LEAST, [97](#)

        CUSTOM, [98](#)

        DEADBAND, [97](#)

        KILL, [98](#)

        ONLY, [97](#)

        RESTART, [98](#)

        TIME\_DELAY, [97](#)

    ID, [96](#)

    INITIAL\_STATE, [97](#)

    INPUT\_ID, [96](#)

    LATCH, [96](#)

    N, [97](#)

    ON\_BOUND, [98](#)

    RAMP\_ID, [98](#)

    SETPOINT, [98](#)

DEVC, [87](#)

    BYPASS\_FLOWRATE, [93](#)

    DELAY, [93](#)

    FLOWRATE, [93](#)

    ID, [87](#)

    IOR, [88](#)

    ORIENTATION, [88](#)

    PROP\_ID, [87](#)

    QUANTITY, [88](#)

    XYZ, [87](#)

Device

    Aspiration Detector, [92](#)

    Beam Detector, [92](#)

    Heat Detector, [91](#)

    Smoke Detector, [91](#)

    Spray Nozzle, [90](#)

    Sprinkler, [88](#)

Download, [7](#)

dry-pipe sprinkler system, [99](#)

DUMP, [101](#)

    COLUMN\_DUMP\_LIMIT, [88](#)

DUMP:CHECK\_VOLUME\_FLOW, [34](#)

fan, [98](#)

fds2ascii, [114](#)

Features, [3](#)

    Recent Changes, [4](#)

Fire from Heat Release Rate, [46](#)

fixed surface temperature, [47](#)

gravity, [33](#)

HEAD, [23](#)

    CHID, [23](#)

    TITLE, [23](#)

HOLE, [41](#)

    COLOR, [41](#)

    CTRL\_ID, [41](#), [135](#)

    DEVC\_ID, [41](#)

- RGB, [41](#)
  - TRANSPARENCY, [41](#)
  - XB, [41](#)
- HRRPUA, [46](#)
- HVAC, [35](#), [96–98](#)
- INIT, [37](#)
- initial solid temperature, [63](#)
- Input File
  - Overview, [19](#)
- ISOF, [105](#)
- Large Eddy Simulation, [35](#)
- Liquid Fuels, [61](#)
- louver, [49](#)
- Mass Flux, [47](#)
- Material layers, [56](#)
- MATL, [56](#)
  - A, [57](#)
  - ABSORPTION\_COEFFICIENT, [57](#)
  - BOILING\_TEMPERATURE, [61](#)
  - CONDUCTIVITY, [57](#)
  - DENSITY, [57](#)
  - E, [57](#)
  - EMISSIVITY, [57](#)
  - HEAT\_OF\_COMBUSTION, [59](#)
  - HEAT\_OF\_REACTION, [59](#)
  - N\_S, [57](#)
  - N\_T, [59](#)
  - NU\_FUEL, [57](#)
  - NU\_GAS, [61](#)
  - NU\_RESIDUE, [57](#)
  - NU\_WATER, [57](#)
  - REFERENCE\_RATE, [59](#)
  - REFERENCE\_TEMPERATURE, [59](#)
  - RESIDUE, [57](#)
  - SPECIFIC\_HEAT, [57](#)
  - THRESHOLD\_TEMPERATURE, [59](#)
- MB - Mesh Boundary, [42](#)
- MESH, [25](#)
  - IJK, [25](#)
  - SYNCHRONIZE, [27](#)
  - XB, [25](#)
- mesh dimensions, [31](#)
- MISC, [32](#)
  - GROUND\_LEVEL, [50](#)
  - RADIATION, [77](#)
- MISC:PRESSURE\_CORRECTION, [34](#)

- MLRPUA, [46](#)
- multi-mesh efficiency, [29](#)
- Multiple Meshes, [26](#)
- Namelist Group, [19](#)
- Namelist Groups Table, [22](#)
- Navier-Stokes, [3](#)
- non-planar geometries, [51](#)
- OBST, [39](#)
  - CTRL\_ID, [135](#)
  - PERMIT\_HOLE, [42](#)
- outdoor fires, [50](#)
- Output, [101](#)
  - Adiabatic Surface Temperature, [110](#)
  - Boundary File, [105](#)
  - fds2ascii, [114](#)
  - Integrated Measurements, [103](#)
  - Isosurface File, [105](#)
  - Material Components, [111](#)
  - Plot3D, [105](#)
  - Point Measurements, [103](#)
  - Slice File, [104](#)
  - Smoke and Fire, [106](#)
  - Statistics, [111](#)
  - Summary of Quantities, [115](#)
- Output Files
  - .out, [12](#)
  - .stop, [12](#)
  - \_devc.csv, [88](#)
  - \_hrr.csv, [107](#)
- PART, [79](#)
  - DROPLETS\_PER\_SECOND, [80](#)
- Poisson initialization, [15](#)
- POROUS\_FLOOR
  - output issues, [110](#)
- pre-action sprinkler system, [99](#)
- pressure leakage, [53](#)
- PROF, [104](#)
  - IOR, [104](#)
  - QUANTITY, [104](#)
  - XYZ, [104](#)
- PROP, [88](#)
- Pyrolysis models, [57](#)
- RADI, [77](#)
  - ANGLE\_INCRMENT, [77](#)
  - CH4\_BANDS, [77](#)

- KAPPA0, 77
- NMIEANG, 77
- NUMBER\_RADIATION\_ANGLES, 77
- RADIATIVE\_FRACTION, 77
- RADTMP, 77
- TIME\_STEP\_INCREMENT, 77
- WIDE\_BAND\_MODEL, 77
- radial fire spread, 51
- RAMP, 64
- REAC, 69
- Restart, 33
- Running FDS, 9
  - Parallel, 10
    - LAM-MPI, 12
    - MPICH2, 11
  - Serial, 9
- Sawtooth, 40
- SLCF, 104
  - PBX,PBY,PBZ, 104
  - VECTOR, 104
- Sloped Ceilings, 40
- Solid fuels, 57
- SPEC, 74
- Spray Pattern, 90
- sprinkler, 88, 97
  - Spray Pattern, 90
- Sprinkler Suppression, 84
- stack effect, 35, 37
- Support, 13
  - Error Statements, 14
    - Inadequate Resources, 14
    - Input File, 14
    - Numerical Instability, 14
    - Poisson, 15
    - READONLY, 15
    - Run-Time, 15
  - Issue Reporting, 15
  - Version Number, 13
- SURF, 46
  - ADIABATIC, 46, 47
  - BACKING, 47
  - BURN\_AWAY, 62
  - CELL\_SIZE\_FACTOR, 63
  - COLOR, 67
  - CONVECTIVE\_HEAT\_FLUX, 47
  - DUCT\_PATH, 55
  - E\_COEFFICIENT, 84

- EMISSIVITY, 47
- EXTERNAL\_FLUX, 161
- GEOMETRY, 51
- HEAT\_OF\_VAPORIZATION, 60
- HRRPUA, 51, 60
- IGNITION\_TEMPERATURE, 60
- LEAK\_PATH, 53
- MASS\_FLUX, 49
- MASS\_FLUX\_TOTAL, 48
- MASS\_FRACTION, 49, 65
- MATL\_ID, 56
- MATL\_MASS\_FRACTION, 56
- MAX\_PRESSURE, 54
- NPPC, 80
- PART\_ID, 80
- PARTICLE\_MASS\_FLUX, 80
- PLE, 50
- POROUS, 49, 55
- PROFILE, 50
- RAMP\_MF, 65
- RAMP\_Q, 51, 60, 64
- RAMP\_T, 64
- RAMP\_V, 64
- RGB, 67
- SHRINK, 62
- SLIP\_FACTOR, 48
- STRETCH\_FACTOR, 63
- TAU\_MF, 65
- TEXTURE\_HEIGHT, 67
- TEXTURE\_MAP, 67
- TEXTURE\_WIDTH, 67
- THICKNESS, 56
- THICKNESS, 46
- TMP\_BACK, 63
- TMP\_FRONT, 47
- TMP\_INNER, 63
- VEL, 47
- VOLUME\_FLUX, 47
- Z0, 50
- Surface Texture Maps, 67
- System Requirements
  - Hardware, 7
  - MPI, 8
  - Operating System, 8
- TABL, 64
- TAIL, 20
- tangential velocity, 48

- thermostat, [97](#)
- TIME, [23](#)
  - DT, [24](#)
  - SYNCHRONIZE, [24](#)
  - T\_BEGIN, [23](#)
  - T\_END, [23](#)
  - WALL\_INCREMENT, [63](#), [161](#)
- TRNX,TRNY,TRNZ, [25](#), [29](#)
  - CC, [30](#)
  - PC, [30](#)
- Troubleshooting
  - VENT Orientation, [44](#)
- VENT, [42](#)
  - CTRL\_ID, [135](#)
  - DYNAMIC\_PRESSURE, [50](#)
  - PRESSURE\_RAMP, [50](#)
- Volume Flux, [47](#)
- ZONE, [53](#)