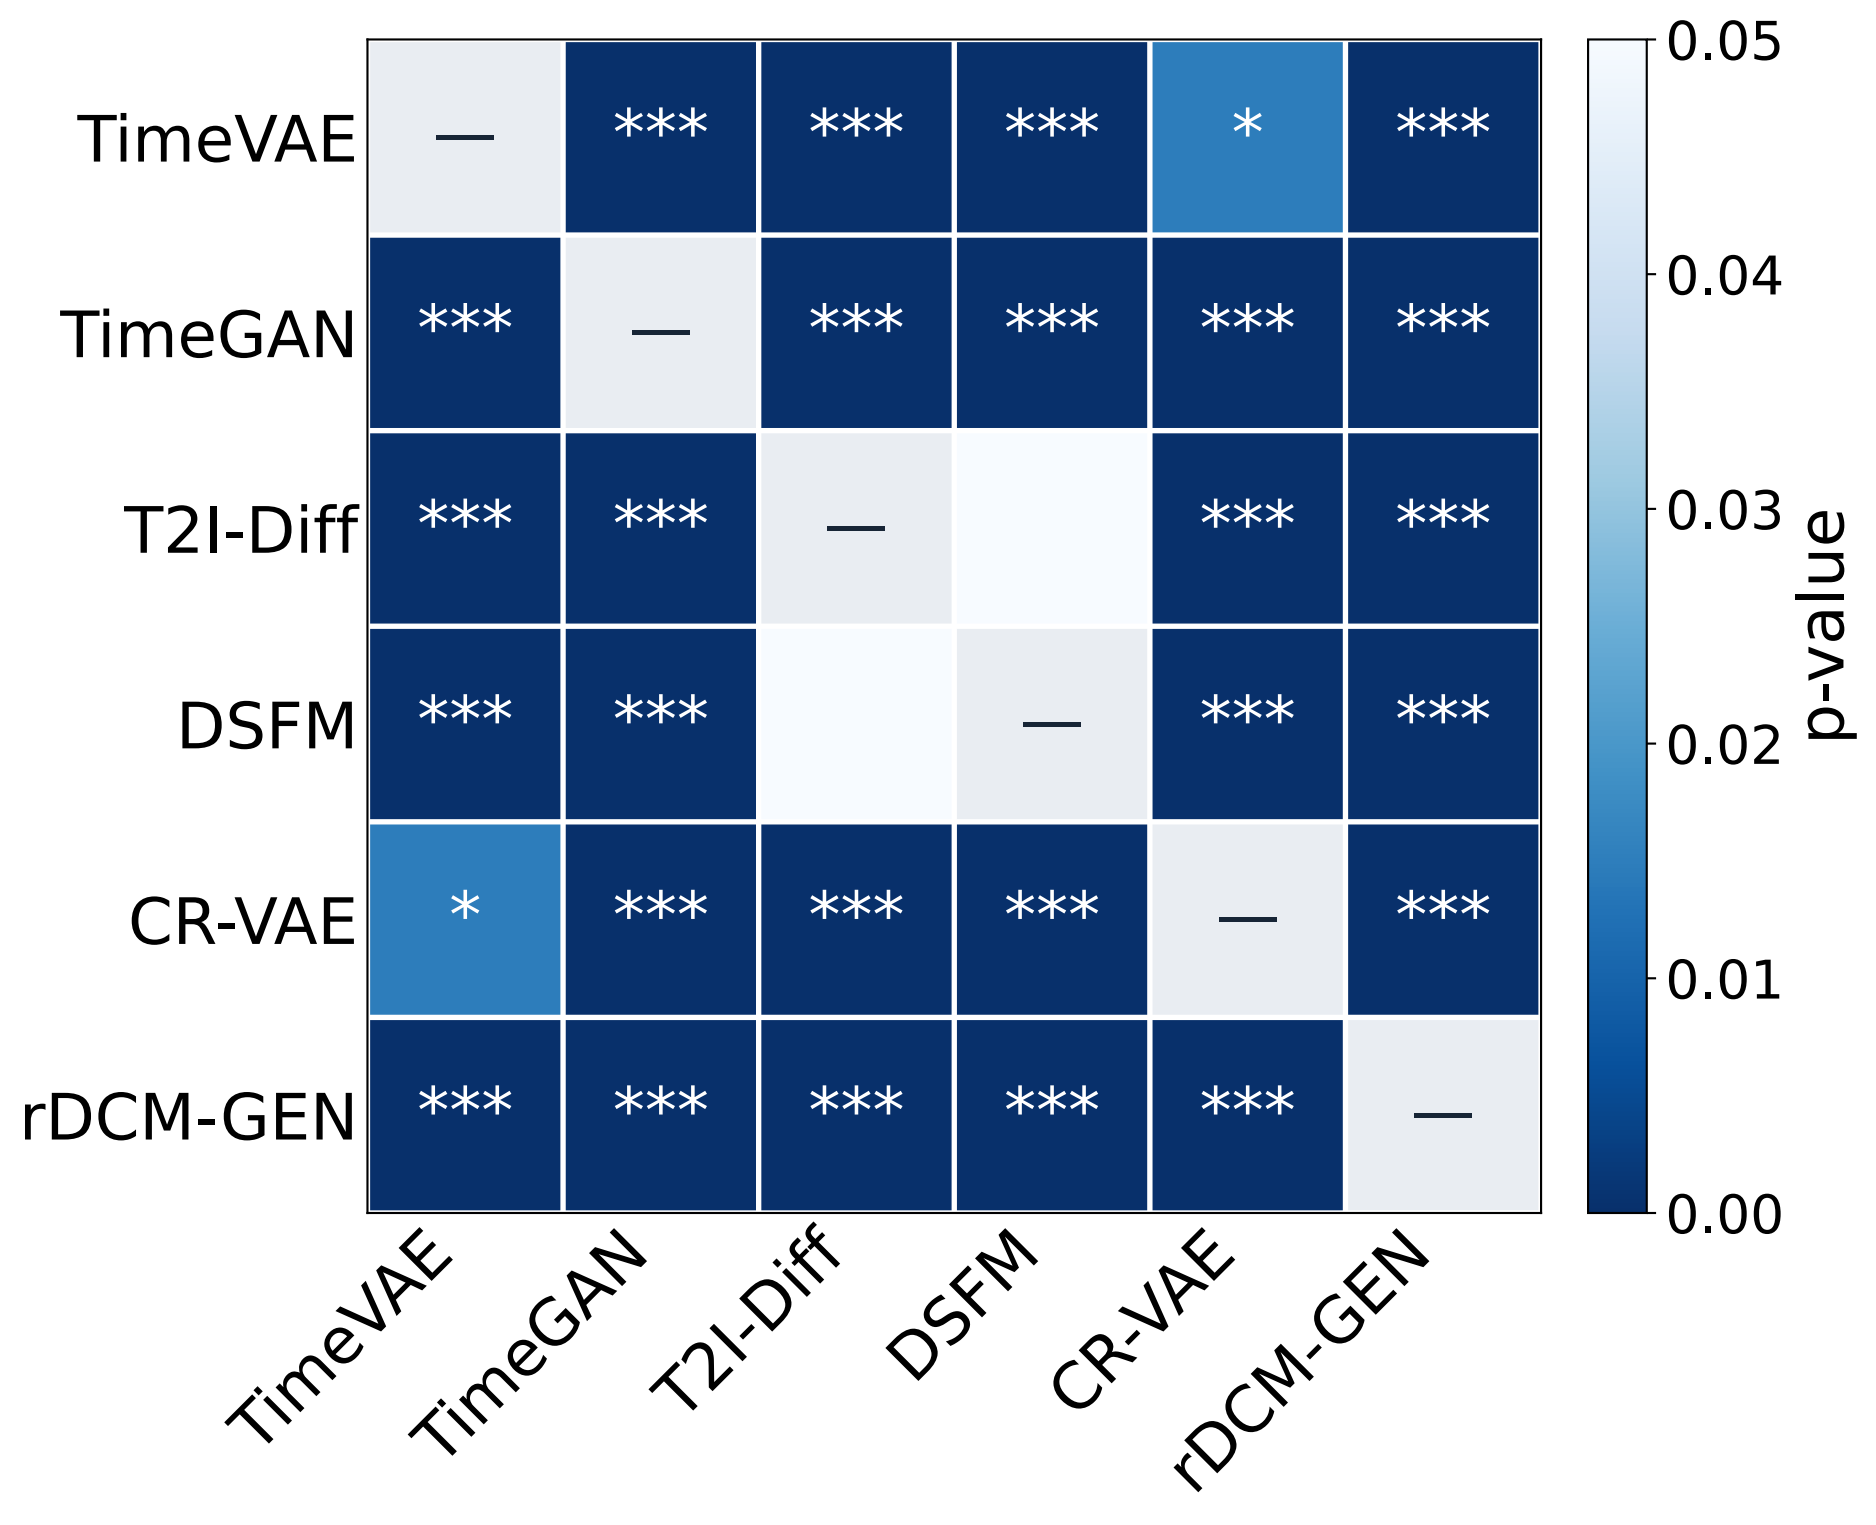
TimeVAE
TimeGAN
T2I-Diff
DSFM
CR-VAE
rDCM-GEN
—
***
***
***
*
***
***
—
***
***
***
***
***
***
***
—
***
***
***
***
***
***
***
—
***
***
*
***
***
—
***
***
***
***
***
—
TimeVAE
TimeGAN
T2I-Diff
DSFM
CR-VAE
rDCM-GEN
0.05
0.04
0.03
0.02
0.01
0.00
p-value