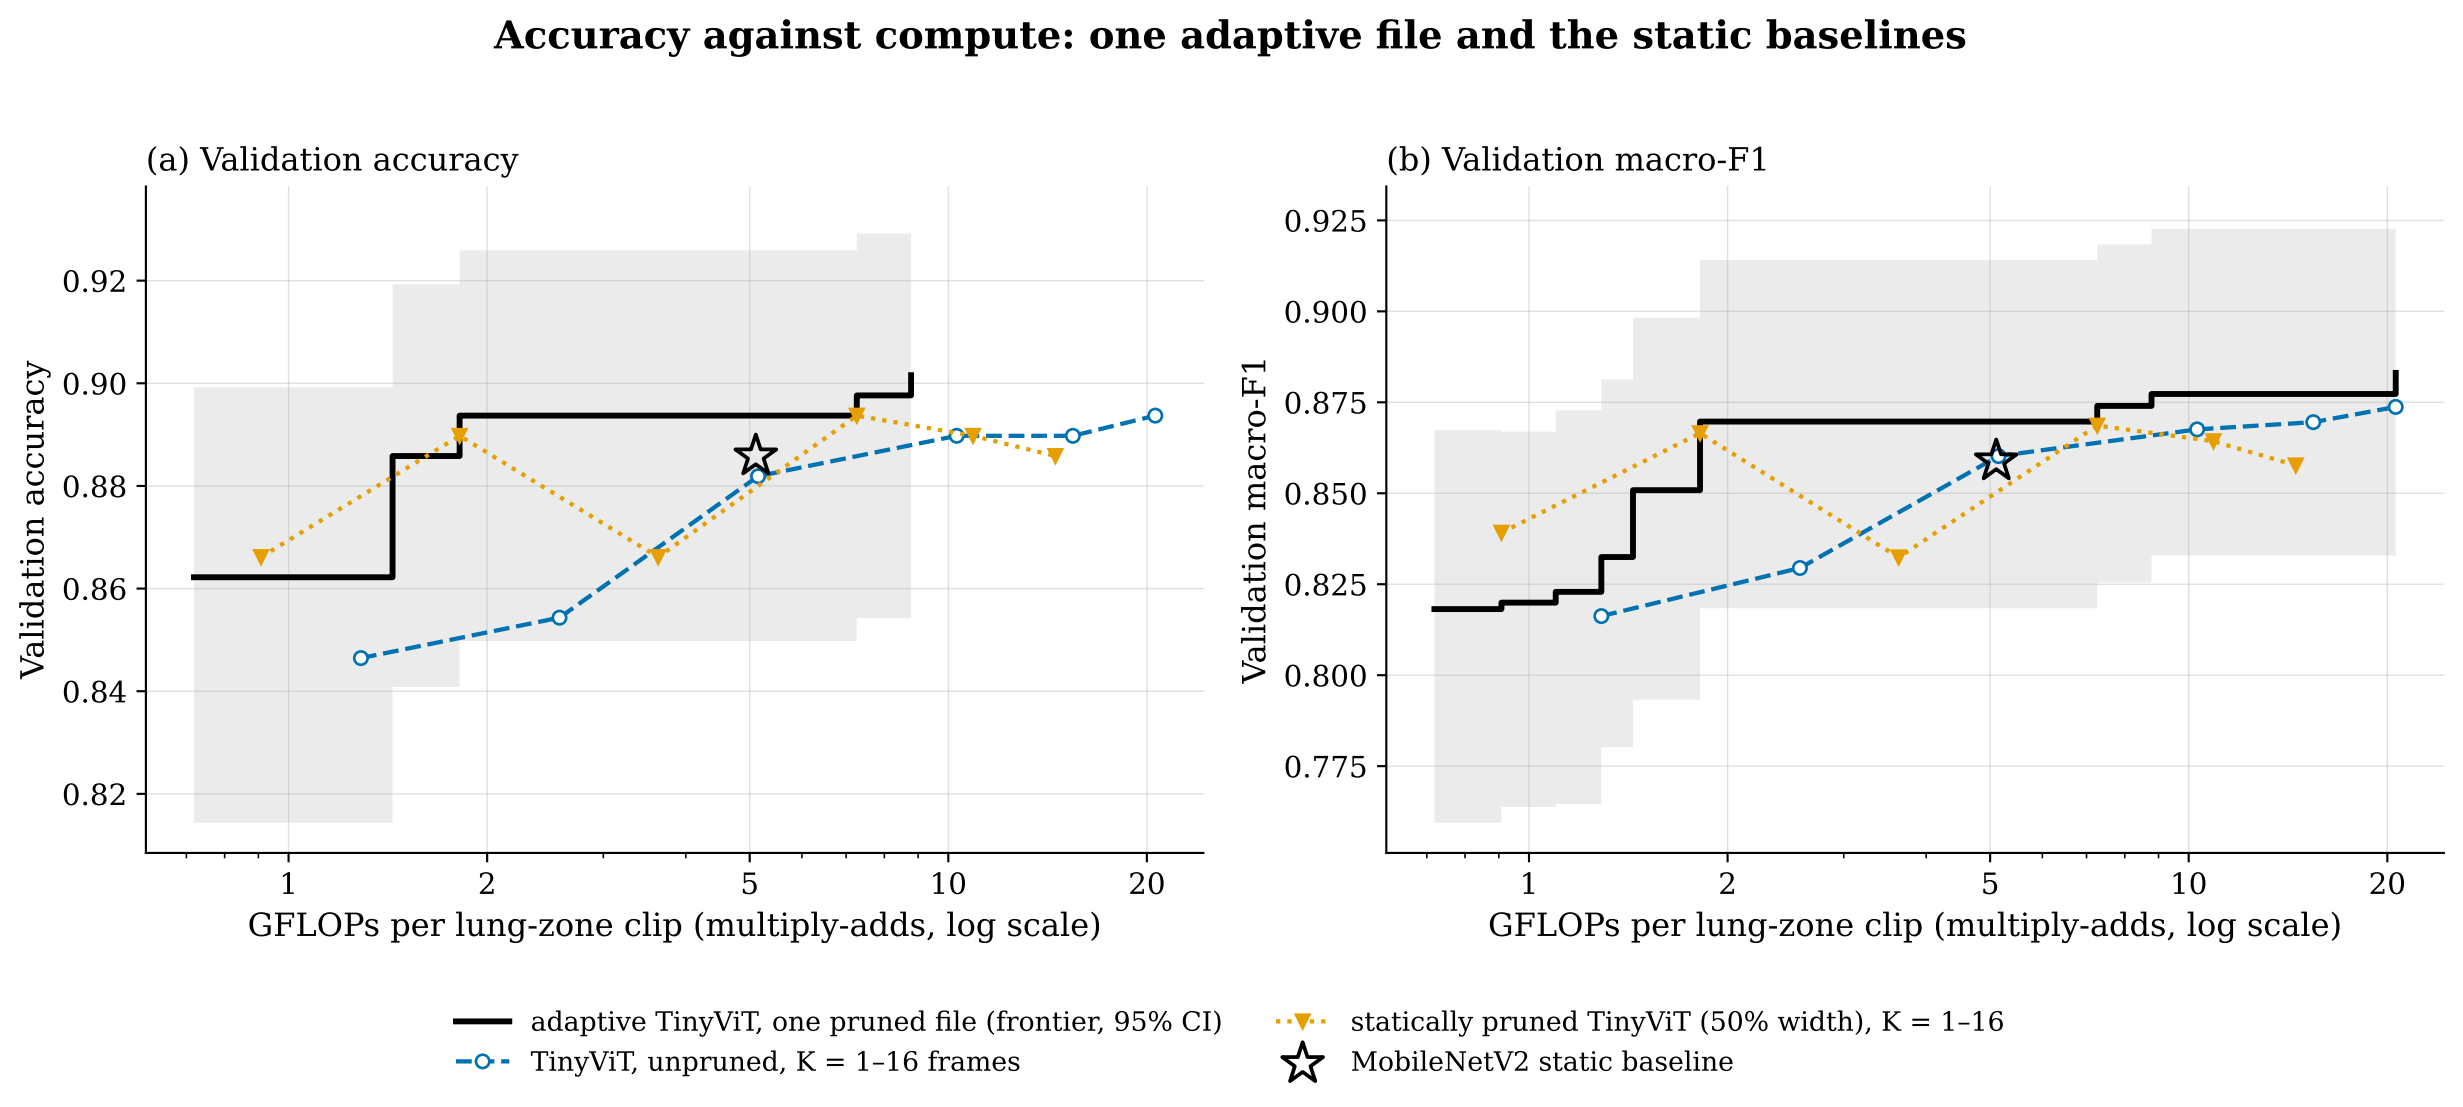
Accuracy against compute: one adaptive file and the static baselines
(a) Validation accuracy
Validation accuracy
0.92
0.90
0.88
0.86
0.84
0.82
1
2
5
10
20
GFLOPs per lung-zone clip (multiply-adds, log scale)
(b) Validation macro-F1
Validation macro-F1
0.925
0.900
0.875
0.850
0.825
0.800
0.775
1
2
5
10
20
GFLOPs per lung-zone clip (multiply-adds, log scale)
adaptive TinyViT, one pruned file (frontier, 95% CI)
statically pruned TinyViT (50% width), K = 1–16
TinyViT, unpruned, K = 1–16 frames
MobileNetV2 static baseline