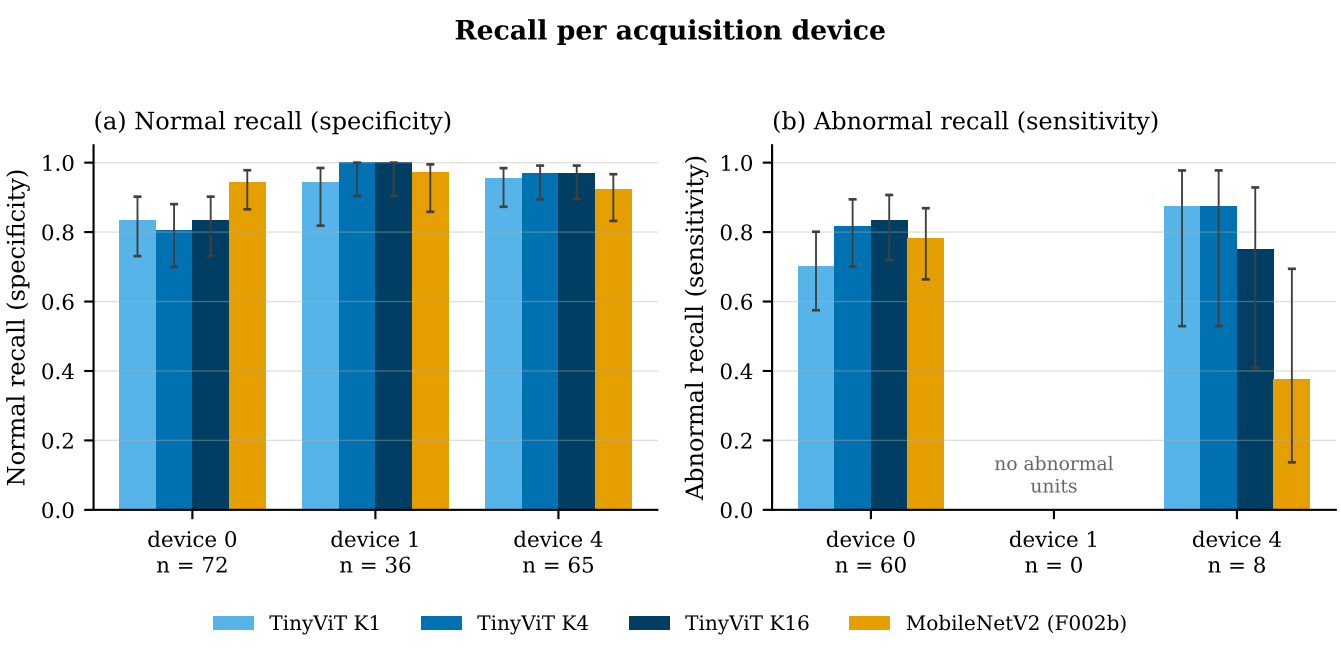
Recall per acquisition device
(a) Normal recall (specificity)
Normal recall (specificity)
1.0
0.8
0.6
0.4
0.2
0.0
device 0
n = 72
device 1
n = 36
device 4
n = 65
(b) Abnormal recall (sensitivity)
Abnormal recall (sensitivity)
no abnormal
units
device 0
n = 60
device 1
n = 0
device 4
n = 8
TinyViT K1
TinyViT K4
TinyViT K16
MobileNetV2 (F002b)