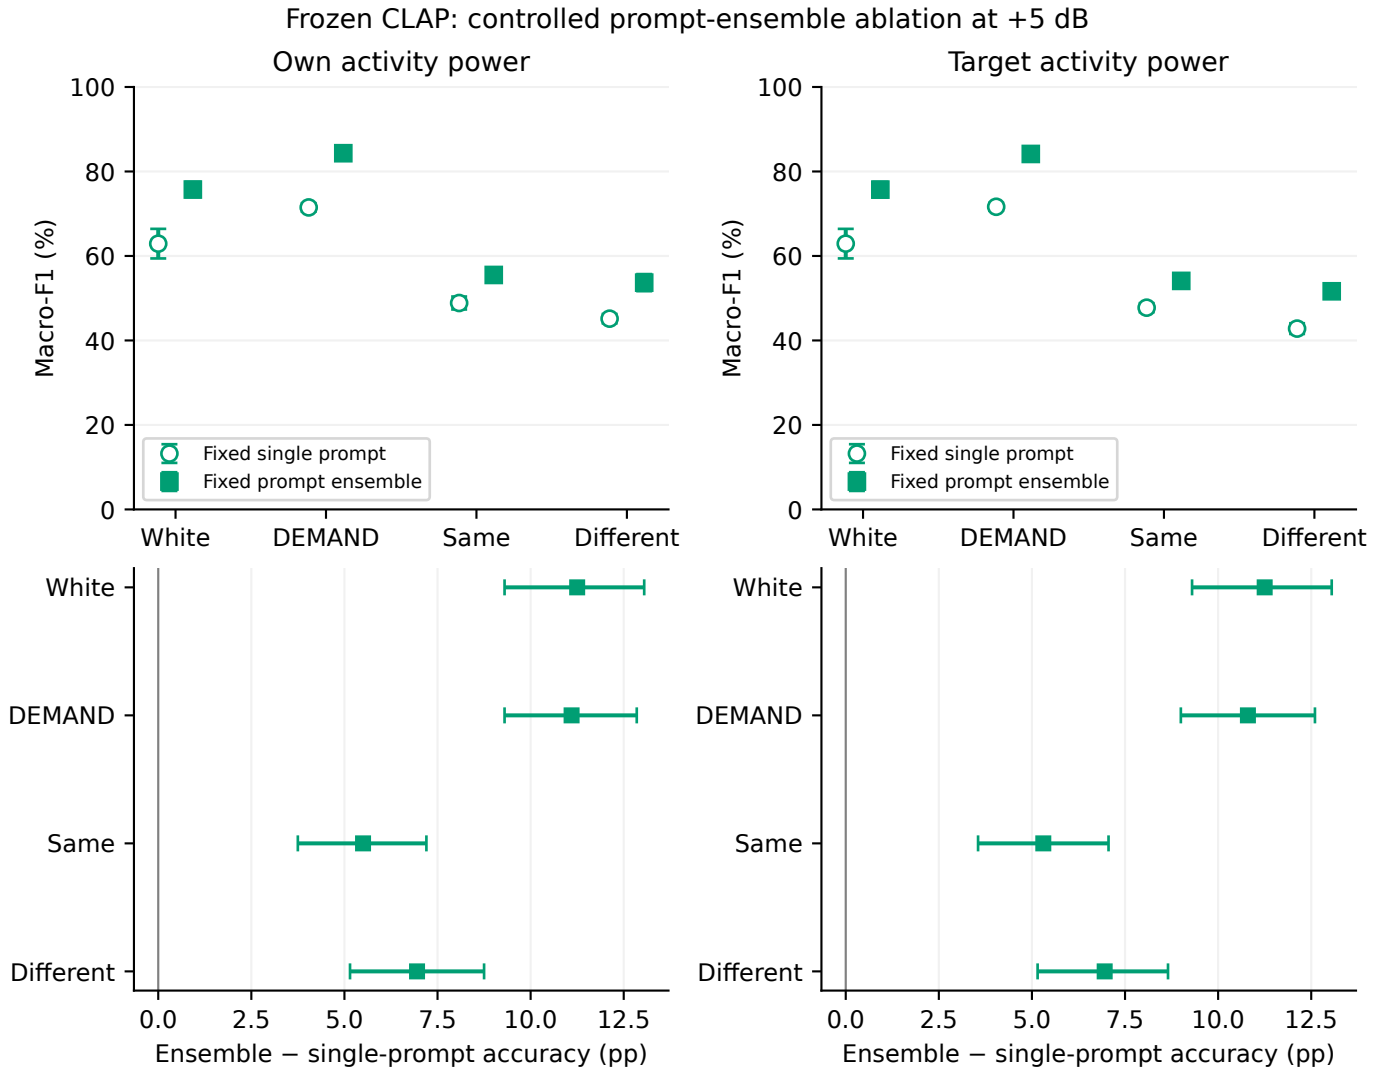
Frozen CLAP: controlled prompt-ensemble ablation at +5 dB
Own activity power
Target activity power
Macro-F1 (%)
100
80
60
40
20
0
Fixed single prompt
Fixed prompt ensemble
White
DEMAND
Same
Different
0.0
2.5
5.0
7.5
10.0
12.5
Ensemble − single-prompt accuracy (pp)