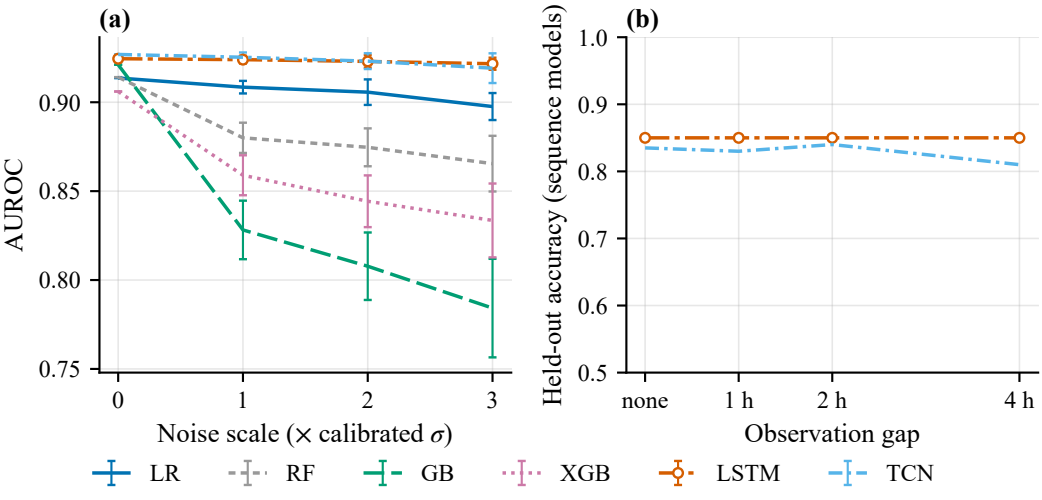
(a)
AUROC
0.90
0.85
0.80
0.75
0
1
2
3
Noise scale (× calibrated σ)
(b)
Held-out accuracy (sequence models)
1.0
0.9
0.8
0.7
0.6
0.5
none
1 h
2 h
4 h
Observation gap
LR
RF
GB
XGB
LSTM
TCN