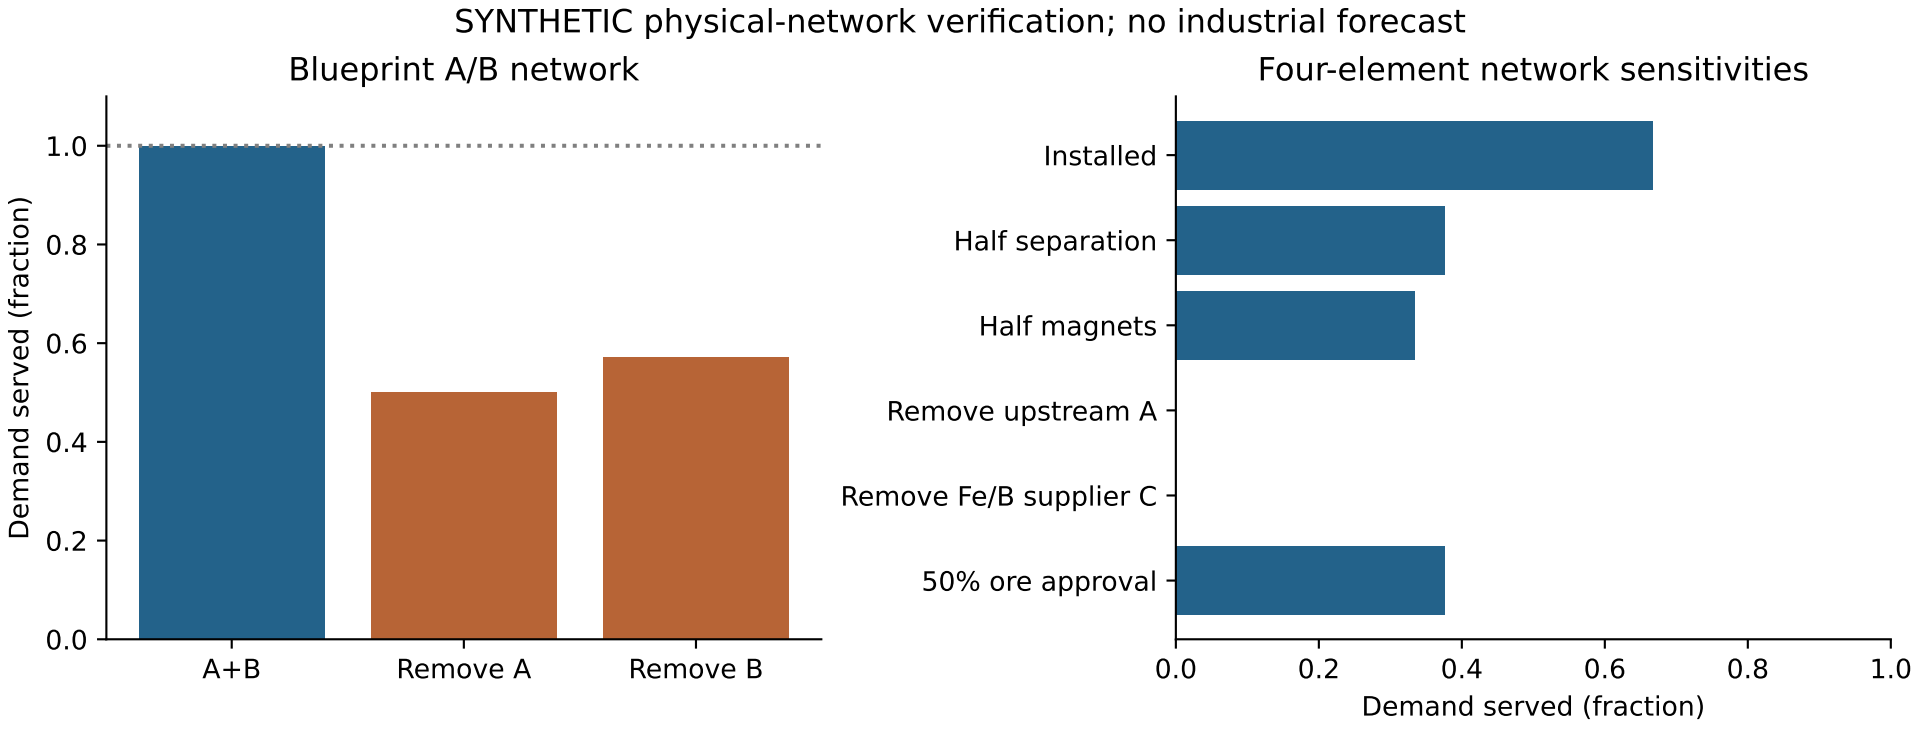
SYNTHETIC physical-network verification; no industrial forecast
Blueprint A/B network
Demand served (fraction)
1.0
0.8
0.6
0.4
0.2
0.0
A+B
Remove A
Remove B
Four-element network sensitivities
Installed
Half separation
Half magnets
Remove upstream A
Remove Fe/B supplier C
50% ore approval
0.0
0.2
0.4
0.6
0.8
1.0
Demand served (fraction)