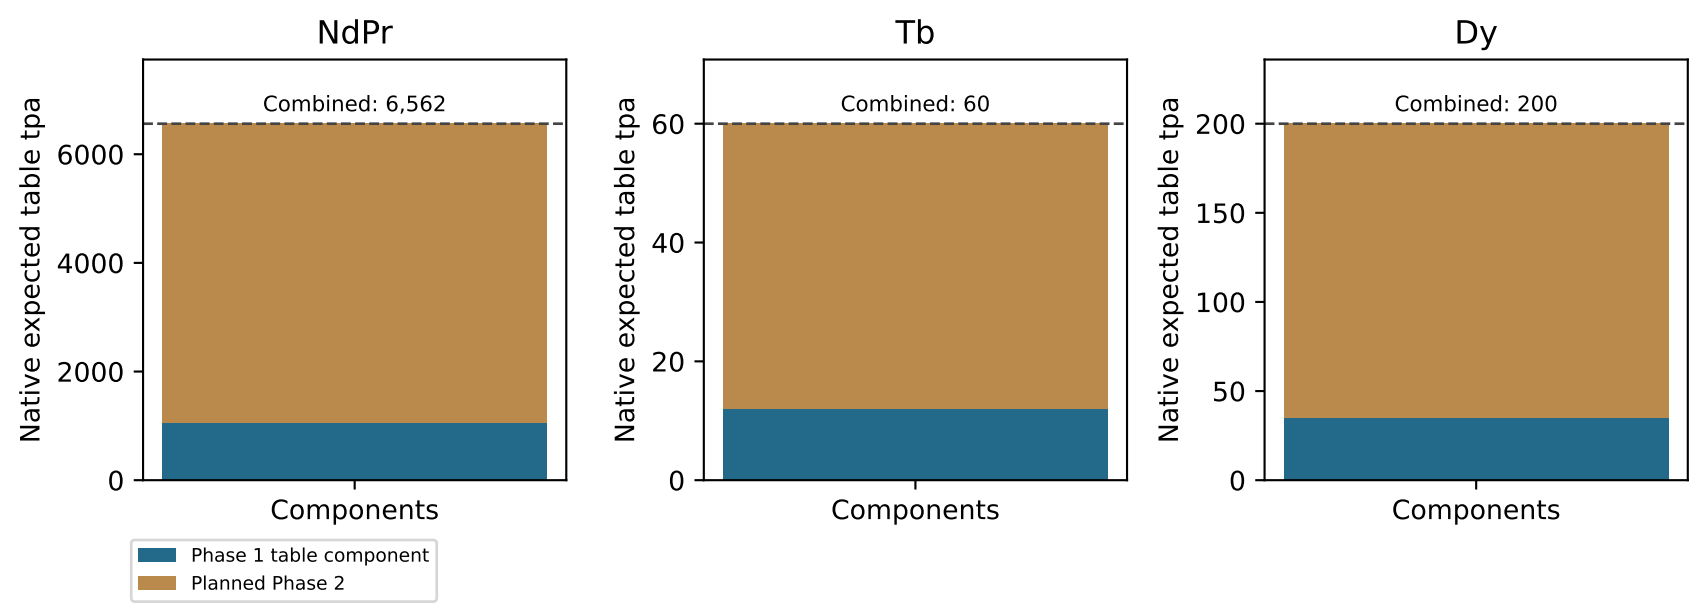

Conditional issuer capacity table, not observed throughput. Phase 1 HREE additions are planned;
its existing NdPr label does not verify the expected rate. Combined totals are not added again; product panels are not summed.