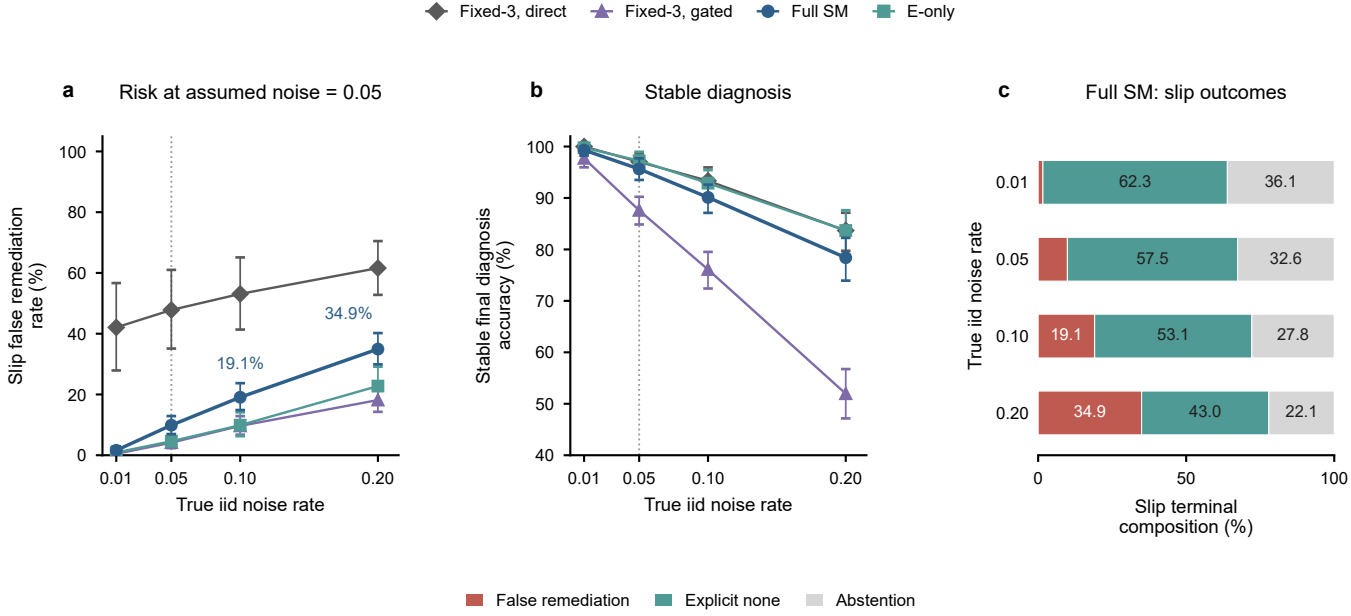
Fixed-3, direct
Fixed-3, gated
Full SM
E-only
a
Risk at assumed noise = 0.05
Slip false remediation rate (%)
True iid noise rate
34.9%
19.1%
b
Stable diagnosis
Stable final diagnosis accuracy (%)
True iid noise rate
c
Full SM: slip outcomes
True iid noise rate
0.01
0.05
0.10
0.20
62.3
36.1
57.5
32.6
19.1
53.1
27.8
34.9
43.0
22.1
Slip terminal composition (%)
False remediation
Explicit none
Abstention