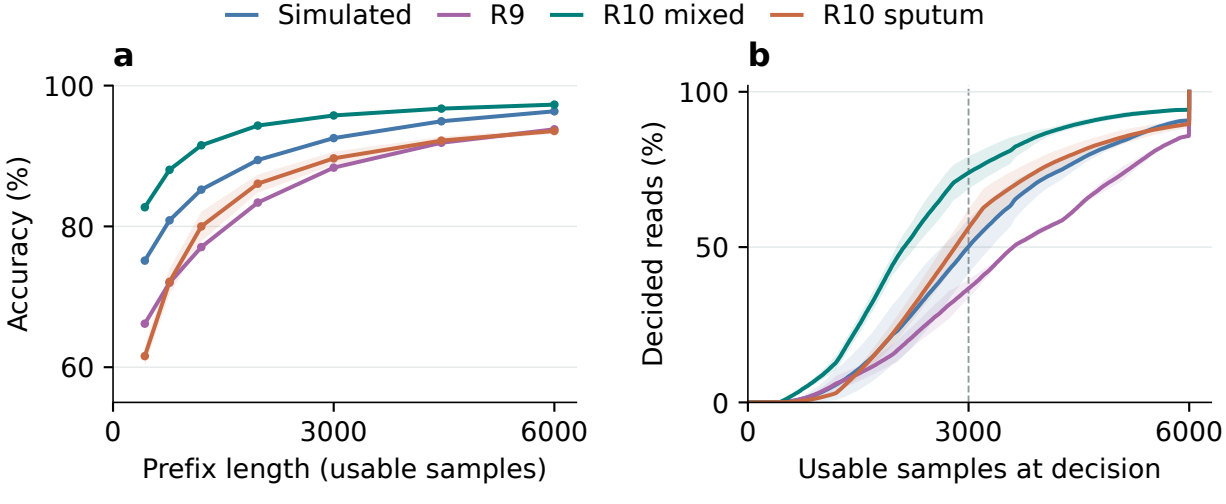

Simulated
R9
R10 mixed
R10 sputum
a
Accuracy (%)
100
80
60
0
3000
6000
Prefix length (usable samples)
b
Decided reads (%)
100
50
0
0
3000
6000
Usable samples at decision