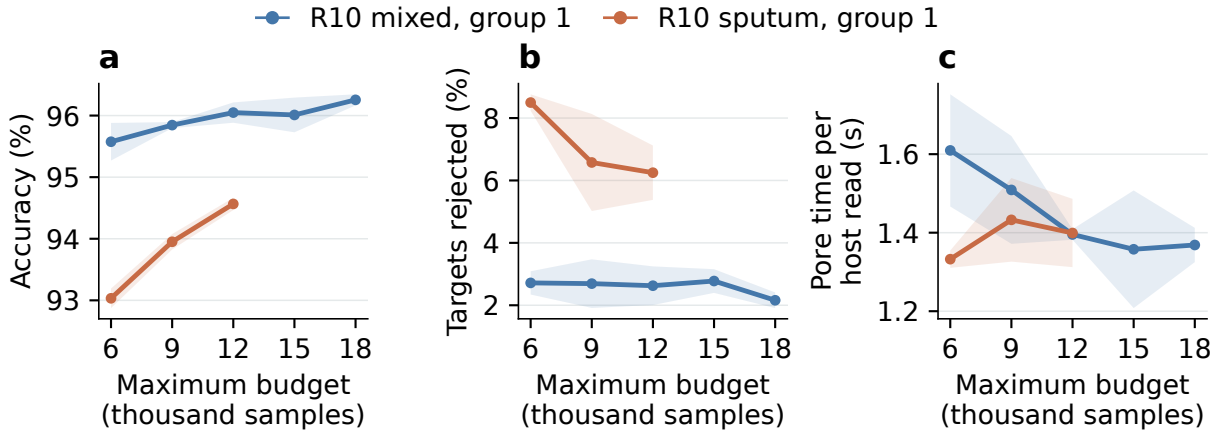
R10 mixed, group 1
R10 sputum, group 1
a
Accuracy (%)
96
95
94
93
6
9
12
15
18
Maximum budget
(thousand samples)
b
Targets rejected (%)
8
6
4
2
6
9
12
15
18
Maximum budget
(thousand samples)
c
Pore time per
host read (s)
1.6
1.4
1.2
6
9
12
15
18
Maximum budget
(thousand samples)