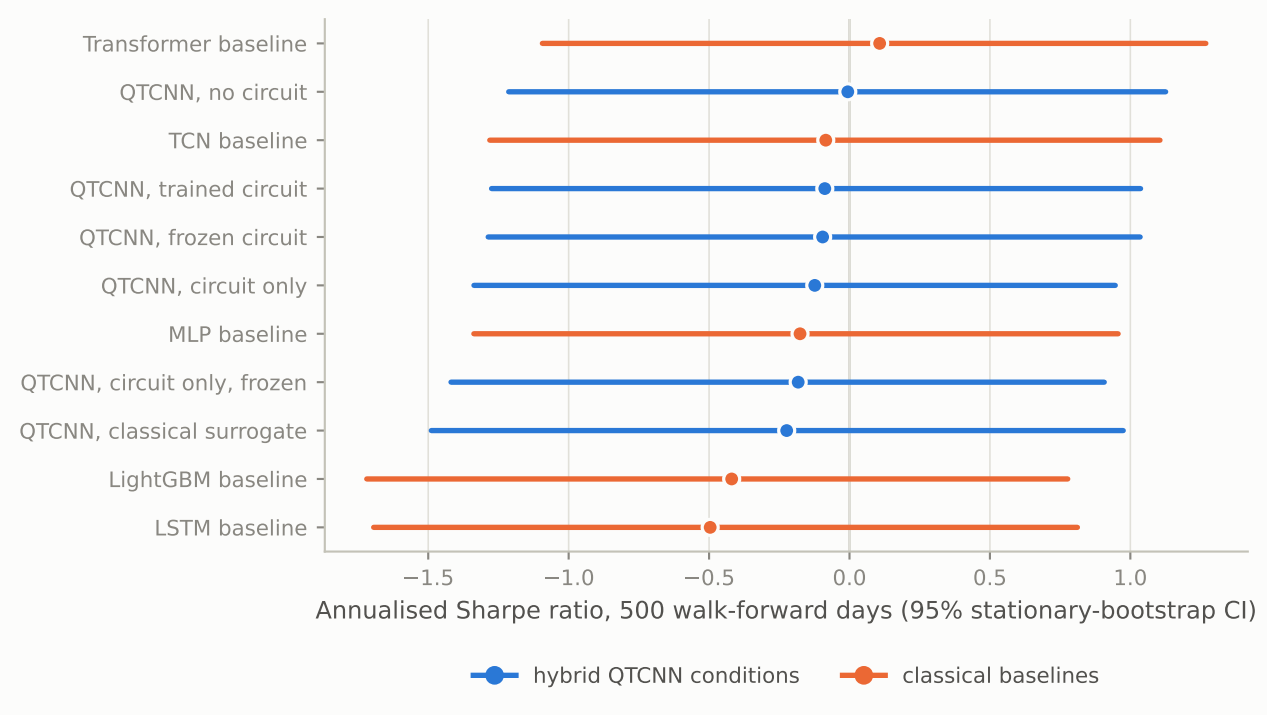
Transformer baseline
QTCNN, no circuit
TCN baseline
QTCNN, trained circuit
QTCNN, frozen circuit
QTCNN, circuit only
MLP baseline
QTCNN, circuit only, frozen
QTCNN, classical surrogate
LightGBM baseline
LSTM baseline
−1.5
−1.0
−0.5
0.0
0.5
1.0
Annualised Sharpe ratio, 500 walk-forward days (95% stationary-bootstrap CI)
hybrid QTCNN conditions
classical baselines