

Enclosure fire dynamics with a cross-laminated timber ceiling

Robert McNamee¹  | Jochen Zehfuss² | Alastair I. Bartlett³  |
 Mohammad Heidari⁴  | Fabienne Robert⁴ | Luke A. Bisby³

¹Brandskyddslaget AB, Stockholm, Sweden

²The Institute of Building Materials, Concrete Constructions and Fire Safety, Technische Universität Braunschweig (iBMB), Braunschweig, Germany

³School of Engineering, The University of Edinburgh, Edinburgh, UK

⁴CERIB Fire Testing Centre, Epernon, France

Correspondence

Robert McNamee, Brandskyddslaget AB, Stockholm, Sweden.
 Email: robert.mcnamee@brandskyddslaget.se

Summary

An experimental study of the influence of an exposed combustible ceiling on compartment fire dynamics has been performed. The fire dynamics in compartments with combustible cross-laminated timber ceilings vs non-combustible reinforced concrete ceilings in otherwise identical compartments with three different ventilation factors were investigated. The experimental results are compared against predictions from two theoretical models for compartment fire dynamics: (a) the parametric fire model given in EN 1991-1-2, and (b) a model developed at Technische Universität Braunschweig, which are the parametric fire models currently used in Germany. It is confirmed that the introduction of a combustible timber ceiling leads to higher temperatures within the enclosure, both under fuel-controlled and ventilation-controlled scenarios. It is also demonstrated that the theoretical models considered in this article require refinement in order to adequately represent all relevant scenarios when combustible ceilings are present. A refinement of the German model, by adding the fuel from the combustible ceiling to the occupancy fuel load, was shown to not adequately capture the response for the ventilation-controlled fires.

KEYWORDS

cross-laminated timber, fire dynamics, parametric fire models

1 | INTRODUCTION

The 'Epernon Fire Test Programme' is an experimental campaign aimed at studying the fire dynamics and structural response of compartments with ceilings consisting of two types of loaded one-way spanning slabs in different standard and compartment (ie, 'natural') fire exposures: (a) those made from exposed (ie, unencapsulated) cross-laminated timber (CLT), and (b) those made from exposed reinforced concrete. These two types of slabs were tested both in standard fire resistance (ie, furnace) tests, and in compartment fire experiments with timber crib fuel loads and different opening factors at the CERIB testing facility in Epernon, France. This article focuses on the variations in fire dynamics observed when the natural fire compartments had ceilings made from CLT, and compares the experimental data against both theoretical calculations and notionally identical experiments performed with concrete ceilings.

The common reference for fire exposure during fire resistance testing internationally is a standard cellulosic fire time-temperature curve¹; however, this is strictly only a reference fire exposure; real fires may be less or more severe than the standard exposure, and may have lesser or greater rates of heating (or decay). Real fires also include a decay phase, which is only very rarely considered in fire resistance testing in furnaces. The standard cellulosic temperature vs time curve was first defined a century ago by the American Society for Testing and Materials (ASTM). At that time, knowledge regarding fire dynamics in building enclosures was extremely limited, since few real fire dynamics experiments had been performed.² Ingberg later undertook seminal research in this area and developed the equal area concept to suggest an 'equivalency' between real burnout fires and a duration of standard fire exposure.³ Ingberg's equivalency concept suggested that the severity of two fires could be assessed as equal if the area under the time-temperature curve above a certain reference temperature was equal for both the real and standard fire gas-phase

temperature vs time curves. This equal area concept can, of course, be criticised on a number of grounds, for instance, because different materials and cross sections respond differently to changes in thermal exposure, that is, this type of transformation includes a material dependence that is not properly accounted for. Several alternative approaches to this time equivalence approach have subsequently been developed.⁴⁻⁶ For instance, the method for time equivalence in Eurocode 1 Annex F⁷ is based on the work by Schneider using the MRFC (Multi-Room-Fire-Code) computer program developed at the University of Kassel.^{8,9} This method is, by its nature, material dependent, and is not strictly applicable to composite steel and concrete or timber construction.

The primary factors influencing temperature development in fully developed fires in non-combustible enclosures are the fuel load (quantity and geometry), total size of the openings, the geometry of the compartment and its openings, and the thermal properties of the enclosure boundaries. Early models for fully developed fires, including these important factors, were developed around, both, 1963 by Ödeen^{10,11} and by Kawagoe.¹² During the 1960s, Ödeen's model was further developed and validated against a set of experiments and by using computer calculations, resulting in the well-known 'Swedish fire curves'.¹³ These curves were subsequently parameterised by Wickström¹⁴ and later included in EN 1991-1-2 with some further modifications. The Eurocode parametric fire curves, which assume uniform gas-phase temperature, are generally considered valid for compartments with floor areas up to 500 m² and ceilings up to 4 m in height. The current article compares experimental results from the Epernon fire test series against the Eurocode parametric fire model,⁷ and also against a more recently developed Technische Universität Braunschweig (iBMB) parametric model.

The iBMB parametric fire model¹⁵ is a natural fire model, which is more directly connected to the heat release rate in a fire. The model, defined in the national annex of the German Eurocode,¹⁶ is considered by its developers to be valid for floor areas up to 400 m² and ceilings up to 5 m in height. It describes the gas-phase temperature-time curve in the growth, fully developed, and decay phases of a compartment fire. The qualitative shapes of the heat release rate (HRR) from the Eurocode and the temperature-time curve from the iBMB

model are shown in Figure 1, where a temporal link between the two is evident.

The iBMB parametric fire curves^{15,16} can be divided into three sections based on the HRR from the Eurocode (Figure 1 shows the development of gas-phase temperature and HRR). From the beginning of the fire until time, t_1 , the temperature increases rapidly (representing the growth phase). At t_1 , the maximum of the HRR is achieved, and it remains constant until time t_2 (representing the fully developed phase). After t_1 , the temperature increases more moderately. As 70% of the fire load is expected to be consumed at time t_2 , the HRR is assumed to drop off linearly (representing the decay phase) and the temperatures decrease. At time t_3 , the fire load is assumed to be totally consumed and the HRR is thus zero. At this time, the temperature-time curve changes in slope and is assumed to decay more gradually. To fully describe the temperature-time curve, the associated characteristic temperatures θ_1 , θ_2 , and θ_3 have to be determined (Figure 1). The HRR depends on the ventilation conditions, and a distinction must be made between ventilation-controlled fires and fuel-controlled fires. The iBMB model is presented in detail by Zehfuss and Hosser¹⁵; it is based on the HRRs suggested in Annex E of the Eurocode,⁷ along with a best-fit of results from parametric studies,¹⁵ using the zone model, CFAST.

For ventilation-controlled fires in residential and office buildings, the maximum HRR inside the compartment is assumed, based on Zehfuss and Hosser,¹⁵ with $H_u = 17.3$ MJ/kg and $\chi = 0.7$, as:

$$\dot{Q}_{max,v} = 1.21 A_w \sqrt{h_w} \text{ (MW)}. \quad (1)$$

For fuel-controlled fires in residential and office buildings, the maximum HRR is assumed, according to EN 1991-1-2 Table E.5, as:

$$\dot{Q}_{max,f} = 0.25 A_f \text{ (MW)}. \quad (2)$$

For ventilation-controlled fires, the characteristic temperature values for a reference fire load density, $q = 1300$ MJ/m², are assumed based on a regression analysis of the CFAST zone model calculations¹⁵ as:

$$\theta_1 = -8.75 \cdot 1/O - 0.1b + 1175 \text{ (}^\circ\text{C)}, \quad (3)$$

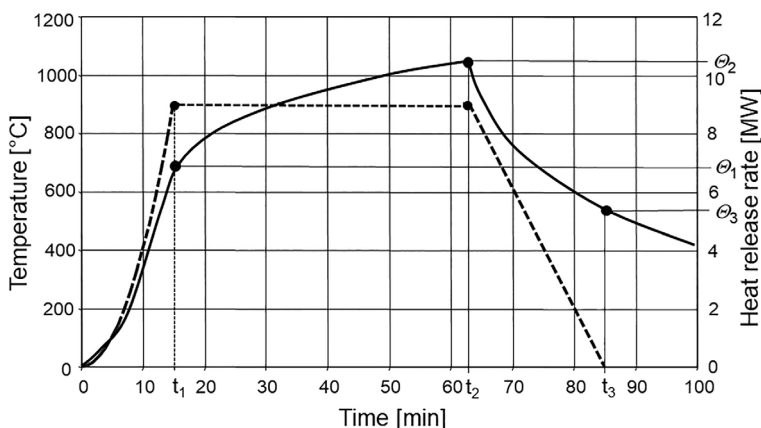


FIGURE 1 Temperature development in the simplified iBMB fire model (solid line) and the heat release rate (dashed line) from the Eurocode (principle)

$$\theta_2 = (0.004b - 17) \cdot 1/O - 0.4b + 2175 (^{\circ}\text{C}), \quad (4)$$

$$\theta_3 = -5.0 \cdot 1/O - 0.16b + 1060 (^{\circ}\text{C}), \quad (5)$$

with:

opening factor $O = A_w \sqrt{h_w} / A_t$ ($\text{m}^{1/2}$),

area of ventilation openings A_w (m^2),

averaged height of ventilation openings h_w (m),

total area of enclosure including openings A_t (m^2),

fire compartment area A_f (m^2),

averaged thermal property of enclosure b ($\text{J}/\text{m}^2 \text{ s}^{1/2} \text{ K}$).

For fuel-controlled fires, the following temperature functions for a reference fire load density of $q = 1300 \text{ MJ}/\text{m}^2$ are assumed:

$$\theta_1 = 24000k + 20 (^{\circ}\text{C}) \text{ for } k \leq 0.04 \text{ and } \theta_1 = 980^{\circ}\text{C} \text{ for } k > 0.04, \quad (6)$$

$$\theta_2 = 33000k + 20 (^{\circ}\text{C}) \text{ for } k \leq 0.04 \text{ and } \theta_2 = 1340^{\circ}\text{C} \text{ for } k > 0.04, \quad (7)$$

$$\theta_3 = 16000k + 20 (^{\circ}\text{C}) \text{ for } k \leq 0.04 \text{ and } \theta_3 = 660^{\circ}\text{C} \text{ for } k > 0.04, \quad (8)$$

with:

$$k = \left(\frac{\dot{Q}^2}{A_w \sqrt{h_w} \cdot (A_t - A_w) \cdot b} \right)^{1/3}, \quad (9)$$

$$\text{and maximum HRR } \dot{Q} = \text{MIN} \left(\dot{Q}_{\max,v}, \dot{Q}_{\max,f} \right). \quad (10)$$

For fire load densities less than the reference value of $1300 \text{ MJ}/\text{m}^2$, the maximum temperature occurs earlier, when 70% of the fuel is consumed and the decay phase begins; this point can be determined from the HRR function.

For buildings with unprotected timber elements and fuel-controlled fire dynamics, the additional fire load from the burning timber must obviously be considered. Therefore, the iBMB model has been modified in the current article using a simplified approach with an assumed linear burning rate for temperatures above 300°C based on an assumed charring rate. Charring rates are, of course, not constant in reality; however, this is considered a reasonable first approximation and is indeed a fundamental assumption of the methods provided within EN 1995-1-2. This enhancement is marked in *bold* characters in the formulae below. Thus, the total fire load density, $q_{f,\text{tot}}$, becomes:

$$q_{f,\text{tot}} = q_{f,k} \cdot \chi + A_{\text{tim}} \cdot d_{\text{char},t} \cdot h_{\text{eff,tim}} \cdot \rho_{\text{tim}} / A_f, \quad (11)$$

with:

fire load density according to EN 1991-1-2 (only 'mobile fire load') $q_{f,k}$ (MJ/m^2),

combustion efficiency χ (-),

surface area of timber elements A_{tim} (m^2),

effective heat of combustion of timber $h_{\text{eff,tim}}$ (MJ/kg),

density of timber ρ_{tim} (kg/m^3),

fire compartment floor area A_f (m^2),

charring depth $d_{\text{char},t} = \beta_0 \cdot t_{>300}$ with $t_{>300} = \sum_{T \geq 300} t_T$ (m).

The charring depth is calculated from the charring rate multiplied by the time during which the enclosure temperature is calculated as being higher than 300°C .

The maximum HRR for fuel-controlled fires is then assumed as:

$$Q_{\max,f,k} = \text{HRR}_f \cdot A_f + \text{HRR}_{\text{tim}} \cdot A_{\text{tim}}, \quad (12)$$

with the heat released by timber = $\text{HRR}_{\text{tim}} = \dot{r}'' \cdot \Delta H_{c,\text{tim}}$ (MW/m^2)

burning rate of the timber = $\dot{r}'' = 0.014$ ($\text{kg}/\text{m}^2 \text{ s}$)¹⁷:

$$\text{HRR}_{\text{tim}} = \dot{r}'' \cdot \Delta H_{c,\text{tim}} \approx 0.20 \left(\frac{\text{MW}}{\text{m}^2} \right). \quad (13)$$

2 | COMPARTMENT FIRE EXPERIMENTS

Compartment fire experiments were performed on compartments $6000 \text{ mm} \times 4000 \text{ mm}$ in plan and with a ceiling height of 2520 mm . The basic material of the walls of the fire compartment was aerated concrete with a nominal density of $350 \text{ kg}/\text{m}^3$, and the floor was covered with calcium silicate boards on top of mineral wool insulation. Three experiments with unencapsulated CLT ceilings and three experiments with exposed concrete ceilings were performed.

For the CLT experiments, the ceiling consisted of an assembly of two CLT slabs with dimensions $5900 \text{ mm} \times 1950 \text{ mm}$ in plan and a thickness of 165 mm . These were joined together along the structural spanning direction and placed on top of the fire compartment. The CLT slabs were manufactured from five 33-mm thick spruce lamellae stacked and crossed at 90° . The adhesive used was a single-component polyurethane resin, designated as HB S709 from the company, PURBOND. The concrete slabs, with dimensions of $5900 \text{ mm} \times 3900 \text{ mm}$ in plan and with a thickness of 180 mm , were cast in situ from C35/45 concrete with a welded reinforcement mesh (ST50C, $5.03 \text{ cm}^2/\text{m}$, $\varnothing 8 \text{ mm}$ every 100 mm in both directions) and a clear cover of 20 mm (axis distance 24 mm). Both the CLT and concrete slabs were loaded during the experiments—the mechanical behaviour of the CLT slabs has been discussed in a complementary paper.^{18,19} Selected experiments included a façade mock-up to characterise the external fire plume, the data from which are also discussed in a complementary paper.²⁰

The fuel load during the experiments consisted of spruce wood cribs ignited using heptane accelerant, for a total moveable fuel load of $891 \text{ MJ}/\text{m}^2$. Three different opening factors were investigated, as shown in Table 1 and Figure 2. The opening factors were determined following the definition in EN 1991-1-2.⁷ With an opening factor of $0.144 \text{ m}^{1/2}$, the fire was expected to be fuel-controlled, and in the two other cases, with opening factors of 0.050 and $0.032 \text{ m}^{1/2}$, respectively, the fires were expected to be ventilation-controlled. The opening factors for the three experiments were chosen based on the

TABLE 1 Opening geometries in compartment fire experiments

Scenario #	Number of openings	Height of opening (mm)	Width of opening (mm)	Opening factor ($\text{m}^{1/2}$)	Opening factor* ($\text{m}^{-1/2}$)
1	2	2000	2500	0.144	4.64
2	3	1200	1250	0.050	14.2
3	1	2000	1100	0.032	23.2

*Opening factor according to the definition by Thomas and Heselden.²¹



FIGURE 2 CLT slabs tested with three different opening configurations; opening factors were 0.144, 0.050, and 0.032 $\text{m}^{1/2}$. CLT, cross-laminated timber

work of Thomas and Heselden, involving cellulosic fuels.²¹ The average compartment gas-phase temperatures of the two regimes, fuel- and ventilation-controlled, during steady burning as a function of their definition of opening factor, $A_T/A_w H^{1/2}$ ($\text{m}^{-1/2}$), are shown in Figure 3. In their definition, which is notably not the same as in the Eurocode, A_T is the total area of the compartment excluding the ventilation area, A_w , and H is the height of the opening. The chosen opening factors are included in Figure 3 where Scenario 1 (blue line) was in the fuel-controlled regime according to these definitions, and the two other scenarios (red and green lines) were considered to be ventilation-controlled.


Fifteen plate thermometers were placed at a distance of 100 mm below the slab soffit in the gas phase; the average, maximum, and minimum values from these are shown in Figure 4. In addition, shielded Type K thermocouples were used to measure the temperature at four locations, each including TCs at distances of 500, 1000, 1500, and 2000 mm below the slabs' soffits. Temperature

measurements were also taken with embedded plate thermometers fitted flush within the fire-exposed surfaces of the slabs, as well as in-depth within the slabs using shielded thermocouples. The data resulting from these different measurements will be presented in more detail in a companion paper (under preparation). In the current article, measurements from plate thermometers and shielded thermocouples at a distance of 100 mm from the fire-exposed slab soffit, and temperatures measured in the centre of the compartment, 1500 mm below the soffit, are presented and discussed.

3 | CALCULATIONS

The experimental results were compared with calculations according to the EN 1991-1-2⁷ and the iMBM^{15,16} parametric fire models. Both models were implemented by assuming the thermal properties for compartment boundaries given in Table 2. The Eurocode model

FIGURE 3 Average compartment gas-phase temperatures during the steady burning period for wood cribs based on data from Thomas and Heselden,²¹ different symbols for different compartment shapes, and thin vertical lines indicate the span of temperatures recorded. The opening factors in the current study are included as three thick vertical lines (Scenarios 1, 2, and 3)

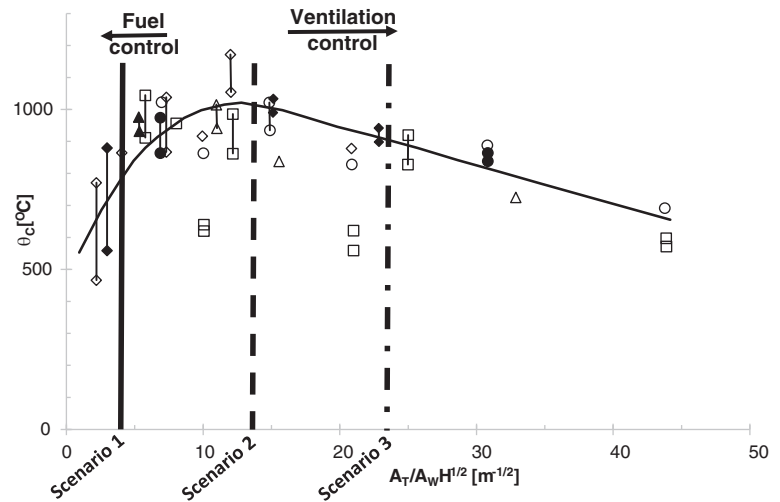

calculations do not include additional fuel from burning of the wood in the ceiling; however, the iBMB model has been modified to include the contribution from the CLT, as already described.

For application of the Eurocode method,⁷ the combustion efficiency was set to 0.8, gamma factors set to 1, and the fire development was defined as 'fast' for the fuel-controlled fires, since 18 L of heptane was used to ignite the timber cribs (the Eurocode prescribes 'medium' fire development for dwellings but due to the experimental procedure 'fast' was chosen as an initial assumption). A sensitivity analysis of the combustion efficiency, with values 0.7, 0.8, and 0.9, is provided later in this article to show the resulting variation in the predictions using the Eurocode method. Moreover, a sensitivity analysis of the choice of fire development is included later in this article.

4 | RESULTS

A summary of results from all six experiments and calculations are provided in Figure 4.

4.1 | Scenario 1: Opening factor 0.144 m^{1/2}

When comparing the data between the compartments with CLT or concrete ceilings, in the case of the largest opening factor of 0.144 m^{1/2}, the largest temperature difference measured at 100 mm beneath the slab soffit was around 200°C. In this case, the results from the calculations with the EN 1991-1-2 model indicated that the fire was fuel-controlled. Since this calculation was performed without including the contribution from the burning ceiling, which is clearly an incorrect assessment of the available fuel; however, it indicates that more oxygen was available in this scenario than in those with lower opening factors. This additional available oxygen is considered to account for the more pronounced effect of the addition of a combustible ceiling (ie, significantly increased peak gas-phase temperatures as measured by plate thermometers within the

compartment). During this experiment, there was no structural collapse of the CLT slab.

4.2 | Scenario 2: Opening factor 0.050 m^{1/2}

With an opening factor of 0.050 m^{1/2}, the CLT slab collapsed after 29 hours due to a reduced cross-section. This is thought to have resulted from continued localised smouldering of the CLT after extinction of flaming. At all four measurement stations, with thermocouples in-depth at distances of 4, 12, 23, 33, 44, 55, 66, 77, and 99 mm from the surface, the temperatures measured within the CLT after 15 hours were less than 40°C. The data acquisition was then turned off; however, smouldering appears to have continued in localised areas deeper in the slab where no temperature measurements were made. This ongoing in-depth heating resulted in a continued loss of load-bearing capacity, eventually resulting in structural collapse of the slab.

4.3 | Scenario 3: Opening factor 0.032 m^{1/2}

During the experiment with the lowest opening factor of 0.032 m^{1/2}, giving the longest duration of the fully developed phase, the CLT structure collapsed after 108 minutes of natural fire exposure. While comparisons of fire resistance durations from natural fires cannot be compared with standard fire resistance durations, the fire resistance rating for this slab would have been REI 120 based on the applied loading and using the reduced cross-section method (RCSM) given in EN 1995-1-2.

The gas-phase temperatures recorded in all experiments significantly exceeded those of the standard cellulosic fire curve during the steady burning phase.

Figure 5 compares the length of the growth phases and maximum temperatures measured during the experiments with the results from calculations. The maximum temperatures recorded in the experiments were considerably higher than suggested by the work of Thomas and

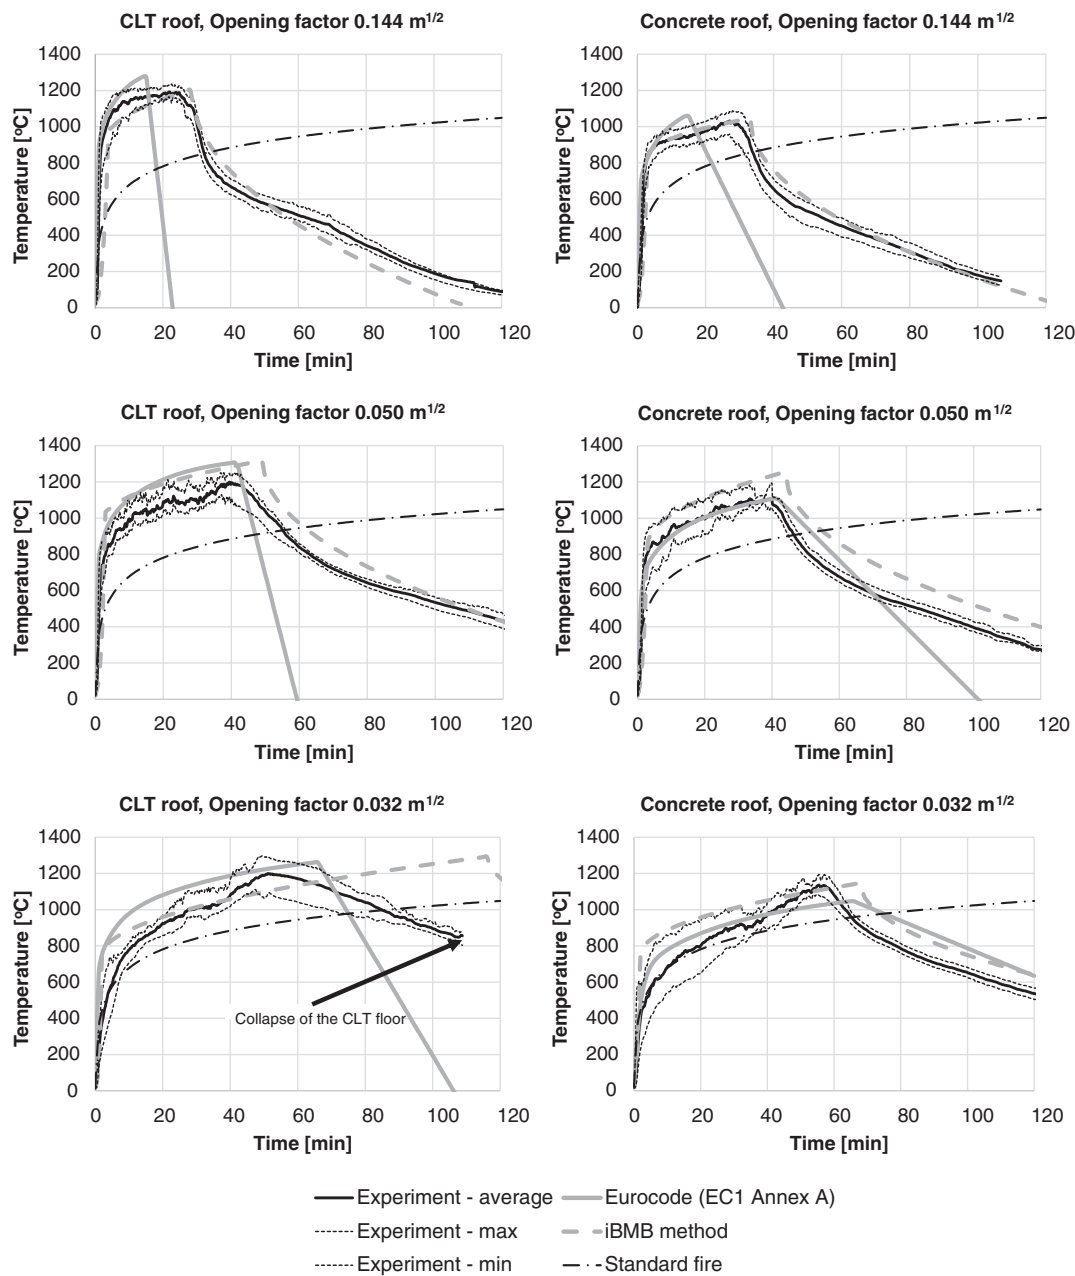


FIGURE 4 Average, maximum, and minimum temperatures of the 15 plate thermometers mounted 100 mm beneath the slabs' soffits, compared against calculations according to the EN 1991-1-2 and iBMB parametric fire models

Heselden²¹ that was used to design the experiments (shown in Figure 3). In the CLT experiments, the maximum temperature was 200°C to 440°C higher than during the concrete experiments, 110°C to 280°C higher. Moreover, Scenario 2 was predicted to reach the highest temperature based both on the data from Thomas and Heselden²¹ and according to the two models used; however, this was not the case during the experiments. In the experiments, the maximum temperatures for CLT were about 1200°C for all three scenarios. The corresponding temperatures in the concrete experiments ranged between 1031°C, 1108°C, and 1136°C for scenarios 1, 2, and 3. The reasons for this difference in maximum


temperatures compared with Thomas and Heselden²¹ are not presently known.

4.4 | Calculations with the EN 1991-1-2 model

According to the EN 1991-1-2 calculations, the fire with an opening factor of $0.144 \text{ m}^{1/2}$ was fuel-controlled and the other opening factors, 0.050 and $0.032 \text{ m}^{1/2}$, were ventilation-controlled. A summary of the comparison between calculations with the EN 1991-1-2 parametric fire model and the experiments is given in Table 3.

TABLE 2 Material data used in calculations

	Density (kg/m ³)	Specific heat (J/kg K)	Thermal conductivity (W/mK)	Thermal inertia ('b' in fire model) (J/m ² s ^{1/2} K)
Aerated concrete	350	1000	0.36	355
Calcium silicate board	900	1000	0.212	437
Mineral wool	96	1000	0.05	69
Wood	450	1530 (EC)	0.12 (EC)	287
Concrete	2400	900 (EC)	1.33 (EC)	1695

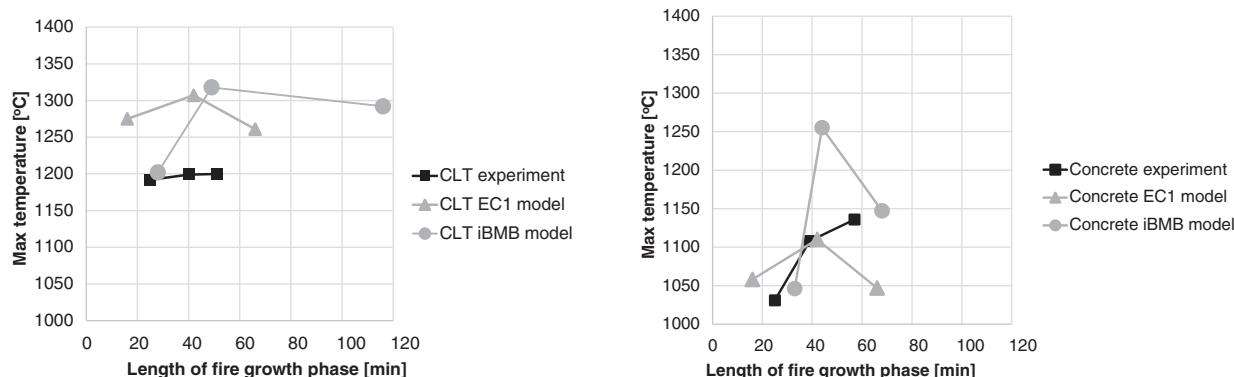**FIGURE 5** Summary of maximum temperatures and durations of the fire growth phases during experiments and predicted by models. Each series includes from left to right scenarios 1, 2, and 3

4.5 | Calculations with the iBMB model

Generally, the modified iBMB model was able to reproduce the temperature-time development of the experiments reasonably well. But in Scenario 3 ($O = 0.032 \text{ m}^{1/2}$), the maximum temperature of the CLT calculation was higher and the time of maximum temperature was overestimated. It appears that, for the highly under-ventilated fire, the simplified approach of adding a linear burning rate of the timber additionally to the moveable fire load leads to an overestimation of the total consumed fire load. For these cases, an appropriate approach has to be developed. A summary of the comparison between calculations with the iBMB parametric fire model and the experiments is given in Table 4.

5 | ANALYSIS

As expected, the presence of a combustible ceiling with different thermal inertia influences the temperature development in a compartment fire. In Figure 6, the average temperatures measured by plate thermometers from the experiments with either a combustible CLT ceiling or a non-combustible concrete ceiling are compared. The largest difference is seen in the experiment with the largest opening factor where the difference is around 200°C during the fire growth phase. Measurements with ordinary shielded thermocouples placed in parallel with the plate thermometers are also included. During the heating phase, the temperature difference was highest for the fuel-controlled

fire, Scenario 1. This is likely because the heat release rate in the enclosure was higher due to burning of the ceiling in this case, and because a wooden ceiling absorbs/transfers less energy than a concrete ceiling. During the ventilation-controlled experiments, that is, Scenarios 2 and 3, the differences in temperatures are less dependent on differences in the ceilings' thermal properties. During these experiments, the extra energy added from the CLT appears to have resulted mainly in more severe external flaming.²⁰ Moreover, the measurements made with shielded thermocouples (that are not directionally dependent as the plate thermometers) corroborate this hypothesis. In general, the temperatures measured with plate thermometers and ordinary shielded thermocouples were very similar in the fire growth phase, and the only significant difference being the first few minutes when the plate thermometers are slower to react, as expected. In the decay phase, differences between the two ways of measuring temperature are highest for the concrete slab experiment with the largest opening factor, again as expected.

The main focus of the comparisons shown in Figure 6 is the temperatures to which the ceilings, that is, load-bearing structure, were exposed. Figure 7 compares the temperatures measured with plate thermometers 100 mm below the ceiling against those measured in the middle of the room at 1500 mm below the soffit. The difference between these two measures in the growth phase is, in general, small and the temperatures measured in the middle of the room are inside the span of temperatures that were measured with plate thermometers under the ceiling (compare with Figure 4). The only exceptions in the growth phase are between 10 and 33 minutes of the experiment

TABLE 3 Comparison between temperatures calculated with the EN1991-1-2 parametric fire model and average temperatures from measurements

Opening factor ($m^{1/2}$)	CLT slab (calculation not including extra energy contribution for burning ceiling)	Concrete slab
0.144	Calculated temperatures are higher than the measured temperatures in the fully developed phase. The model underestimates the duration of the growth phase by 36%. The decay phase is too rapid in the model	Calculated temperatures are higher than the measured temperatures in the fully developed phase. The model underestimates the duration of the growth phase by 36%. The decay phase is too rapid in the model
0.050	Calculated temperatures, 100°C to 200°C, are higher than the measured temperatures in the fully developed phase. Duration of fully developed phase correlates but decay phase is too rapid in the model	A good correlation between calculated and measured temperatures during the fully developed phase. Minor deviation in shape of the decay phase curve
0.032	Except in the end of the fully developed phase, temperatures 100°C to 200°C higher in calculation compared with measurements. In the model the duration of fully developed phase is slightly longer, and the decay phase is more rapid	A reasonable correlation of temperatures in the fully developed phase although a slight overestimation by the model in the early stages and a slight underestimation in the final stages. A longer fully developed phase in the calculations but a similar decay phase rate

Abbreviation: CLT, cross-laminated timber.

TABLE 4 Comparison between temperatures calculated with the iBMB model and average temperatures from measurements

Opening factor ($m^{1/2}$)	CLT slab (calculation including extra energy contribution for burning ceiling)	Concrete slab
0.144	Calculated temperatures are in reasonable agreement with measured temperatures. The model also has a reasonable agreement concerning the duration of the fully developed phase and the decay phase	Calculated temperatures are in reasonable agreement with measured temperatures. The model also has a reasonable agreement concerning the duration of the fully developed phase. The model over-predicts the rate of decay
0.050	Temperatures 100°C to 200°C higher in calculations. Duration of fully developed phase longer in calculations and decay phase is in reasonable agreement	Temperatures 50°C to 100°C higher in calculations. Duration of fully developed phase correlates. The rate of decay in reasonable agreement
0.032	A reasonable correlation of temperatures in the fully developed phase although a slight overestimation by the model in the early stages and a slight underestimation in the final stages. The model overestimates the duration of the fully developed phase and the decay phase	Except in the end of the fully developed phase, temperatures 100°C to 200°C higher in calculation compared with measurements. The model slightly over-predicts the length of the fully developed phase, rate of decay in reasonable agreement

Abbreviation: CLT, cross-laminated timber.

on concrete with the smallest opening factor, where the temperature in the middle of the room was about 200° higher than as measured by the PTs.

When comparing the temperature development measured in the experiments with calculations based on the Eurocode 1-1-2 model, the model overestimates the temperatures for the CLT experiments. This overestimation of the temperature development is somewhat surprising on the basis of the available literature and validation of the Eurocode parametric fire model. However, in a previous work by Hakkarainen,²² with an opening factor of 0.042 $m^{1/2}$, an overestimation of the temperatures in a compartment with ceilings and walls made of laminated timber was between 300°C and 500°C. During these experiments, it was estimated that 50% of the burning took place outside the compartment, which indicates an elevated pyrolysis rate inside the compartment.

The approach of considering the additional fire load of timber by imposing an increased burning rate with the modified iBMB model led

to reasonable predictions in terms of maximum temperatures and durations of the fully developed phases. For the most under-ventilated case, the duration of the fully developed phase was overestimated for the CLT slab. A simplified approach of considering the additional fire load by imposing a linear charring rate, therefore, requires additional research. A difficulty with this approach is also that the additional fuel generated from pyrolysis of the combustible ceiling appears to have burned outside the compartment, and, therefore, did not lead to significant extension of the duration of the fully developed phase.

An additional factor that must be estimated during real fires is the combustion efficiency, which is the ratio between the heat of combustion in practice to the heat of combustion with perfect combustion. This depends primarily on the material burning and the availability of oxygen for the combustion reaction—with reduced oxygen (as in a compartment fire) incomplete combustion will occur, and the combustion efficiency decreases. A constant combustion

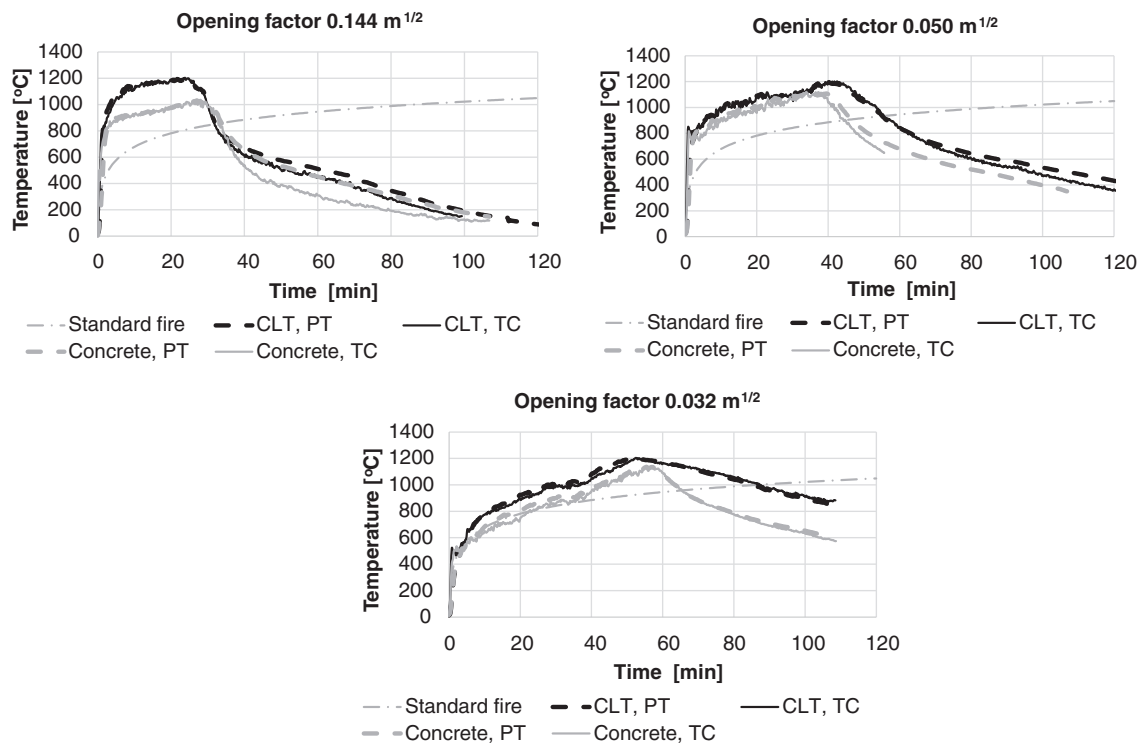


FIGURE 6 Average temperatures recorded by PTs (looking down) and shielded TC placed 100 mm below the surface of the ceiling. PT, plate thermometer; TC, thermocouples

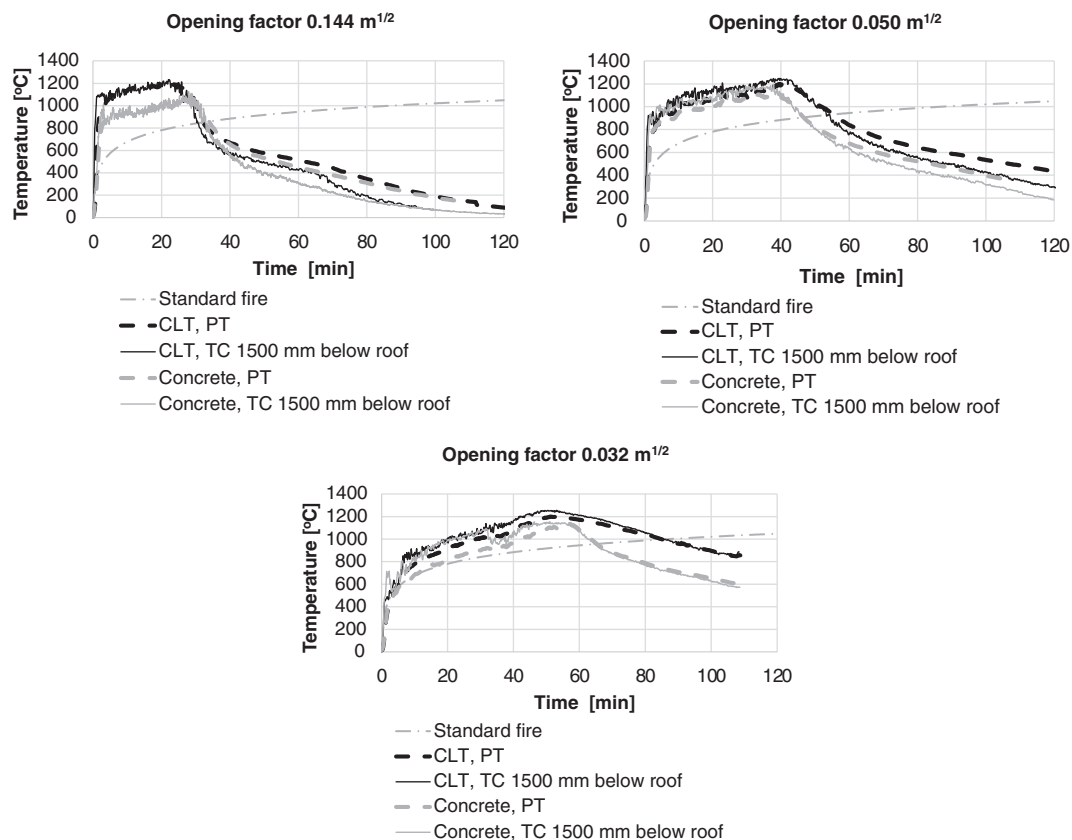


FIGURE 7 Average of PT and shielded TC placed in the centre of the compartments at 1500 mm from the slabs' soffits. PT, plate thermometer; TC, thermocouples

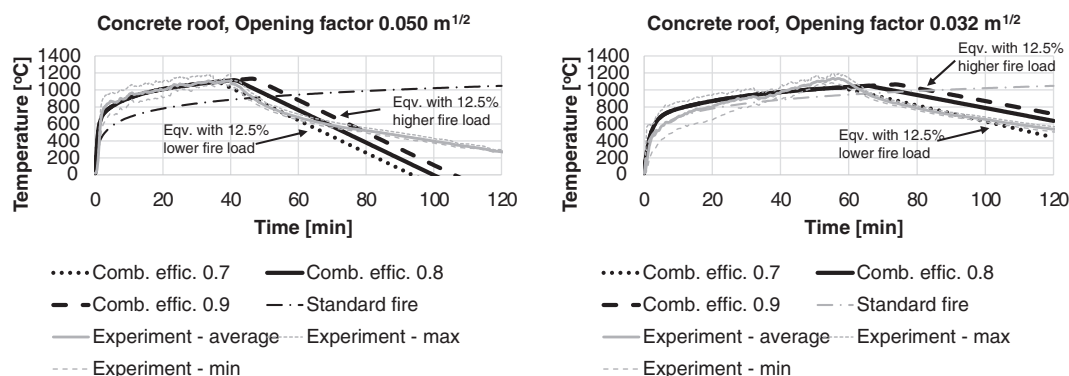


FIGURE 8 Influence of assumed constant combustion efficiency in the EN 1991-1-2 model

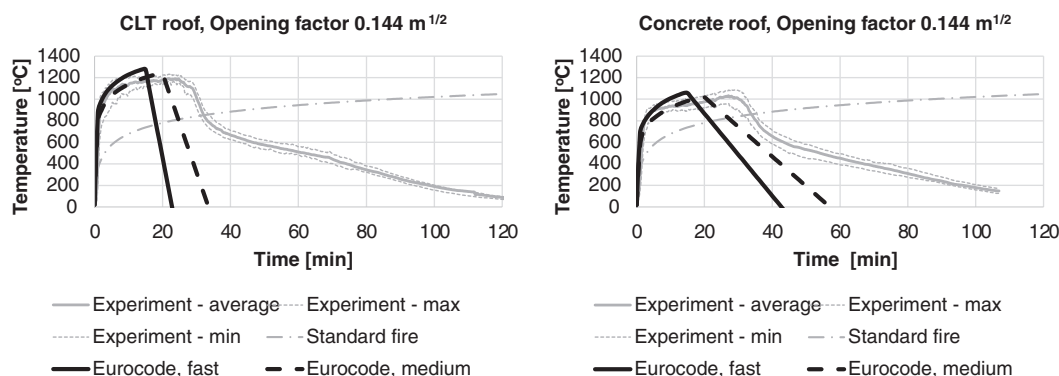


FIGURE 9 Influence of the choice of fire growth rate on the predictions from the EN 1991-1-2 model

efficiency of 0.8 was assumed for all opening factors for calculations with EN 1991-1-2. This introduces a potential error, since the stoichiometry can be expected to change with different opening factors and throughout a fire. When comparing the length of the fully developed phase for the under-ventilated fires, with opening factors of 0.050 and $0.032 \text{ m}^{1/2}$, it is evident that the model with a combustion efficiency of 0.8 reasonably predicts the length of the fully developed phase for the $0.050 \text{ m}^{1/2}$ fire, 3 minutes difference, but overestimates the length of this phase in the $0.032 \text{ m}^{1/2}$ fire. The latter being a difference three times higher, 9 minutes. This might be due to the fact that the $0.032 \text{ m}^{1/2}$ fire is more severely under-ventilated, which would be expected to reduce the combustion efficiency. The reasonable fit of the length of the curves for the opening factor, $0.050 \text{ m}^{1/2}$, suggests that the EN 1991-1-2 model may be calibrated to a combustion efficiency close to 0.8. To illustrate the effect of different values of assumed combustion efficiency on the length of the fully developed phase, calculations with combustion efficiencies of 0.7 to 0.9 are included in Figure 8. A change of combustion efficiency of 0.1 corresponds to a change in fuel load of about 12.5% for the scenarios considered in this article.

During the initial calculation of the two fuel-controlled experiments, the opening factor, 0.144 , shown in Figure 4, fire growth rate 'fast', was used as input parameter for the Eurocode model. This assumption was based on the use of 18 L of heptane as the ignition source, but Table E5 in the Eurocode gives a fire growth rate of medium for dwellings. In Figure 9, calculations with both fast and

medium fire growth rates are shown. When using medium fire growth rate, the predictions correspond better to the data in the growth phase; however, both assumptions predict fire durations that are too short. This deviation is known from previous studies, and was one of the original reasons for developing the iBMB model,¹⁵ which is now required by the German National Annex to the Eurocode.¹⁶

6 | CONCLUSIONS

A series of compartment fire experiments have been performed with a range of opening factors and either a combustible (CLT) or non-combustible (reinforced concrete) load-bearing ceiling. On the basis of the data and models presented and discussed in this article, the following conclusions can be drawn:

- The introduction of a combustible CLT ceiling can lead to higher temperatures in a fire compartment than a corresponding fire compartment with a reinforced concrete ceiling. When the compartment fire was fuel-controlled, with an opening factor of $0.144 \text{ m}^{1/2}$, the temperature in the experimental study was around 200°C higher in the fire growth phase. In the ventilation-controlled cases, opening factor of 0.050 and $0.032 \text{ m}^{1/2}$, the difference between CLT and concrete ceilings was largest in the decay phase with a difference of 150°C to 250°C .

- During the investigated circumstances, the EN 1991-1-2 parametric fire model over-predicted the gas-phase temperatures for compartments with combustible ceilings during the growth phase of ventilation-controlled fires. In the decay phases the converse was true, and the EN 1991-1-2 parametric fire model predicted substantially lower temperatures than those measured in the gas phase. As should be expected, the temperature predictions were better for the cases with non-combustible ceilings during both the growth and decay phases.
- The iBMB model, modified in a simplified manner to account for combustion of the ceiling, gave reasonable predictions for both concrete and CLT ceiling cases during the fire growth phase, but over-predicted the duration of the fully developed phase for CLT in the ventilation-controlled cases due to the simplified approach considering the burned timber as additional fire load.
- According to Thomas and Heselden,¹⁹ the maximum temperatures measured during the experimental studies were expected to have been measured for Scenario 2, with an opening factor of $0.050 \text{ m}^{1/2}$, which, in theory, is closer to stoichiometric combustion than scenarios 1 and 2 (opening factors of 0.144 and $0.032 \text{ m}^{1/2}$). This expectation was not realised during the experiments, since maximum temperatures for all three experiments with CLT ceilings were around 1200°C and the temperatures for the concrete ceilings were highest for Scenario 3 (opening factor $0.032 \text{ m}^{1/2}$).
- While not a novel conclusion, the data presented in this article confirm that parametric models for compartment fire dynamics in compartments that have exposed mass timber (at any point during the fire) must explicitly consider the contribution made by the combustible compartment linings. Such models are under development in the framework of the Eurocode 5 revision.

ACKNOWLEDGEMENTS

We gratefully acknowledge on-going support from the project partners: CERIB, Fire Testing Centre; the School of Engineering, The University of Edinburgh; Bordeaux University; Brandskyddslaget AB; the Institute of Building Materials, Concrete Construction and Fire Safety, Technische Universität Braunschweig, Division of Fire Safety; and Liège University.

ORCID

Robert McNamee  <https://orcid.org/0000-0002-0380-9548>

Alastair I. Bartlett  <https://orcid.org/0000-0002-4133-5865>

Mohammad Heidari  <https://orcid.org/0000-0002-4411-390X>

REFERENCES

1. EN 1363-1:2012. Fire resistance tests - part 1: general requirements; July, 2012.
2. Babrauskas V. Fire endurance in buildings [PhD thesis]. Berkeley, CA: University of Berkeley; 1976.
3. Ingberg, S. H. "Tests of the severity of building fires.", *Quarterly of the National Fire Protection Association* Vol. 22, no. 1, Boston: National Fire Protection Association; (1928): 43-61.
4. Law M. Prediction of fire resistance. Paper in Symposium No. 5, Fire Resistance Requirements of Buildings - A New Approach; September 28, 1971; London, England: Department of the Environment and Fire Offices Committee Joint Fire Research Organization, HMSO; 1973.
5. Wickström U. Application of the standard fire curve for expressing natural fires for design. ASTM STP, American Society for Testing and Materials; 1985.
6. Harmathy TZ. On the equivalent fire exposure. *Fire Mater.* 1987;11: 95-104.
7. Eurocode 1-1-2. Action on structures—Part 1-2: general actions—Actions on structures exposed to fire; 2002.
8. Schneider U, Kersken-Bradley M, Max U. Neuberechnung der Wärmeabzugsfaktoren für die DIN V 18230. Baulicher Brandschutz Industriebau. Kassel, Germany: Arbeitsgemeinschaft Brandsicherheit München; May 1990.
9. Law M. A review of formulae for T-equivalent. *Fire Safety Science - Proceedings of the Fifth International Symposium*. Vol 5; 1997:985-996.
10. Ödeen K. *Theoretical Study of Fire Characteristics in Enclosed Spaces*. Stockholm, Sweden: Royal Institute of Technology; 1963.
11. Personal communication between Robert McNamee and Kai Ödeen, Professor Emeritus at KTH, Stockholm, Sweden: Royal Institute of Technology.
12. Kawagoe K, Sekine K. Estimation of fire temperature-time curve in rooms. Japanese Building Research Institute Occasional Reports Nos. 11. Tokyo; 1963.
13. Magnusson SE, Thelandersson S. Temperature - time curves of complete process of fire development. Theoretical study of wood fuel fires in enclosed spaces. *Acta Polytechnica Scandinavia Civil Engineering and Building Construction Series*, No. 65. Stockholm, Sweden; 1970.
14. Wickström U. Natural fires for design of steel and concrete structures - a Swedish approach. International Symposium on Fire Engineering for Building Structures and Safety, The Institute of Engineers, Australia, National Conference Publication No. 89/16, Melbourne; November 1989.
15. Zehfuss J, Hosser D. A parametric natural fire model for the structural fire design of multi-storey buildings. *Fire Saf J.* 2007;42:115-126.
16. DIN EN-1-2/NA. National annex - national determined parameter - Eurocode 1: actions on structures - part 1-2: general actions - actions on structures exposed to fire. DIN (German Standard Association); 2010.
17. Schneider U. *Ingenieurmethoden im Brandschutz*, 2. Auflage. Düsseldorf, Germany: Werner Verlag; 2008.
18. Mindeguia J-C, Mohaine S, Bisby L, Robert F, McNamee R, Bartlett A. Thermo-mechanical behavior of cross-laminated timber slabs under standard and natural fires. *Interflam*. London, England: Royal Holloway Colleague; 2019.
19. Bartlett A, McNamee R, Robert F, Bisby L. Comparative energy analysis from fire resistance tests on combustible versus noncombustible slabs. *Fire Mater.* 2020;44:301-310.
20. Bartlett A, Law A, McNamee R, et al. Heat fluxes to a façade resulting from compartment fires with combustible and non-combustible ceilings. FSF 2019 - 3rd International Symposium on Fire Safety of Facades Paris, France; September 26-27, 2019.
21. Thomas PH, Heselden AJM. Fully developed fires in single compartments. A cooperative programme of the Conceil International du Batiment. Conceil International du Batiment Report No. 20, Fire Research Note. 923; 1972
22. Hakkarainen T. Post-flashover fires in light and heavy timber construction compartments. *J Fire Sci.* 2002;20:133-175.

How to cite this article: McNamee R, Zehfuss J, Bartlett AI, Heidari M, Robert F, Bisby LA. Enclosure fire dynamics with a cross-laminated timber ceiling. *Fire and Materials*. 2021;45: 847-857. <https://doi.org/10.1002/fam.2904>