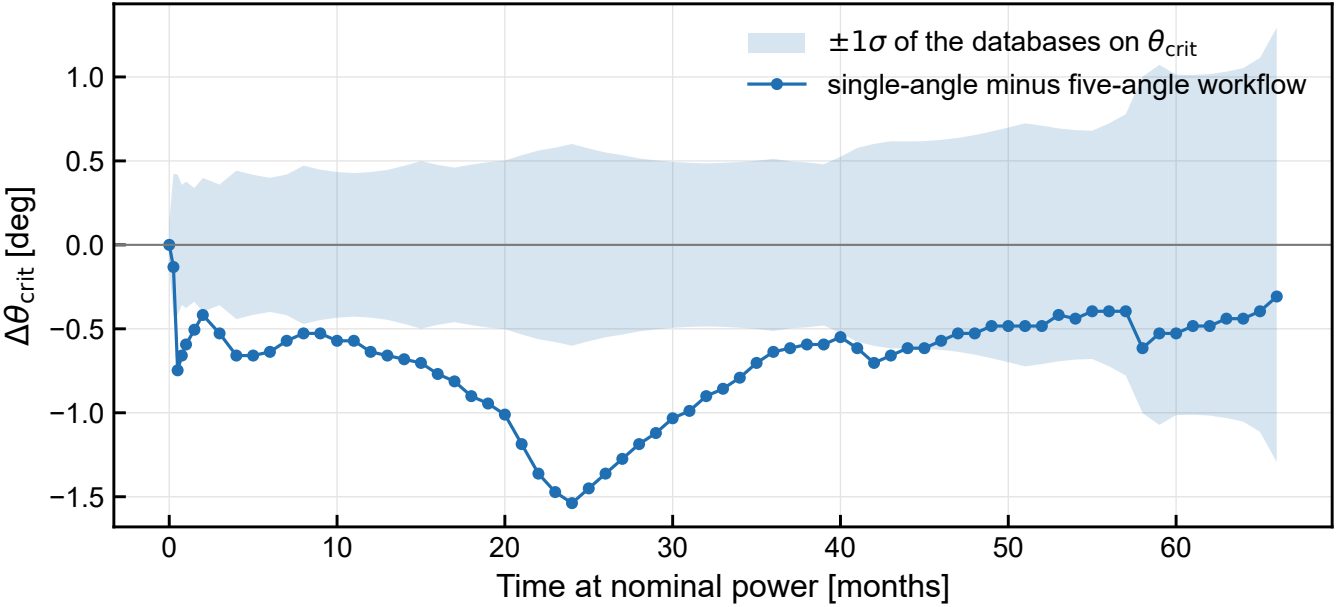
±1σ of the databases on θcrit
single-angle minus five-angle workflow
Δθcrit [deg]
1.0
0.5
0.0
−0.5
−1.0
−1.5
0
10
20
30
40
50
60
Time at nominal power [months]