

REVISION	DESCRIPTION	BY	DATE
0	ISSUE FOR CONSTRUCTION		09/06/13
1	PRE-BID CLARIFICATION		11/08/13
2	CONTRACTOR QUESTION		10/30/14


GENERAL NOTES:

1. SEE DETAILS FOR ADDITIONAL PIPING SPECIALTIES REQUIRED AT EQUIPMENT.

MECHANICAL AND ELECTRICAL ENGINEERING CONSULTANT:



MEP CONSULTANTS
20251 CENTURY BLVD #125
GERMANTOWN, MD 20874
P: 877-871-4229
F: 301-560-6336
JFORD@CFRENGINEERING.COM
PROJECT #12074

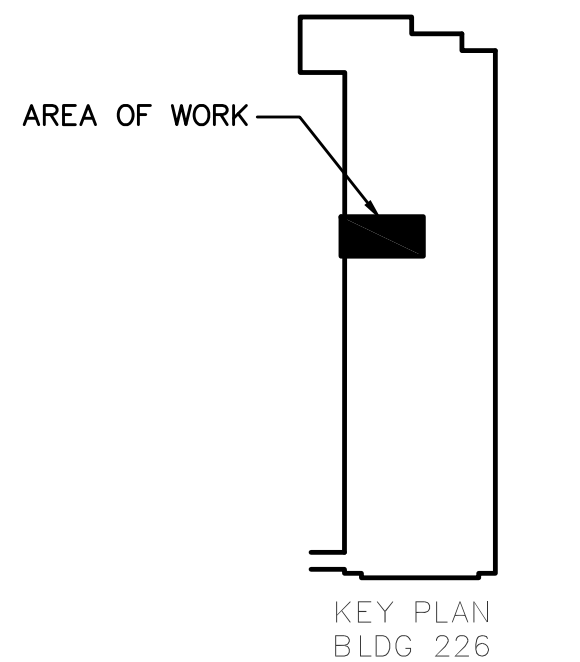

1/4" = 1'-0"




M-12

U.S. DEPARTMENT OF COMMERCE
NATIONAL INSTITUTE OF STANDARDS AND TECHNOLOGY
PLANT DIVISION


BUILDING 226 - ROOM A122 HVAC TESTING LAB

MECHANICAL SYSTEM DIAGRAMS

SH.NO. 13 OF 16 DWG. 226-372

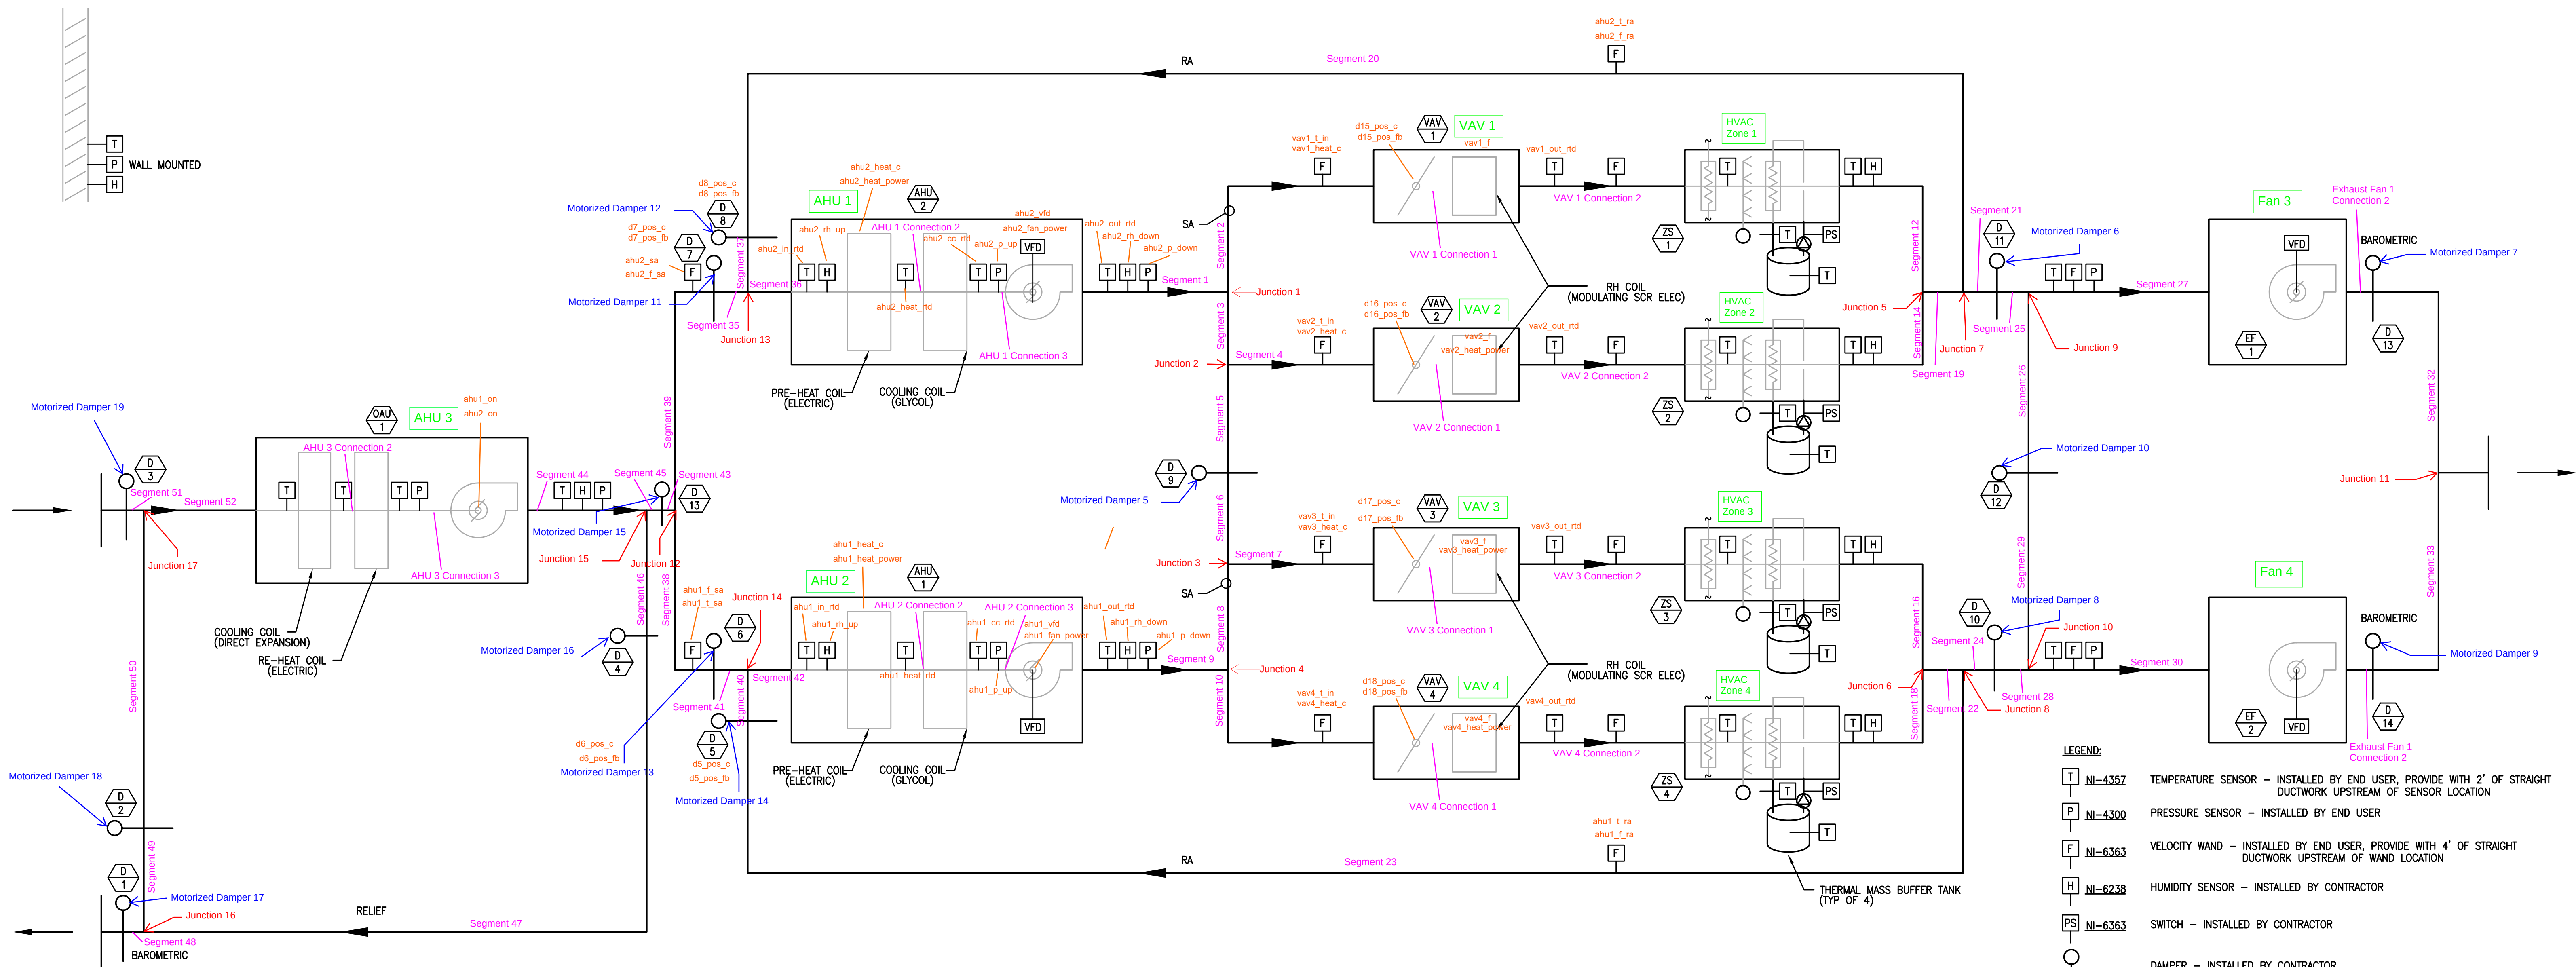

1 AIRFLOW DIAGRAM
NOT TO SCALE

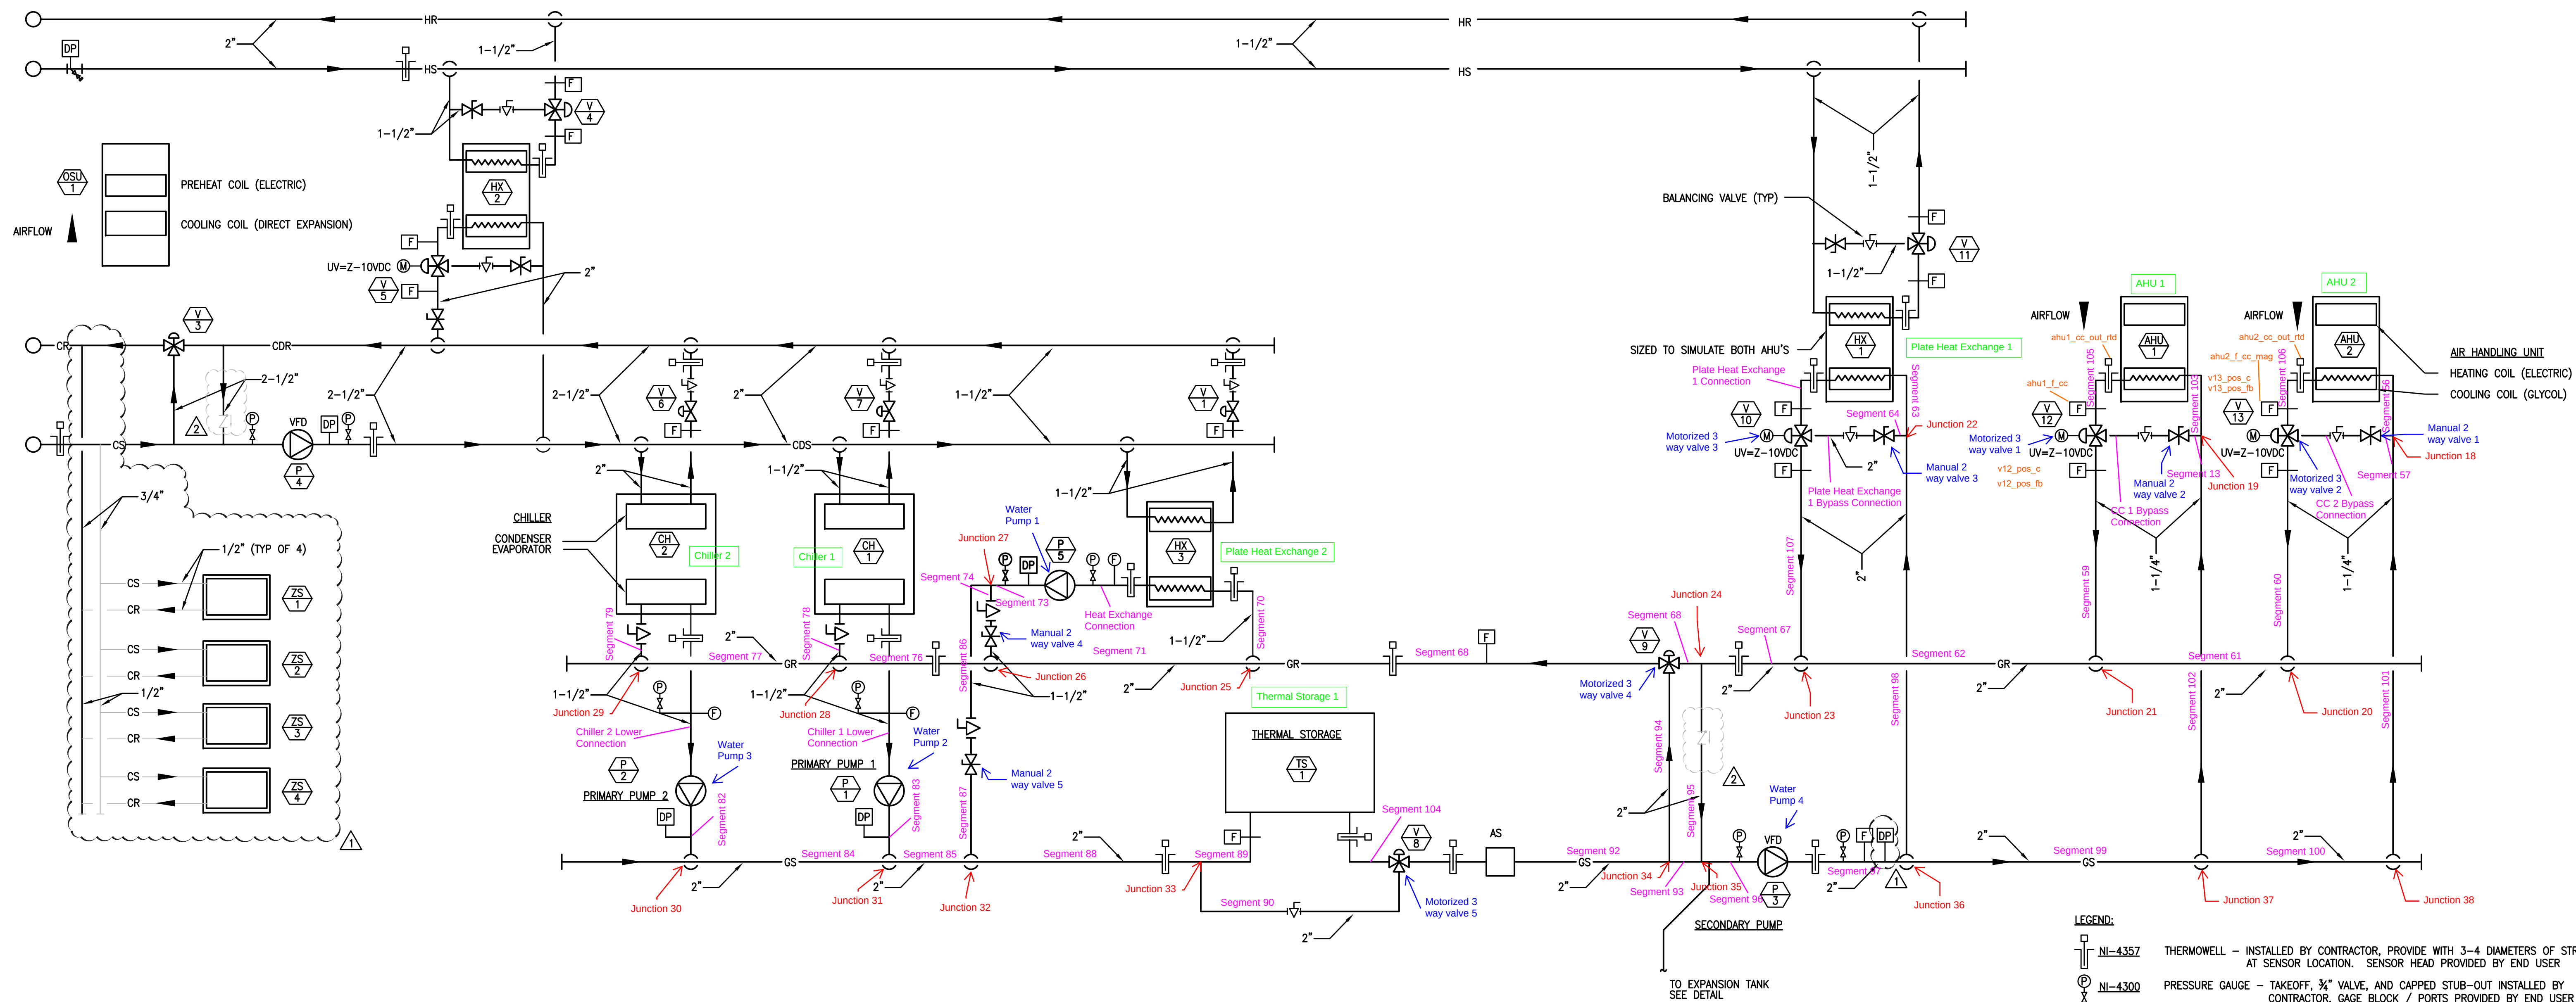

2 HYDRONIC DIAGRAM
NOT TO SCALE