

1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 | 10



CIRRUS
SYSTEMS, INC.

HEADQUARTERS
200 WEST RD,
PORTSMOUTH,
NH 03801
Phone: 877-636-2331

A

A

B

B

C

C

D

D

E

E


F

F

G


G

DISPLAY
-20FT-

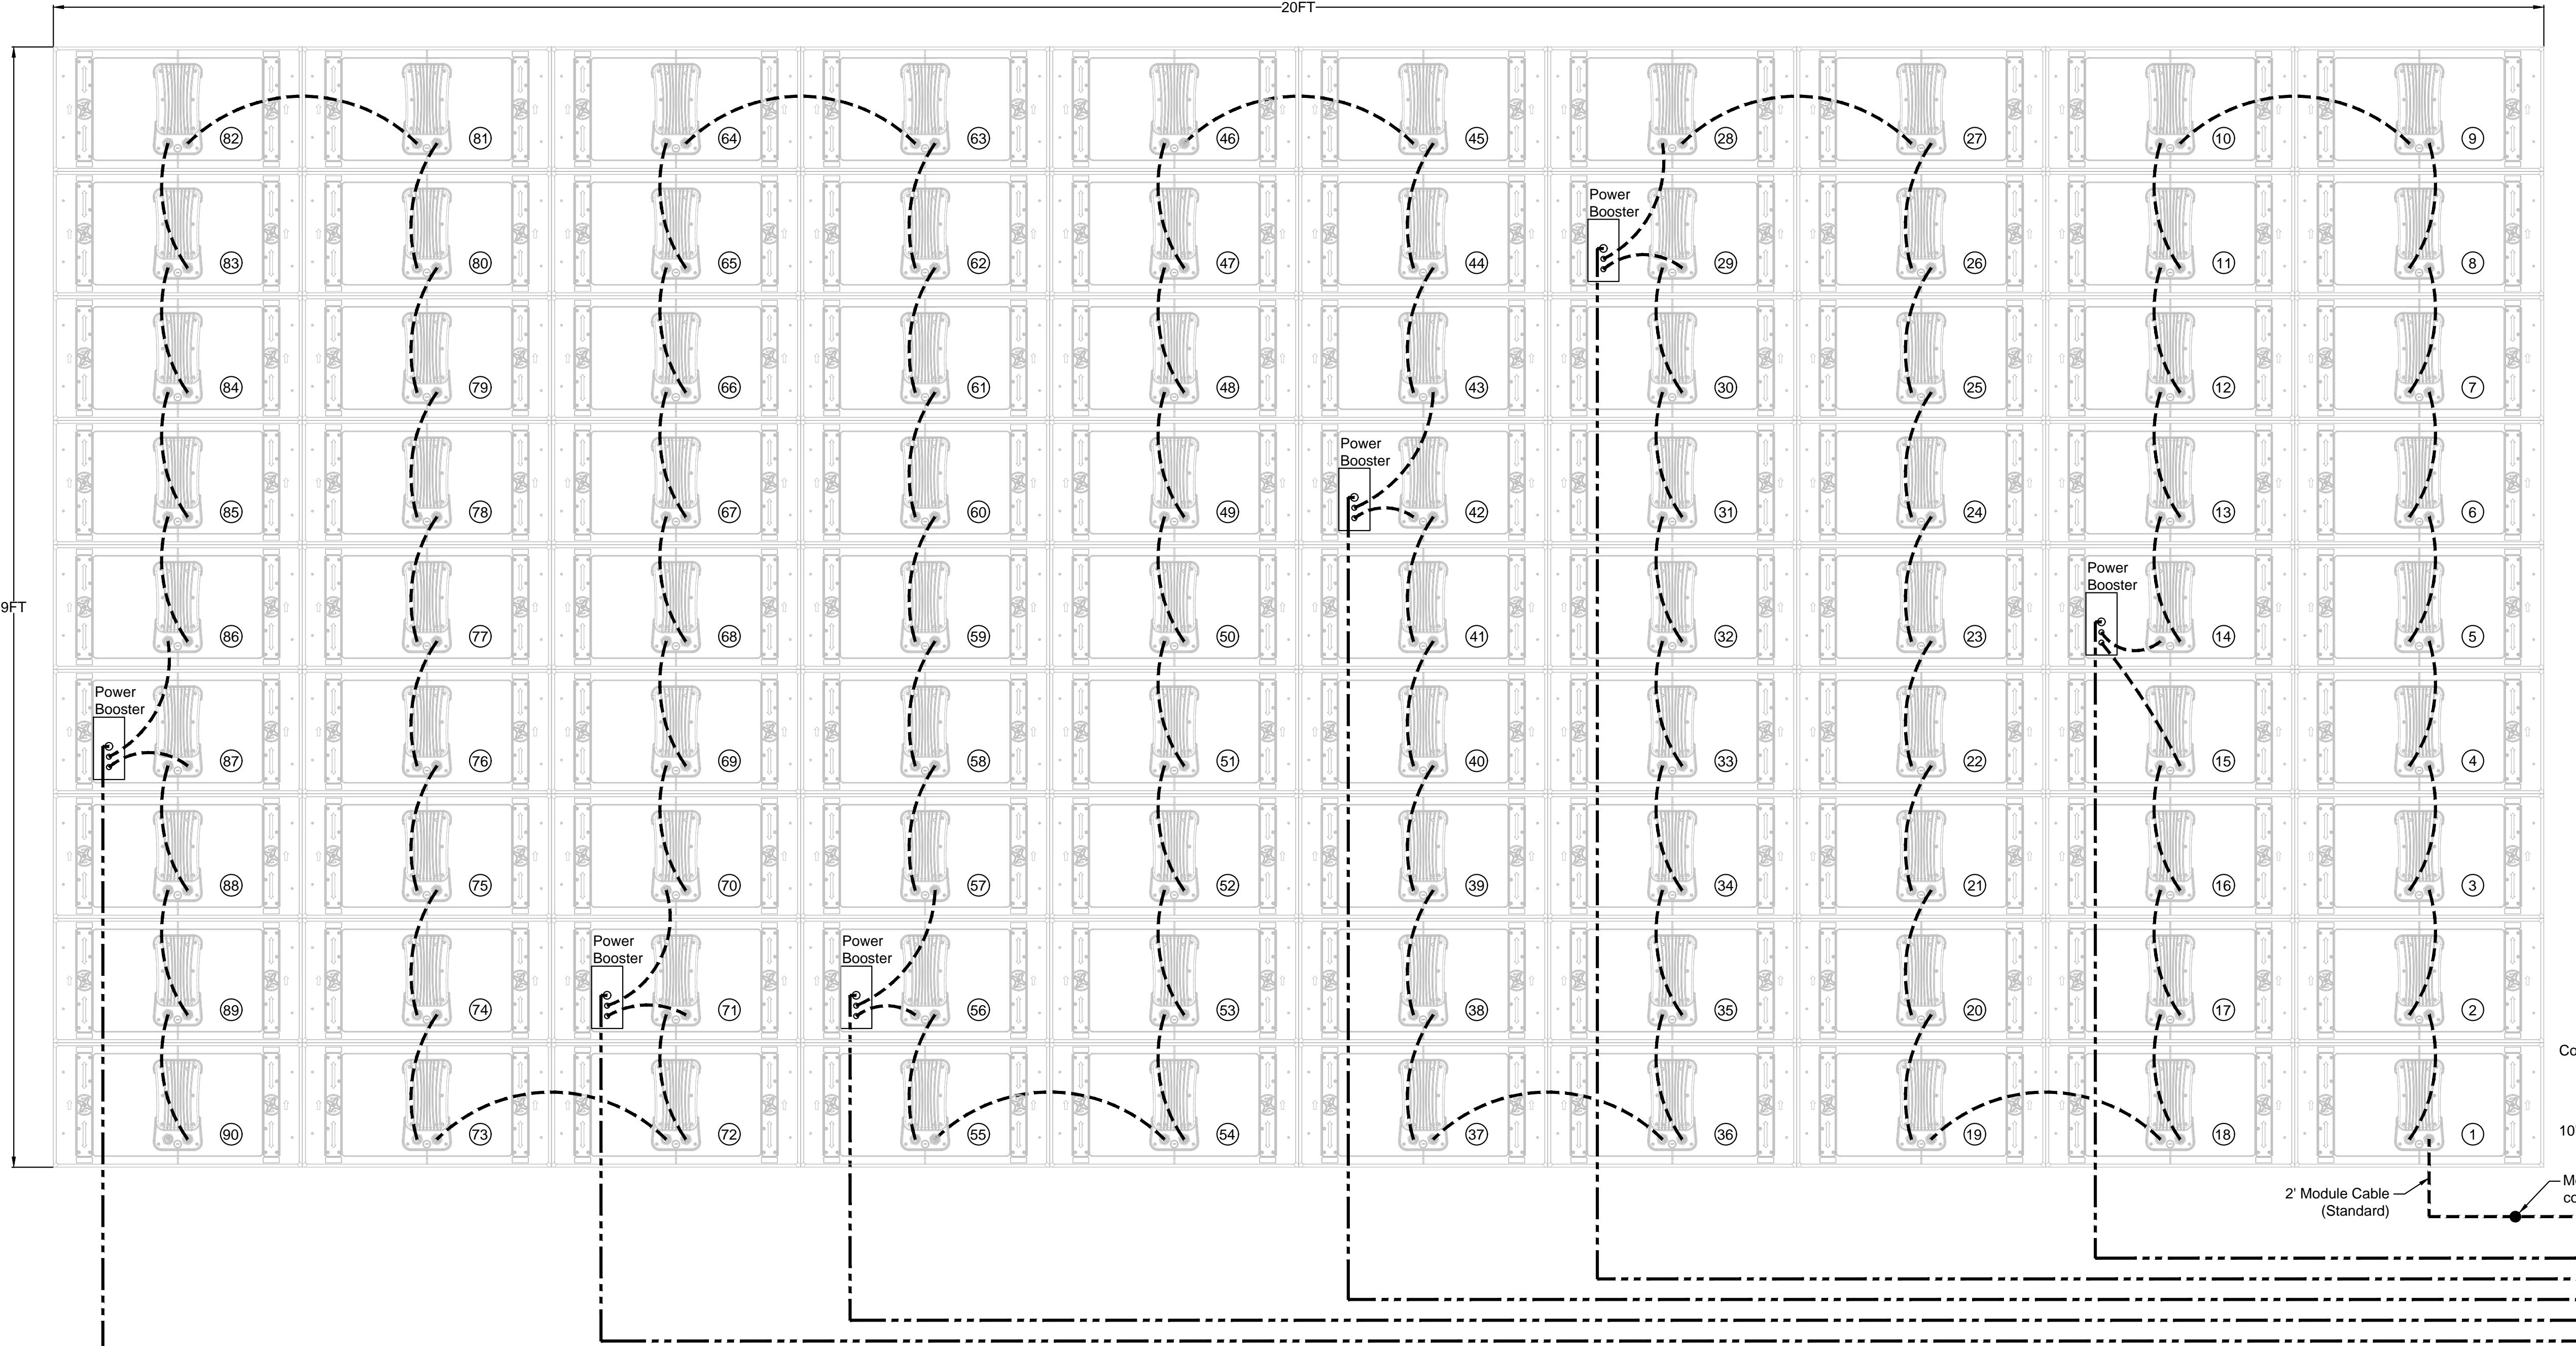


140 Amp Circuit
Breaker at Building

208V Circuit

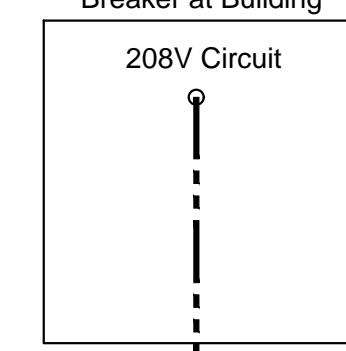

Sub-Panel at
the sign with (7)
20 Amp breaker
and line output

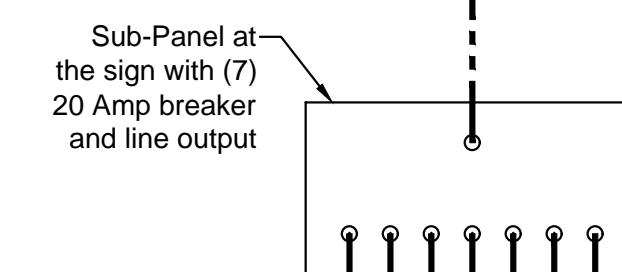

Power
Controller

10' Extension Cable
(Optional)

Module cable
connection

KEY PLAN

OWNER:

XXX
XXX
XXX
XXX

PROJECT #: XXXXX DATE: 05/20/2020

DRAWN BY: P.J.C. APPROVED BY: XX

SCALE: AS SHOWN REVISION: 0.0

PAGE # AND NAME:
V99.0 - 9ft x 20ft SINGLE
SCREEN DETAILS

REVISION

DATE # PAGE COMMENT
05/20/20 1 INITIAL DRAFT

ALL SCREEN WIRING SHOULD BE
CONFIRMED AND PERFORMED BY
A LOCALLY LICENSED ELECTRICIAN
IN ACCORDANCE WITH THE
CIRRUS SYSTEMS INCORPORATED
INSTALLATION MANUAL. FOR THIS
PRODUCT, SITE CONDITIONS MAY
VARY. IMPROPER WIRING CAN
RESULT IN ELECTRICAL SHOCK
AND DEATH.

001