


1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 | 10



CIRRUS
SYSTEMS, INC.

HEADQUARTERS
200 WEST RD,
PORTSMOUTH,
NH 03801
Phone: 877-636-2331

A

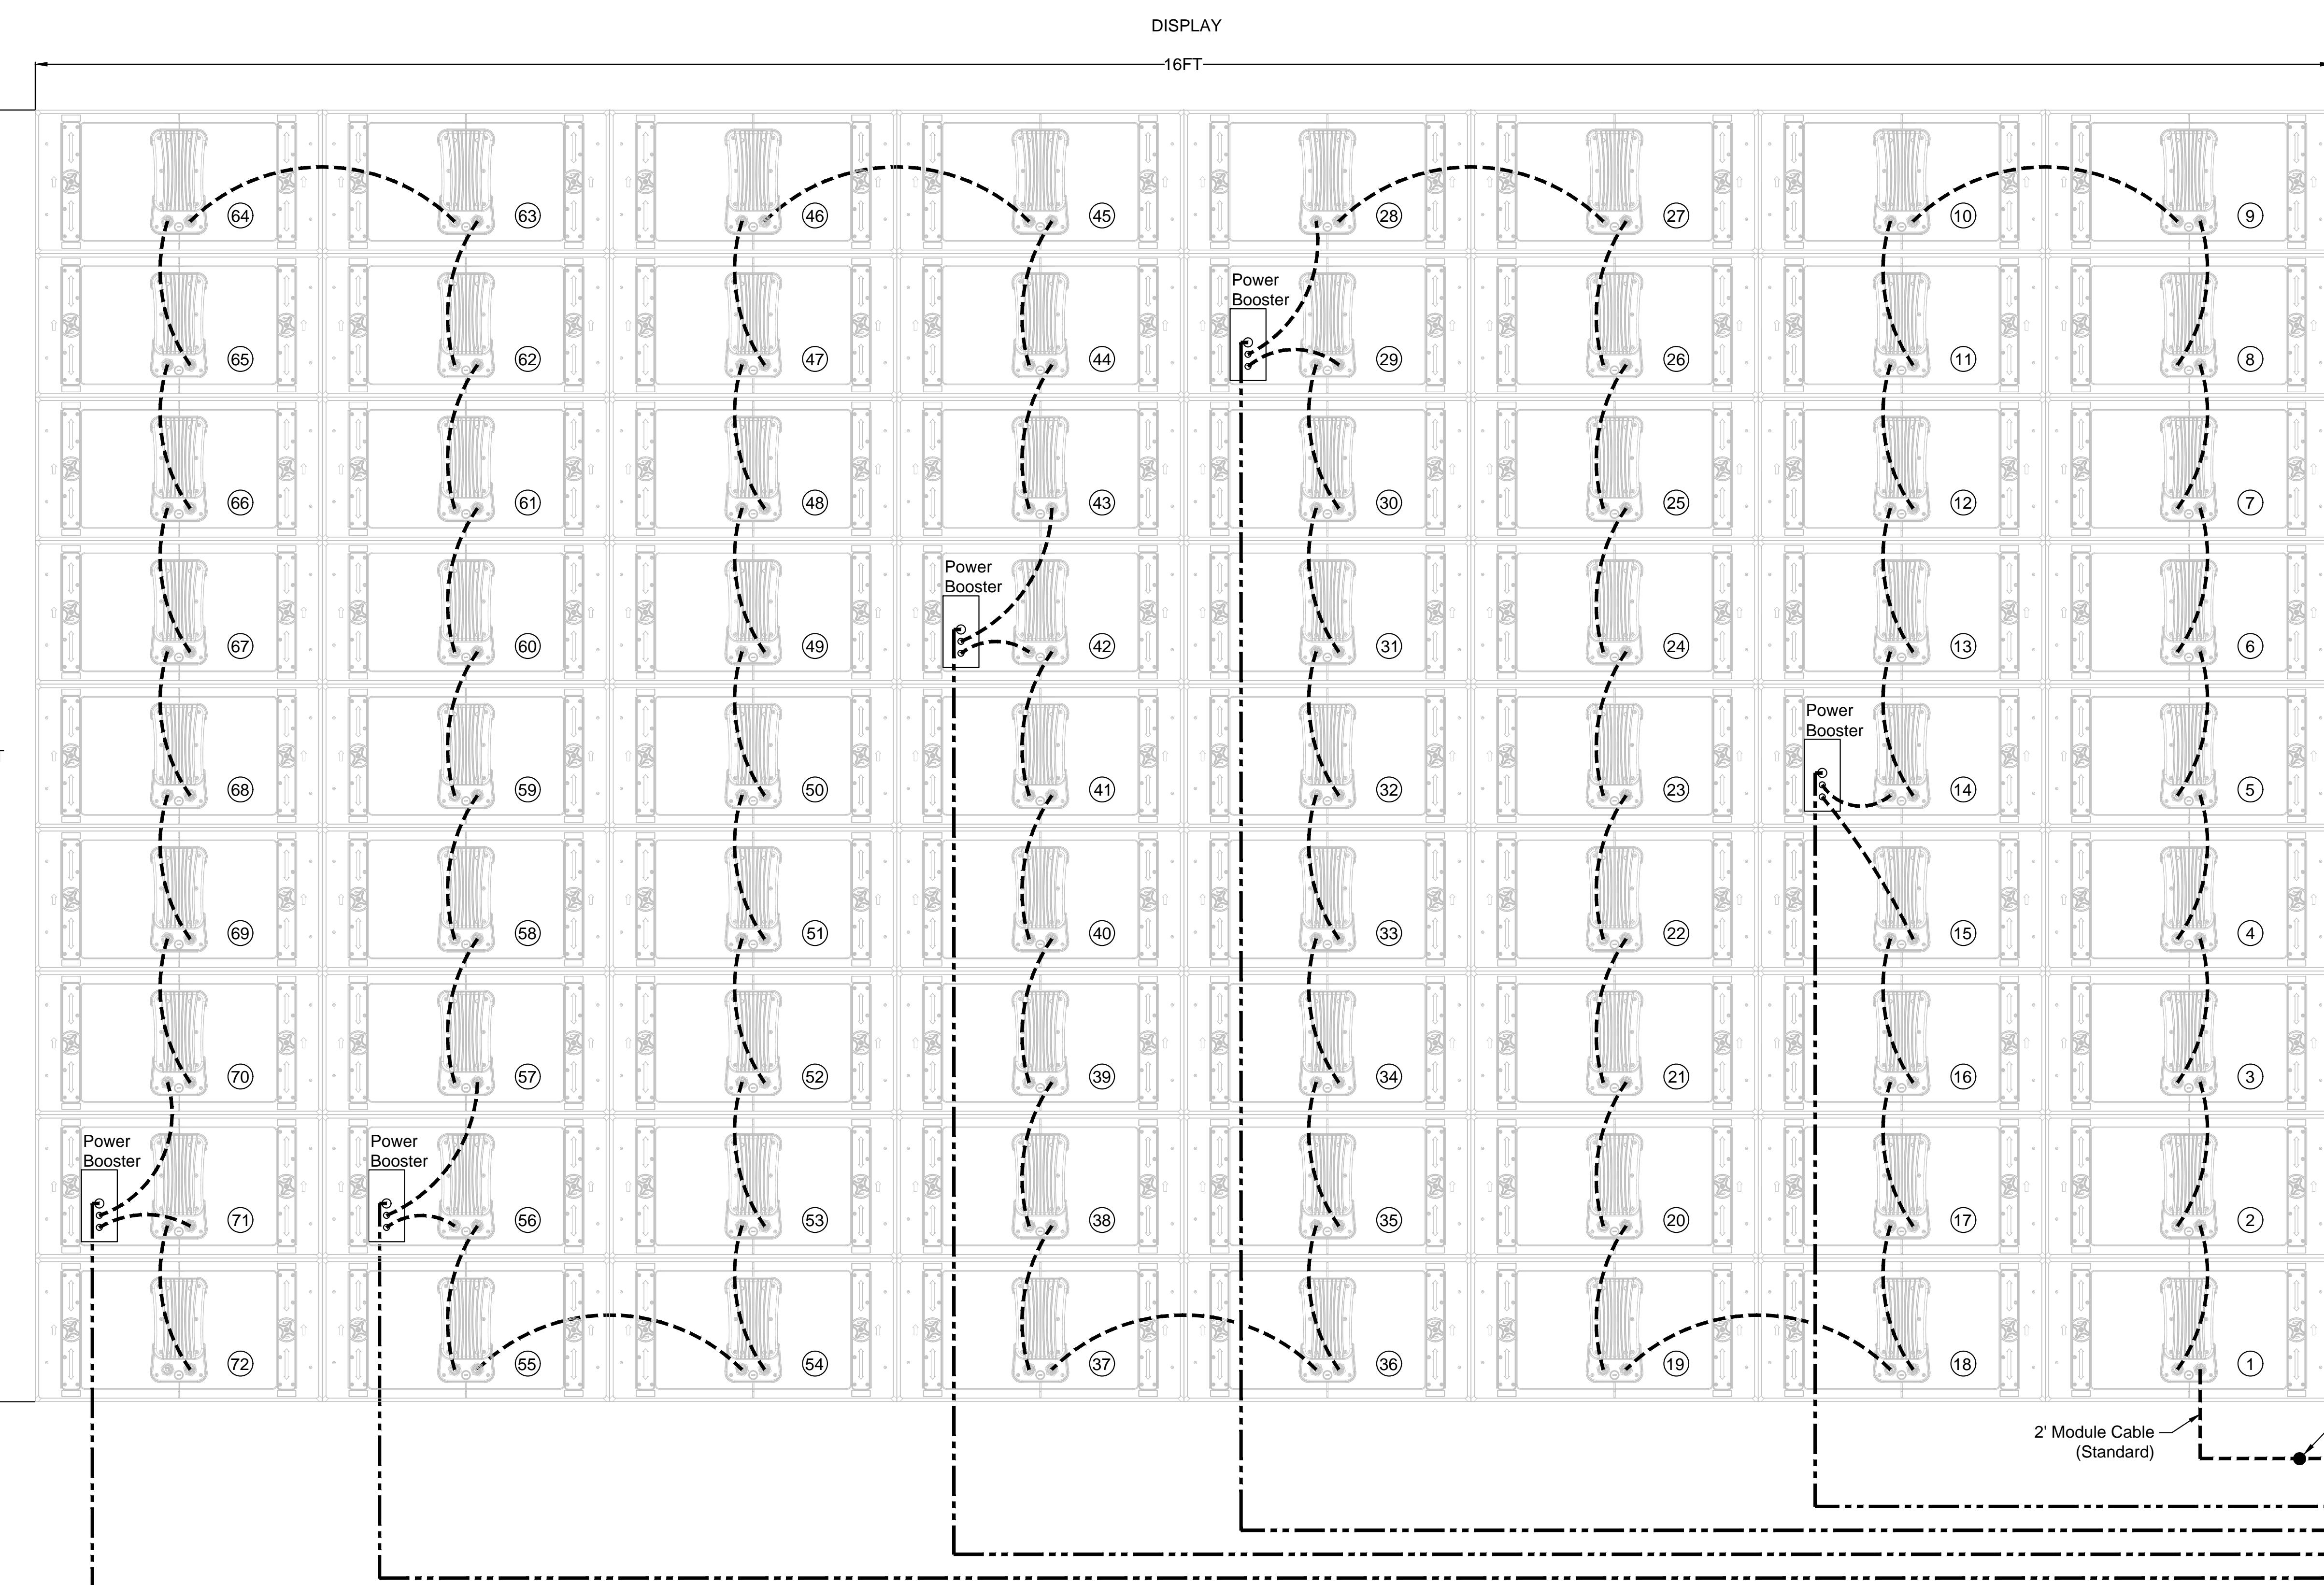

A

B

C

D


E

F

G

120 Amp Circuit
Breaker at Building

208V Circuit

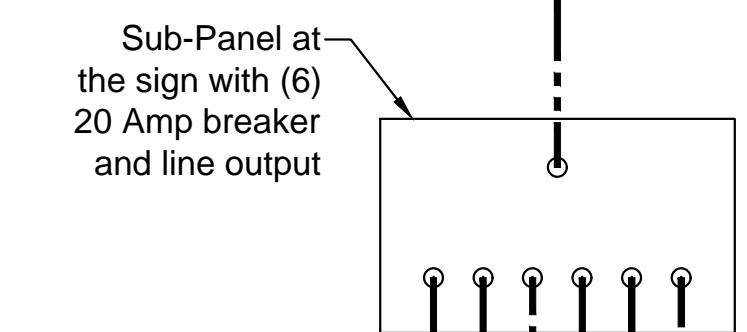

OWNER:

XXX
XXX
XXX
XXX

PROJECT #:	XXXX	DATE:	05/20/2020
DRAWN BY:	P.J.C.	APPROVED BY:	XX
SCALE:	AS SHOWN	REVISION:	0.0
PAGE # AND NAME:	V79.0 - 9ft x 16ft SINGLE SCREEN DETAILS		

REVISION

DATE	#	PAGE	COMMENT
05/20/20	1		INITIAL DRAFT

ALL SCREEN WIRING SHOULD BE
CONFIRMED AND PERFORMED BY
A LOCALLY LICENSED ELECTRICIAN
IN ACCORDANCE WITH THE
CIRRUS SYSTEMS INCORPORATED
INSTALLATION MANUAL. FOR THIS
PRODUCT, SITE CONDITIONS MAY
VARY. IMPROPER WIRING CAN
RESULT IN ELECTRICAL SHOCK
AND DEATH.

001