


1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 | 10 | 11

DISPLAY

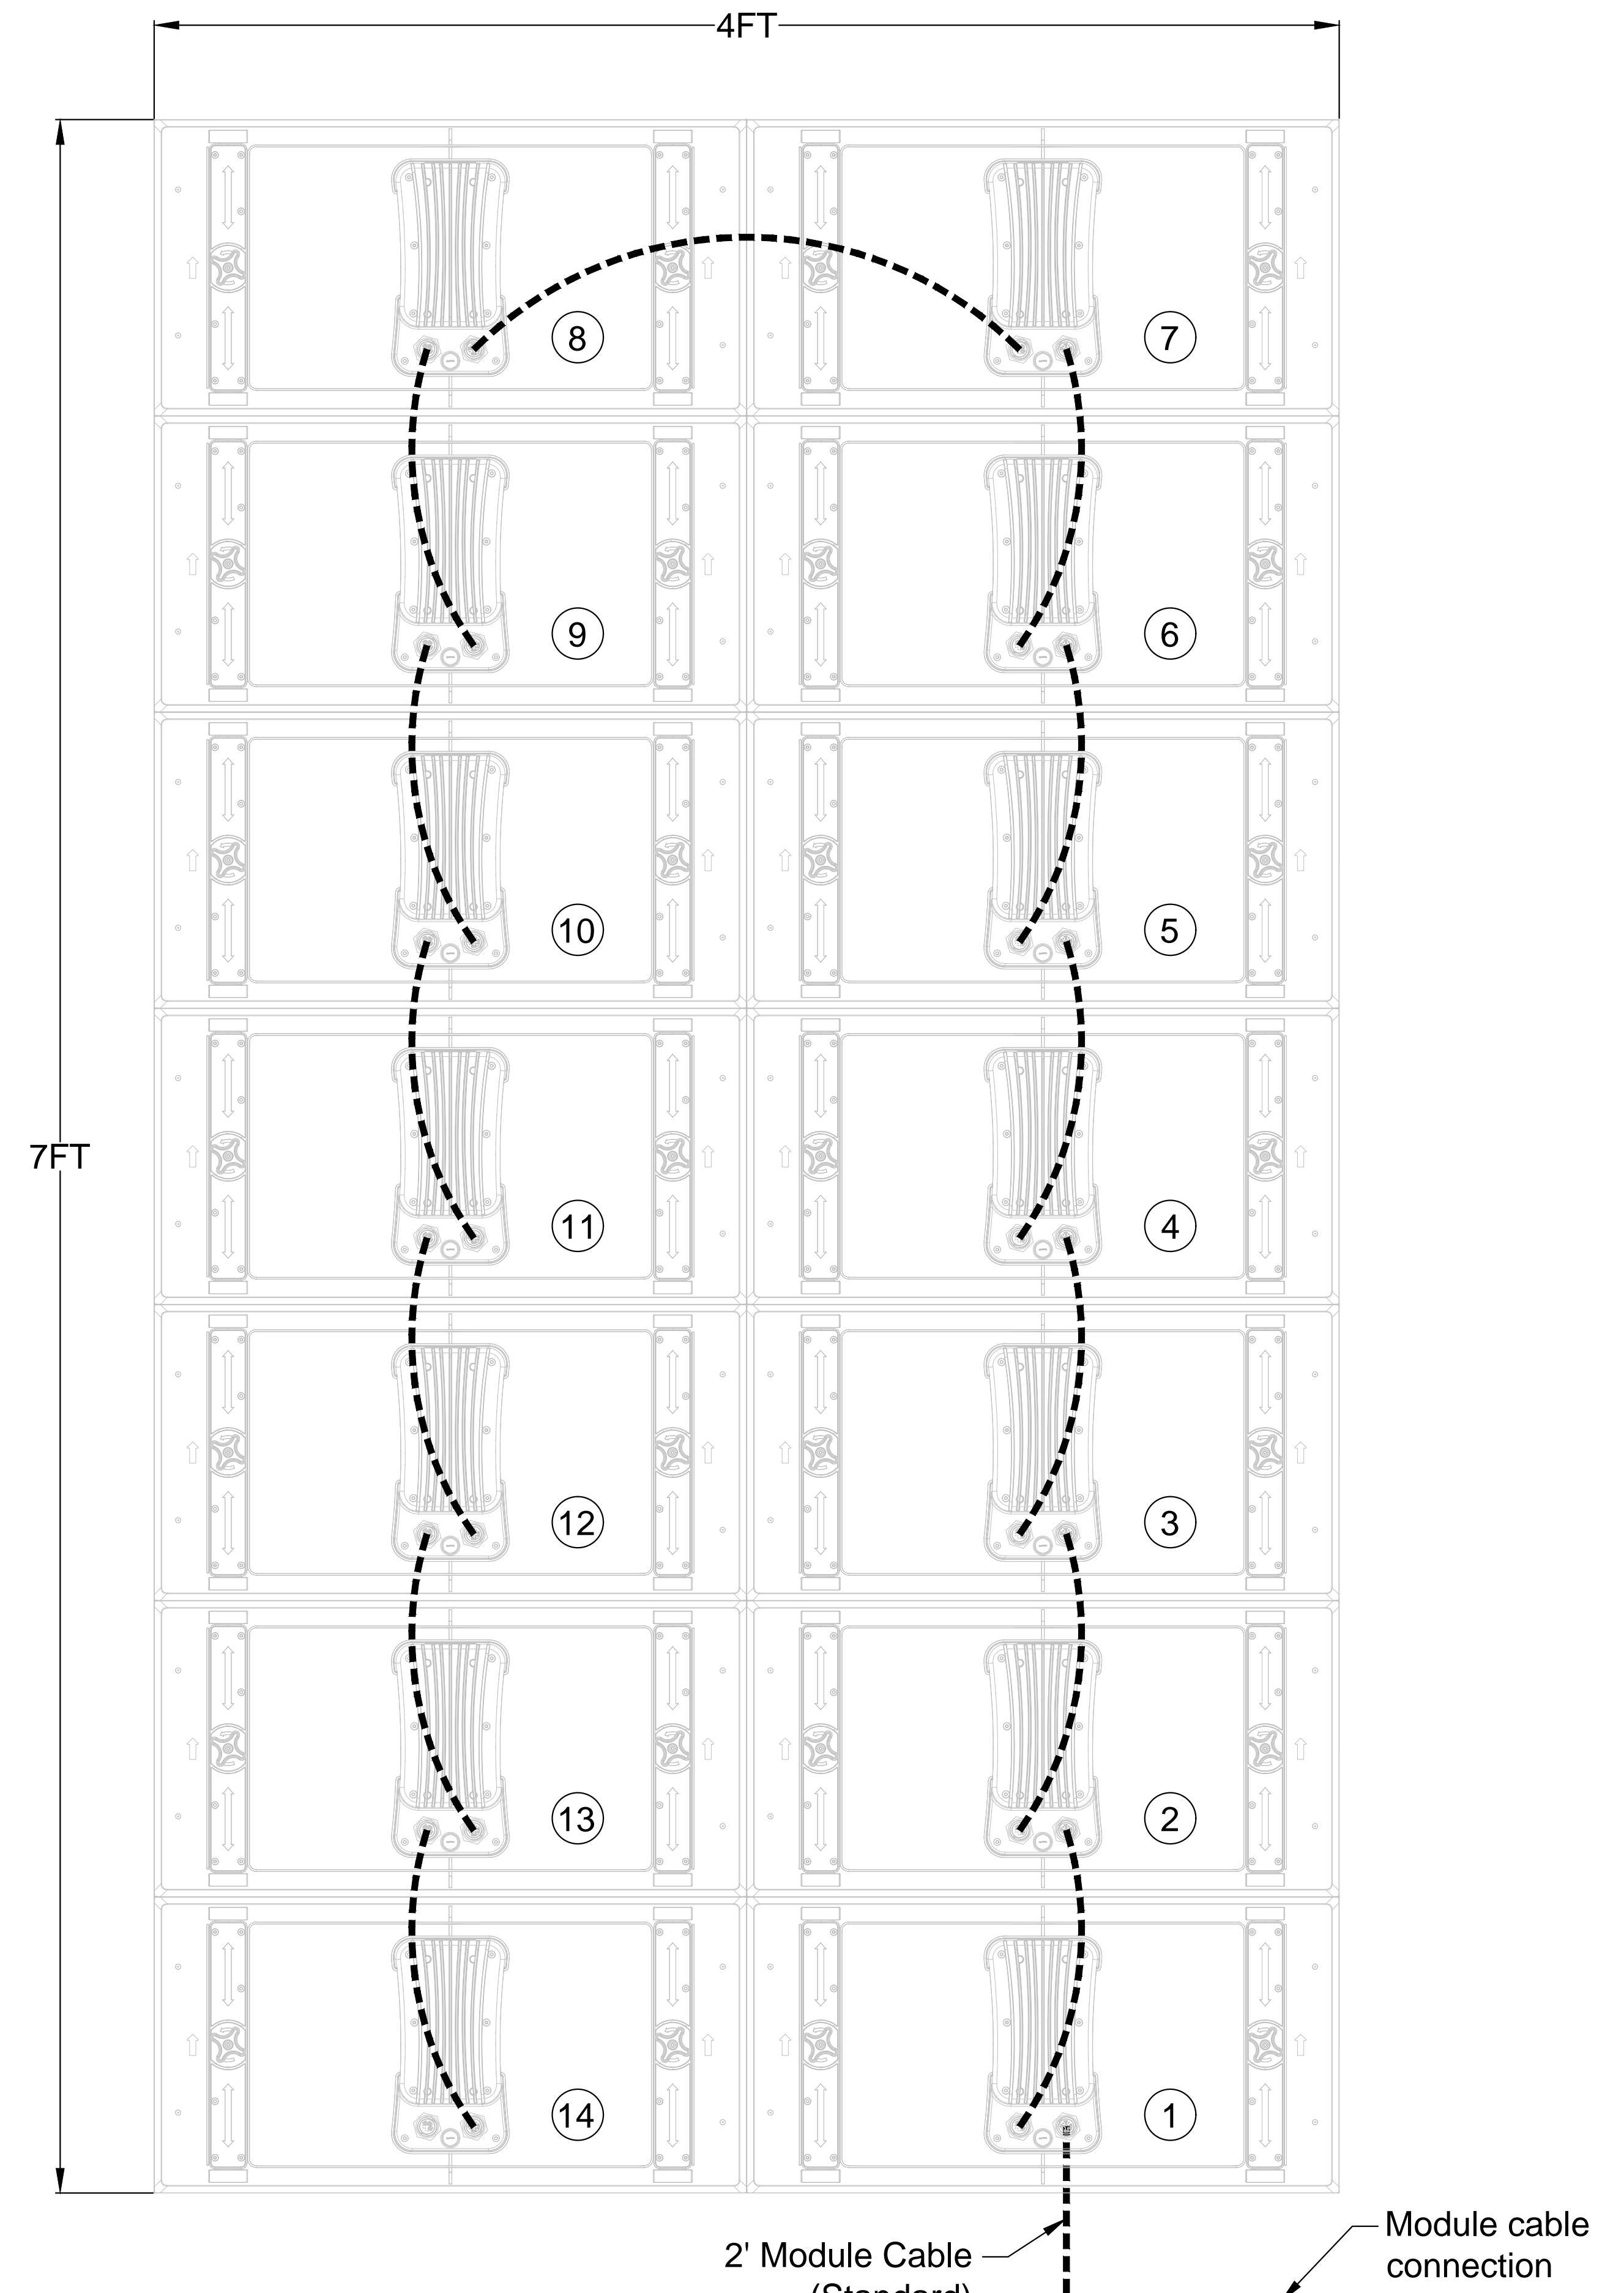


40 Amp Circuit Breaker at Building

208V Circuit

Sub-Panel at
the sign to step
down to 20 Amp
breaker and
line output

The diagram illustrates the connection of a Controller unit. A solid line labeled "Power" connects to the top terminal of the Controller. A dashed line labeled "10' Extension Cable (Optional)" connects from the bottom terminal of the Controller to a vertical dashed line.

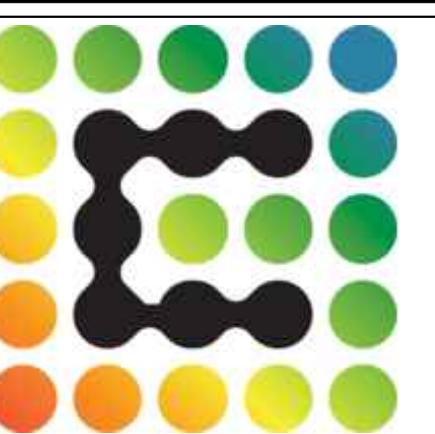

CIRRUS SYSTEMS, INC.

HEADQUARTERS
200 WEST RD,
PORTSMOUTH,
NH 03801
Phone: 877-636-2331

Phone: 877-858-2331

KEY PLAN

OWNER:

PROJECT #: XXXXX	DATE: 05/20/2020
DRAWN BY: P.J.C.	APPROVED BY: XX
SCALE: AS SHOWN	REVISION: 0.0
PAGE # AND NAME: V17.0 - 7ft x 4ft SINGLE	

REVISION

SCREEN WIRING SHOULD BE
NFERRED AND PERFORMED BY
OCALLY LICENSED ELECTRICIAN
CCORDANCE WITH THE
RUS SYSTEMS INCORPORATED
STALLATION MANUAL FOR THIS
ODUCT. SITE CONDITIONS MAY
Y. IMPROPER WIRING CAN
ULT IN ELECTRICAL SHOCK
O DEATH.

001