

1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 | 10



CIRRUS
SYSTEMS, INC.

HEADQUARTERS
200 WEST RD,
PORTSMOUTH,
NH 03801
Phone: 877-636-2331

A

A

B

B

C

C

D

D

E

E

F


F

G


G

DISPLAY


8FT

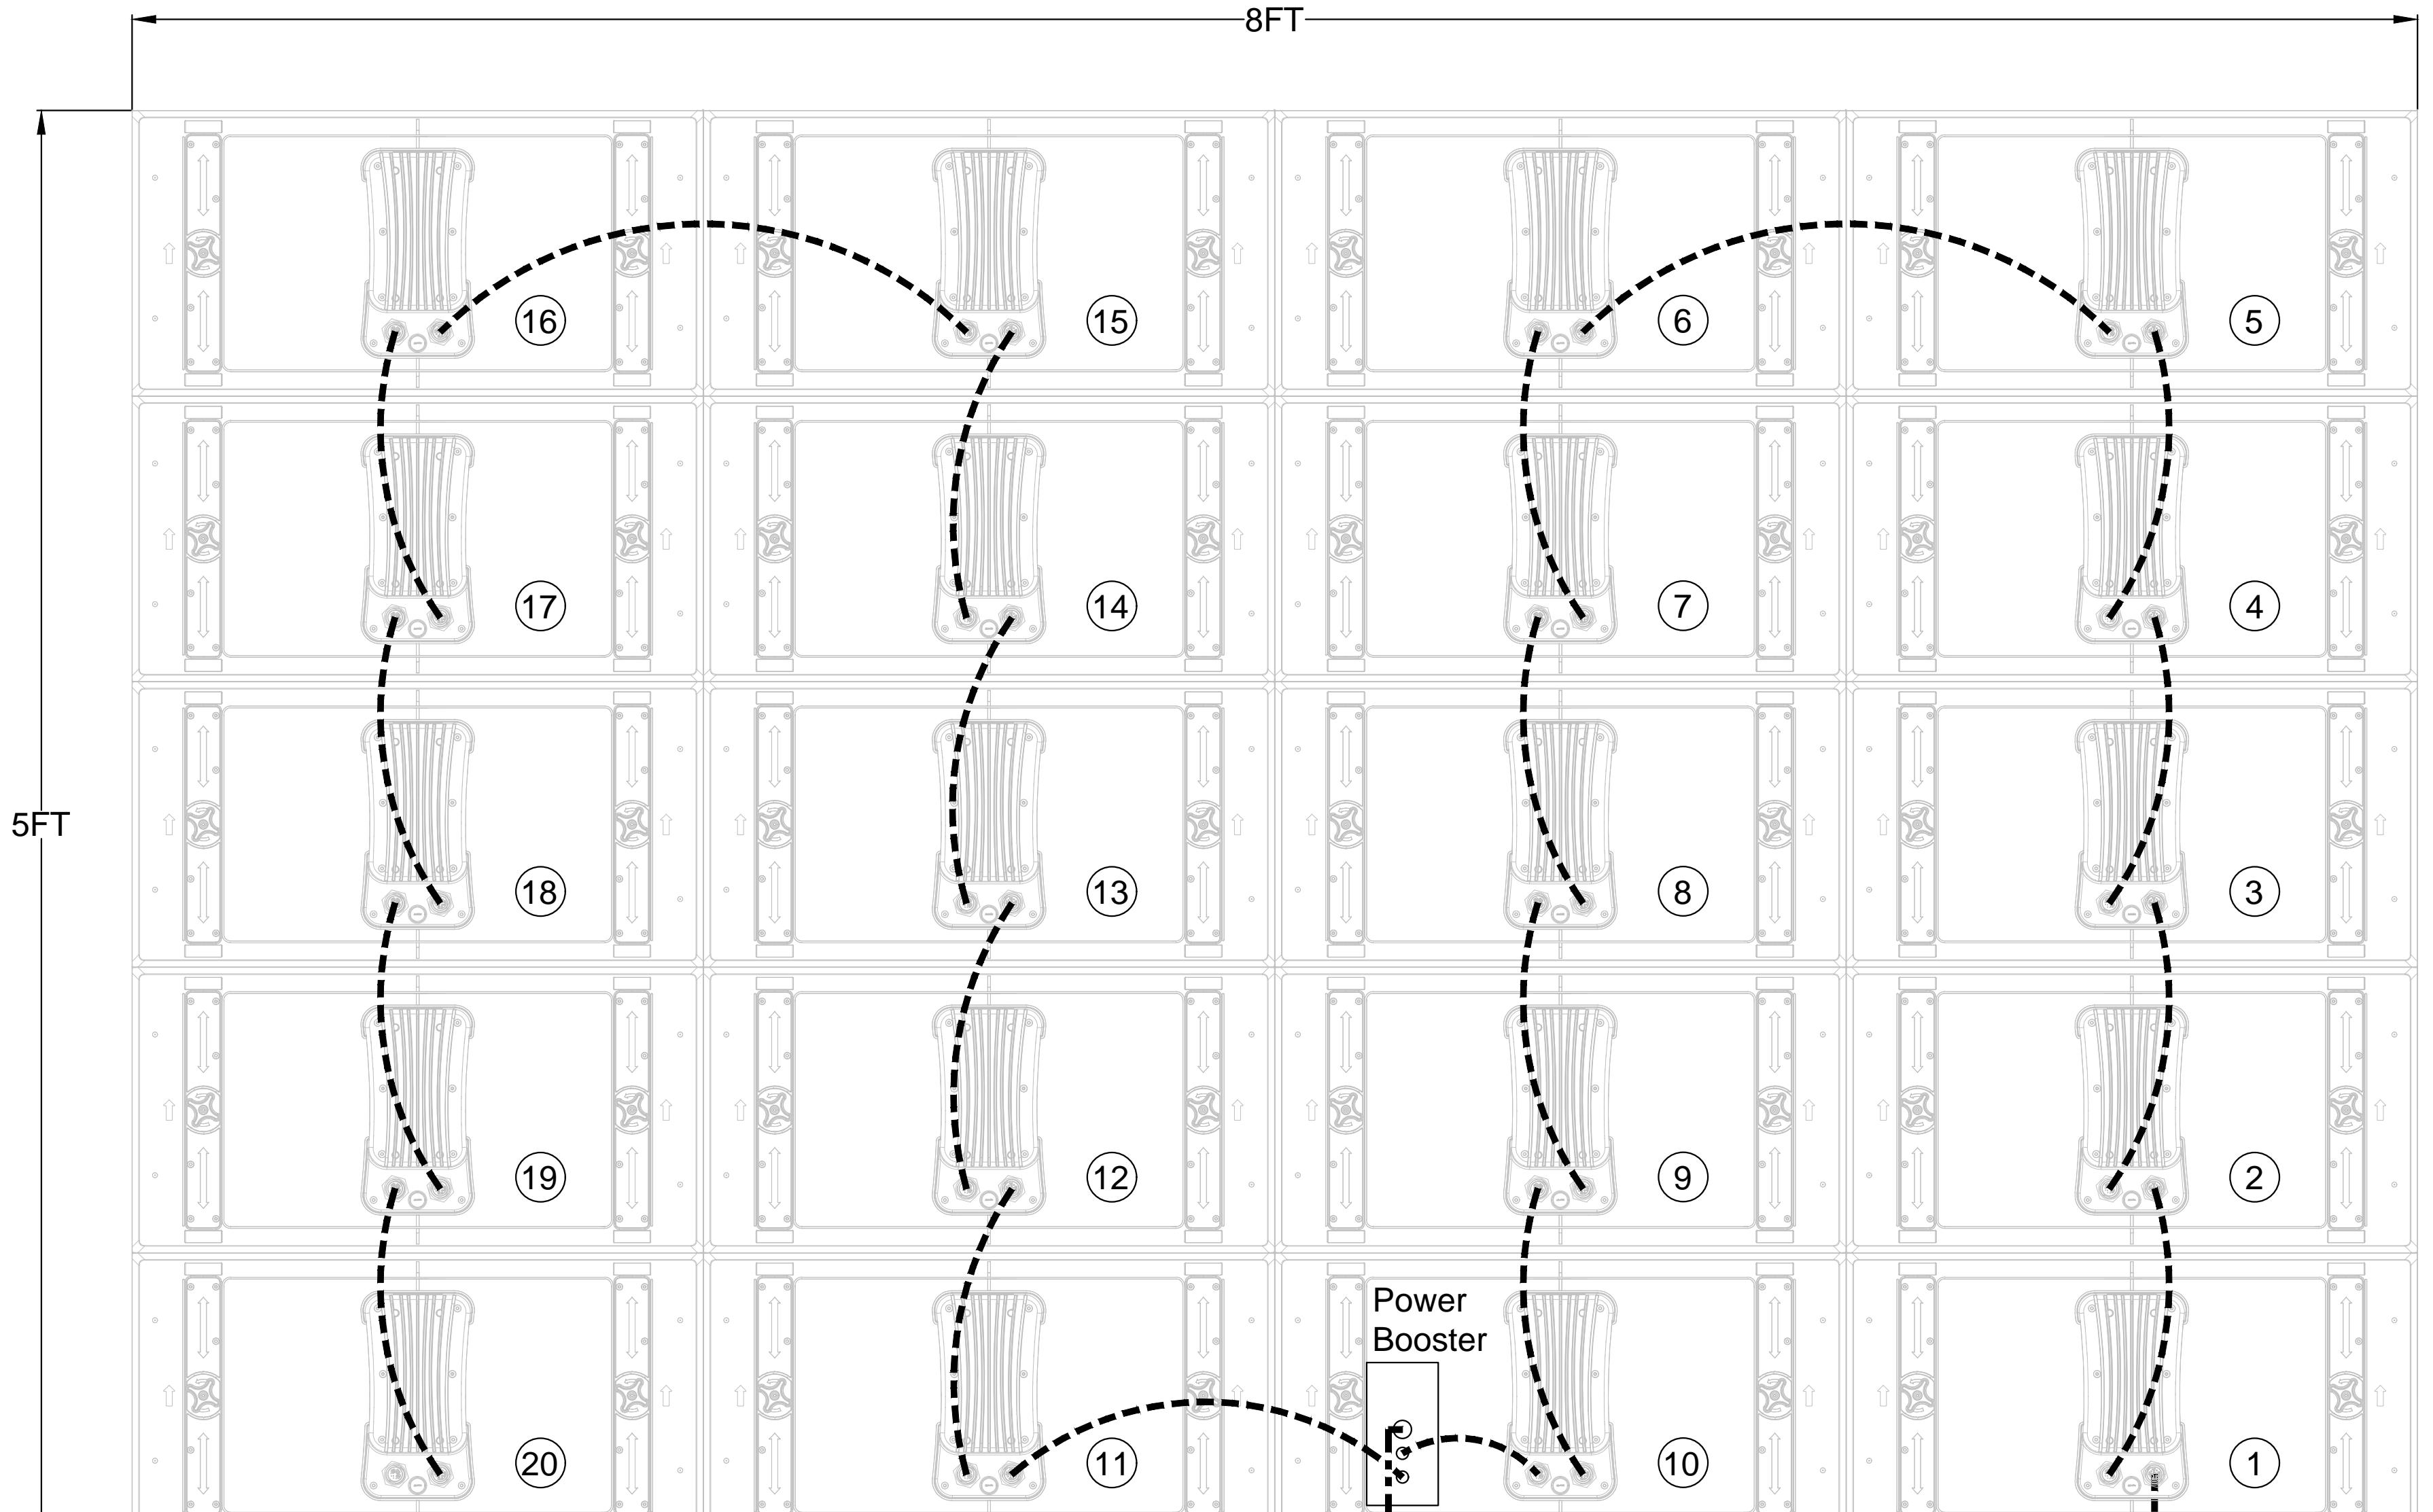

40 Amp Circuit
Breaker at Building

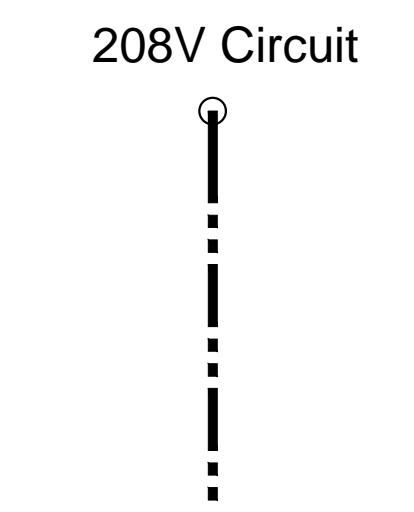

Sub-Panel at
the sign to step
down to 20 Amp
breaker and
line output

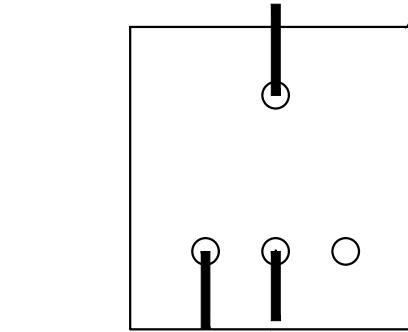

2' Module Cable
(Standard)

Module cable
connection

10' Extension Cable
(Optional)

Power
Controller

Module Cable

1 5ft x 8ft SINGLE SCREEN
NO SCALE

1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 | 10

001

ALL SCREEN WIRING SHOULD BE
CONFIRMED AND PERFORMED BY
A LOCALLY LICENSED ELECTRICIAN
IN ACCORDANCE WITH THE
CIRRUS SYSTEMS INCORPORATED
INSTALLATION MANUAL. FOR THIS
PRODUCT, SITE CONDITIONS MAY
VARY. IMPROPER WIRING CAN
RESULT IN ELECTRICAL SHOCK
AND DEATH.

KEY PLAN

OWNER:

XXX
XXX
XXX
XXX

PROJECT #: DATE:
XXXXX 05/20/2020

DRAWN BY: APPROVED BY:
P.J.C. XX

SCALE: REVISION:
AS SHOWN 0.0

PAGE # AND NAME:
V35.0 - 5ft x 8ft SINGLE
SCREEN DETAILS

REVISION

DATE # PAGE COMMENT
05/20/20 1 INITIAL DRAFT