


3) **Testing New Water Line:** All pumps, gauges, plugs, saddles, corporation stops, miscellaneous hose, pipe, and measuring equipment necessary for performing the test shall be furnished and installed by contractor. The test for cast iron pipe will be 300 pounds, test for ductile iron pipe will be 275 pounds, each for 15 minutes with a loss of not more than 15 pounds. Chlorine must be used in testing water. The new main will be tested with all services, blow-offs, and air-release valves installed. Test will be made on all valves including fire hydrant valves.

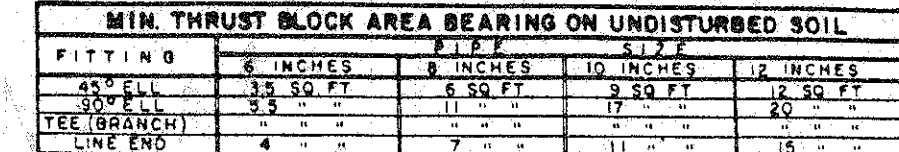

APPROVED FOR CONSTRUCTION
Joe E. Bischman 10/20/86
CITY OF MOUNTLAKE TERRACE DATE

SHEET 2 OF 5

3 REV BLDG 2 1/5 LAYOUT & WEST S.S. RUN
2 REV. BLDG 5 SERVICE PER CITY
1 ADD WET TAP, MOVE WATER PER CITY REVIEW

SILVER OAK II SEWER & WATER PLAN

CITY OF MOUNTLAKE TERRACE

WASHINGTON

85-501