TYPICAL
FIRE HYDRANT LOCATION PLAN


NOT TO SCALE

CUT INTO EXIST. 8" MAIN & INSTALL
1-8" TEE (MJ)
2-8" G.V. (MJ)RELOCATED PRV ASSY
W/NEW VAULT FROM
252ND ST. LOCATIONASPHALT REPAIR PER CITY OF
M.L.T. STD. No. 107 SEE
DETAIL, SHEET C-5395
400
405

CEDAR WAY

EXIST 8" WATER

- REMOVAL OF EXISTING PRV VAULT:
- 1) MJ SLEEVE BOTH ENDS OF EXIST. 8" MAIN.
 - 2) BREAK DOWN WALLS OF VAULT. REMOVE DEBRIS & FILL VOID WITH 1 1/2" MINUS.
 - 3) ASPHALT REPAIR PER CITY OF M.L.T. STANDARD No. 107 SEE DETAIL SHEET C-5


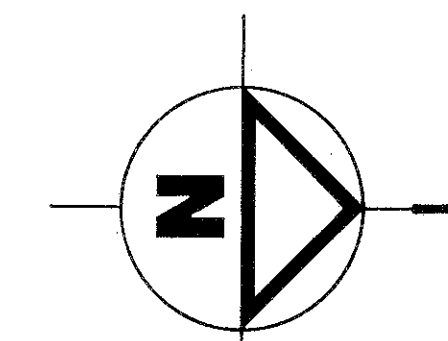


SCALE 1" = 30'

WATER SERVICE DATA

AVAILABLE PRESSURE AT CEDAR WAY = 83 PSI

BUILDING	METER SIZE	SERVICE LINE SIZE
A, D, E, F, G, H, J, K, L, M, N, T, U	1 1/2"	1 1/2"
B, C, P, Q, R, S	1"	1 1/4"
REC. BLDG.	1"	1 1/4"

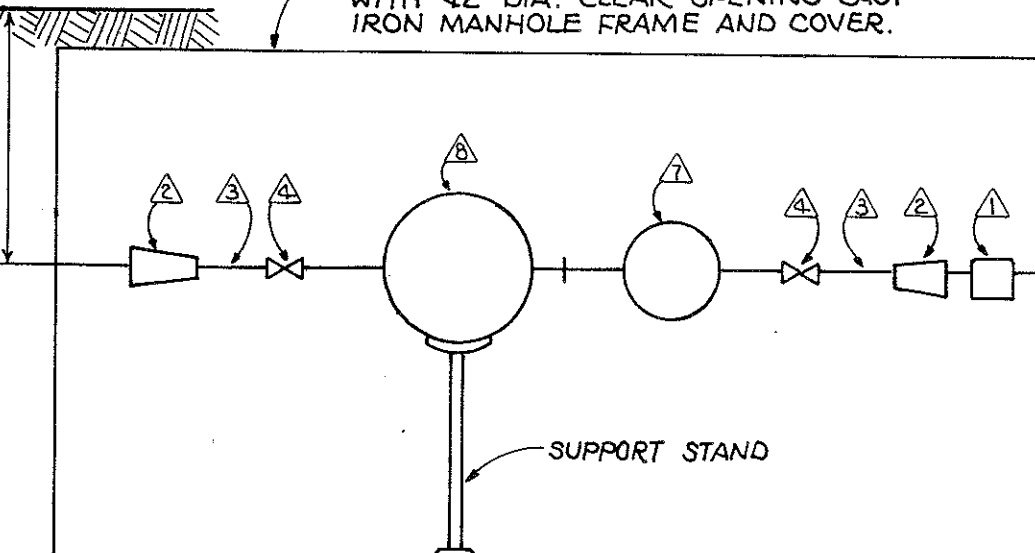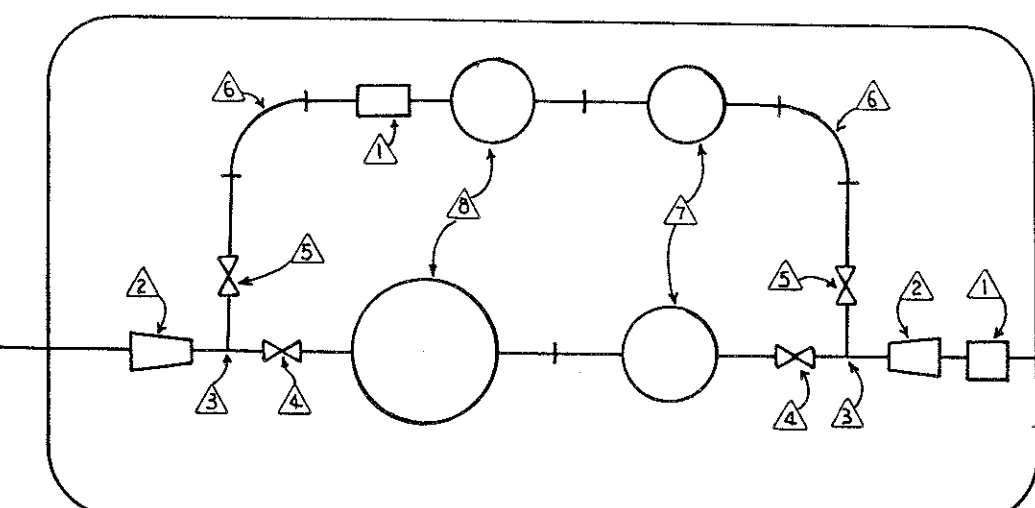

- △ MJ SPOOL
- △ 8" x 6" MJ x FLS REDUCER
- △ 6" x 2" FLS TEE
- △ 6" FLS IOWA NON-RISING STEM GV W/ HAND WHEEL
- △ 2" FLS IOWA NON-RISING STEM GV W/ HAND WHEEL
- △ 2" 30° BEND
- △ CLA - VAL "Y" STRAINER
- △ CLA - VAL PRESSURE REDUCING VALVE
- △ 6" - 90G - GIAB PILOT CRD - 2-75 W/ SUPPORT STAND
- △ 2" - 90G - 01 PILOT CRD - 2-75

P.R.V. ASSEMBLY DETAIL

N.T.S.

APPROVED FOR CONSTRUCTION

19
CITY OF MOUNTLAKE TERRACE DATE 7/28/88

159-88-4

SEWER & WATER PLAN

MARKLAND WOODS


City of Mountlake Terrace
Snohomish County, Washington

SHEET NO C4

JOB NO 87-4512

GROUP FOUR, Inc.
19502 56th Avenue West
Lynnwood, Washington 98036 • 206 775-4581

ENGINEERING PLANNING
DRAWN BY KRW
CHECKED BY REM 12-11-87
APPROVED BY 7/22/87

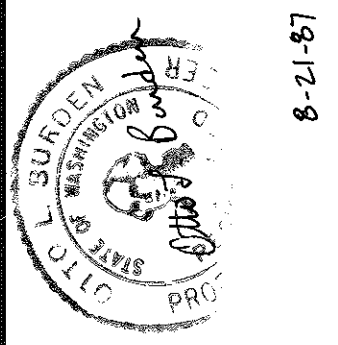

NO.	REVISION	DATE	BY
1	REV. PER CITY COMMENTS DATED 10-18-87	12-15-87	JB
2	REV. PER CITY COMMENTS DATED 6-22-88	7-20-88	MEP
3	REV. PER CLIENT REVISION	9-15-88	MEP
4	REV. PER CONTRACTOR	10-10-88	MEP
5	REV. PER CONTRACTOR	11-2-88	MEP
6	REV. PER CONTRACTOR	11-2-88	MEP
7	REV. PER CONTRACTOR	11-2-88	MEP
8	REV. PER CONTRACTOR	11-2-88	MEP
9	REV. PER CONTRACTOR	11-2-88	MEP