


TEST PIT LOG AT PUMP STATION

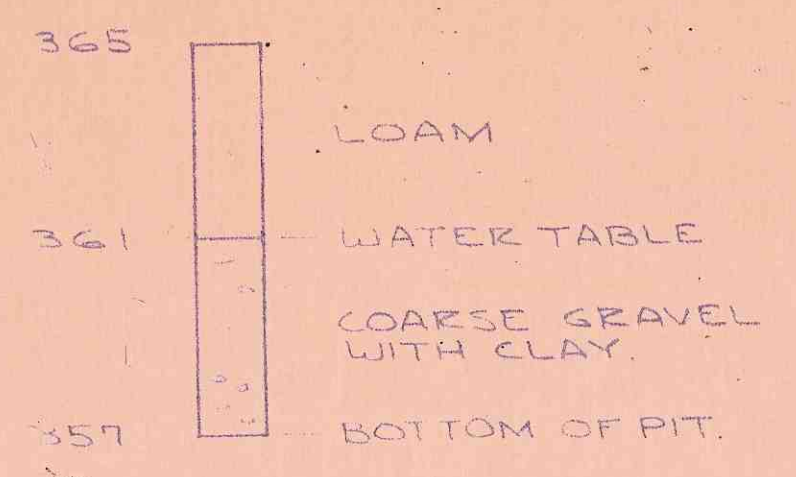


LIST OF VALVES AND FITTINGS TO BE FURNISHED BY CITY

QUAN.	DESCRIPTION
4	6" C.I. PLUG VALVES
2	6" C.I. CHECK VALVES
2	6" C.I. 90° BEND

3/4" GALV. BOLT, NO THREADS, BEND AS SHOWN.
3" x 3/4" x 2' 6" LONG, SECURE TO CONC. WITH 2 3/8" GALV. EXP. BOLTS. SET AT SLIGHT ANGLE TO PROVIDE WEDGING ACTION TO DOG DOWN HATCH TIGHT.


HATCH LOCK

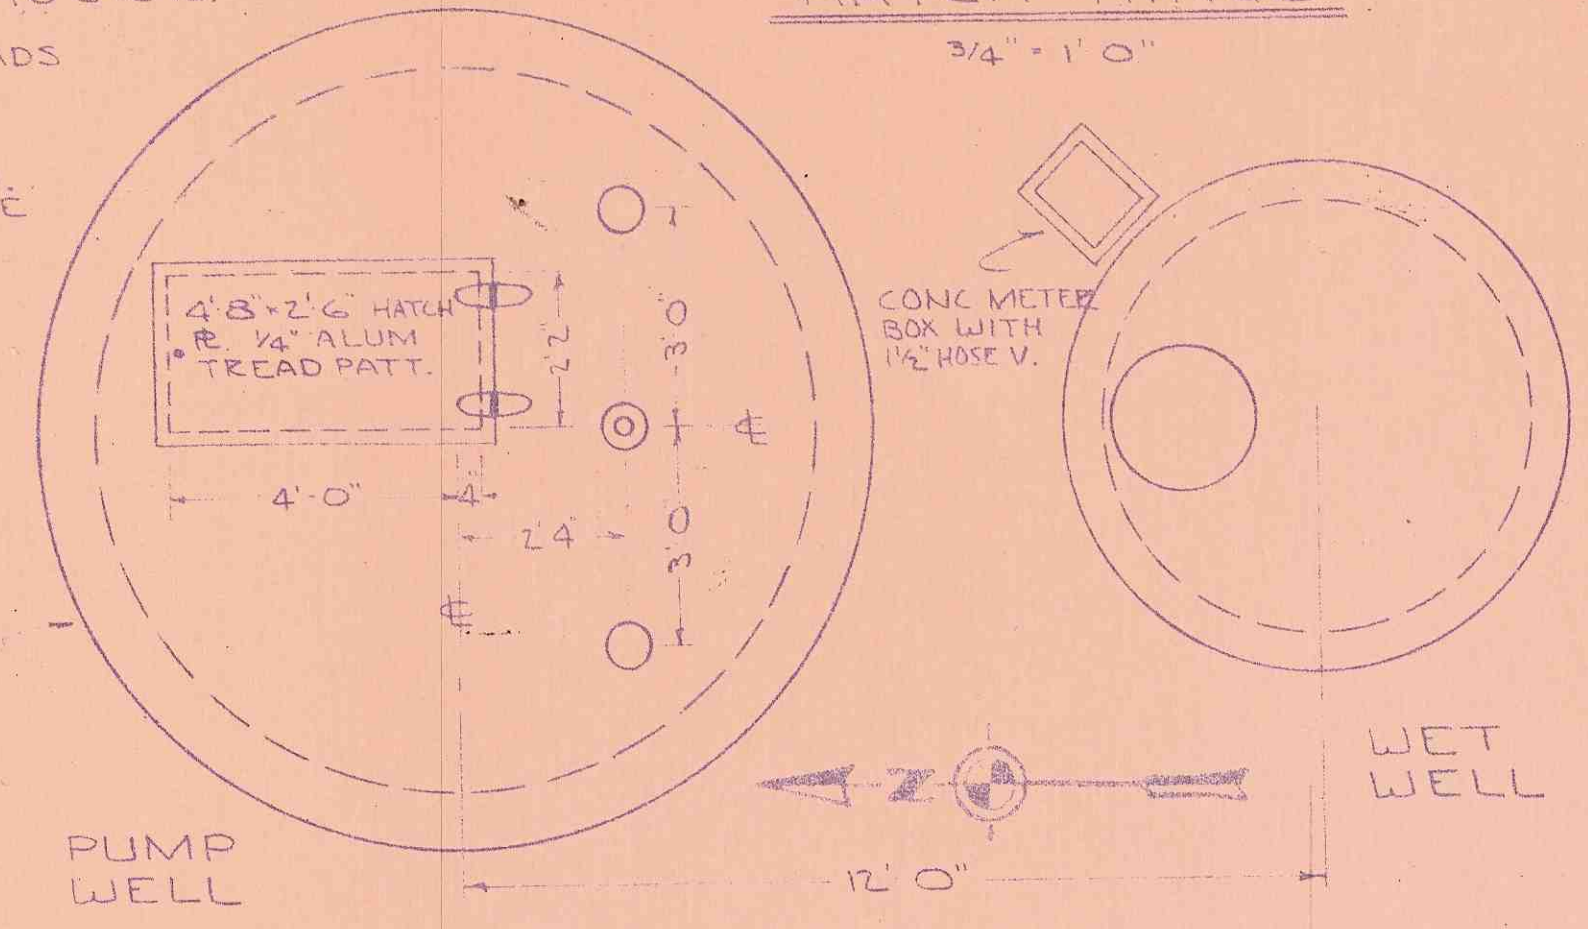



TOP SLAB TO BE 8" THICK AT HATCH OPENING AND SLOPE DN. TO 7" THICK AT OUTER EDGES.

4" @ 8" O.C. EACH WAY 3/4" CLEAR OF BOT.

PLAN - TOP SLABS

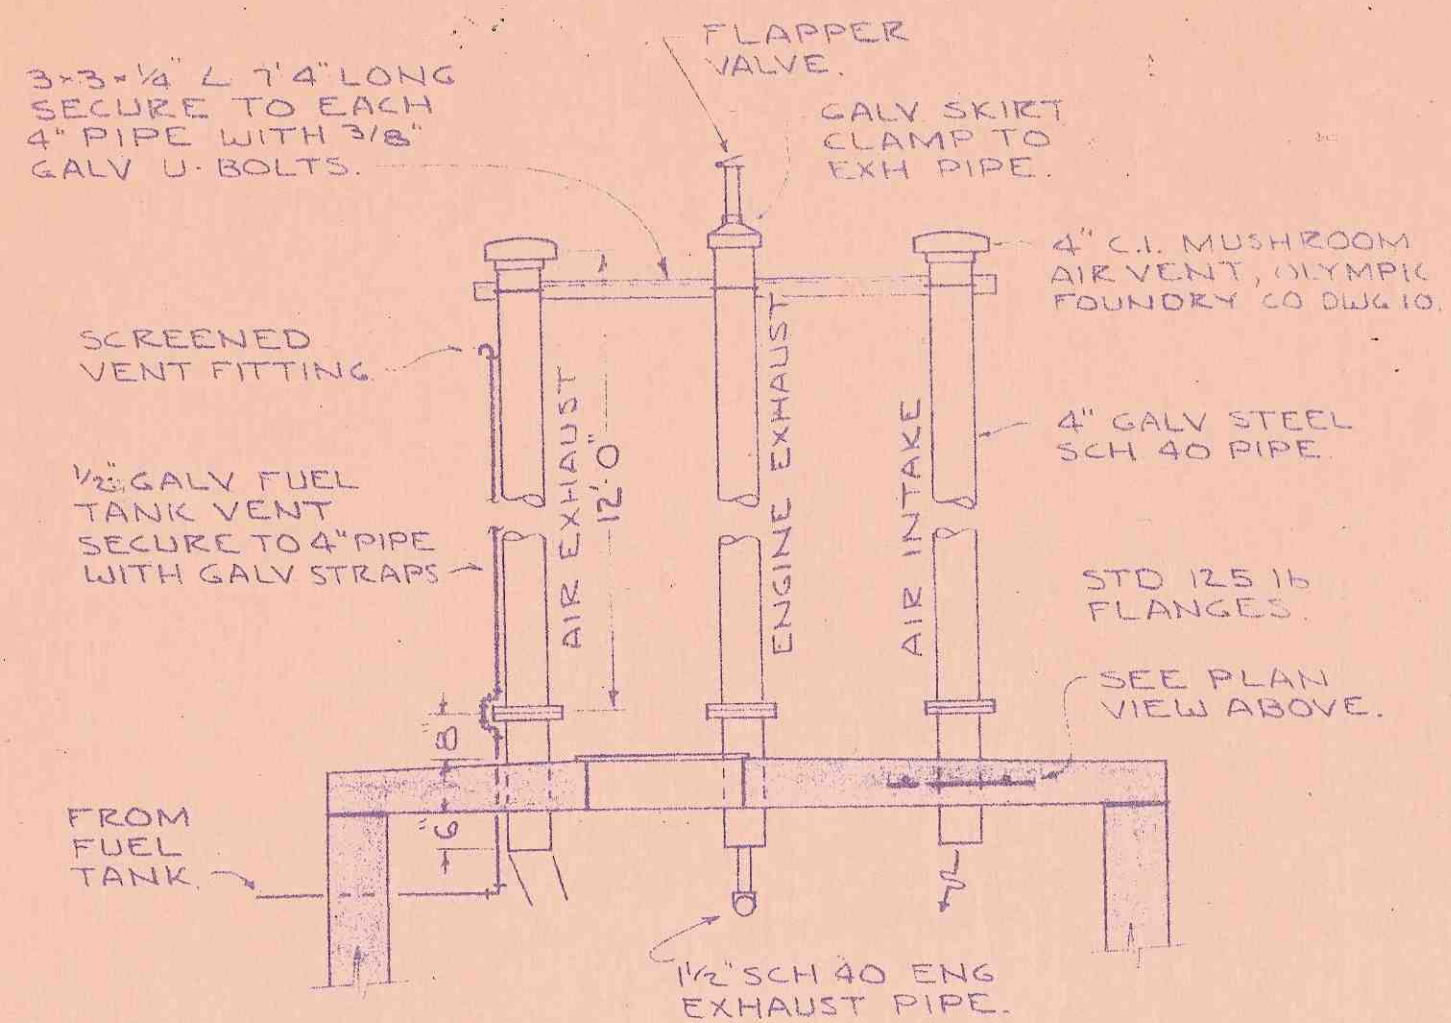


Scan Name: scans06369.pdf
Scan Date:

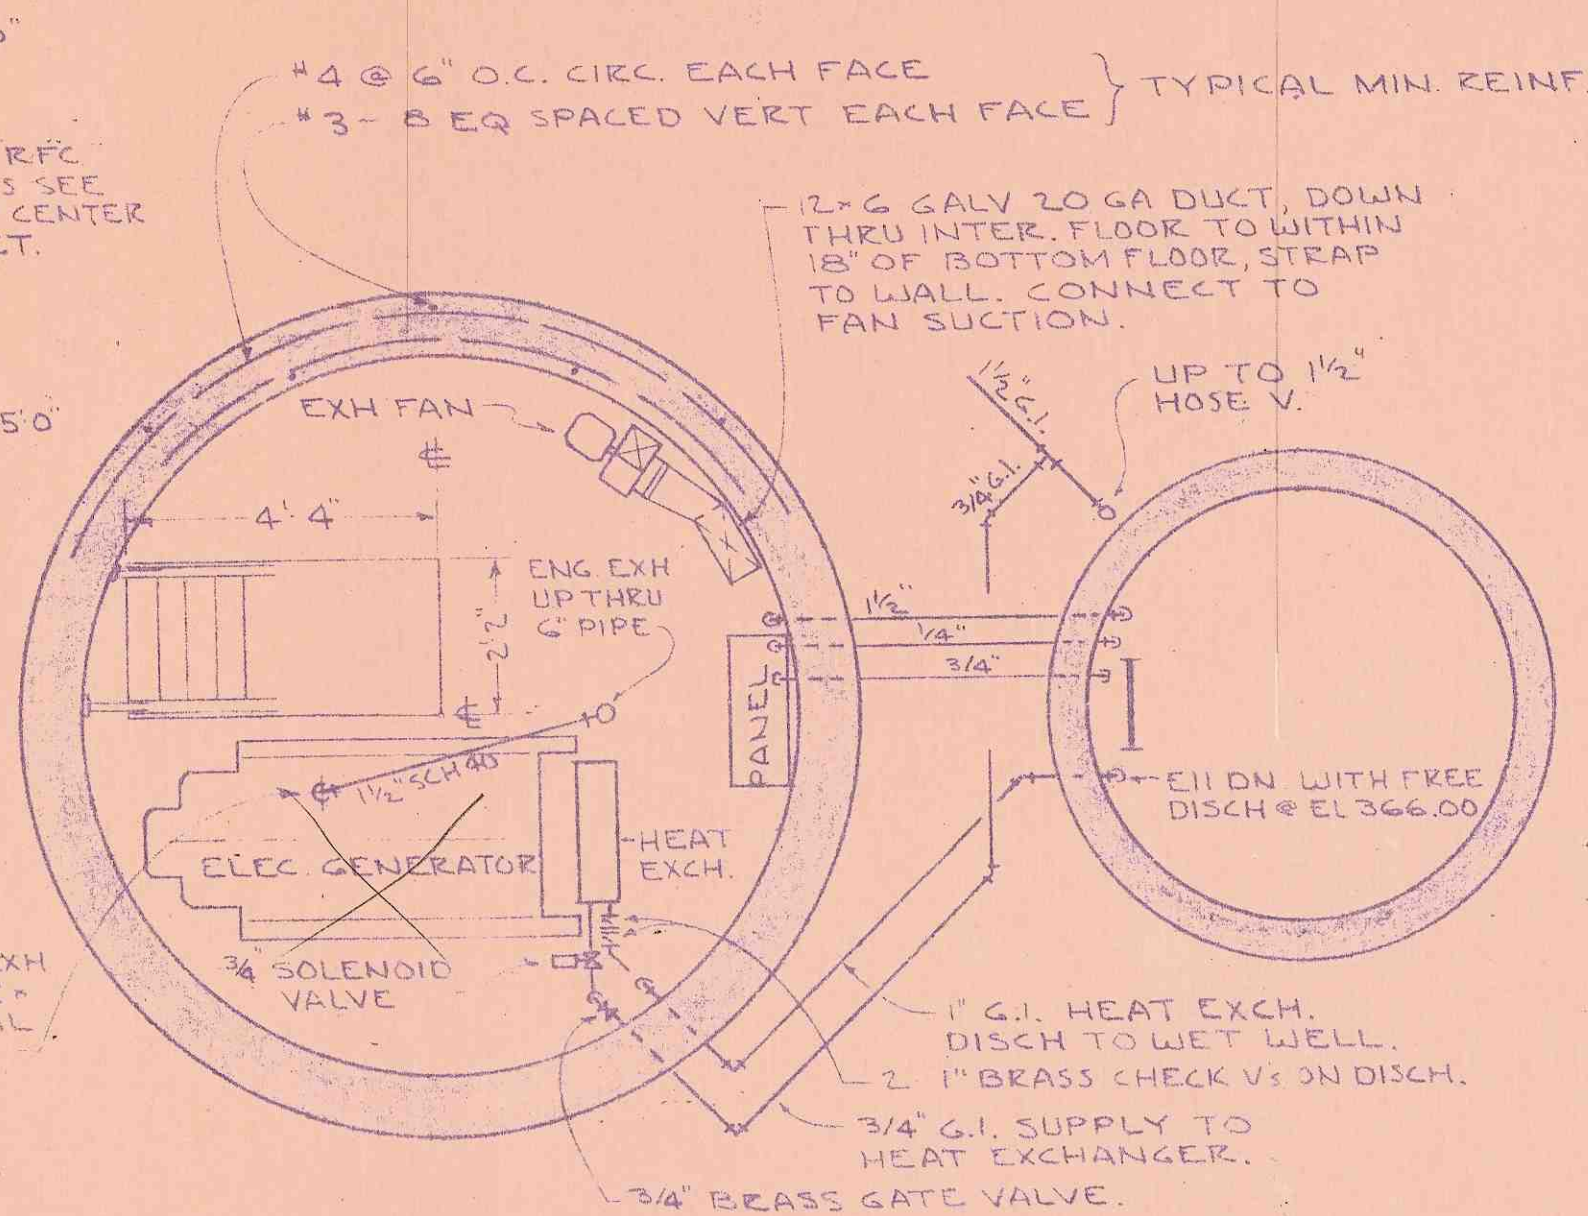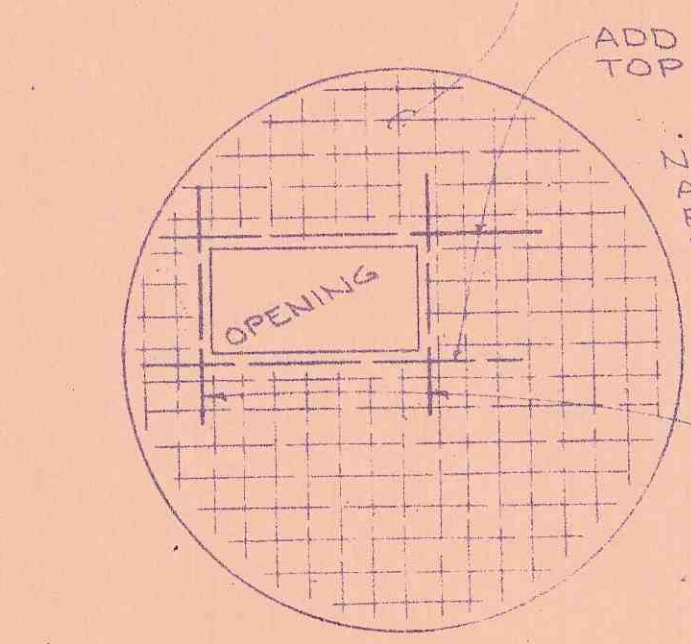


REINFORCING PLAN TOP & INT. SLABS

PROVIDE STEEL FLEX EXH COUPLING AT ENGINE 1/2" x 1/2" LONG, ATLANTIC METAL HOSE CO TYPE SW.


PLAN - INTERMEDIATE LEVEL

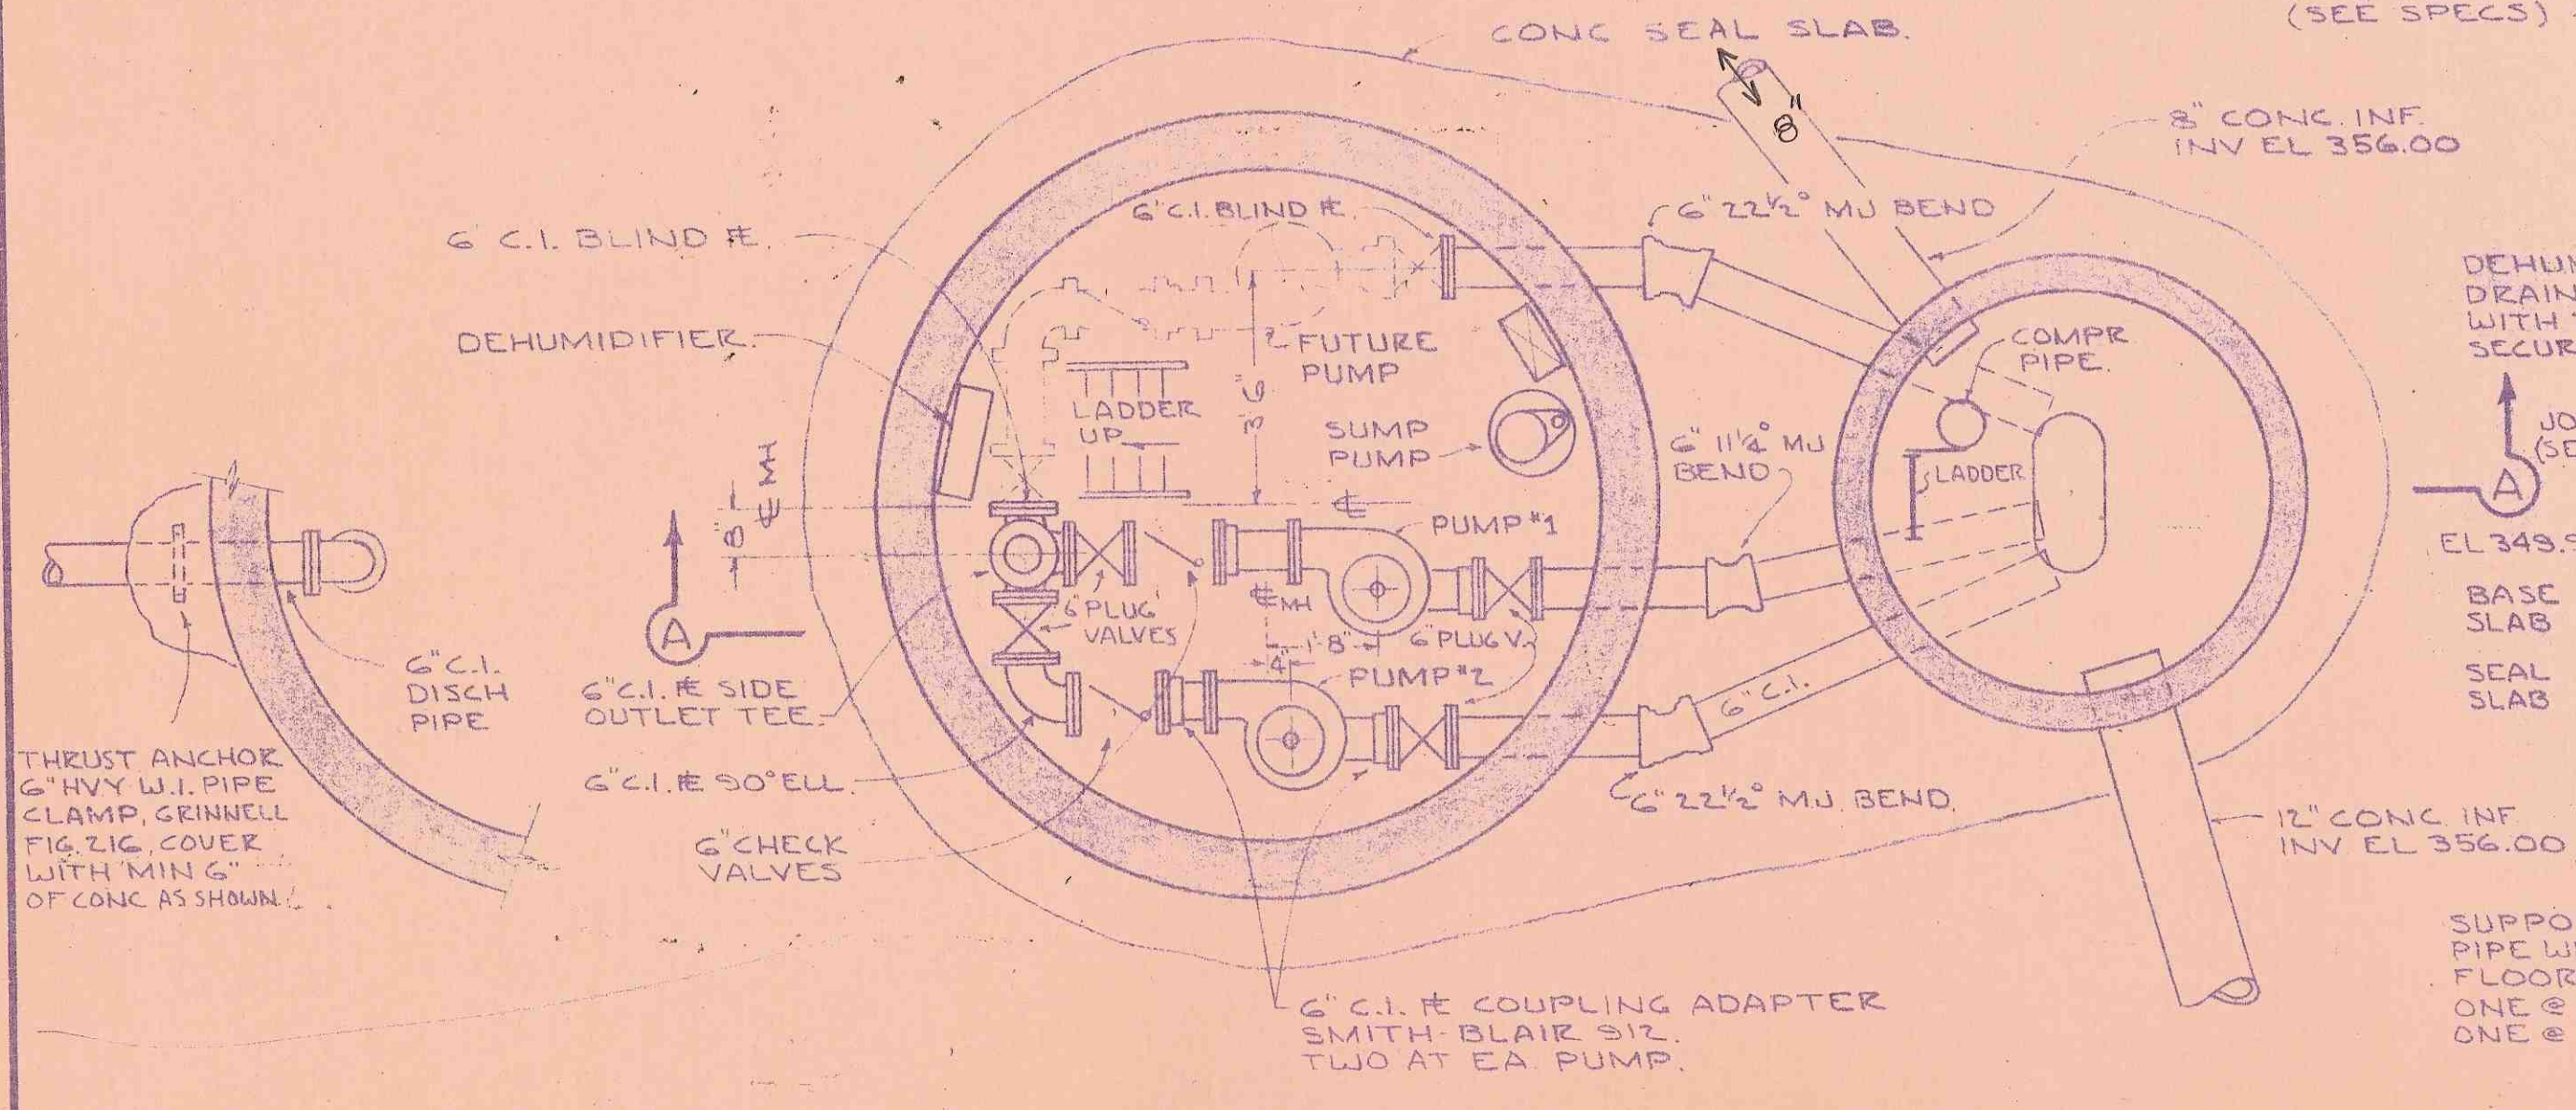

PLAN - BOTTOM LEVEL

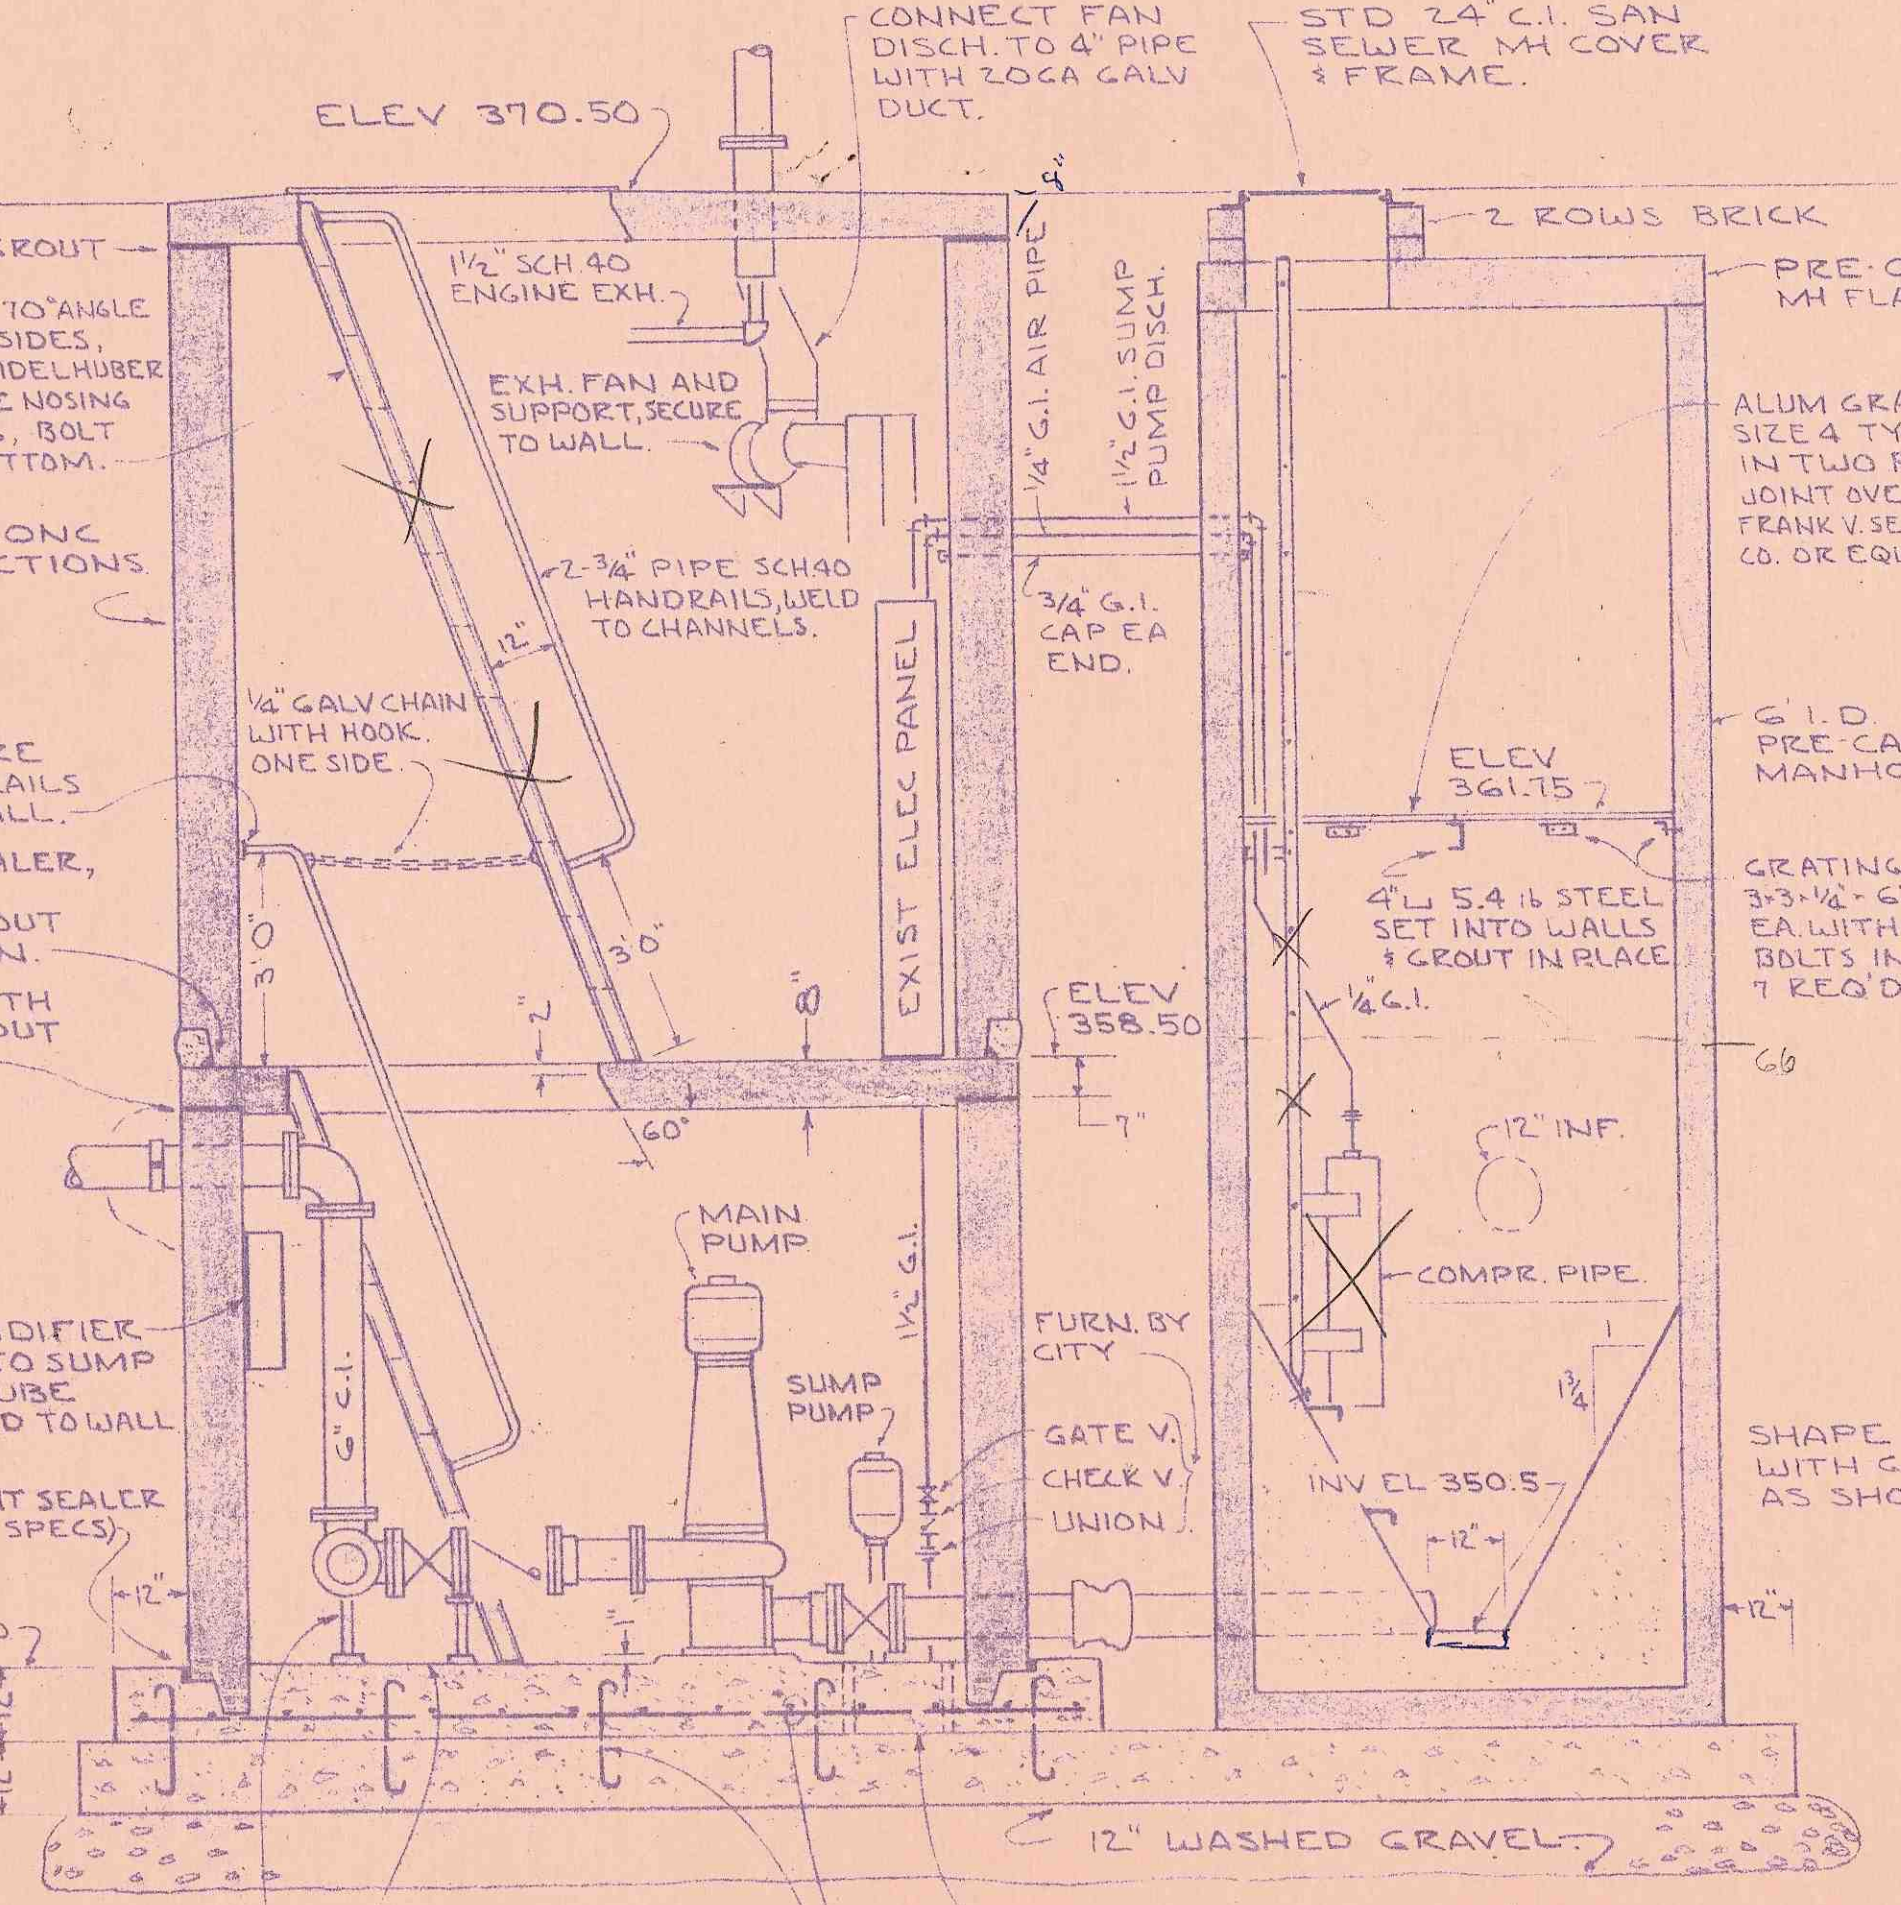


MID LENGTH LADDER SUPPORT

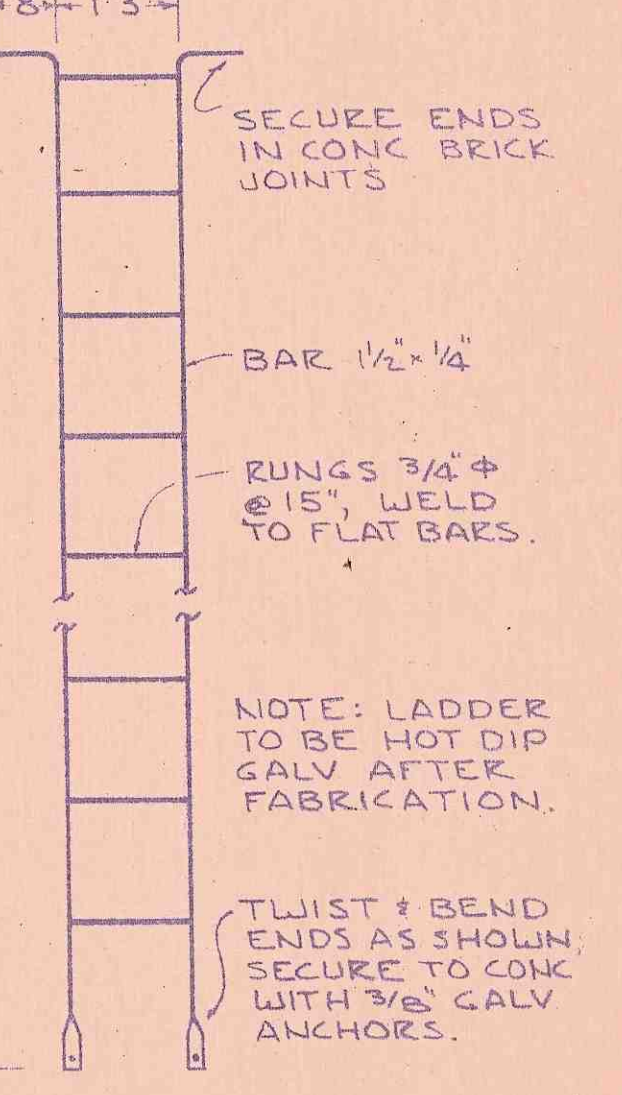

WET WELL STEEL LADDER

1/2" = 1' 0"

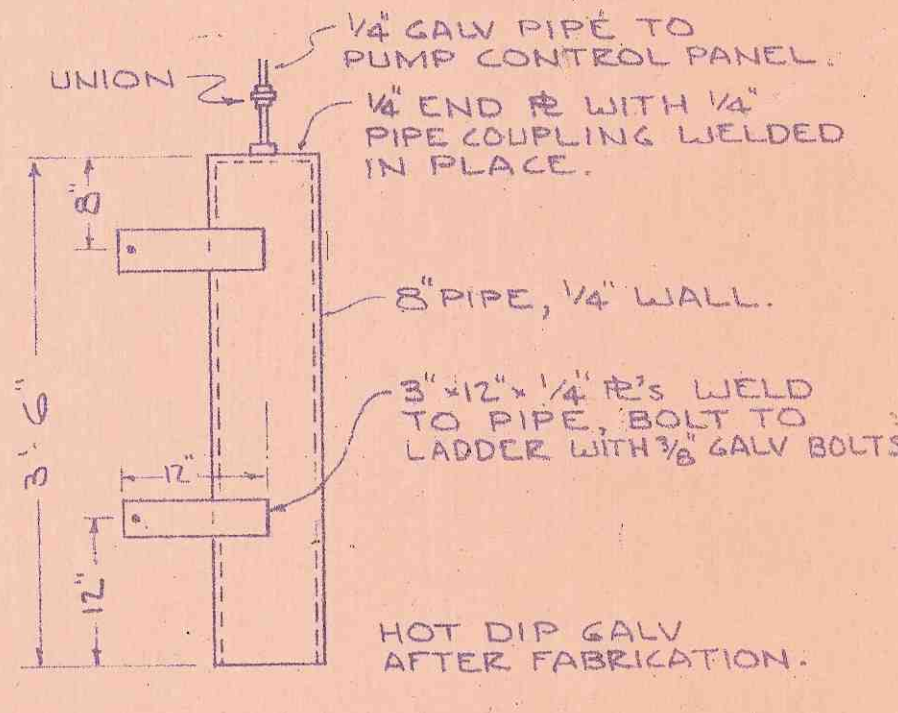

PUMP CONTROL COMPRESSION PIPE

3/4" = 1' 0"

PUMP SETTINGS

	PUMP NO. 1	PUMP NO. 2
ON	354.5	355.5
OFF	352.5	354.5
HI-WATER	356.0	

Sewerage Unit 2A-4-C

NO.	REVISIONS	DATE	BY
1	DELETED OVER FLOOD, MOVED 1/2" NOSE OUTSIDE WET WELL, ADDED 2" CHUY ON HEAT EXCH DISCH & RAISED DISCH.	SEPT 27, 1966	KCT
CITY OF MOUNTLAKE TERRACE			
CEDARGROVE SEWAGE PUMPING STATION			
PLANS, SECTIONS AND DETAILS			
REID, MIDDLETON & ASSOCIATES, INC.			
CONSULTING ENGINEERS & LAND SURVEYORS			
324 MAIN STREET EDMONDS, WASHINGTON			

