


- 1- ALL CONSTRUCTION AND MATERIALS ARE TO CONFORM TO THE STANDARDS AND SPECIFICATIONS OF THE CITY OF MOUNTLAKE TERRACE AS APPROVED BY THE WASH. STATE DEPT. OF SOCIAL AND HEALTH SERVICES.
- 2- THE CONTRACTOR SHALL VERIFY SIZE, LOCATION, AND ELEVATION OF EXISTING UTILITIES PRIOR TO CONSTRUCTION TO AVOID DAMAGE OR DISTURBANCE.
- 3- SIDE SEWERS TO BE IN ACCORDANCE WITH THE REQUIREMENTS OF THE CITY OF MOUNTLAKE TERRACE. MIN. SLOPE TO BE 2% .- MIN. 6" C.F .
- 4- CONCRETE PIPE TO BE C-14, CLASS II, ACCORDING TO APWA SPECIFICATIONS, SEC. G1-303. BEDDING TO BE CLASS "C". OPTIONAL: POLYVINYL CHLORIDE (PVC) CONFORM TO ASTM-D 3034-73 WITH CLASS II BEDDING DEFINED BY ASTM. OPTIONAL: JOHNS-MANSVILLE TRANSITE, CLASS 2400, C1 BEDDING OR EQUIV.
- 5- CAST IRON WATER MAINS TO MEET FED STD. WW-P-421 B, CLASS 150; CLASS "C" BEDDING.
- 6- ALL WATER MAINS TO HAVE A MINIMUM COVER OF 36 INCHES.
- 7- THE CITY OF MOUNTLAKE TERRACE SHALL BE GIVEN 24 HOUR NOTICE PRIOR TO CONSTRUCTION OR CONNECTION TO EXISTING WATER MAINS.
- 8- ALL SEWERS TO BE TESTED IN THE PRESENCE OF A REPRESENTATIVE OF THE CITY OF MOUNTLAKE TERRACE

9- ALL WEATHER SERVICES WILL BE COORDINATED

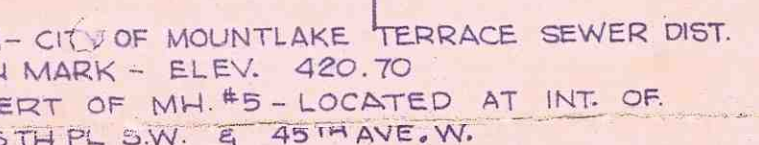

VERLE L. LONG
State of Washington
No. 3-8-76
Professional Engineer

1	ADDED OPTION	PIPE TO GEN. NOTE 4	7-19-76	AY
NO.	REVISION		DATE	BY

SANITARY SEWER & WATER PLAN / PROFILE

HIDDEN HIGHLANDS NO. 2

CITY OF MOUNTLAKE TERRACE

SNODHOMISH COUNTY, WASHINGTON