



NOTE: DUCTILE IRON PIPE SHALL CONFORM TO AWWA C-151 AND SHALL BE CEMENT LINED, PUSH-ON JOINT, MINIMUM THICKNESS SHALL BE CLASS 2.

CREEK CROSSING DETAIL
@ SE CORNER OF PLAT

NO SCALE

APPROVED: Frederick C. Anderson DATE: 10/22/75
CITY OF MOUNTLAKE TERRACE
DEPT. OF PUBLIC WORKS

SCALE: HORIZ: 1"=50'
VERT: 1"=5'

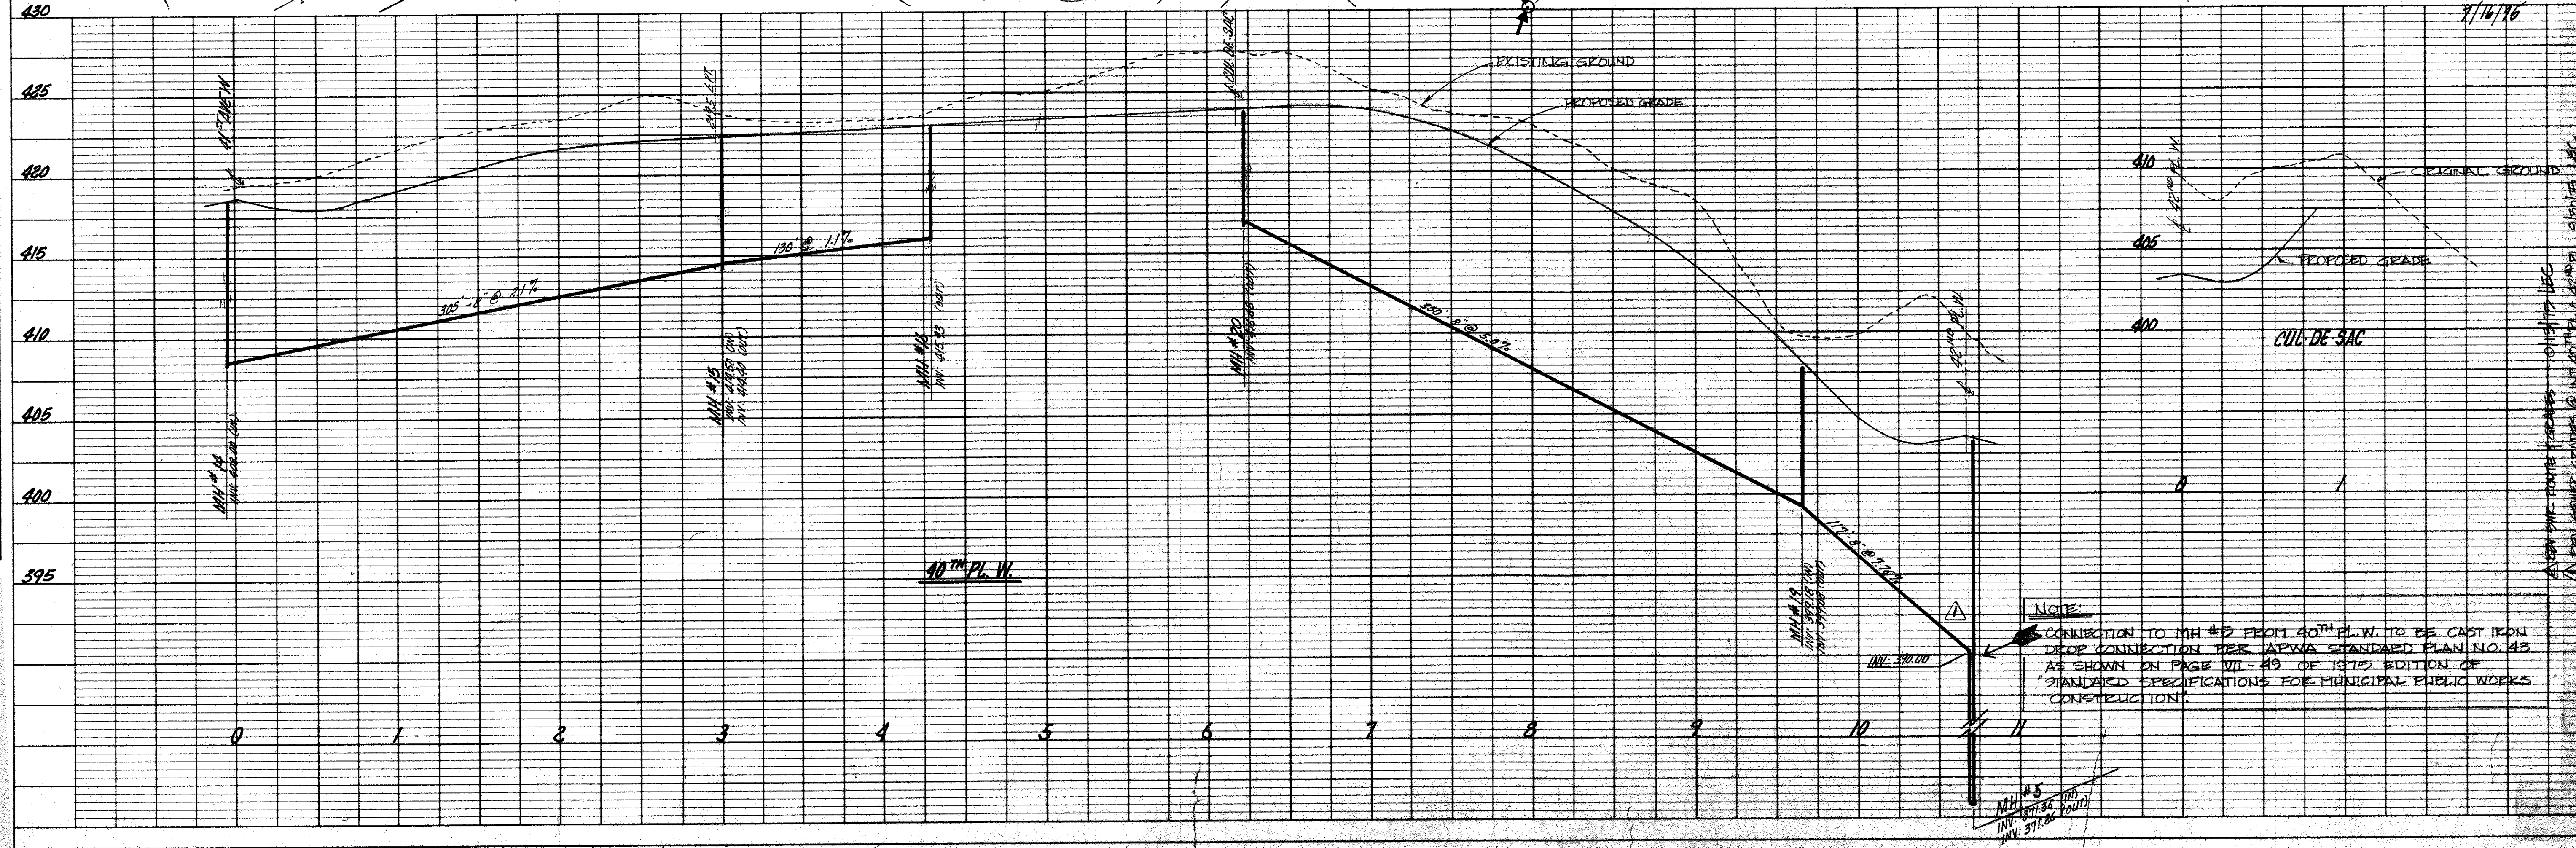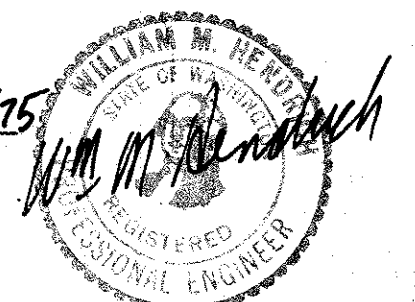

NOTE:
CONNECTION TO MH #3 FROM 40TH PL.W. TO BE CAST IRON
DIPOR CONNECTION PER A.P.W.A. STANDARD PLAN NO. 43
AS SHOWN ON PAGE VII-49 OF 1973 EDITION OF
"STANDARD SPECIFICATIONS FOR MUNICIPAL PUBLIC WORKS
CONSTRUCTION".

SEEN SWAMP GRADERS @ INT 40TH PL & 42ND PL. 9/30/75 JAC

SANITARY SEWERS
PLAT OF CEDAR RIDGE
MOUNTLAKE TERRACE, WASH.



TRIAD ASSOCIATES