


Industrial PLC Integration Architecture

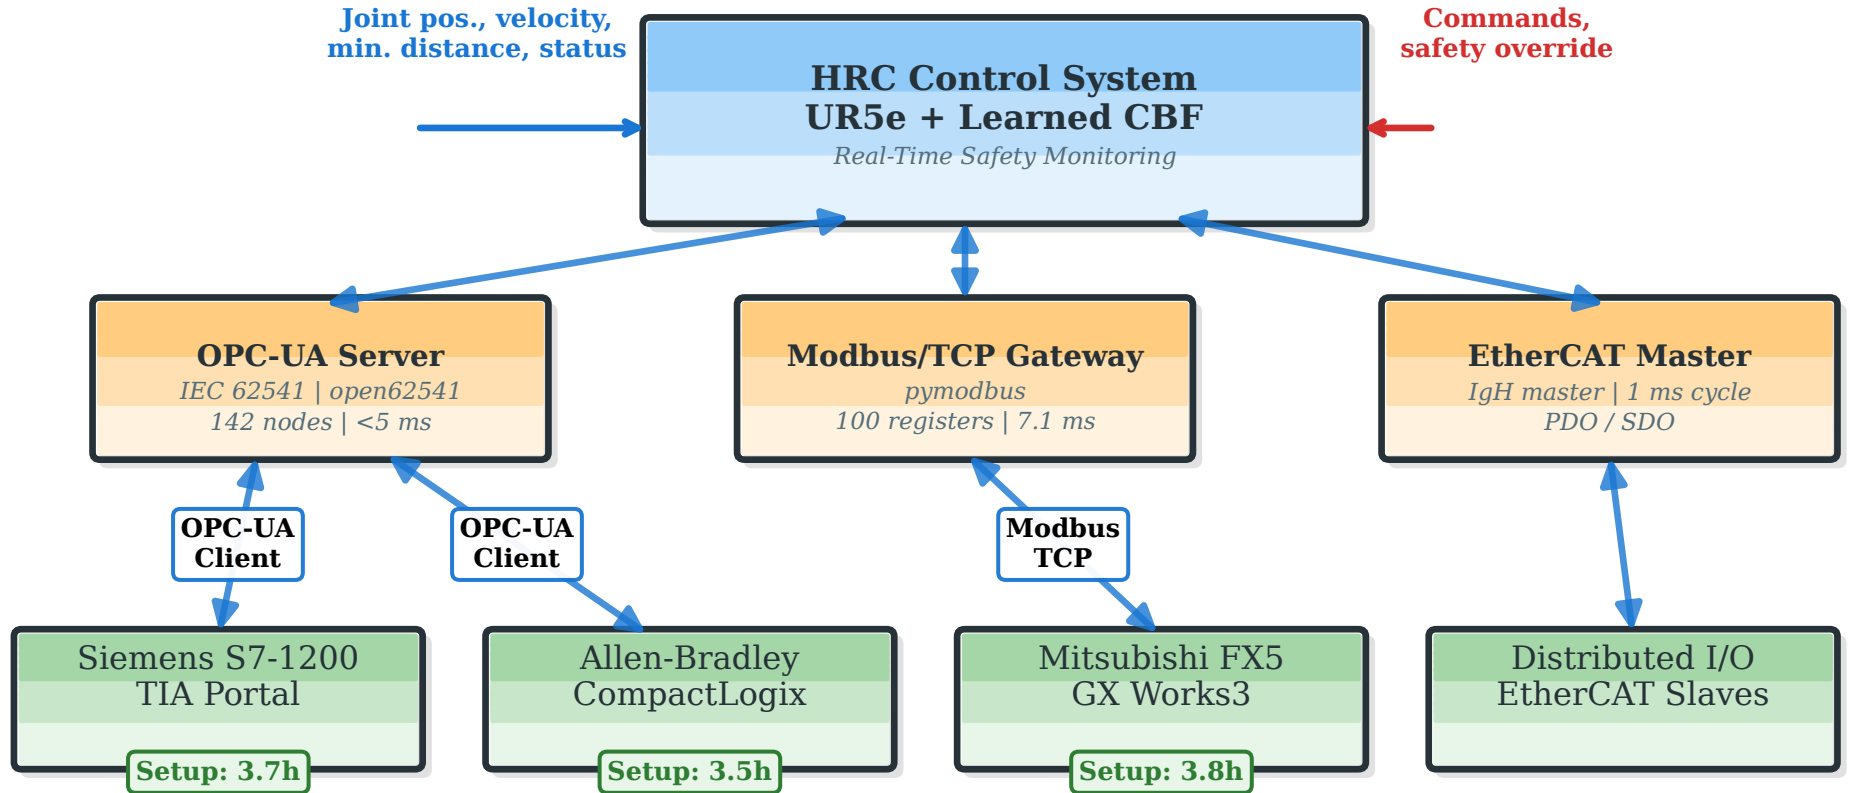

Config. time (measured)

3.67 h mean

Protocols

OPC-UA | Modbus TCP | EtherCAT

PLC vendors

Siemens | Allen-Bradley | Mitsubishi