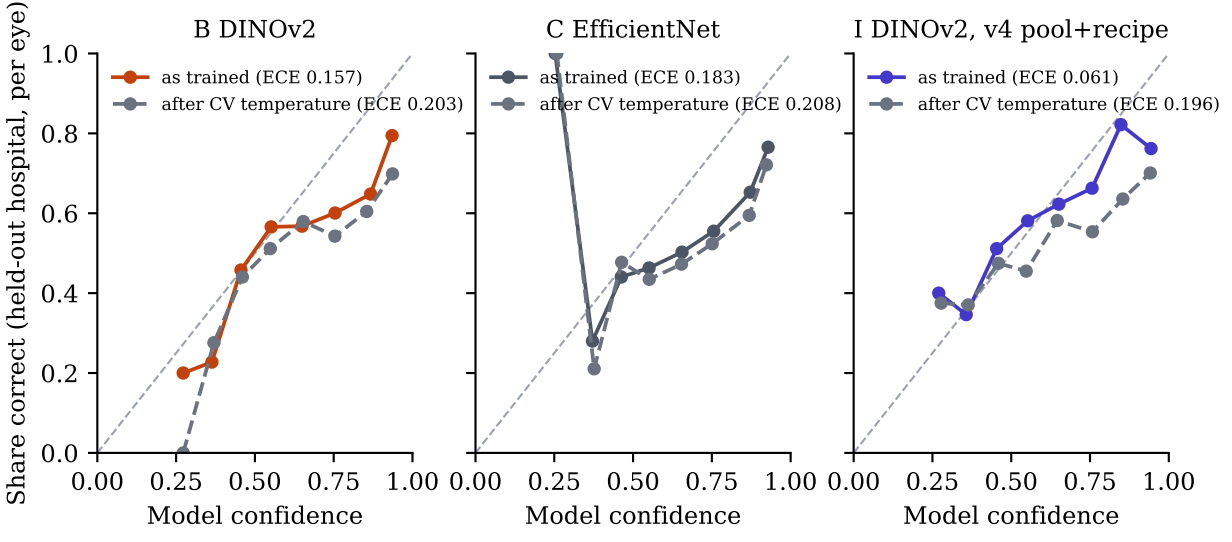
B DINOv2
as trained (ECE 0.157)
after CV temperature (ECE 0.203)
C EfficientNet
as trained (ECE 0.183)
after CV temperature (ECE 0.208)
I DINOv2, v4 pool+recipe
as trained (ECE 0.061)
after CV temperature (ECE 0.196)
Share correct (held-out hospital, per eye)
Model confidence
Model confidence
Model confidence
0.0
0.2
0.4
0.6
0.8
1.0
0.00
0.25
0.50
0.75
1.00