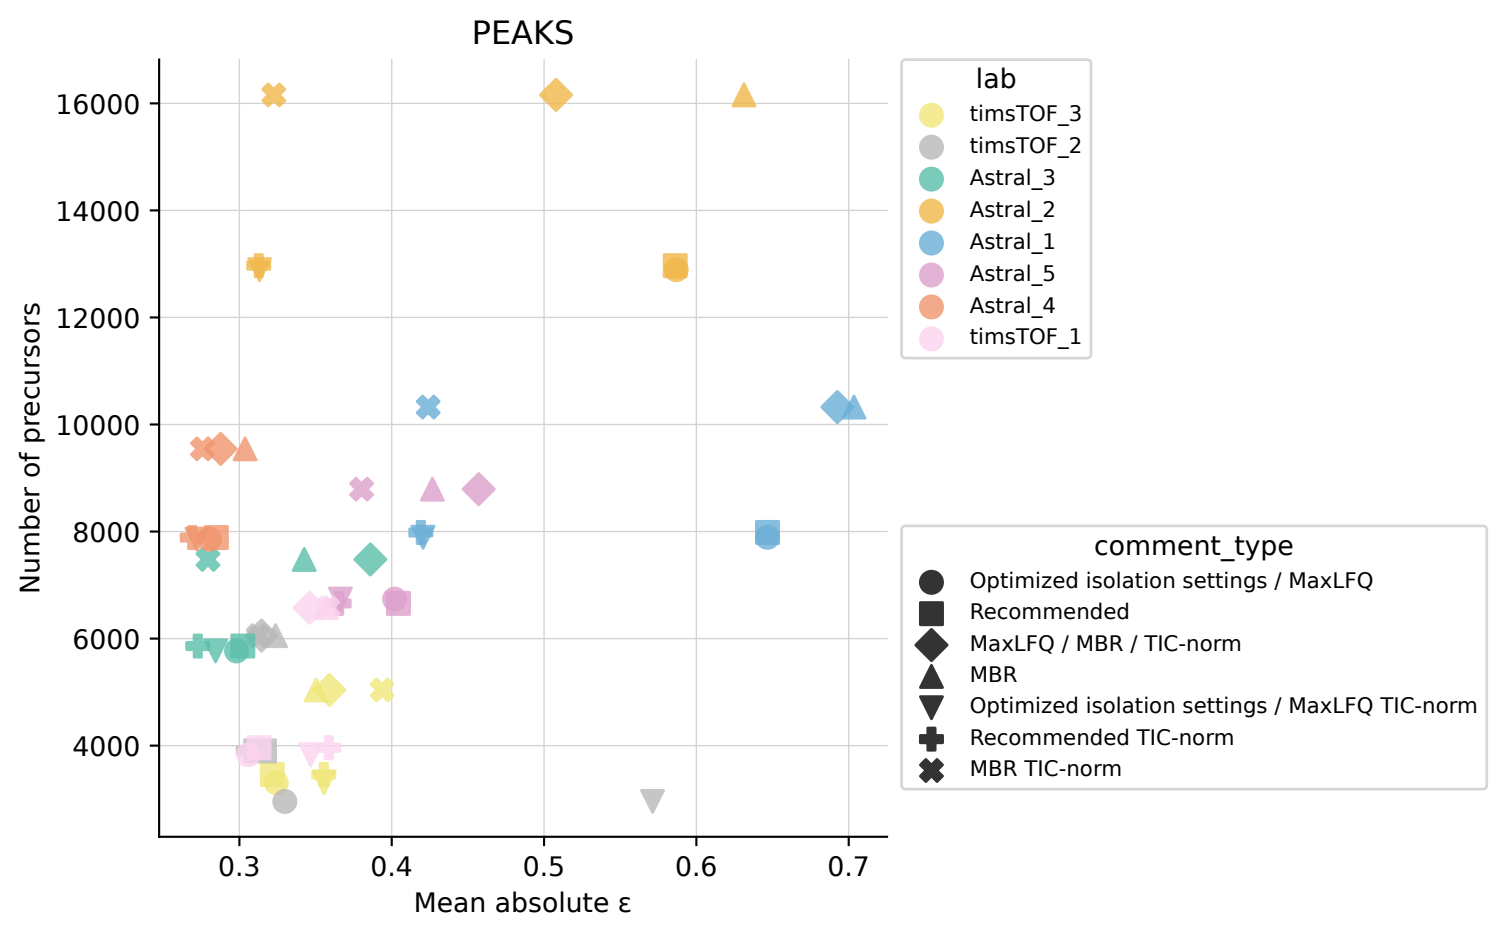
PEAKS
Number of precursors
16000
14000
12000
10000
8000
6000
4000
0.3
0.4
0.5
0.6
0.7
Mean absolute ε
lab
timsTOF_3
timsTOF_2
Astral_3
Astral_2
Astral_1
Astral_5
Astral_4
timsTOF_1
comment_type
Optimized isolation settings / MaxLFQ
Recommended
MaxLFQ / MBR / TIC-norm
MBR
Optimized isolation settings / MaxLFQ TIC-norm
Recommended TIC-norm
MBR TIC-norm