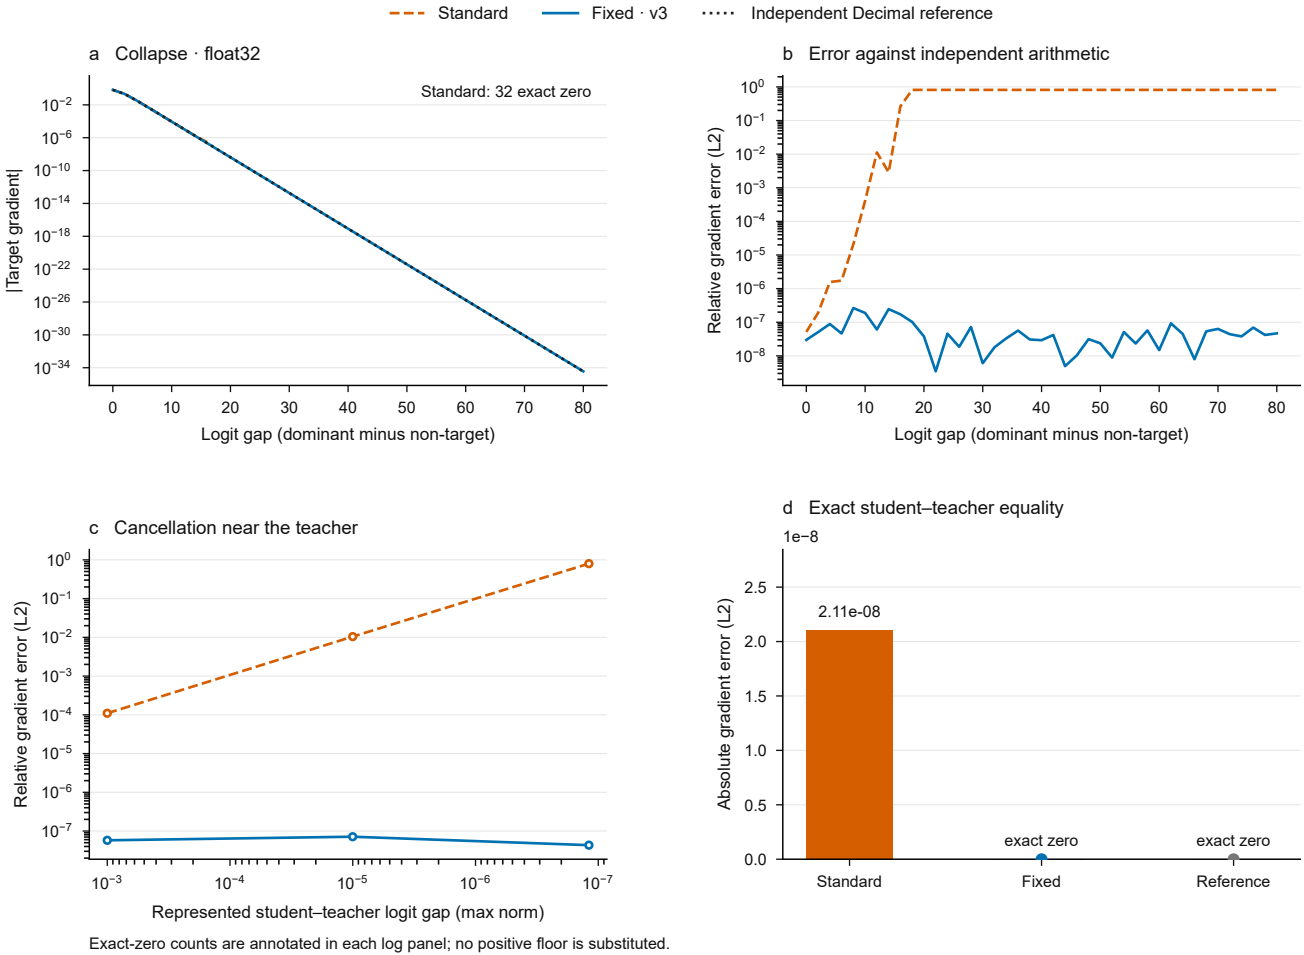

Exact-zero counts are annotated in each log panel; no positive floor is substituted.