INCH-POUND
MIL-F-16377/45B(SH)
22 November 1989
SUPERSEDING
MIL-F-16377/45A(SH)
18 March 1982

MILITARY SPECIFICATION SHEET

FIXTURES, LIGHTING; BALLAST, FOR ONE 8-WATT T-5 FLUORESCENT LAMP

This specification is approved for use by the Naval Sea Systems Command, Department of the Navy, and is available for use by all Departments and Agencies of the Department of Defense.

The requirements for acquiring the product described herein shall consist of this specification sheet and the issue of the following specification listed in that issue of the Department of Defense Index of Specifications and Standards (DoDISS) specified in the solicitation: MIL-F-16377.

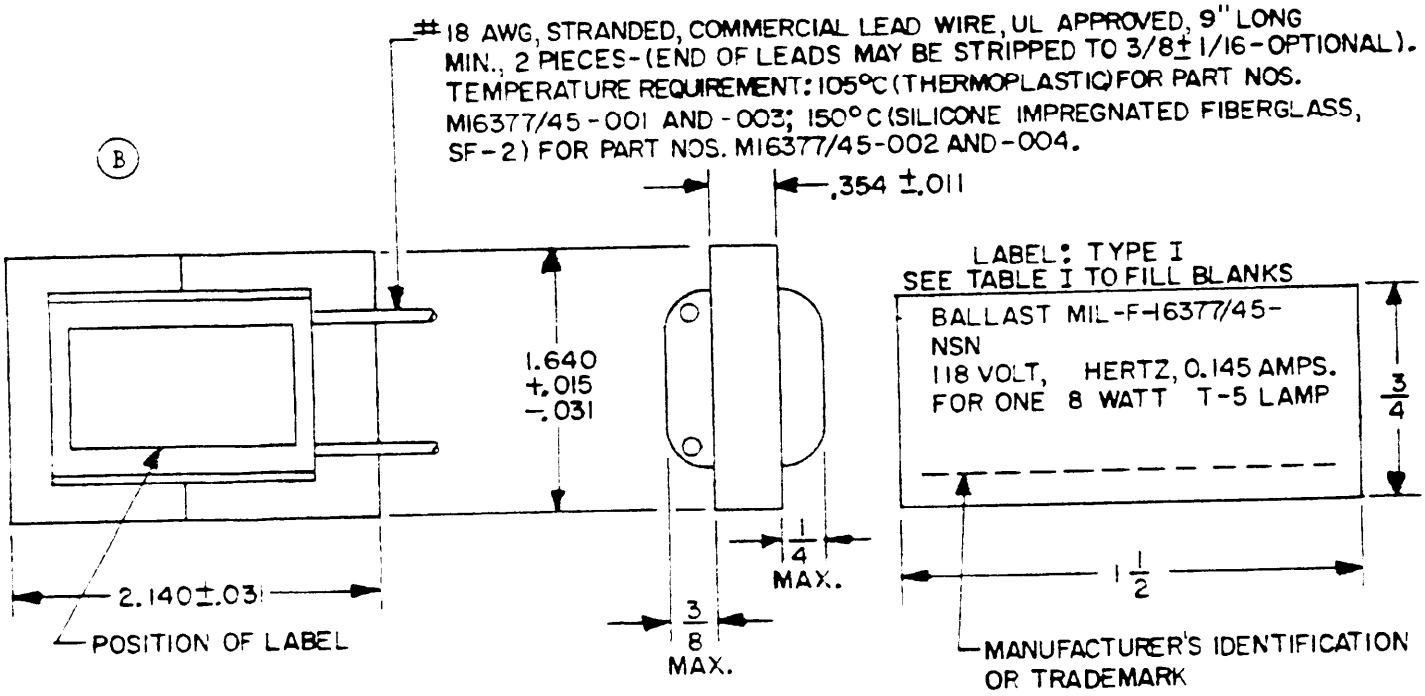


FIGURE 1. Ballast for one 8-watt T-5 fluorescent lamp.

All dimensions in inches.
For tolerances, other than specified herein, see 3.5.2 of MIL-F-16377.

(B) denotes changes

FSC 6250

AMSC N/A
DISTRIBUTION STATEMENT A. Approved for public release; distribution is unlimited.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T08:49Z
Check the source to verify that this is the current version before use.

(B) TABLE I. Ballast rating and general information.

Military Part or Idenifying number (PIN) M16377/45	Rating			National Stock Number (NSN)	Remarks
	Volts	Amperes	Hertz		
001 1/	118	0.145	60	6250-00-295-2735	Standard
002	118	0.145	60		Heat Resistant
003	118	0.145	400		Standard
004	118	0.145	400		Heat Resistant

1/ Previously covered by MS16572.

REQUIREMENTS:

DESIGN:

Dimensions and configurations: See figure 1.
Assembly: The ballast shall consist of a laminated iron core and coil, integrally assembled and conforming to the dimensions and requirements shown herein. The ballast shall have a standard rating as shown on table I. Commercial U.L. approved ballast may be furnished if it conforms to the dimensions and requirements specified herein.
Impregnating: The assembled ballast shall be submerged in coil varnish for sufficient time to insure complete penetration and baked. Impregnation is not required if nylon coated magnet wire, nylon bobbin, and oxide coated laminations are used.
Markings: Ballast shall conform to marking requirements and color coding of leads as specified in the applicable paragraph of American National Standards Institute (ANSI) C82.1.
Label: Label shall be in accordance with type I except as specified herein.

QUALITY ASSURANCE: Quality assurance shall be as specified in MIL-F-16377 and as follows:

First article inspection: See table II.
Quality conformance:
Comparison inspection: Same as the first article inspection.
Inspection of product for delivery: (See table II for test procedures.)

Examination: See MIL-F-16377.
Examination for preparation of delivery: See MIL-F-16377.
Quality conformance tests:

(a) Power output (except ratio peak current to r.m.s. current).
(b) Dielectric withstanding voltage.
(c) Insulation resistance.
(d) Voltage drop across ballast.

Source: https://assist.dla.mil -- Downloaded: 20260-18T08:49Z
Check the source to verify that this is the current version before use.

GENERAL INFORMATION:

Assignment of Military part numbers and general information is shown in table I.

TABLE II. First article and comparison inspection.

Tests	Requirement	Test	Remarks
Examination	3.13	4.5	3/
Performance:	1/	2/	3/
(a) Power output			
(b) Regulation			
(c) Noise			
(d) Voltage drop across ballast			
Dielectric withstanding voltage	3.6.15	4.8.2	3/
Insulation resistance	3.6.16	4.8.3	3/

1/ The performance of the ballasts shall be in conformance with the requirements listed in the applicable paragraph of ANSI C82.1, except for the following:

(a) Power output when operated with an 8-watt lamp shall be not less than 83 percent.
(b) Regulation when operated with an 8-watt lamp shall be not less than 79 percent or more than 115 percent.

In addition to the above requirements the voltage drop across the ballast shall be no less than 84 volts.

2/ Test procedure:

(a) Performance tests shall be made in accordance with ANSI C82.2.
(b) Fluorescent lamp reference ballasts shall be in conformance with ANSI C82.1.
(c) Lamps shall conform with ANSI C78.
(d) When supplying a reference lamp, voltage across starter terminals and across ballast shall be measured.

3/ Sample size for inspection shall consist of five ballasts.

Preparing activity:
Navy - SH
(Project 6250-N177)

Source: https://assist.dla.mil -- Downloaded: 202610-18T08:49Z
Check the source to verify that this is the current version before use.