MILITARY SPECIFICATION SHEET

(A) FIXTURES, LIGHTING; BALLAST BOX, FOR ONE 8-WATT T-5

FLUORESCENT LAMP, SYMBOLS 514 AND 514.1

This specification sheet is approved for use by the Naval Sea Systems Command and is available for use by all Departments and Agencies of the Department of Defense.

The complete requirements for acquiring the fixtures described herein shall consist of this document and the latest issue of MIL-F-16377(SH)

(A)

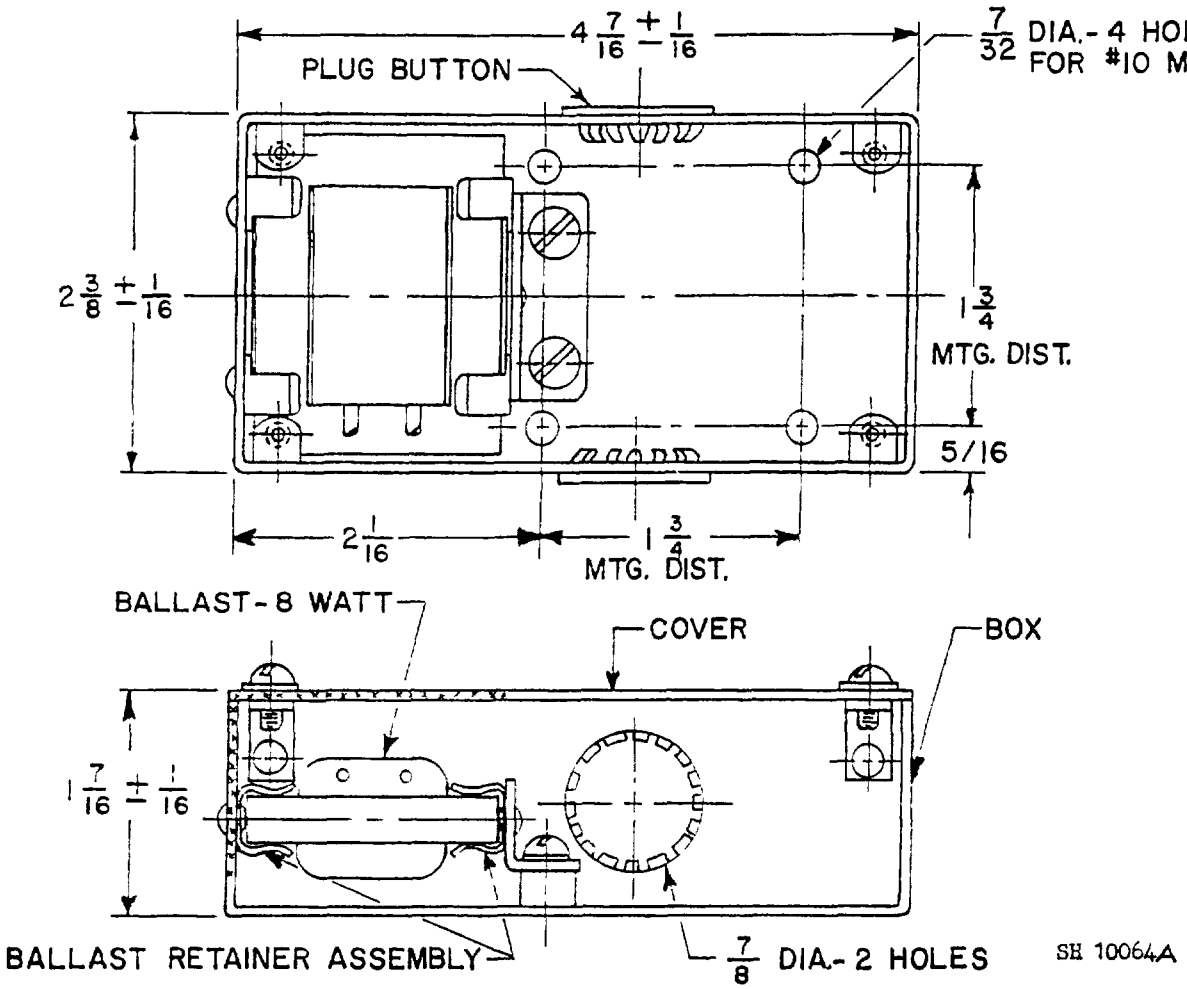


FIGURE 1. Ballast box assembly symbols 514 and 514.1.

All dimensions in inches.
For tolerances, other than specified herein, see paragraph 3.5.2 of MIL-F-16377.

(A) denotes changes

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T08:49Z
Check the source to verify that this is the current version before use.

A

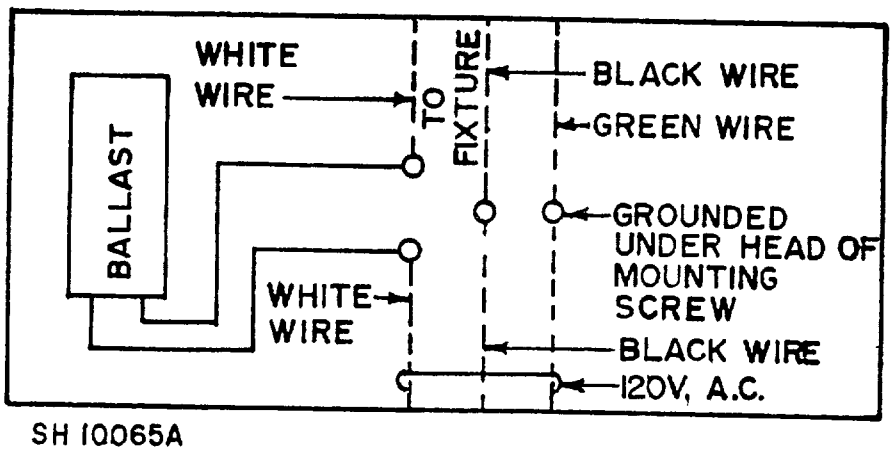


FIGURE 2. Wiring diagram.

A

TABLE I. Ballast box characteristics and general information.

Military part number M16377/46-	Ballast shall be in accordance with MIL-F-16377/45	National stock number (NSN)	Circuit use
514 1/	M16377/45-001	6250-00-569-9501	120 volts, 60Hz
514.1	M16377/45-003		120 volts, 400Hz

1/ Previously covered by MS17176.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T08:49Z
Check the source to verify that this is the current version before use.

REQUIREMENTS:

DESIGN:

Dimensions and configurations: See figure 1.

Box assembly: Box and cover shall be aluminum. A commercially available box and cover (steel or aluminum, protected against corrosion) adapted for the purpose, may be substituted for the specified box and cover.

Ballast retainer assembly: Shall be made of aluminum brackets and phospor bronze ballast retaining spring clips.

Ballast: See table I.

Effectiveness of enclosure: Totally enclosed.

Labels: One type I and one type III label showing the wiring diagram of figure 2 shall be attached to the inside surface of the cover. Labels shall be as specified in MIL-F-16377.

QUALITY ASSURANCE:	Quality assurance shall be as specified in MIL-F-16377 and as follows:
First article inspection:	See table II
Quality conformance:	
Comparison inspection:	Same as the first article inspection
Inspection of product for delivery:	
Examination:	See MIL-F-16377
Examination for preparation of delivery:	See MIL-F-16377
Quality conformance tests:	Operation, Electric withstanding voltage and insulation resistance

GENERAL INFORMATION:

Assignment of Military part numbers and general information is shown in table I.

TABLE II. First article and comparison inspection.

Tests	Requirement paragraph	Test paragraph
Examination	3.13	4.5
Dielectric withstanding voltage	3.6.15	4.8.2
Insulation resistance	3.6.16	4.8.3
Enclosure effectiveness	3.5.11	4.8.14.1

Preparing activity:
Navy - SH
(Project 6250-N163)

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T08:49Z
Check the source to verify that this is the current version before use.