
MILITARY SPECIFICATION SHEET


METERS, ELECTRICAL INDICATING, PANEL TYPE, RUGGEDIZED. AMMETER, DC (FLUSH MOUNTING, ROUND FLANGE, 2-1/2 INCH), STYLE 26

This specification is approved for use by all Departments and Agencies of the Department of Defense.

The complete requirements for procuring the meters described herein shall consist of this document and the latest issue of Specification MIL-M-10304

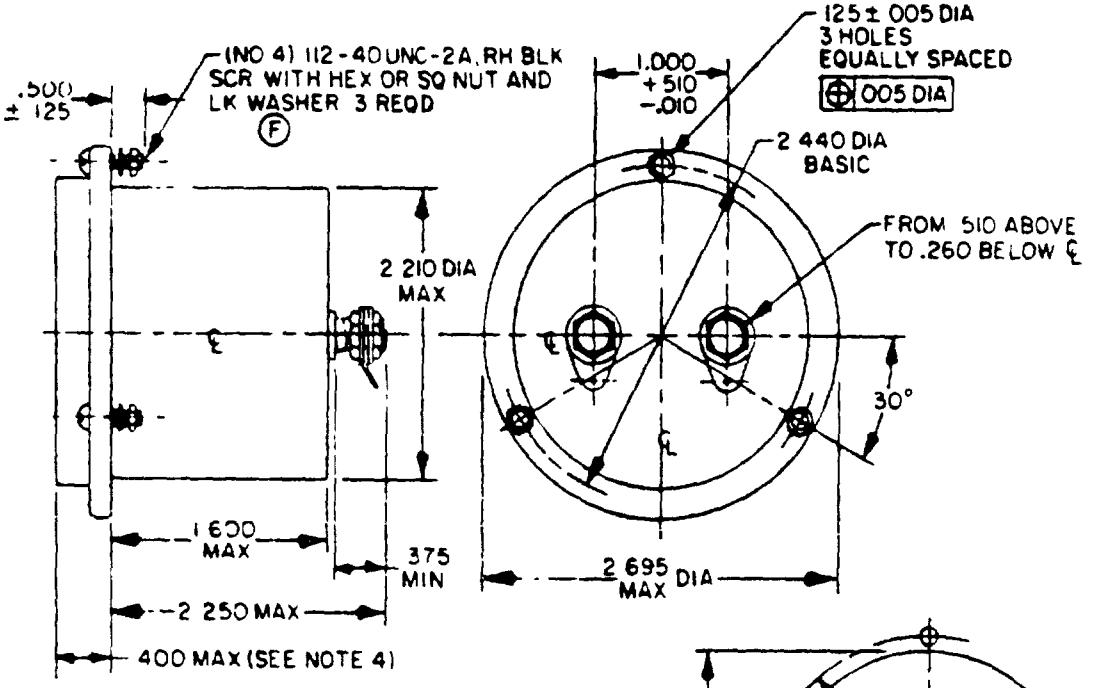

INCHES	MM	INCHES	MM	INCHES	MM
.005	.13	.400	10.16	2.220	56.39
.010	.25	.500	12.70	2.250	57.15
.112	2.84	.510	12.95	2.440	61.98
.125	3 18	1.000	25.40	2.500	63.50
.260	6 60	1.600	40 64	2.695	68.45
.375	9 53	2.210	56.13		

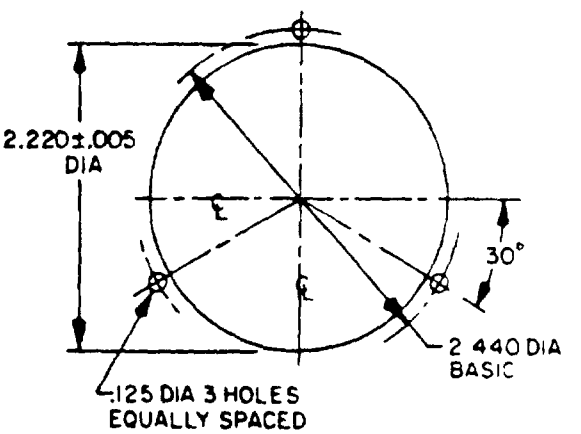

PANEL DRILLING PLAN

NOTES
1. Dimensions are in inches.
2. Metric equivalents (to the nearest .01 mm) are given for general information only and are based upon 1 inch = 25.4 mm.
3. Tolerance is ±1/2° on angles
4. Maximum projection from front of panel including mounting gaskets (if used)

Ⓕ denotes changes

FSC 6625

Source: https://assist.dla.mil -- Downloaded: 2026-10-17T13:46Z
Check the source to verify that this is the current version before use.

REQUIREMENTS
(Readings expressed as a percent of full-scale value)

Dimensions and configuration See figure.

Weight 12 ounces maximum.

Full-scale ranges: See table I.

Scale:
Length 1.5 inches minimum.
Pointer deflection: 90° minimum.

Position influence: ±2 percent change for 60° rotation from normal operating position

Accuracy ±2 percent.

(F) Overshoot 40 percent maximum.

Response time 2 seconds maximum.

Power consumption (loss) (at end scale deflection)
Microammeters and milliammeters. 150 mV maximum.
Ammeters (self-contained). 75 mV maximum.
Ammeters (external shunt) 50 mV ±2 percent with leads of 0 065 ±0 010 ohms resistance

High temperature cycling.
±4 percent
±2 percent permanent change

Temperature influence ±1 percent change

Exposure to extreme temperatures
±3 percent permanent change.

Overload capacity
Momentary overload ±2 percent change.
Sustained overload
±1 percent temporary zero shift.
±1 percent permanent zero shift
±2 percent permanent change.

Dielectric withstanding voltage 3,000 volts rms.

Vibration, random drop, and shock: Repeatability is not applicable for those microammeters below 100-microampere ranges.

Source: https://assist.dla.mil -- Downloaded: 2026-10-17T13:46Z
Check the source to verify that this is the current version before use.

TABLE I Full-scale ranges.

Microamperes		Milliamperes		Amperes		Kiloamperes
Zero left	Zero center	Zero left	Zero center	Zero left	Zero center	
10	30-0-30	1	1-0-1	1	1-0-1	1/ 1.0
20	50-0-50	5	5-0-5	2	5-0-5	1/ 1 2
30	100-0-100	10	10-0-10	5	10-0-10	
50	300-0-300	50	50-0-50	10	1/ 10-0-30	
100	500-0-500	100	100-0-100	20	1/ 20-0-20	
200		300	500-0-500	30	1/ 30-0-30	
300		300		1/ 50		
500		500		1/ 100		
				1/ 200		
				1/ 300		
				1/ 500		

1/ Used with external shunt

Custodians.
Army - EL
Navy - EC
Air Force - 82

Review activities:
Army - EL, AV, AT, ME, WC
Navy - EC, MC
Air Force - 11
DSA - ES

User activities:
Army - MI
Navy - CG
Air Force - None

Preparing activity
Army - EL

Agent:
DSA - ES

(Project 6625-0574-3)

Source: https://assist.dla.mil -- Downloaded: 2026-10-17T13:46Z
Check the source to verify that this is the current version before use.

FOLD

Department of the Army
Headquarters
U.S.Army Electronics Command
Fort Monmouth, New Jersey 07703

POSTAGE AND FEES PAID

OFFICIAL BUSINESS

Commanding General
U.S.Army Electronics Command
ATTN. ~~XXXXXX~~ DRSEL-RD-TS
Fort Monmouth, New Jersey 07703

To detach this form, cut along this line

FOLD

Source: https://assist.dla.mil -- Downloaded: 2026-10-17T13:46Z
Check the source to verify that this is the current version before use.

To detach this form, cut along this line

SPECIFICATION ANALYSIS SHEET

Form Approved
Budget Bureau No 22-R255

INSTRUCTIONS This sheet is to be filled out by personnel, either Government or contractor, involved in the use of the specification in procurement of products for ultimate use by the Department of Defense This sheet is provided for obtaining information on the use of this specification which will insure that suitable products can be procured with a minimum amount of delay and at the least cost Comments and the return of this form will be appreciated Fold on lines on reverse side, staple in corner, and send to preparing activity Comments and suggestions submitted on this form do not constitute or imply authorization to waive any portion of the referenced document(s) or serve to amend contractual requirements

SPECIFICATION MIL-M-10304/5F METERS, ELECTRICAL INDICATING, PANEL TYPE, RUGGEDIZED: AMMETER, DC(FLUSH MOUNTING, ROUND FLANGE, 2½ INCH), STYLE 26

ORGANIZATION

CITY AND STATE

CONTRACT NUMBER

MATERIAL PROCURED UNDER A

☐ DIRECT GOVERNMENT CONTRACT ☐ SUBCONTRACT

1 HAS ANY PART OF THE SPECIFICATION CREATED PROBLEMS OR REQUIRED INTERPRETATION IN PROCUREMENT USE?

A GIVE PARAGRAPH NUMBER AND WORDING

B RECOMMENDATIONS FOR CORRECTING THE DEFICIENCIES

2 COMMENTS ON ANY SPECIFICATION REQUIREMENT CONSIDERED TOO RIGID

3 IS THE SPECIFICATION RESTRICTIVE?

☐ YES ☐ NO *(If "yes", in what way?)*

4 REMARKS *(Attach any pertinent data which may be of use in improving this specification If there are additional papers attach to form and place both in an envelope addressed to preparing activity)*

SUBMITTED BY *(Printed or typed name and activity - Optional)*

DATE

DD FORM 1 JAN 66 1426

REPLACES EDITION OF 1 OCT 64 WHICH MAY BE USED

ESC-FM 1068-68

Source: https://assist.dla.mil -- Downloaded: 2026-10-17T13:46Z
Check the source to verify that this is the current version before use.