[INCH-POUND]
A-A-2973
June 10, 1996

COMMERCIAL ITEM DESCRIPTION

PULLERS, FUSE

The General Services Administration has authorized the use of this Commercial Item Description for procurement of preference to W-P-796 by all Federal agencies.

1. SCOPE.

1.1 Scope. This Commercial Item Description covers fuse pullers for use in removing and inserting cartridge-type fuses, 1/4 to 2-1/2 inches in diameter from electrical circuits up to 600 volts.

2. CLASSIFICATION.

2.1 Classification. Fuse pullers shall be of the following types and sizes:

Type I - Laminated construction

Size 1 - 1/4 inch through 1/2 inch, fuse diameter range, 0-30 ampere, 250 volt
Size 2 - 1/2 inch through 1-1/4 inches, fuse diameter range, 0-100 ampere, 250 volt or 0-100 ampere, 600 volt
Size 3 - 1 inch through 2-1/2 inches, fuse diameter range, 100-600 ampere, 250 volt or 60-400 ampere, 600 volt

Type II - Molded construction

Size 1 - 1/4 inch through 1/2 inch, fuse diameter range, 0-30 ampere, 250 volt
Size 2 - 1/2 inch through 1 inch, fuse diameter range, 0-100 ampere, 250 volt or *0-60 ampere, 600 volt*
Size 3 - 1-1/2 inches through 1-3/4 inches, fuse diameter range, 110-200 ampere, 250 volt or 110-200 ampere, 600 volt

3. SALIENT CHARACTERISTICS.

3.1 Design. The fuse-gripping surfaces shall provide a firm grip on the fuse body during insertion and removal from the fuse holders. The gripping surfaces of size 1 pullers shall be on one end only. The surfaces of size 2 and size 3 pullers which are held in the hand shall be provided with a means to prevent slipping.

3.1.1 Type I, laminated construction type. Type I fuse pullers shall be similar to Figure 1 and comply with the dimensions of Table I. The fuse pullers shall be fabricated from alternate fiber or plastic sections suitably joined together to form a scissors-action puller. The center section or sections shall be shaped to form a rib or barrier to provide a firm surface against the fuse body during insertion in fuse holders.

Beneficial comments, recommendations, additions, deletions, clarifications, etc., and any other data which may improve this document should be sent to: General Services Administration, Federal Supply Service, Tools and Appliances Commodity Center (6FETE-CO), Washington, DC 20406.

Distribution Statement A. Approved for public release; distribution is unlimited. FSC 5120

Source: https://assist.dla.mil -- Downloaded: 202610-26T08:28Z
Check the source to verify that this is the current version before use.

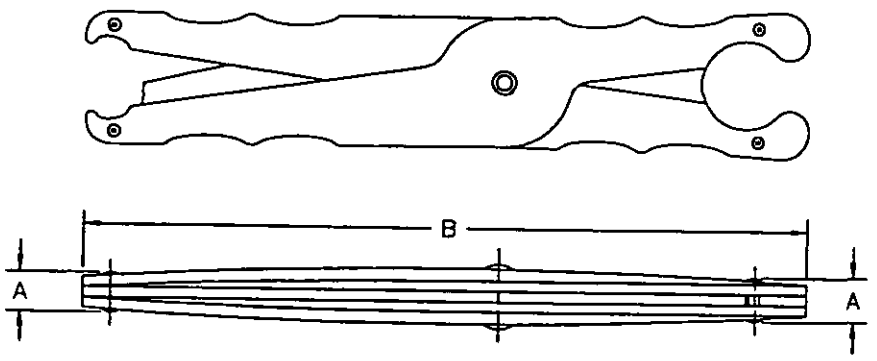


Figure 1. Type I, laminated construction.

TABLE I. Dimensions

Size no.	Jaw thickness 1/ A (inch)	Overall length ± 1/2 B (inch)
1	0.425	4-1/2
2	0.500	7-1/2
3	0.700	11-1/2

1/ Maximum end thickness of layers, including joining hardware, where applicable.

3.1.2 Type II molded construction type. Type II fuse pullers shall be similar to Figure 2 and be of molded plastic construction. The jaw thickness shall not exceed the diameter of the largest fuse to be accommodated. The overall length shall be as specified for type I pullers in Table I.

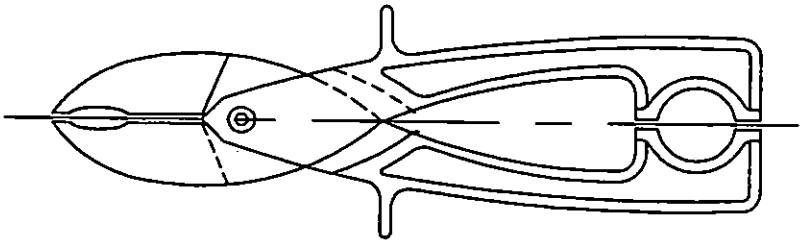


Figure 2. Type II, molded construction.

3.2 Material. Fuse pullers shall be made of laminated sections of sheet vulcanized fiber, or plastic. The material used shall have the necessary characteristics to enable the fuse pullers to perform without an indication of unacceptable performance. The insulation resistance shall not be less than 3 megohms when measured between the points where the fuse is gripped and a point located two inches beyond the pivot of the fuse puller, using a megohmeter (megger) at a direct current potential of 1,000 volts. The dielectric strength shall be such as to withstand the test specified below without arcing or visible damage to the fuse puller.

3.2.1 Dielectric strength test. After immersion for 24 hours in a solution containing 20 percent NaCl by weight, the fuse puller shall be washed in fresh water and then allowed to dry for four hours in still air at a temperature not exceeding 80°F. The puller shall then be subjected to 4,000 volt AC test voltage. This voltage shall be applied for one minute between the points where the fuse is gripped and a point located two inches beyond the pivot of the fuse puller.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T08:28Z
Check the source to verify that this is the current version before use.

3.3 Performance. Fuse pullers shall be required to safely insert and remove fuses of the applicable sizes for the puller from standard fuse-holders without becoming disassembled or distorted in use. Operation of the puller shall be smooth and easily accomplished with the use of one hand.

3.4 Insulation resistance. The insulation resistance shall be not less than 3 megohms when measured between the points where the fuse is gripped and a point located two inches beyond the pivot of the fuse puller, using a megohmeter (megger) at a direct current potential of 1,000 volts.

3.5 Identification marking. The fuse pullers shall be marked with the manufacturer's name or identifying symbol, and the state or country of manufacture, unless otherwise specified. All identification markings shall be engraved, etched, molded, or indented directly on the item's surface in such a manner that it remains clearly legible throughout the life of the item.

3.6 Workmanship. Details of workmanship shall be in accordance with the best commercial practice. Paints, coatings, platings, and finishes shall be smooth, adherent, continuous, and not stained or discolored. External surfaces shall be free of tool and gouge marks, nicks, or other surface imperfections. The item shall be free from manufacturing workmanship defects (e.g., sharp or rough external edges, corners, or surfaces) and material workmanship defects (e.g., pits, rips, fins, burrs, tears, nodules, cracks, blisters) which may adversely impact the item's serviceability, durability, safety, or appearance.

4. REGULATORY REQUIREMENTS.

4.1 Recovered materials. The offeror/contractor is encouraged to use recovered material to the maximum extent practicable, in accordance with paragraph 23.403 of the Federal Acquisition Regulation (FAR).

4.2 Metric products. Products manufactured to metric dimensions will be considered on an equal basis with those manufactured using inch-pound units, provided they fall within the tolerances specified (using conversion tables contained in the latest revision of Federal Standard 376) and all other requirements of this document are met. If a product is manufactured to metric dimensions and those dimensions exceed the tolerances specified in the inch-pound units, a request should be made to the contracting officer to determine if the product is acceptable.

5. QUALITY ASSURANCE PROVISIONS.

5.1 Product conformance. The product provided to the Government shall conform to the contractually specified requirements. For product characteristics and requirements which are not contractually specified, the provided product shall conform to the producer's own drawings, standards, specifications, and quality assurance practices for the highest quality product commercially offered by the producer. If the product is not commercially offered by the producer, the best commercial practices shall apply. The Government reserves the right to require proof of such conformances prior to first delivery and thereafter as provided for under the provisions of the contract.

5.2 Responsibility for inspection. Unless otherwise specified, the contractor is responsible for the performance of all inspection requirements and may use any commercial facilities (including the contractor's own facilities) suitable for performance of the inspection requirements, unless disapproved by the Government. The Government reserves the right to perform any inspections deemed necessary to assure the item conforms to the specified requirements.

5.3 Bid sample(s). When a bid sample requirement is specified in the solicitation, the bid sample(s) shall be inspected for all salient characteristics by the Government. A failure of any bid sample to meet the salient characteristics shall be cause for rejection.

5.4 First article sample(s). When a first article requirement is specified in the contract, the first article sample(s) shall be inspected for all salient characteristics. A failure of any first article sample to meet the salient characteristics shall be cause for rejection.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T08:28Z
Check the source to verify that this is the current version before use.

6. PACKAGING.

6.1 Packaging. Requirements of preservation, packing, packaging, and marking of packages shall be as specified in the contract or order.

7. NOTES.

(This section contains information of a general or explanatory nature that is not mandatory.)

7.1 Addresses for obtaining copies of referenced documents:

Federal Specifications and Standards: Federal Supply Service Bureau, Specification Section, Suite 8100, 470 L'Enfant Plaza, SW, Washington, DC 20407.

Federal Acquisition Regulations (FAR): Government Printing Office, Superintendent of Documents, Washington, DC 20402-9371.

ANSI/ASQC Z1.4: American Society for Quality Control, P.O. Box 3005, 611 East Wisconsin Avenue, Milwaukee, WI 43201-4606.

7.2 Ordering data. Purchasers should select the preferred options permitted herein and should include the following information in procurement documents:

(a) Title, number, and date of this Commercial Item Description.
(b) When applicable, the appropriate NSN(s).
(c) When applicable, the specific type, styles, classes, sizes, etc., as specified in the Commercial Item Description.
(d) If bid samples are required, the number of samples required, and the subjective inspection requirements.
(e) If first article samples are required and the number of samples required.
(f) *If lot sampling inspection is required and the applicable lot sampling requirements.*

For example, the following typical lot sampling requirements would be specified in the contract:

Sampling for inspection. Sampling for inspection (both examinations and testing) shall be in accordance with ANSI/ASQC Z1.4.

Inspection. Each sample tool shall be examined and tested for all salient characteristics. The Inspection Level shall be X-Y (e.g., S-2) with an Acceptable Quality Level of X.Y (e.g., 4.0), expressed in terms of defects per hundred units.

or

Sampling for inspection. *Sampling for inspection (both examinations and testing) shall be in accordance* with ANSI/ASQC Z1.4.

Examinations. Each sample tool shall be examined for all salient characteristics. The Inspection Level shall be X-Y with an Acceptable Quality Level of X.Y, expressed in terms of defects per hundred units.

Testing. Each sample tool shall be tested for all salient characteristics. The Inspection Level shall be X-Y with an Acceptable Quality Level of X.Y, expressed in terms of defects per hundred units.

(g) What options as specified in the Commercial Item Description are to be contractually required, if any. For example: a case is to be furnished with each item.
(h) What preservation, packing, packaging, and marking of packages are required.

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T08:28Z
Check the source to verify that this is the current version before use.

7.3 National Stock Numbers (NSNs). The following list of NSNs corresponds to the types, classes, and sizes specified in this CID. This list may not be indicative of all possible NSNs associated with this CID.

Type	Size	NSN
I	1	5120-00-224-9453
I	2	5120-00-224-9456
I	3	5120-00-243-2776
II	1	5120-01-127-0754
II	2	5120-00-688-9868
II	3	

MILITARY INTERESTS:

NONE: DoD has no registered interest in revisions and notices to this Commercial Item Description until further notice.

PREPARING ACTIVITY:

GSA - FSS

Source: https://assist.dla.mil -- Downloaded: 2026-10-26T08:28Z
Check the source to verify that this is the current version before use.