
INCH-POUND
MIL-F-15160/15B
29 October 1990
SUPERSEDING
MIL-F-15160/15A
29 December 1986


MILITARY SPECIFICATION SHEET

FUSES: INSTRUMENT, POWER, AND TELEPHONE (NONINDICATING), STYLE F15

This specification sheet is approved for use by all departments and agencies of the Department of Defense

The requirements for acquiring the product described herein shall consist of this specification sheet and the issue of the following specification listed in that issue of the Department of Defense Index of Specifications and Standards (DODISS) specified in the solicitation. MIL-F-15160

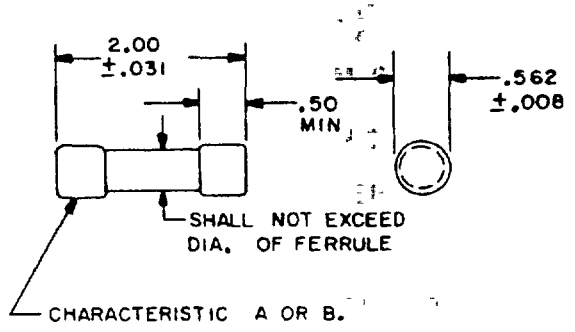



ALTERNATE FERRULE CONSTRUCTION
FOR CHARACTERISTIC B ONLY

INCHES	MM
0.008	0 20
0 031	0 71
0 050	12.70
0.562	14.27
2.00	50 40


NOTES
1. Dimensions are in inches
2. Metric equivalents are given for information purposes only and are based on 1 inch = 25 4 mm

FIGURE 1 *Style F15, characteristic A and B*

AMSC N/A FSC 5920

DISTRIBUTION STATEMENT A. Approved for public release, distribution is unlimited.

Source: https://assist.dla.mil -- Downloaded: 202610-18T05:42Z
Check the source to verify that this is the current version before use.

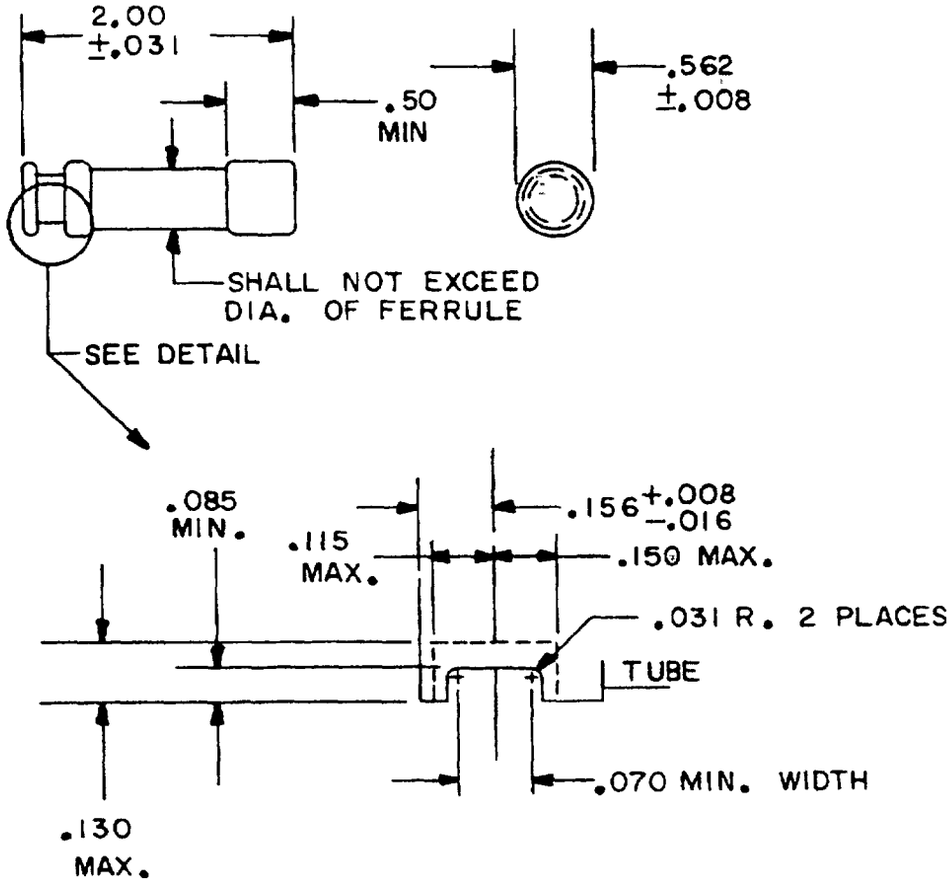

INCHES	MM
0 008	0 20
0 016	0 41
0 031	0 71
0 070	1 79
0 085	2.16
0 115	2.92
0 150	3 81
0 156	3.96
0.50	12.70
0.562	14.27
2.00	50.80

DETAIL OF REJECTION GROOVE

NOTES
1. Dimensions are in inches
2. The diameter of the rejection ferrule shall be within zero and minus 0 050 inch of the diameter of the main contact area
3. The end of the ferrule shall be flat with not greater than 0 015 inch concavity

FIGURE 2 *Style F15, characteristic BR*

Source: https://assist.dla.mil -- Downloaded: 202610-18T05:42Z
Check the source to verify that this is the currentversion before use.

REQUIREMENTS:

1 *Design and construction* See figures 1 and 2

Physical

Material:

Case – Fiber or alternate material
(Alternate to fiber material (tube) shall have an average burst strength of 2,100 pounds per square inch with a value of not less than 1,450 pounds per square inch)

Ferrule – Brass

Finish – Nickel, bright alloy, or bright dipped, silver plated when specified

Terminal strength – MIL-STD-202, method 211, test condition E, 5 pound-inch torque between ferrules and fuse body.

Electrical.

Electrical requirements shall be as specified in table I

Shock – MIL-STD-202, method 204, HI shock

Vibration – MIL-STD-202, method 204, test condition A (except 5 g, 500 Hz)

2. *Type designation:* Type designation shall be as specified in table II.

3. *Qualification:* Required

TABLE I. *Electrical requirements*

	Characteristic		
	A	B	BR
Voltage rating	250 Vac 250 Vdc 450 Vrms ac	250 Vac 250 Vdc –	250 Vac 250 Vdc –
Overload test[1]			
135%	0 – 1 hr	0 – 1 hr	0 – 1 hr
500%	–	10 – 25 sec	10 – 25 sec
Short circuit test			
at 250 Vdc	10,000A	10,000A	10,000A
at 250 Vac	–	–	200,000A (20% PF max.)
at 450 Vrms ac[2]	(50% PF max.)[3]		
0 – 20A fuse	8,000A	–	–
25 – 30A fuse	1,500A	–	–

[1]Overload is shown as a percentage of the current rating of the fuse
[2]Characteristic A fuses may be used for 450 Vrms ac
[3]Power factor (PF)

Source: https://assist.dla.mil -- Downloaded: 202640-18T05:42Z
Check the source to verify that this is the current version before use.

TABLE II *Type designation* [1]

Style	Characteristic	Voltage	Current[4]
F15	A	250	1A
F15	A	250	3A
F15	A	250	6A
F15	A	250	10A
F15	A	250	15A
F15	A	250	20A
F15	A	250	25A
F15	A	250	30A
F15	B[2,3]	250	1A
F15	B	250	1-6/10A
F15	B	250	2A
F15	B	250	2-1/2A
F15	B	250	3-2/10A
F15	B	250	4A
F15	B	250	5A
F15	B	250	6-1/4A
F15	B	250	8A
F15	B	250	10A
F15	B	250	12A
F15	B	250	15A
F15	B	250	20A
F15	B	250	25A
F15	B	250	30A
F15	BR[4]	250	1A
F15	BR[4]	250	1-6/10A
F15	BR[4]	250	2A
F15	BR[4]	250	2-1/2A
F15	BR[4]	250	3-2/10A
F15	BR[4]	250	4A
F15	BR[4]	250	5A
F15	BR[4]	250	6-1/4A
F15	BR[4]	250	8A
F15	BR[4]	250	10A
F15	BR[4]	250	12A
F15	BR[4]	250	20A
F15	BR[4]	250	25A
F15	BR	250	30A

[1]For silver plated terminals, the designator "S" is added after the current rating.
[2]The characteristic B fuse is cancelled upon the issue of this document and establishment of a QPL for the type BR fuse
[3]A characteristic B fuse shall not be used to replace characteristic BR fuse
[4]The characteristic BR fuse may be used to replace the characteristic B fuse of the same current rating

Source: https://assist.dla.mil -- Downloaded: 202610-18T05:42Z
Check the source to verify that this is the current version before use.

QUALITY ASSURANCE PROVISIONS:

Qualification inspections The number of qualification samples required shall be

a 24 samples maximum current rating of each voltage and design
b. 24 samples minimum current rating of each voltage and design.

NOTE: If labels are used, 5 additional samples of any rating are required.

PACKAGING:

Unit packaging The standard unit pack shall be 5 pieces.

Revision letters are not used to denote changes due to the extensiveness of the changes

Custodians:
Army – ER
Navy – SH
Air Force – 85

Review activities.
Army – MI, AR
Navy – AS, OS, YD,
Air Force – 17, 99
DSA – ES

User activities
Army – ME, AT
Navy – MC, CG
Air Force - 19

Preparing activity
Navy – SH
(Project 5920-0447-06)

Source: https://assist.dla.mil -- Downloaded: 202610-18T05:42Z
Check the source to verify that this is the currentversion before use.