
INCH-POUND
MIL-F-15160/20B
29 October 1990
SUPERSEDING
MIL-F-15160/20A
29 December 1986

MILITARY SPECIFICATION SHEET

FUSES: INSTRUMENT, POWER, AND TELEPHONE (NONINDICATING), STYLE F20

This specification sheet is approved for use by all departments and agencies of the Department of Defense.

The requirements for acquiring the product described herein shall consist of this specification sheet and the issue of the following specification listed in that issue of the Department of Defense Index of Specifications and Standards (DODISS) specified in the solicitation: MIL-F-15160

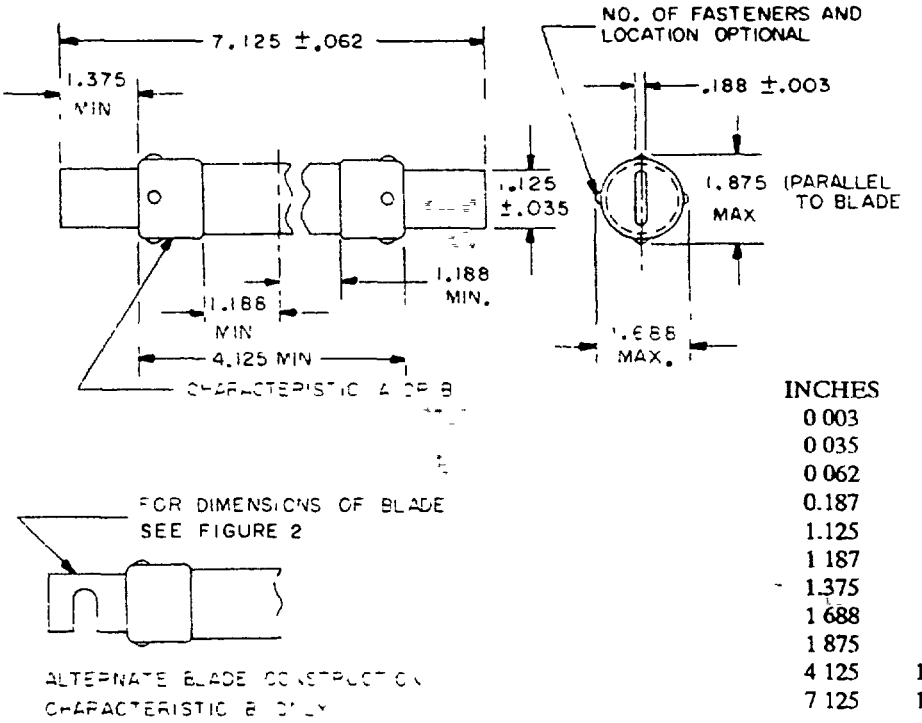

INCHES	MM
0 003	0 08
0 035	0 89
0 062	1 57
0.187	4 75
1.125	28 54
1 187	30 15
1.375	34 92
1 688	42.88
1 875	47 63
4 125	104 78
7 125	180 98


NOTES
1 Dimensions are in inches
2 Metric equivalents are given for information purposes only and are based on 1 inch = 25 4 mm


FIGURE 1. *Style F20, characteristic A and B*

AMSC N/A FSC 5920

DISTRIBUTION STATEMENT A. Approved for public release, distribution is unlimited.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T05:43Z
Check the source to verify that this is the current version before use.

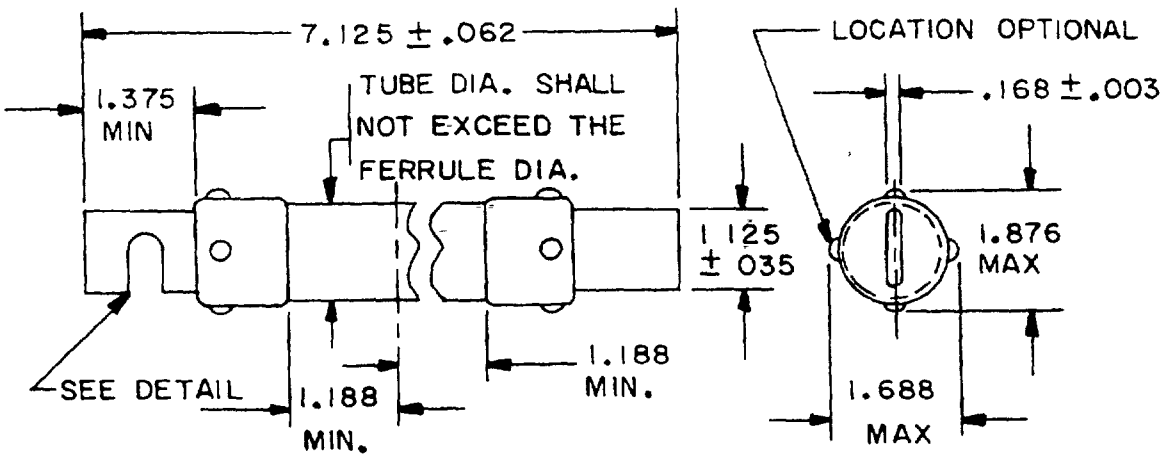

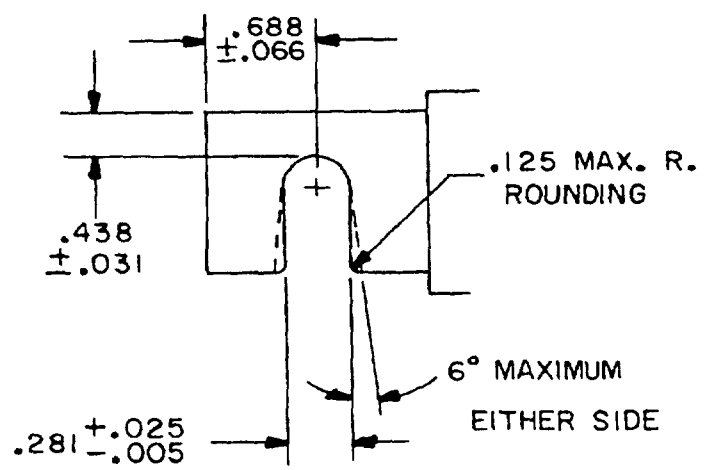

REJECTION BLADE DETAIL

INCHES	MM
0 003	0 08
0 005	0 13
0 008	0 20
0 025	0.64
0 031	0 79
0.035	0 89
0 062	1.57
0 125	3 18
0.187	4 75
0.281	7 14
0 438	11.13
0.688	17.50
1.125	28.58
1 188	30 18
1 375	34 92
1 688	42.88
1 876	47.65
7 125	180 98

NOTES
1 Dimensions are in inches
2 Metric equivalents are given for information purposes only and are based on 1 inch = 25 4 mm

FIGURE 2. *Style F20, characterstic BR*

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T05:43Z
Check the source to verify that this is the current version before use.

REQUIREMENTS:

1. *Design and construction* See figures 1 and 2

Physical

Material

Case – Fiber or alternate material
(Alternate to fiber material (tube) shall have an average burst strength of 2,300 pounds per square inch with a value of not less than 1,900 pounds per square inch)
Knifeblade – Copper
Finish – Nickel, bright alloy, or bright dipped, silver plated when specified
Terminal strength – MIL-STD-202, method 211, test condition E, 5 pound-inch torque between ferrules and fuse body.

Electrical

Electrical requirements shall be as specified in table I
Shock – MIL-STD-202, method 207, HI shock
Vibration – MIL-STD-202, method 204, test condition A (except 5 g, 500 Hz).

Temperature Temperature rise shall be not greater than the values shown in table II

2 *Type designation.* Type designation shall be as specified in table III.

3. *Qualification* Required.

TABLE I. *Electrical requirements*

	Characteristic		
	A	B	BR
Voltage rating	250 Vac 250 Vdc	250 Vac 250 Vdc	250 Vac 250 Vdc
Overload test[1]			
135%	0 – 2 hr	0 – 2 hr	0 – 2 hr
500%	–	10 – 25 sec	10 – 25 sec
Short circuit current			
at 250 Vdc	10,000A	10,000A	10,000A
at 250 Vac	10,000A	10,000A	200,000A (20% PF max)[3]
Short circuit current at 450 Vac, single phase, 50% PF max.	8,000A	–	–

[1]Overload is shown as a percentage of the current rating of the fuse
[2]Characteristic A fuses may be used for 450 Vac with reduced interrupting capacity
[3]Power factor (PF)

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T05:43Z
Check the source to verify that this is the current version before use.

TABLE II *Allowable temperature rise in degrees Celsius (°C)*

Casing or body		Terminals	
Thermometer	Thermocouple	Thermometer	Thermocouple
50 °C	90 °C	60 °C	90 °C

TABLE III *Type designation* [1]

Style	Characteristic	Voltage	Current
F20	A	250	110A
F20	A	250	125A
F20	A	250	150A
F20	A	250	175A
F20	A	250	200A
F20	B[2,4]	250	110A
F20	B	250	125A
F20	B	250	150A
F20	B	250	175A
F20	B	250	200A
F20	BR[3]	250	110A
F20	BR	250	125A
F20	BR	250	150A
F20	BR	250	175A
F20	BR	250	200A

[1]For silver plated terminals the designator "S" is added after the current rating
[2]The characteristic B fuse is cancelled upon the issue of this document and the establishment of a QPL for the type BR fuse
[3]The characteristic BR fuse may be used to replace the characteristic B fuse of the same rating, even in nonrejection type fuse clips
[4]Characteristic B fuses shall not be used to replace characteristic BR fuses

QUALITY ASSURANCE PROVISIONS:

Qualification inspections The number of qualification samples required shall be.

a 24 samples maximum current rating of each voltage and design
b 24 samples minimum current rating of each voltage and design

NOTE: If labels are used, 5 additional samples of any rating are required

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T05:43Z
Check the source to verify that this is the current version before use.

PACKAGING:

Unit packaging The standard unit pack shall be 1 piece

Revision letters are not used to denote changes due to the extensiveness of the changes

Custodians
Army – ER
Navy – SH
Air Force – 85

Review activities
Army – MI, AR
Navy – AS, OS, YD,
Air Force – 17, 99
DSA – ES

User activities.
Army – ME, AT
Navy – MC, CG
Air Force - 19

Preparing activity.
Navy – SH
(Project 5920-0447-09)

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T05:43Z
Check the source to verify that this is the current version before use.