INCH-POUND
MIL-PRF-15160/20F
w/Amendment 1
21 March 2017
SUPERSEDING
MIL-PRF- 15160/20F
15 November 2011

PERFORMANCE SPECIFICATION SHEET

# FUSES, INSTRUMENT, POWER, AND TELEPHONE (NONINDICATING), STYLE F20

This specification is approved for use by all Departments and Agencies of the Department of Defense.

The requirements for acquiring the product described herein shall consist of this specification sheet and MIL-PRF-15160.

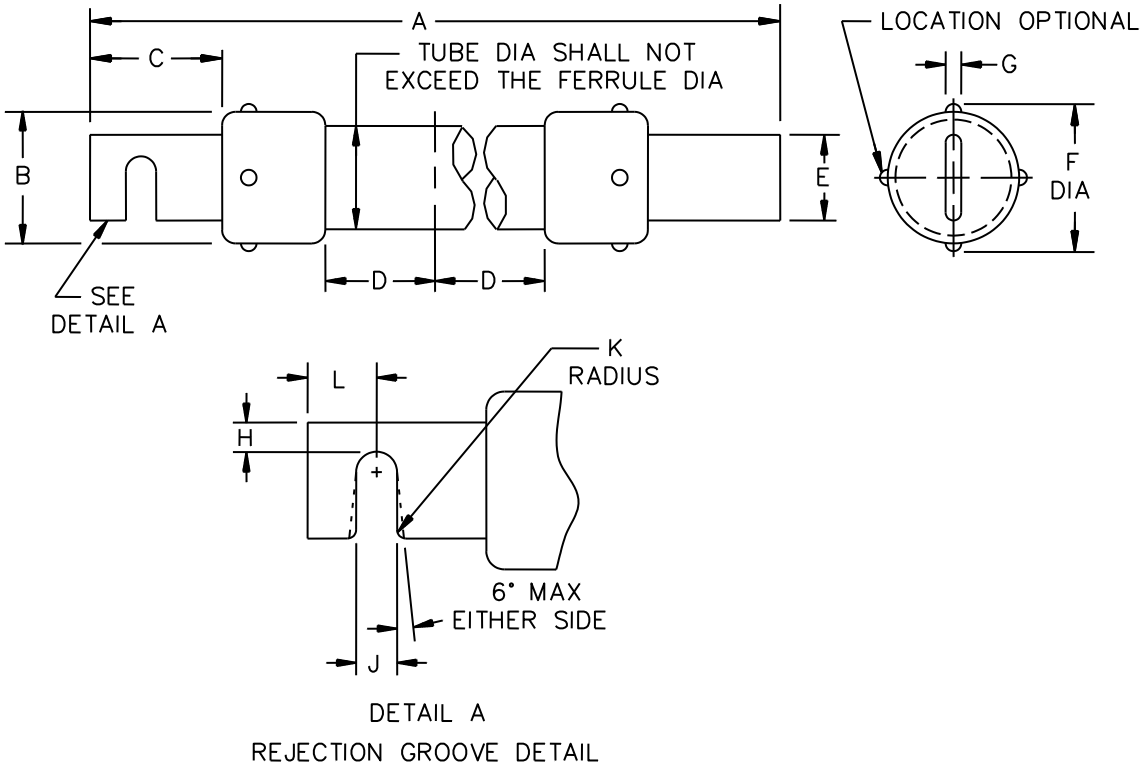



FIGURE 1. Style F20, characteristic BR.



Source: https://assist.dla.mil -- Downloaded: 2026-10-18T05:43Z
Check the source to verify that this is the current version before use.

| Ltr | Inches | | mm | |
|---|---|---|---|---|
| | Min | Max | Min | Max |
| A | 7.063 | 7.187 | 179.40 | 182.55 |
| B | --- | 1.688 | --- | 42.88 |
| C | 1.375 | --- | 34.93 | --- |
| D | 1.188 | --- | 30.18 | --- |
| E | .990 | 1.160 | 25.15 | 29.46 |
| F | --- | 1.876 | --- | 47.65 |

| Ltr | Inches | | mm | |
|---|---|---|---|---|
| | Min | Max | Min | Max |
| G | .165 | .171 | 4.19 | 4.34 |
| H | .407 | .469 | 10.34 | 11.91 |
| J | .276 | .306 | 7.01 | 7.77 |
| K | --- | .125 | --- | 3.18 |
| L | .622 | .754 | 15.80 | 19.15 |
| | | | | |

NOTES:
1. Dimensions are in inches.
2. Metric equivalents are given for general information only.

FIGURE 1. Style F20 characteristic BR - Continued.

REQUIREMENTS:

Interface and physical dimensions: See figure 1.

Case: Fiber or alternate material.
(Alternate to fiber material (tube) shall have an average burst strength of 2,300 pounds per square inch with a value of not less than 1,900 pounds per square inch).

Knifeblade: Copper.

Finish: Nickel, bright alloy, or bright dipped, silver plated when specified.

Terminal strength: MIL-STD-202-211, test condition E, 5 inch-pound torque between ferrules and fuse body.

Electrical:

Electrical requirements shall be as specified in table I.

Shock: MIL-STD-202-207, HI shock.

Vibration: MIL-STD-202-204, test condition A (except 5g peak).

Temperature: Temperature rise shall be not greater than the values shown in table II.



Source: https://assist.dla.mil -- Downloaded: 2026-10-18T05:43Z
Check the source to verify that this is the current version before use.

TABLE I Electrical requirements.

| Characteristics | BR |
|---|---|
| Voltage rating | 250 V ac<br>250 V dc |
| Overload test 1/<br>135%<br>500% | <br>0 - 2 hour<br>10 - 25 seconds |
| Short circuit test<br>at 250 V dc<br>at 250 V ac | <br>10,000A<br>200,000A<br>(20% PF max.) 2/ |

1/ Overload is shown as a percentage of the current rating of the fuse.
2/ Power factor (PF).

TABLE II. Allowable temperature rise in degrees Celsius ($^{O}$C).

| Casing of body | | Terminals | |
|---|---|---|---|
| Thermometer | Thermocouple | Thermometer | Thermocouple |
| 50$^{O}$C | 90$^{O}$C | 60vC | 90$^{O}$C |

Part or Identifying Number (PIN): The PIN shall be constructed from table III (e.g., F20BR250V110A).

TABLE III Part or Identifying Number. 1/ 2/

| Style | Characteristic | Maximum voltage | Current rating |
|---|---|---|---|
| F20 | BR 3/ | 250 V | 110A<br>125A<br>150A<br>175A<br>200A |

1/ For silver plated terminals, the designator “S” is added after the current rating.
2/ The characteristic A fuse has been discontinued without replacement.
3/ The characteristic B fuse has been discontinued. The characteristic BR fuse may be used to replace the old characteristic B fuse of the same current rating.



Source: https://assist.dla.mil -- Downloaded: 2026-10-18T05:43Z
Check the source to verify that this is the current version before use.

VERIFICATION:

Qualification inspections: The number of qualification samples required shall be:

a. 24 samples maximum current rating of each voltage and design.
b. 24 samples minimum current rating of each voltage and design.

NOTE: If labels are used, five additional samples of any rating are required.

Referenced documents. In addition to MIL-PRF-15160, this document references the following:

MIL-STD-202-204
MIL-STD-202-207
MIL-STD-202-211

The margins of this specification are marked with vertical lines to indicate where changes from the previous issue were made. This was done as a convenience only and the Government assumes no liability whatsoever for any inaccuracies in these notations. Bidders and contractors are cautioned to evaluate the requirements of this document based on the entire content irrespective of the marginal notations and relationship to the last previous issue.

Custodians:
Army - CR
Navy - SH
Air Force - 85
DLA - CC

Preparing activity:
DLA - CC

Review activities:
Army - AT, CR4, MI
Navy - AS, CG, MC, OS
Air Force - 19, 99

(Project 5920-2017-007)

NOTE: The activities listed above were interested in this document as of the date of the this document. Since organizations and responsibilities can change, you should verify the currency of the information above using the Assist Online database at https://assist.dla.mil.



Source: https://assist.dla.mil -- Downloaded: 2026-10-18T05:43Z
Check the source to verify that this is the current version before use.