INCH-POUND
MIL-PRF-15160/20F
w/AMENDMENT 2
21 September 2026
SUPERSEDING
MIL-PRF- 15160/20F
w/AMENDMENT 1
21 March 2017

PERFORMANCE SPECIFICATION SHEET

FUSES, INSTRUMENT, POWER, AND TELEPHONE (NONINDICATING), STYLE F20

This specification is approved for use by all Departments and Agencies of the Department of Defense.

The requirements for acquiring the product described herein shall consist of this specification sheet and MIL-PRF-15160.

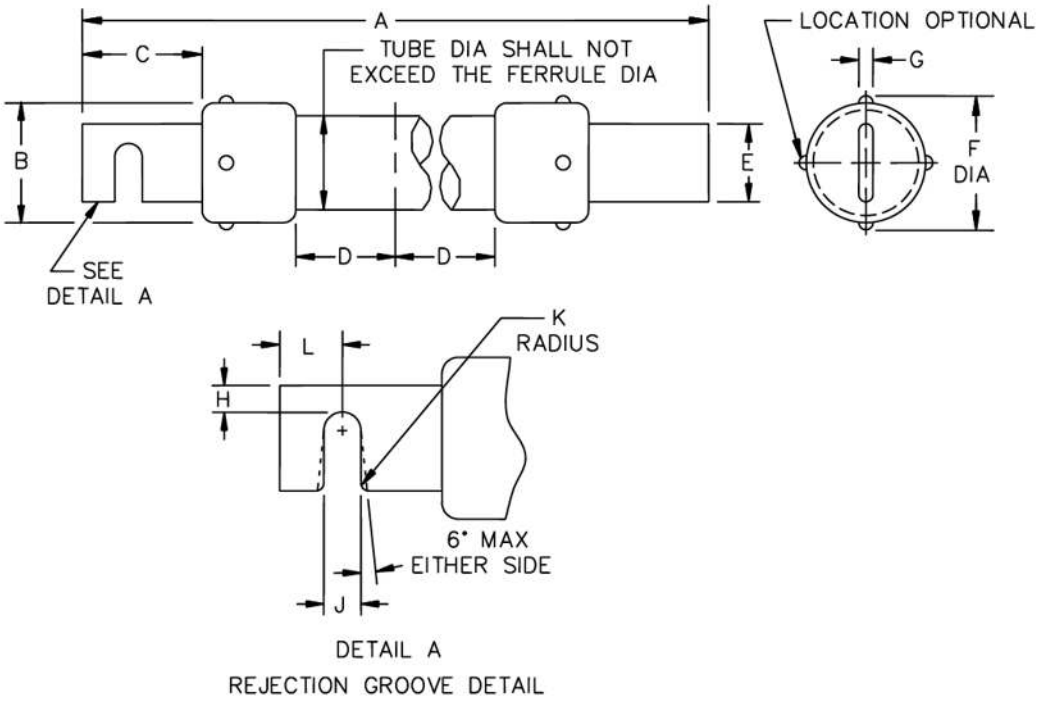


FIGURE 1. Style F20, characteristic BR.

AMSC N/A
FSC 5920
DISTRIBUTION STATEMENT A. Approved for public release; distribution is unlimited.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T05:43Z
Check the source to verify that this is the current version before use.

Ltr	Inches		mm	
	Min	Max	Min	Max
A	7.063	7.187	179.40	182.55
B	---	1.688	---	42.88
C	1.375	---	34.93	---
D	1.188	---	30.18	---
E	.990	1.160	25.15	29.46
F	---	1.876	---	47.65

Ltr	Inches		mm	
	Min	Max	Min	Max
G	.165	.171	4.19	4.34
H	.407	.469	10.34	11.91
J	.276	.306	7.01	7.77
K	---	.125	---	3.18
L	.622	.754	15.80	19.15

NOTES:
1. Dimensions are in inches.
2. Metric equivalents are given for general information only.

FIGURE 1. Style F20 characteristic BR - Continued.

REQUIREMENTS:

Interface and physical dimensions: See figure 1.

Case: Fiber or alternate material.
(Alternate to fiber material (tube) shall have an average burst strength of 2,300 pounds per square inch with a value of not less than 1,900 pounds per square inch).

Knifeblade: Copper.

Finish: Nickel, bright alloy, or bright dipped, silver plated when specified.

Terminal strength: MIL-STD-202-211, test condition E, 5 inch-pound torque between ferrules and fuse body.

Electrical:

Electrical requirements shall be as specified in table I.

Shock: MIL-STD-202-207, HI shock.

Vibration: MIL-STD-202-204, test condition A (except 5g peak).

Temperature: Temperature rise shall be not greater than the values shown in table II.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T05:43Z
Check the source to verify that this is the current version before use.

TABLE I Electrical requirements.

Characteristics	BR
Voltage rating	250 V ac 250 V dc
Overload test 1/ 135% 500%	 0 - 2 hour 10 - 25 seconds
Short circuit test at 250 V dc at 250 V ac	 10,000A 200,000A (20% PF max.) 2/

1/ Overload is shown as a percentage of the current rating of the fuse.
2/ Power factor (PF).

TABLE II. Allowable temperature rise in degrees Celsius (^{O}C).

Casing of body		Terminals	
Thermometer	Thermocouple	Thermometer	Thermocouple
50°C	90°C	60vC	90°C

Part or Identifying Number (PIN): The PIN shall be constructed from table III (e.g., F20BR250V110A).

TABLE III Part or Identifying Number. 1/ 2/

Style	Characteristic	Maximum voltage	Current rating
F20	BR 3/	250 V	110A 125A 150A 175A 200A

1/ For silver plated terminals, the designator “S” is added after the current rating.
2/ The characteristic A fuse has been discontinued without replacement.
3/ The characteristic B fuse has been discontinued. The characteristic BR fuse may be used to replace the old characteristic B fuse of the same current rating.

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T05:43Z
Check the source to verify that this is the current version before use.

VERIFICATION:

Qualification inspection is not applicable for this specification sheet and is replaced by acceptance testing which shall consist of group A and group B inspection of MIL-PRF-15160.

NOTE: If labels are used, five additional samples of any rating are required.

Referenced documents. In addition to MIL-PRF-15160, this document references the following:

MIL-STD-202-204
MIL-STD-202-207
MIL-STD-202-211

Amendment notations. The margins of this specification sheet are marked with vertical line to indicate modifications generated by this amendment. This was done as a convenience only and the Government assumes no liability whatsoever for any inaccuracies in these notations. Bidders and contractors are cautioned to evaluate the requirements of this document based on the entire content irrespective of the marginal notations.

CONCLUDING MATERIAL

Custodians:
Army - CR
Navy - SH
Air Force - 85
DLA - CC

Preparing activity:
DLA - CC

Review activities:
Army - AT, CR4, MI
Navy - AS, CG, MC
Air Force - 19

(Project 5920-2026-013)

NOTE: The activities listed above were interested in this document as of the date of this document. Since organizations and responsibilities can change, you should verify the currency of the information above using ASSIST at https://assist.dla.mil

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T05:43Z
Check the source to verify that this is the current version before use.