
INCH-POUND
MIL-F-15160/21B
29 October 1990
SUPERSEDING
MIL-F-15160/21A
29 December 1986

MILITARY SPECIFICATION SHEET

FUSES: INSTRUMENT, POWER, AND TELEPHONE (NONINDICATING), STYLE F21

This specification sheet is approved for use by all departments and agencies of the Department of Defense

The requirements for acquiring the product described herein shall consist of this specification sheet and the issue of the following specification listed in that issue of the Department of Defense Index of Specifications and Standards (DODISS) specified in the solicitation: MIL-F-15160

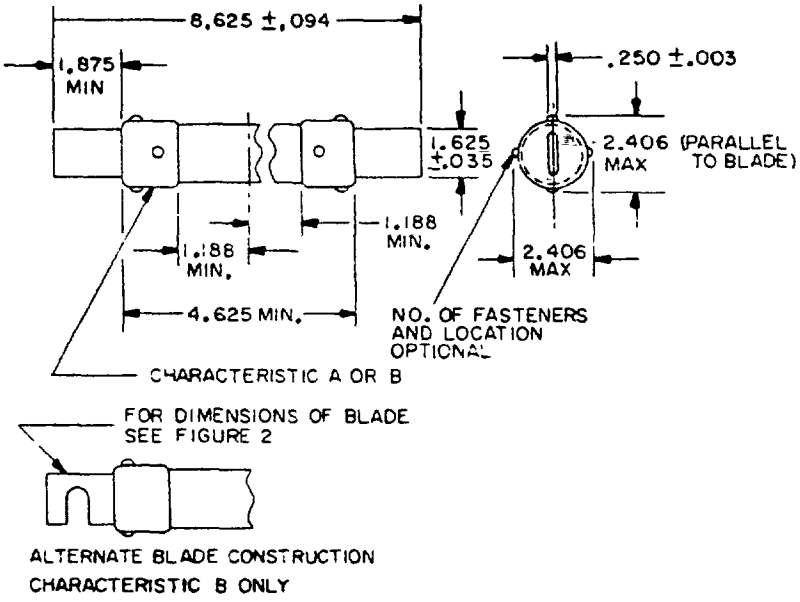

INCHES	MM
0 003	0 08
0.035	0 89
0 094	2.39
0.250	6 35
1 188	30 15
1 625	41 28
1.875	47 63
2 406	61 11
4.625	117 48
8 625	219 08


NOTES
1. Dimensions are in inches
2. Metric equivalents are given for information purposes only and are based on 1 inch = 25 4 mm


FIGURE 1. *Style F21, characteristic A and B*

AMSC N/A FSC 5920

DISTRIBUTION STATEMENT A. Approved for public release, distribution is unlimited

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T05:43Z
Check the source to verify that this is the current version before use.

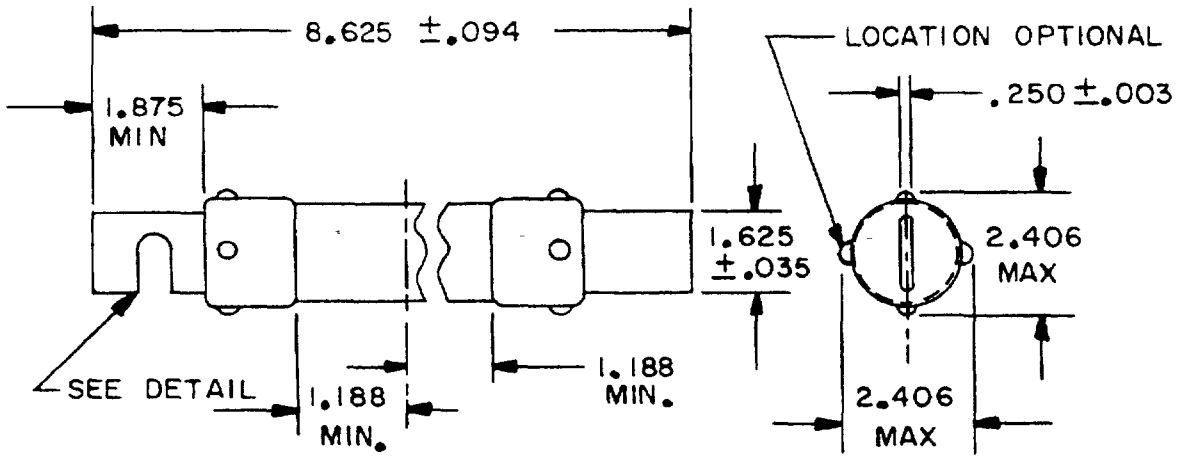

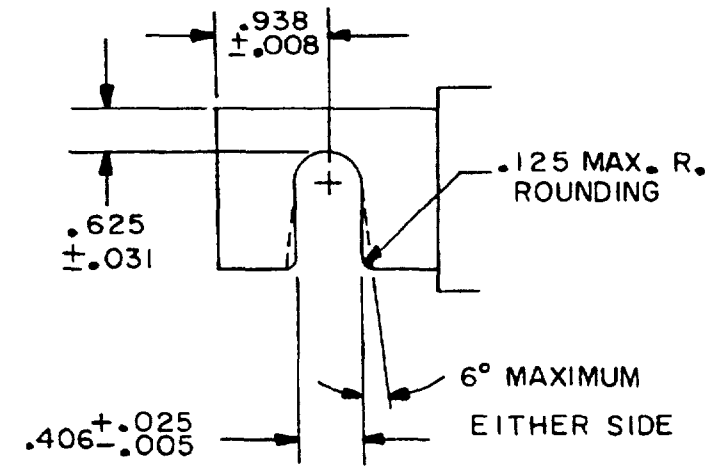

REJECTION BLADE DETAIL

INCHES	MM
0 003	0 08
0 005	0 13
0 008	0.20
0.025	0 64
0 031	0 79
0 035	0.89
0.094	2.39
0.125	3 18
0.250	6.35
0 406	10.31
0 625	15.88
0 938	23.83
1 188	30 18
1 625	41.28
1 875	47.63
2.406	61 11
8.625	219 08

NOTES
1. Dimensions are in inches
2. Metric equivalents are given for information purposes only and are based on 1 inch = 25 4 mm

FIGURE 2. *Style F21, characteristic BR*

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T05:43Z
Check the source to verify that this is the current version before use.

REQUIREMENTS:

1 *Design and construction*· See figures 1 and 2

Physical.

Material·

Case – Fiber or alternate material
(Alternate to fiber material (tube) shall have an average burst strength of 1,650 pounds per square inch with a value of not less than 1,400 pounds per square inch)

Knifeblade – Copper

Finish – Nickel, bright alloy, or bright dipped, silver plated when specified

Terminal strength – MIL-STD-202, method 211, test condition E, 5 pound-inch torque between ferrules and fuse body

Electrical·

Electrical requirements shall be as specified in table I

Shock – MIL-STD-202, method 207, HI shock

Vibration – MIl-STD-202, method 204, test condition A (except 5 g, 500 Hz).

Temperature rise· Temperature rise shall be not greater than the value shown in table II.

2. *Type designation* Type designation shall be as specified in table III.

3. *Qualification.* Required.

TABLE I. *Electrical requirements*

	Characteristic		
	A	B	BR
Voltage rating	250 Vac 250 Vdc	250 Vac 250 Vdc	250 Vac 250 Vdc
Overload test[1]			
135%	0 – 2 hr	0 – 2 hr	0 – 2 hr
500%	–	10 – 25 sec	10 – 25 sec
Short circuit current			
at 250 Vdc	10,000A	10,000A	10,000A
at 250 Vac	10,000A	10,000A	200,000A (20% PF max.)
Short circuit current at 450 Vac, single phase, 50% PF max	10,000A	–	–

[1]Overload is shown as a percentage of the current rating of the fuse

[2]Characteristic A fuses may be used at 450 Vac with reduced interrupting capacity

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T05:43Z
Check the source to verify that this is the current version before use.

TABLE II *Allowable temperature rise*

Casing or body		Terminals	
Thermometer	Thermocouple	Thermometer	Thermocouple
50 °C	90 °C	75 °C	90 °C

TABLE III *Type designation* [1]

Style	Characteristic	Voltage	Current
F21	A	250	225A
F21	A	250	250A
F21	A	250	300A
F21	A	250	350A
F21	A	250	400A
F21	B[2,4]	250	225A
F21	B	250	250A
F21	B	250	300A
F21	B	250	350A
F21	B	250	400A
F21	BR[3]	250	225A
F21	BR	250	250A
F21	BR	250	300A
F21	BR	250	350A
F21	BR	250	400A

[1]For silver plated terminals the designator "S" is added after the current rating
[2]The characteristic B fuse is cancelled upon the issue of this document and the establishment of a QPL for the type BR fuse
[3]The characteristic BR fuse may be used to replace the characteristic B fuse of the same current rating, even in nonrejection type clips
[4]Characteristic BR fuses shall not be used to replace characteristic BR fuses

QUALITY ASSURANCE PROVISIONS:

Qualification inspections. The number of qualification samples required shall be:

a 24 samples maximum current rating of each voltage and design
b 24 samples minimum current rating of each voltage and design.

NOTE If labels are used, 5 additional samples of any rating are required

Source: https://assist.dla.mil -- Downloaded: 202610-18T05:43Z
Check the source to verify that this is the current version before use.

PACKAGING:

Unit packaging The standard unit pack shall be 1 piece.

Revision letters are not used to denote changes due to the extensiveness of the changes.

Custodians:
Army – ER
Navy – SH
Air Force – 85

Review activities.
Army – MI, AR
Navy – AS, OS, YD,
Air Force – 17, 99
DSA – ES

User activities:
Army – ME, AT
Navy – MC, CG
Air Force - 19

Preparing activity.
Navy – SH
(Project 5920-0447-10)

Source: https://assist.dla.mil -- Downloaded: 2026-10-18T05:43Z
Check the source to verify that this is the current version before use.